


MINIMUM BAR LAP
 #4 bar = 2'-7"
 #5 bar = 3'-3"

PLAN

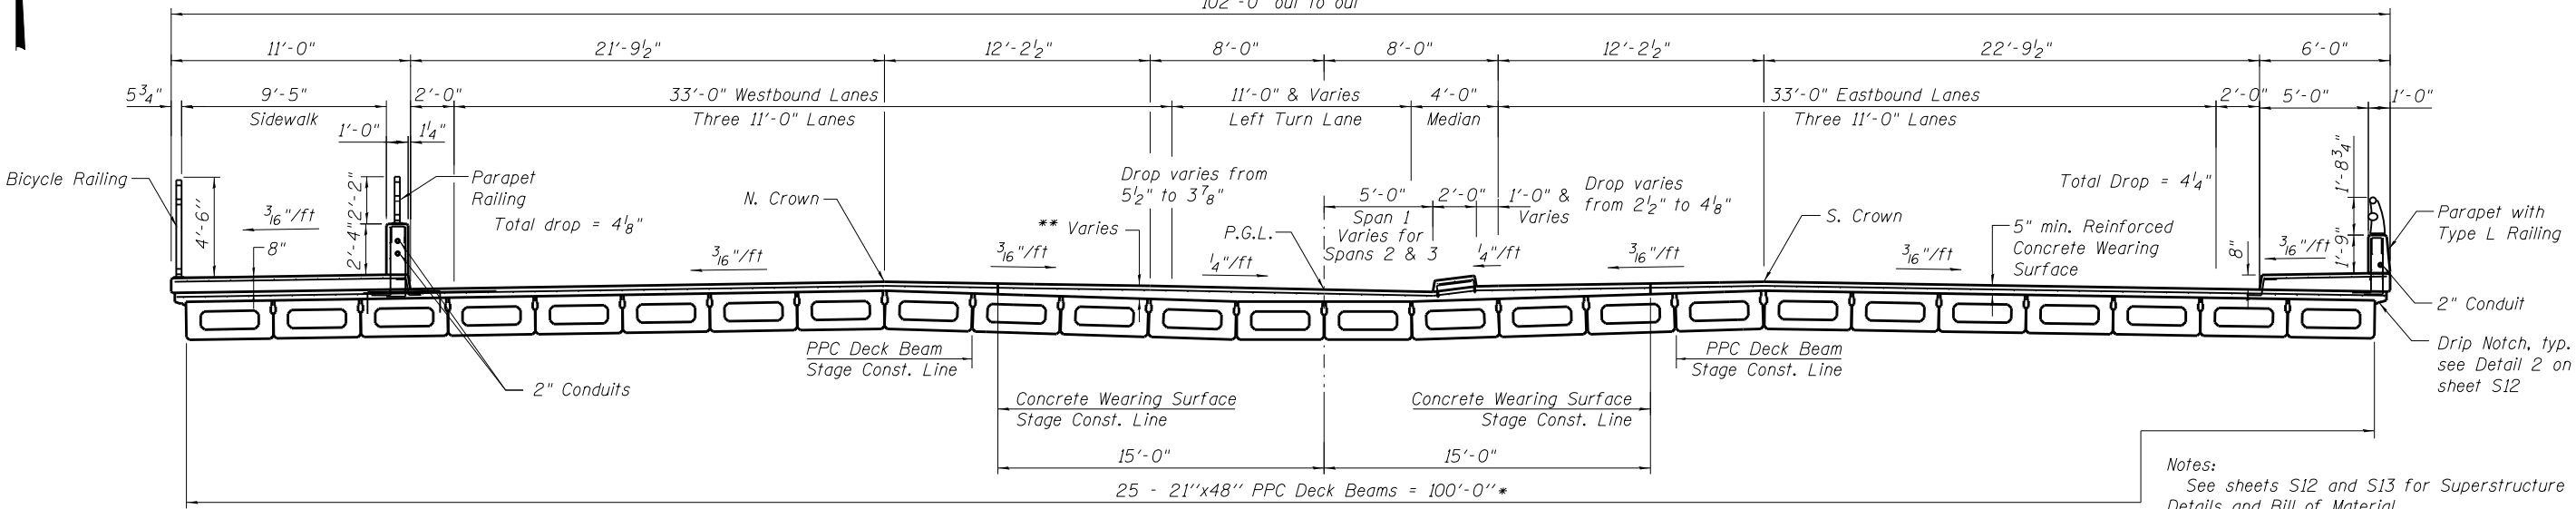

CROSS SECTION

Note:
 For superstructure reinforcement details refer to Sections Thru North Sidewalk, Median, South Sidewalk and Thru CWS Stage Constr. Joint on sheet S12.

* Dimensions vary depending on beam tolerances
 ** The minimum thickness of concrete wearing surface varies from 5" to 7 5/8" at midspan from N. Crown to S. Crown. See sheets S5 and S6 for top of CWS elevations.

Notes:
 See sheets S12 and S13 for Superstructure Details and Bill of Material.
 Bars indicated thus 20 x 2-#4 etc. indicates 20 lines of bars with 2 lengths per line. See sheet S12 for Sections A-A and B-B.

COLLINS ENGINEERS
 133 N. Rocker Dr.
 Suite 900
 Chicago, IL 60646
 Tel: (312) 704-9300
 Fax: (312) 704-9320
 www.collinsengr.com
 ILLINOIS PROFESSIONAL DESIGN FIRM LICENSE NO. 184-000993

USER NAME =	DESIGNED - LJ	REVISOR
	CHECKED - EKM	REVISOR
PLOT SCALE =	DRAWN - DR	REVISOR
PLOT DATE =	CHECKED - LJ	REVISOR

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE
STRUCTURE NO. 022-0158

SHEET NO. S11 OF S26 SHEETS

F.A.P. RTE. 307	SECTION 131B-BR	COUNTY DuPAGE	TOTAL SHEETS 111	SHEET NO. 80
CONTRACT NO. 60V24			ILLINOIS FED. AID PROJECT	