



**DECIDUOUS TREE PLANTING DETAIL**  
**(4 1/2" CALIPER AND LARGER)**

**DECIDUOUS TREE PLANTING DETAIL**  
**GREATER THAN 4 FT HEIGHT AND LESS THAN 4 1/2" CALIPER)**

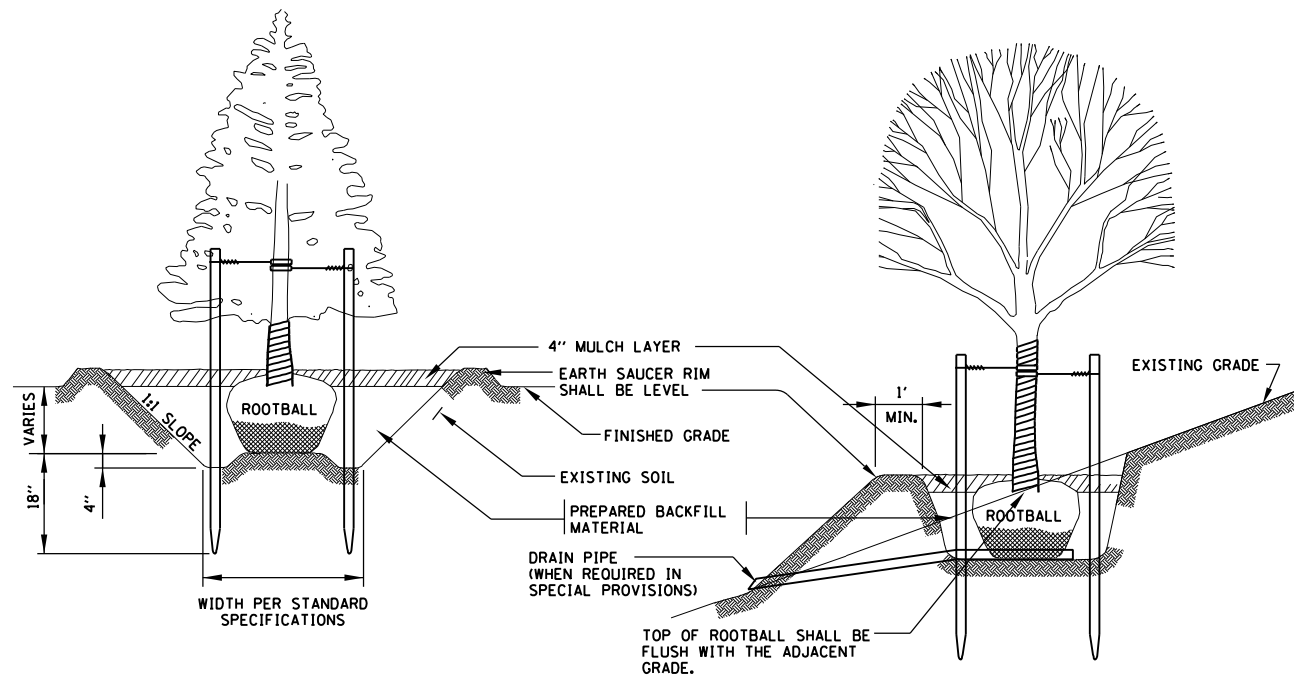

**EVERGREEN TREE PLANTING DETAIL**

**STEEP SLOPE PLANTING DETAIL**

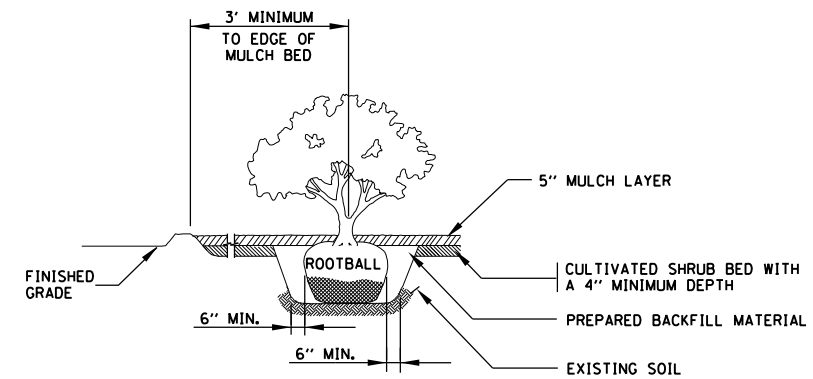

**SHRUB PLANTING DETAIL**

**PLANTING NOTES:**

1. THE CONTRACTOR SHALL VERIFY THE LOCATIONS OF ALL UNDERGROUND UTILITIES, FIBER OPTICS, STORM SEWERS AND DRAINAGE STRUCTURES IN THE FIELD PRIOR TO THE EXCAVATION OF ANY PLANT PITS OR PLANTING BEDS. LOCATIONS OF TREE AND SHRUB PLANTINGS SHALL BE ADJUSTED TO AVOID DAMAGING ANY UNDERGROUND FEATURES.
2. THE PLANT LOCATIONS SHOWN ON THE PLANS ARE APPROXIMATELY ONLY. THE EXACT LOCATIONS SHALL BE ADJUSTED AS REQUIRED IN THE FIELD BY THE ENGINEER. TREE LOCATIONS SHALL NOT BE MOVED CLOSER TO PAVEMENT EDGES THAN SHOWN ON THE PLANS OR A MINIMUM OF FIFTY (50) FEET.
3. TREES SHALL BE SPACED A MINIMUM OF FIVE (5) FEET FROM FENCES.
4. TREE AND SHRUB PLANTINGS SHALL NOT BLOCK ACCESS TO GATES IN FENCES.
5. TREES PLANTED IN TURF AREAS SHALL BE SPACED A MINIMUM OF TEN (10) FEET FROM THE EDGE OF A SHRUB BED.
6. TREES SHALL BE SPACED A MINIMUM OF TEN (10) FEET FROM NOISEWALLS OR OTHER STRUCTURES.
7. DITCHES SHALL BE KEPT CLEAR OF PLANTINGS. THE MINIMUM VERTICAL DISTANCE BETWEEN DITCH BOTTOMS AND PLANTS SHALL BE THREE (3) FEET.
8. IF DURING EXCAVATION, A PLANT HOLE OR PLANTING BED SHOWS POOR DRAINAGE, STANDING WATER OR AN IMPERVIOUS STRATUM OF SOIL, THE CONTRACTOR SHALL CEASE EXCAVATION AND SHALL NOTIFY THE ENGINEER. THE PLANT(S) SHALL BE RELOCATED AS DIRECTED BY THE ENGINEER AND THE HOLE(S) OR BED SHALL BE FILLED IN AND RESTORED TO MATCH THE CONDITION AND VEGETATION OF THE ADJACENT AREA.
9. IMPROPERLY PRUNED PLANTINGS WILL BE REJECTED AND REPLACEMENTS WILL IMMEDIATELY BE MADE BY THE CONTRACTOR.
10. THE SIDES OF ALL PLANT PITS SHALL BE LOOSENED TO DISJOIN ANY GLAZING WHICH MAY OCCUR DURING THE DIGGING OPERATION.
11. TREE WRAPPING SHALL EXTEND TO THE LOWEST MAJOR BRANCH.
12. TOP OF ROOTBALL SHALL BE APPROXIMATELY 2 INCHES ABOVE ADJACENT FINISHED GRADE.
13. SHRUB PLANTINGS:
  - A. UNLESS NOTED OTHERWISE, ALL SHRUBS SHALL BE PLANTED IN MULCHED BEDS. THE EDGE OF THE MULCH BED SHALL EXTEND A MINIMUM OF THREE (3) FEET BEYOND THE CENTERS OF THE PERIPHERAL PLANTS IN THE BED.
  - B. THE EDGE OF A MULCH BED FOR SHRUB PLANTINGS ADJACENT TO A WALL, FENCE, GUARDRAIL OR OTHER FIXED OBJECT SHALL EXTEND TO THE OBJECT. THE PERIPHERAL PLANTS IN THE BED SHALL NOT BE PLANTED WITHIN FIVE (5) FEET OF THE OBJECT.
  - C. WHEN A TREE IS LOCATED IN A SHRUB BED, THE MINIMUM DISTANCE BETWEEN THE TREE AND THE ADJACENT SHRUBS SHALL BE SIX (6) FEET.
14. THE CONTRACTOR SHALL RESTORE ALL AREAS, OBJECTS AND VEGETATION DISTURBED BY THE LANDSCAPE OPERATIONS TO ORIGINAL CONDITIONS.
15. STAKES, GUYWIRES AND ALL TREE SUPPORTS SHALL BE REMOVED AFTER ONE YEAR OR AS DIRECTED BY THE LANDSCAPE ARCHITECT.
16. REMOVE ALL TWINE, ROPE, WIRE AND BURLAP FROM TOP HALF OF ROOTBALL. THE LOWER HALF OF BURLAP SHALL BE FOLDED TOWARD THE BOTTOM OF THE ROOTBALL.



DATE	REVISIONS
2-7-2012	REVISED POST BRACING DETAIL.

LANDSCAPE PLANTING  
DETAILS

STANDARD D7-01

APPROVED *Paul Kovacs* CHIEF ENGINEER DATE 2-7-2012