WHEN WORKING IN THE VICINITY OF COMED'S ELECTRIC TRANSMISSION LINES, STA. 348+50 TO STA. 350+00, A MINIMUM FIFTEEN (15) FEET WORKING CLEARANCE MUST BE MAINTAINED BETWEEN ANY EQUIPMENT AND THE EXISTING 138,000 VOLT ELECTRIC TRANSMISSION CONDUCTORS. UNDER NO CIRCUMSTANCES, SHOULD ANY EQUIPMENT BE RAISED UNDERNEATH THE TRANSMISSION LINES.

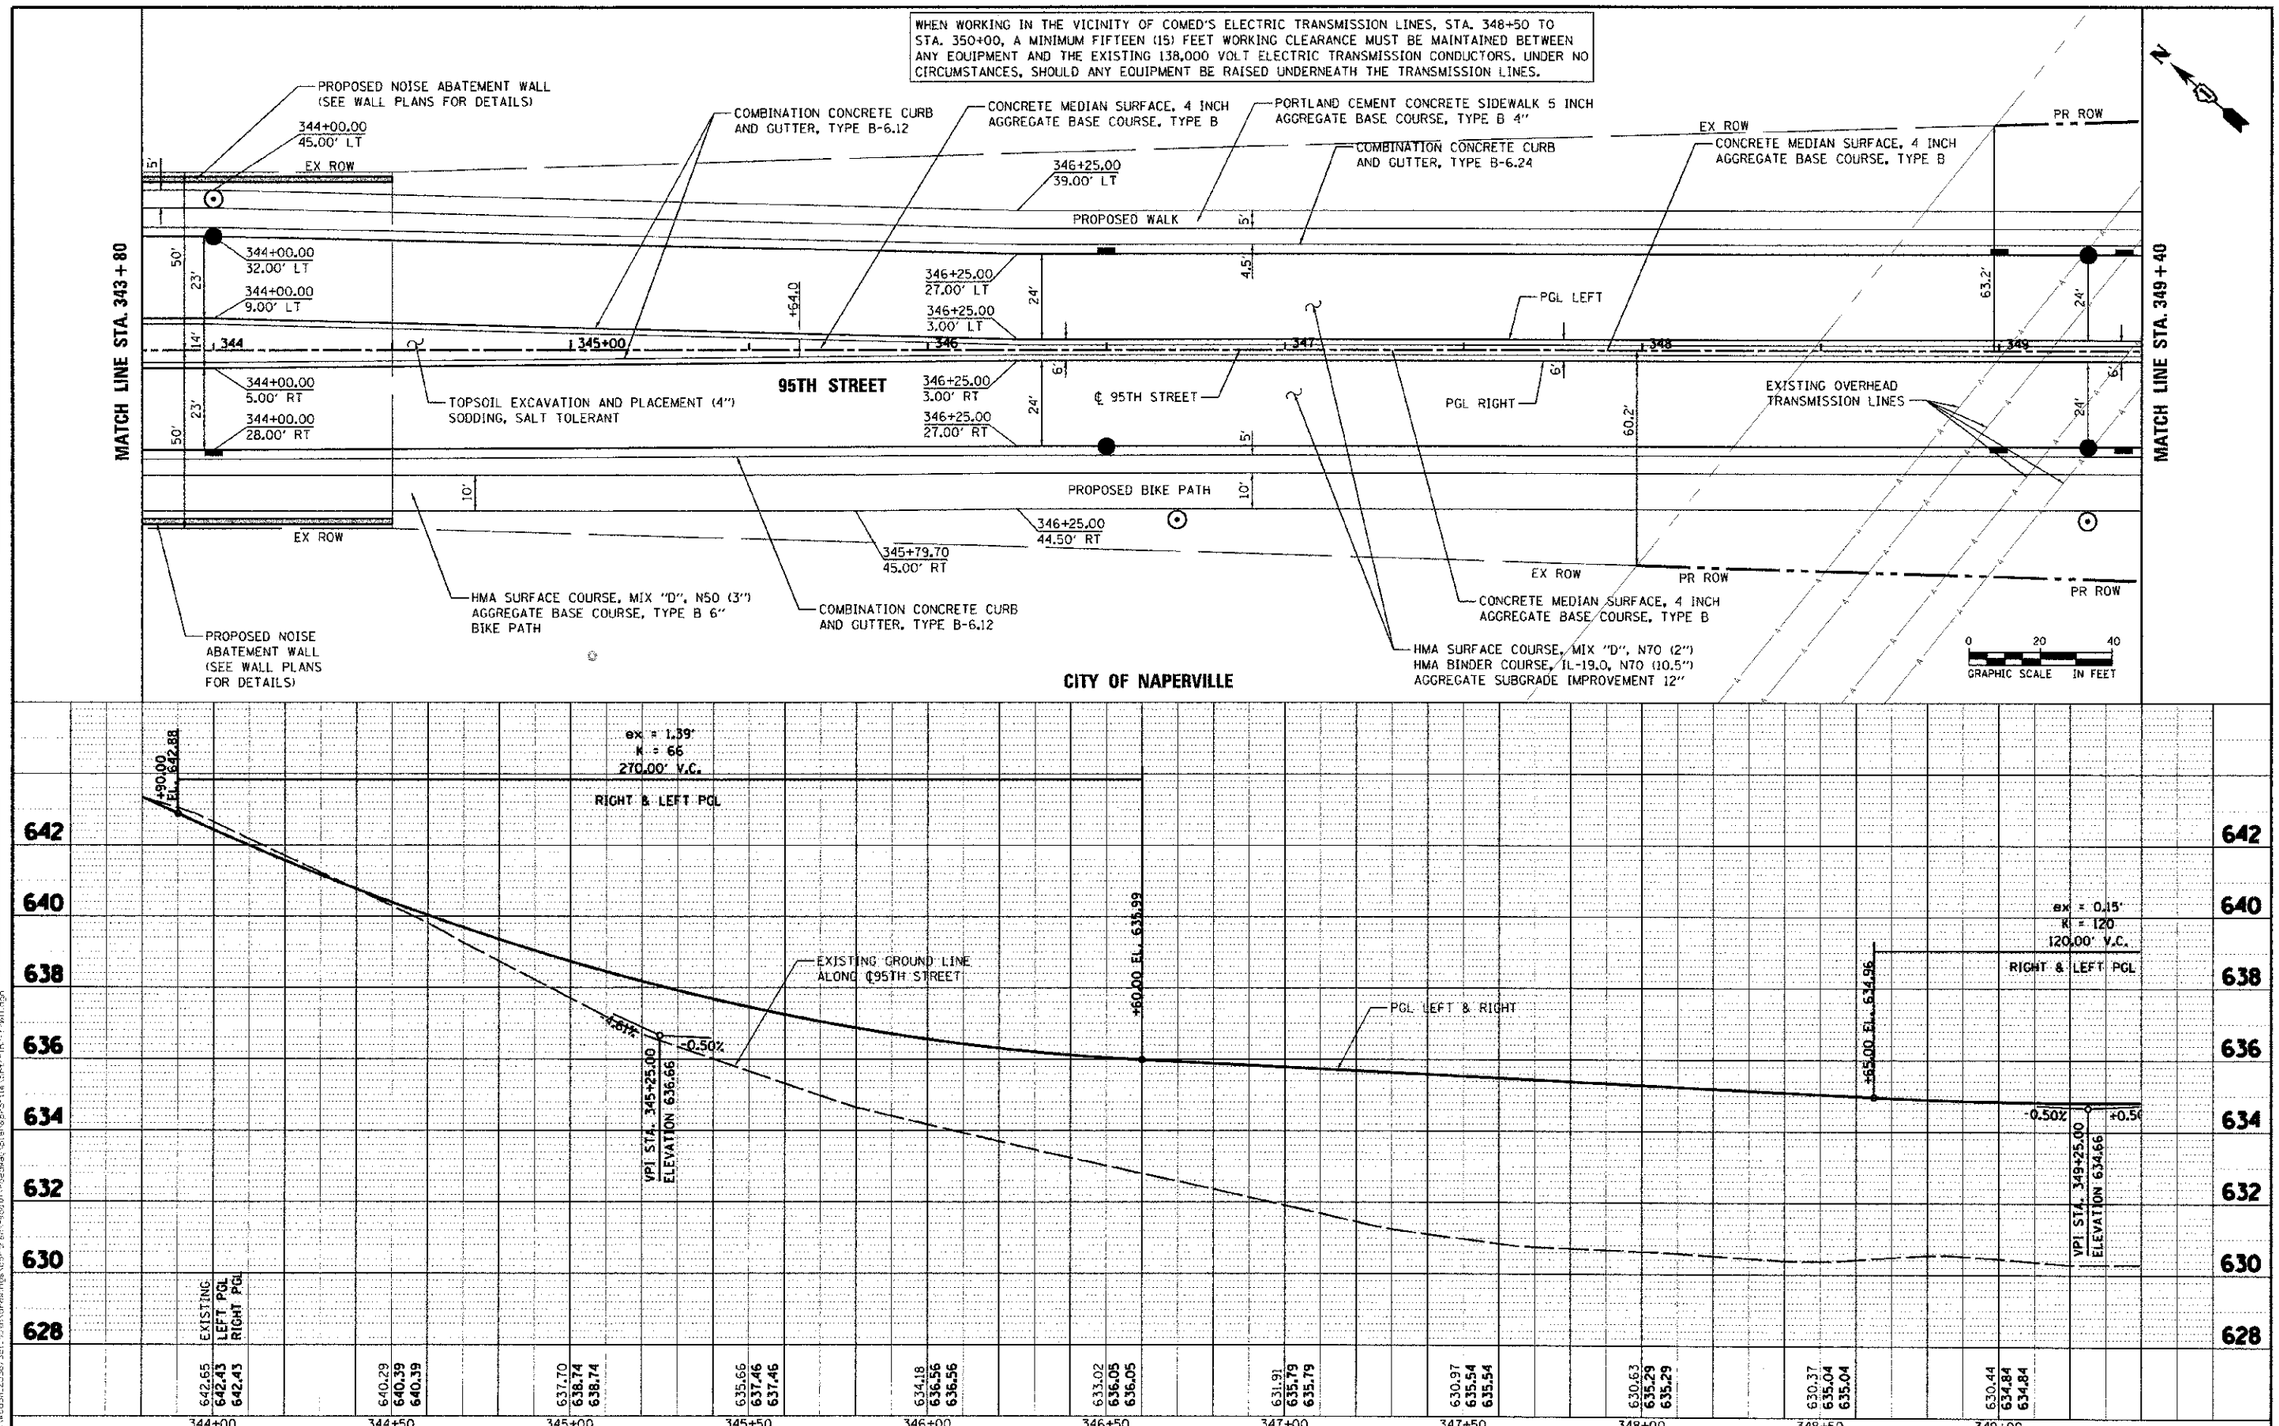

URS
100 S.WACKER DR., SUITE 500
CHICAGO IL 60606
TEL (312)-939-1000
FAX (312)-939-4198

USER NAME = jarrod.pusk	DESIGNED - JRP	REVISED -	
	DRAWN - KB	REVISED -	
PLOT SCALE = 20.0000 ' / IN.	CHECKED - JRP	REVISED -	
PLOT DATE = 10/15/2012	DATE - 10/19/2012	REVISED -	

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

95TH STREET
ROADWAY PLAN & PROFILE

SCALE: 1"=20' | DRAWING NO. 8 OF 17 | STA. 343+80 TO STA. 349+40

F.A.U. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
1644	01-00181-00-FP	WILL	328	43

CONTRACT NO. 63647

ILLINOIS FED. AID PROJECT