
* Granular or solid flux filled headed studs conforming to Article 1006.32 of the Std. Specs., automatically end welded.

after forms are removed, typ.

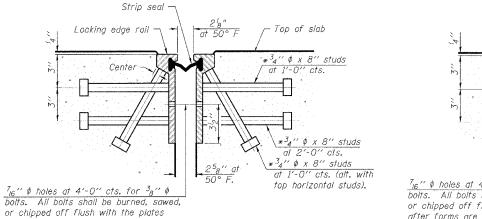

Strip seal Locking edge rail $2\frac{1}{8}$ " Top of slab $3\frac{3}{4}$ " ϕ x 8" studs at 1'-0" cts. Anchor plate Place plates at 1'-0" cts. (alt, with top horizontal studs) or chipped off flush with the plates after forms are removed, typ.

CONTRACT NO.

 ROUTE NO.	SECTION	COUNTY		TOTAL SHEETS	SHEET NO.
F.A.P. 731	•	GREENE		30	12
FED. ROAD L	DIST, NO.	ILLINOIS	FEL	D. AID F	PROJECT
PEDDERAU AR	U BRS PROUDOT				

* 01-00071-00-BR

CONTRACT NO. 97289 Sheet No. 8 of 23 Sheets


Notes

The strip seal shall be made continuous and shall have a minimum thickness of $\frac{1}{4}$ ". The configuration of the strip seal shall match the configuration of the Locking Edge Rails. Open or "webbed" strip seal gland configurations are not permitted. The gland shall be sized for a maximum rated movement of 4 inches.

The height and thickness of the Locking Edge Rails shown are minimum dimensions. The actual configuration of the Locking Edge Rails and matching strip seal may vary from manufacturer to manufacturer. Flanged edge rails will not be allowed. Locking Edge Rails may be spliced at slope discontinuities and stage construction joints.


The manufacturer's recommended installation methods shall be followed. The joint opening and deck dimensions detailed on the superstructure are based on a rolled rall expansion joint. If the Contractor elects to use the welded rail expansion joint, the opening and deck dimensions shall be modified according to the dimensions detailed on this sheet. Required modifications shall be made at no additional cost to the State.

SECTION THRU ROLLED RAIL JOINT

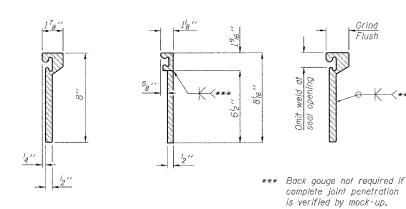


ROLLED
(EXTRUDED) RAIL WELDED RAIL


SECTION THRU WELDED RAIL JOINT



ANCHOR PC (for welded rail)




AT PARAPET

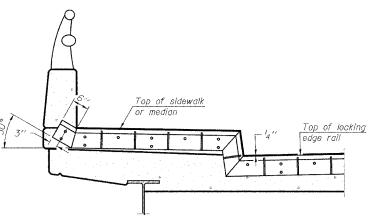


AT SIDEWALK OR MEDIAN

Shorter plates with a single row of studs at 12" cts. may be necessary on medians which are shallower than 9". See manufacturer's recommendation.

LOCKING EDGE RAILS



PLAN



SECTION A-A

*3₄" \$ x 6" Studs 1₂" Plate 3₄" \$ Countersunk bolts at ±12" cts.

TYPICAL END TREATMENTS

SECTION B-B

BILL OF MATERIAL

	Item			Unit	Total
Preformed	Joint	Strip	Seal	Foot	60

POINT BLOCK DETAILS

(for skews > 30°)

EXPANSION JOINTS
(PREFORMED JOINT STRIP SEAL)

F.A.S. 731 - C.H. 2

OVER APPLE CREEK
SECTION 01-00071-00-BR
GREENE COUNTY

LOCKING EDGE

RAIL SPLICE

The inside of the locking edge rail groove shall be free of weld