

CODE	COMMODITY	SIZE	QUANTITY
05-3281-2849	END-BOLT CONDUIT	1/2" DIA. 10' L.	1
05-4451	FLASK, LARGE, RADIUS	3'-12" X 2'-3" X 4"	VARIES
37-8180-0250	ANCHOR ROD	1-1/2" X 60"	4
05-5054-0910	RE-BAR CAGE	20" X 6" (OP. 8")	1
05-2785-1005	GROUND ROD	3/4" X 12'	1
05-2535-3240	GROUND ROD CLAMP	3/4"	1
05-2902	GROUND BUSHING	2" X 1-1/2" X 3" OR 4"	VARIES

- NOTES:**
1. 7 FOOT FOUNDATION FOR ARTERIAL STREET LIGHT POLE, UNLESS NOTED OTHERWISE.
 2. CONCRETE MUST MEET IDOT REQUIREMENTS FOR PORTLAND CEMENT CLASS 51 CONCRETE.
 3. REINFORCING BARS MUST MEET ASTM A-615 GRADE 60.


DATE	REVISION
4/21/02	SURVEYORS INC. AND DRAMM 4/21/01

FOUNDATION FOR 34'-6" ARTERIAL STREET LIGHT OR TRAFFIC SIGNAL POLE - 3" OR 7 GAUGE WITH 15" BOLT CIRCLE

CITY OF CHICAGO
DEPT. OF ELECTRICAL ENGINEERING

DESIGNED BY: J. S. JAMES
CHECKED BY: J. S. JAMES
DRAWN BY: J. S. JAMES
DATE: 4/21/02

818

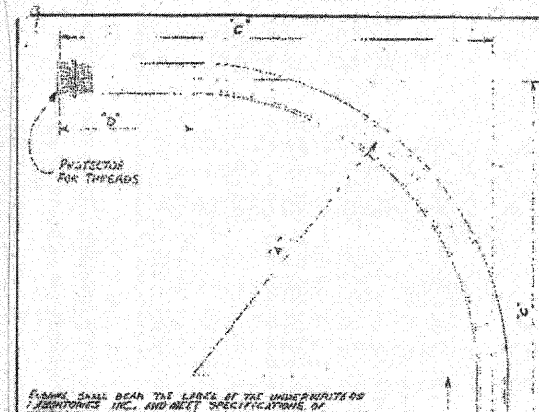

FLASKS SHALL BEAR THE LABELS OF THE UNDERWRITERS OF LABORATORY INC. AND MEET SPECIFICATIONS OF UNDERWRITERS LABORATORIES, INC. IN U.S.A. UNITED STATES OF AMERICA. STANDARD METRIC, C.G.S. AND FEDERAL SPECIFICATIONS ARE NOT APPLICABLE.

NOTE: TWO THREADED PROTECTORS TO BE FURNISHED ON EACH END OF PROTECTOR TO COVER A MINIMUM OF TEN THREADS.

TABLE OF DIMENSIONS

CONDUIT SIZE	CONDUIT DIMENSIONS	COMMODITY CODE
1 1/2"	1 1/2" x 2 1/4" x 3 1/2"	09-4001-0510
2"	2" x 3" x 4"	09-4001-0510
2 1/2"	2 1/2" x 3 1/2" x 4 1/2"	09-4001-0510
3"	3" x 4" x 5"	09-4001-0510
3 1/2"	3 1/2" x 4 1/2" x 5 1/2"	09-4001-0510

ELBOW, CONDUIT RIGID GALVANIZED STEEL, LARGE RADIUS

CITY OF CHICAGO
DEPT. OF ELECTRICAL ENGINEERING

DESIGNED BY: J. S. JAMES
CHECKED BY: J. S. JAMES
DRAWN BY: J. S. JAMES
DATE: 4/21/02

818

