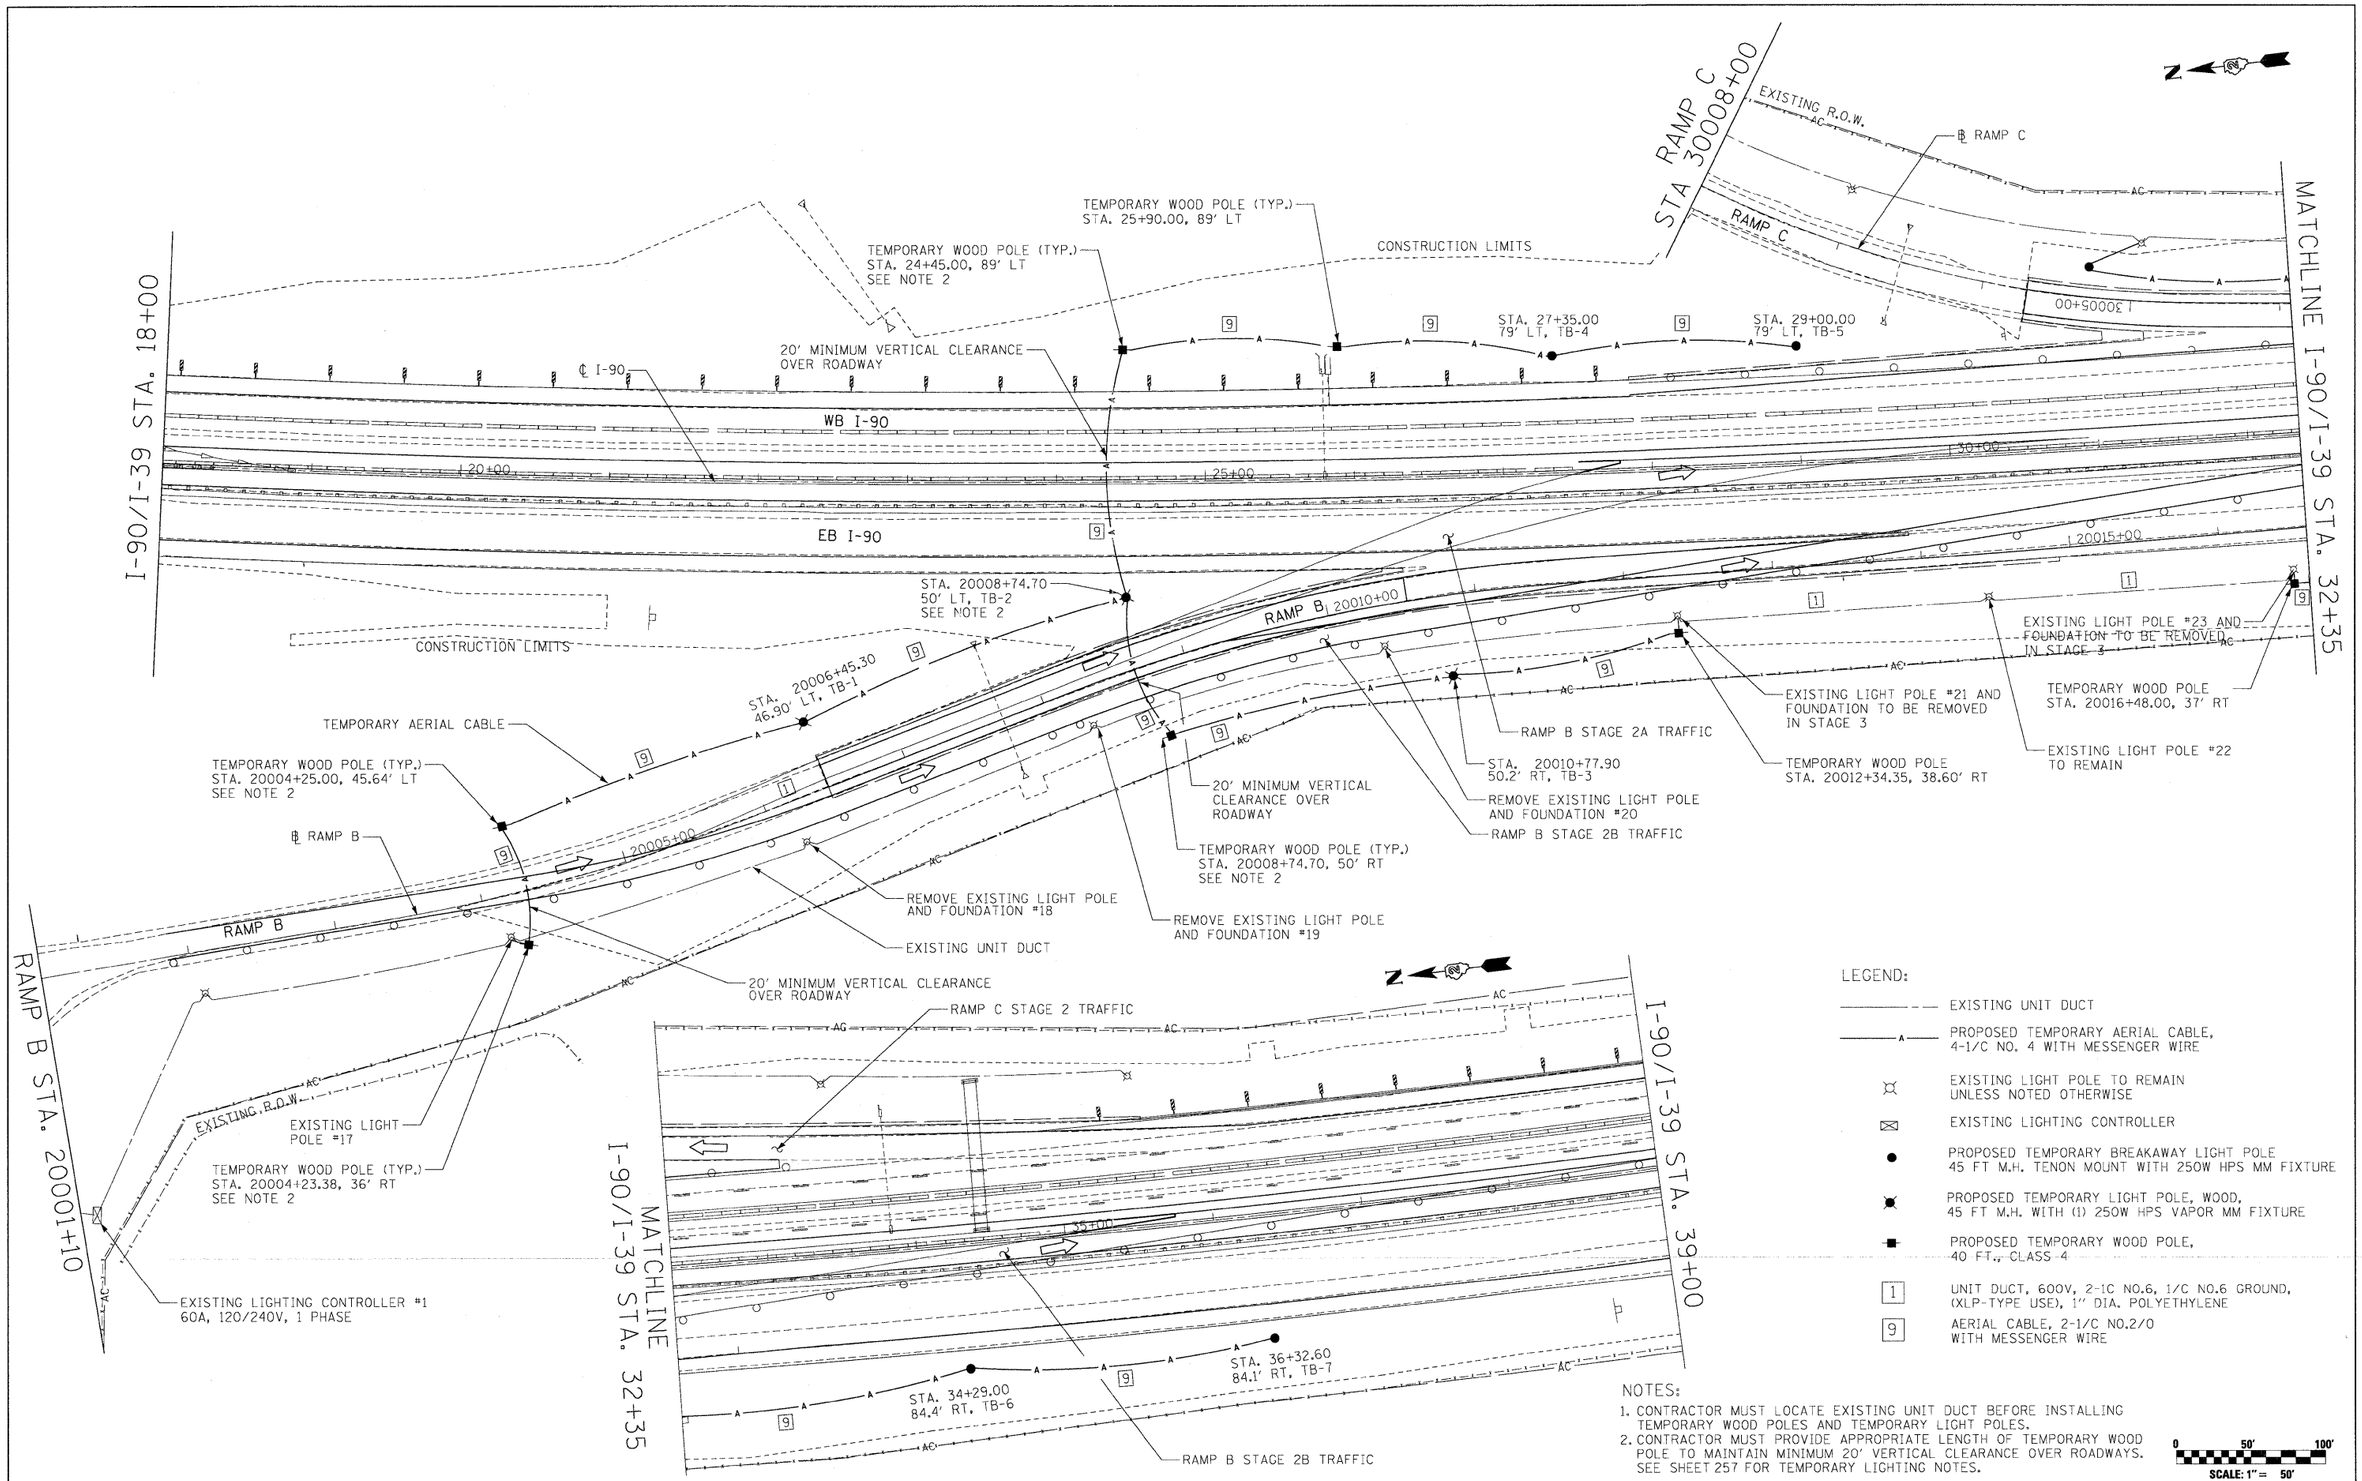

LEGEND:

- EXISTING UNIT DUCT
- PROPOSED TEMPORARY AERIAL CABLE, 4-1/C NO. 4 WITH MESSENGER WIRE
- EXISTING LIGHT POLE TO REMAIN UNLESS NOTED OTHERWISE
- EXISTING LIGHTING CONTROLLER
- PROPOSED TEMPORARY BREAKAWAY LIGHT POLE 45 FT M.H. TENON MOUNT WITH 250W HPS MM FIXTURE
- PROPOSED TEMPORARY LIGHT POLE, WOOD, 45 FT M.H. WITH (1) 250W HPS VAPOR MM FIXTURE
- PROPOSED TEMPORARY WOOD POLE, 40 FT., CLASS 4
- [1] UNIT DUCT, 600V, 2-1C NO.6, 1/C NO.6 GROUND, (XLP-TYPE USE), 1" DIA. POLYETHYLENE
- [9] AERIAL CABLE, 2-1/C NO.2/0 WITH MESSENGER WIRE

NOTES:

1. CONTRACTOR MUST LOCATE EXISTING UNIT DUCT BEFORE INSTALLING TEMPORARY WOOD POLES AND TEMPORARY LIGHT POLES.
2. CONTRACTOR MUST PROVIDE APPROPRIATE LENGTH OF TEMPORARY WOOD POLE TO MAINTAIN MINIMUM 20' VERTICAL CLEARANCE OVER ROADWAYS. SEE SHEET 257 FOR TEMPORARY LIGHTING NOTES.

0 50' 100'
SCALE: 1" = 50'

McClure Engineering Associates, Inc. / LOCHNER HDR, LOCHNER, INC. CHICAGO, ILLINOIS	USER NAME = _USERNAME_	DESIGNED - BLM	REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	TEMPORARY LIGHTING PLAN IL 75 RAMP B	F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS / SHEET NO.
		DRAWN - JPW	REVISED -			90	(X2-1)R	WINNEBAGO	510 / 260
CIVIL ENGINEERING CONSULTANTS: RWA Regina Winter & Associates, Inc. / QUIGG ENGINEERING INC	PLOT SCALE = 50.0000 ' / IN.	CHECKED - BLM	REVISED -					CONTRACT NO. 64C29	
	PLOT DATE = 10/19/2011	DATE - 10/14/11	REVISED -		SCALE: / SHEET NO. OF SHEETS / STA. / TO STA.			ILLINOIS FED. AID PROJECT	