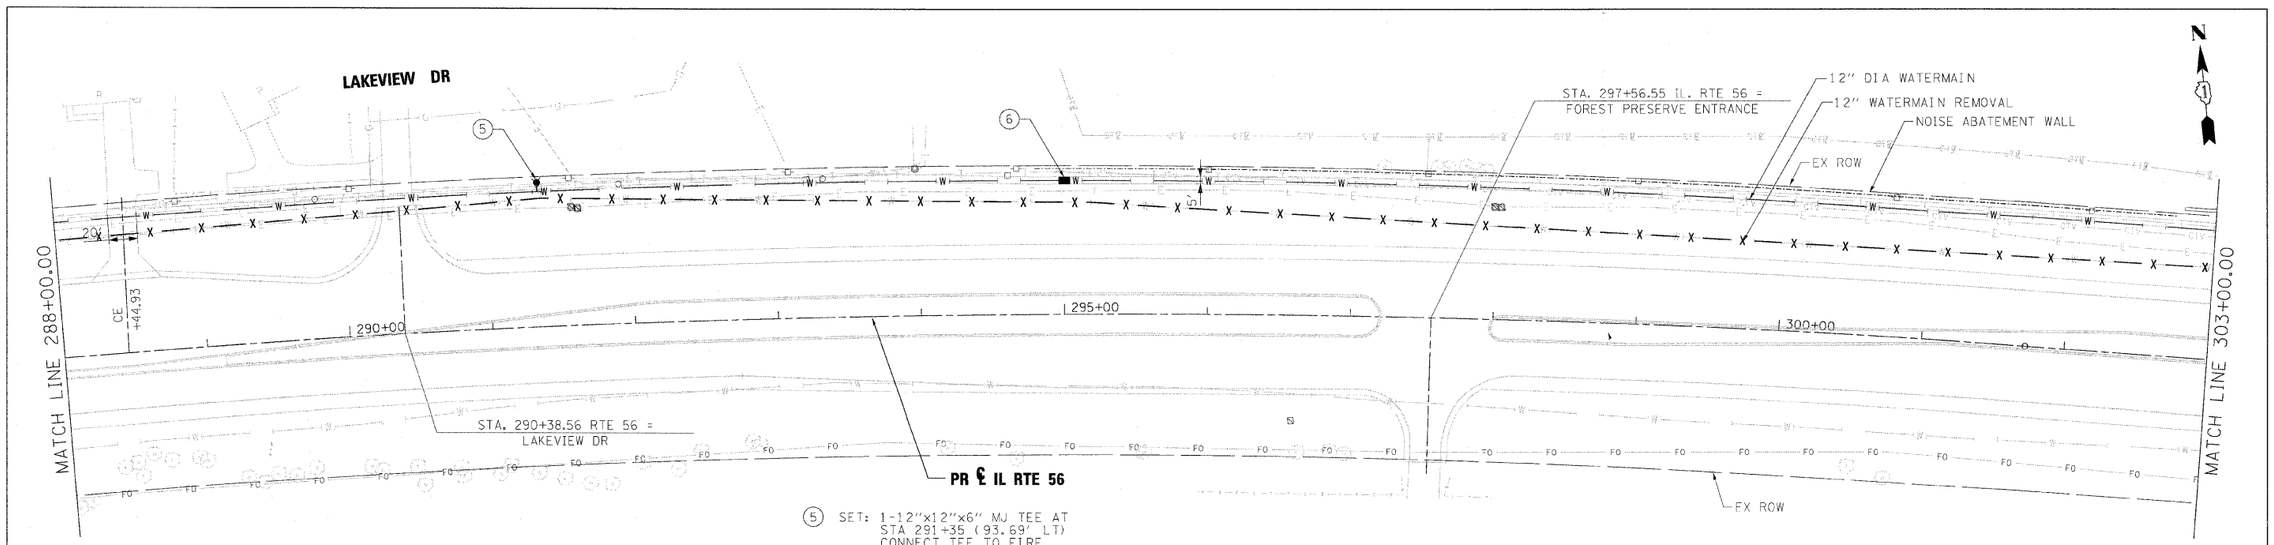

(5) SET: 1-12"x12"x6" MJ TEE AT STA 291+35 (93.69' LT)
CONNECT TEE TO FIRE HYDRANT USING 6" DIA WATERMAIN

SET: 1-6" FIRE HYDRANT AT STA 291+35 (98.99' LT)
REMOVE EXISTING FIRE HYDRANT IF IT CONFLICTS WITH NEW WATERMAIN OR FIRE HYDRANT

(6) SET: 1-12" MJ GATE VALVE WITH VALVE BOX AT STA 295+00 (92.47' LT)

FOREST PRESERVE ENTRANCE

NOTE:
WHERE PROPOSED WATERMAIN INSTALLATION CONFLICTS WITH EXISTING SIDEWALK, THE EXISTING SIDEWALK SHALL BE REMOVED AND REPLACED. QUANTITY FOR PAYMENT HAS BEEN INCLUDED

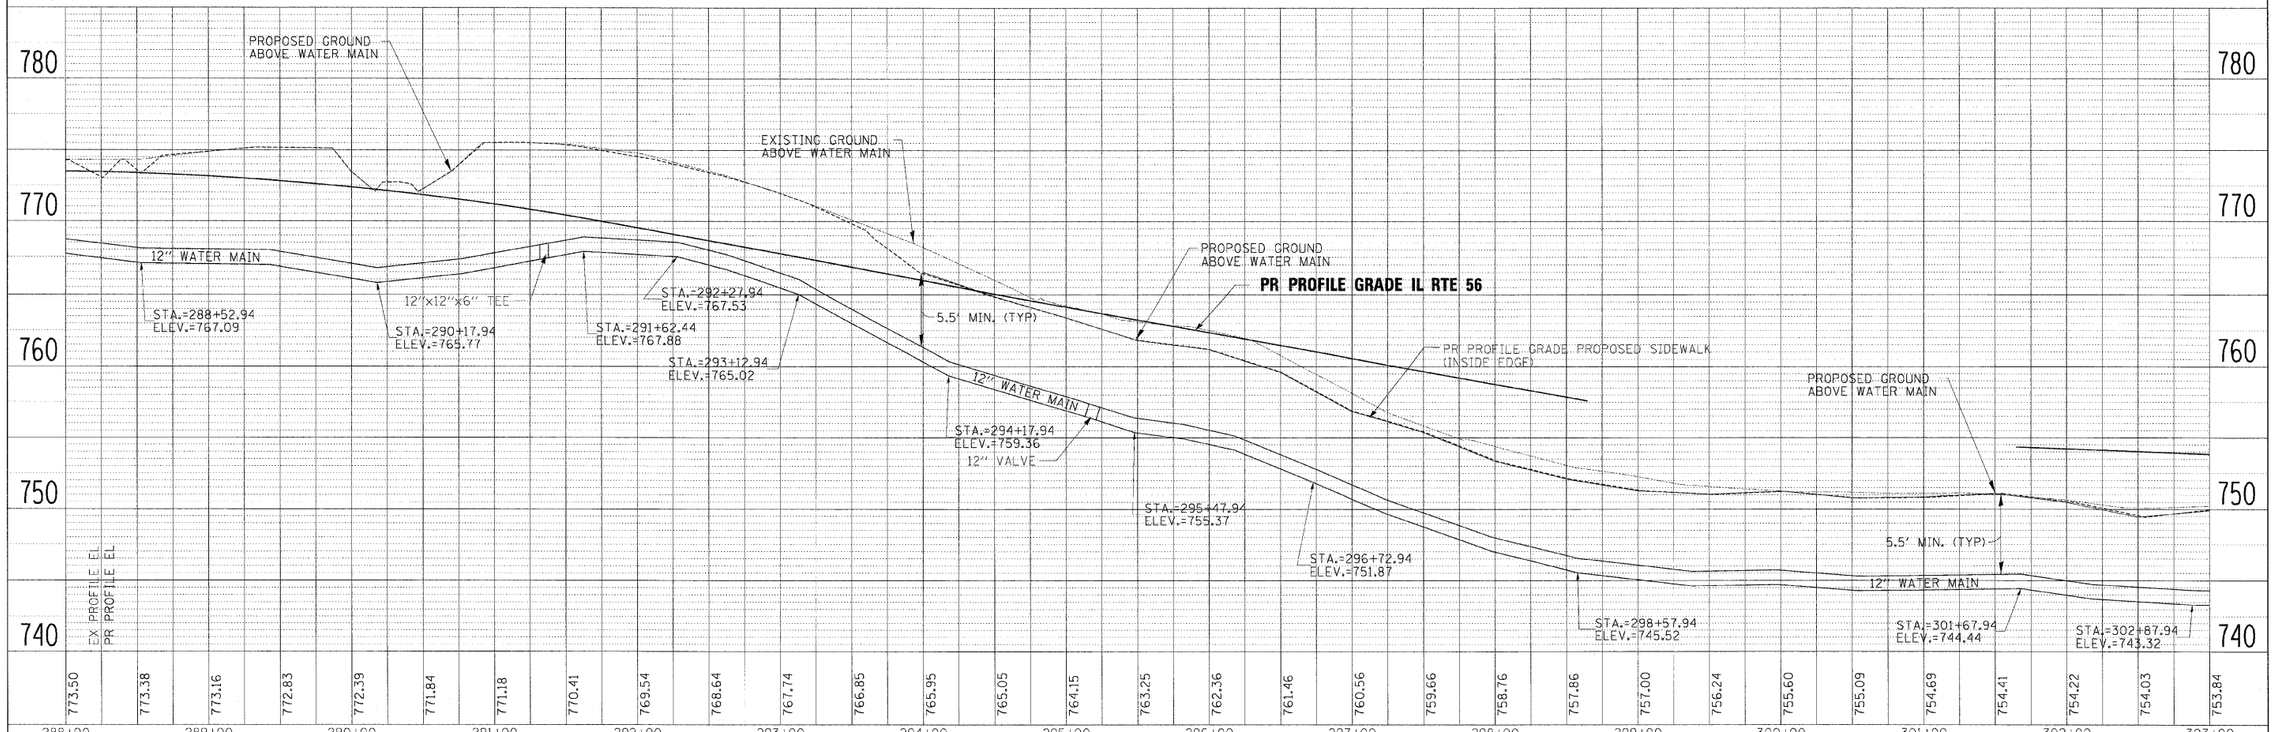

FILE NAME = ...\0162419-sht-wm_plnpr04.dgn	DESIGNED - JMM	REVISED -
USER NAME = wlank	DRAWN - TMB	REVISED -
PLOT DATE = 12/7/2010	CHECKED - RMT	REVISED -
	DATE - 12/6/10	REVISED -

benesch

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

WATERMAIN PLAN AND PROFILE
IL RTE 56

SCALE: 1"=50' | SHEET NO. 4 OF 11 SHEETS | STA. 288+00 TO STA. 303+00

F.A.P RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
365	(57 & 58)WRS-2	DUPAGE	681	288

CONTRACT NO. 62419
ILLINOIS FED. AID PROJECT