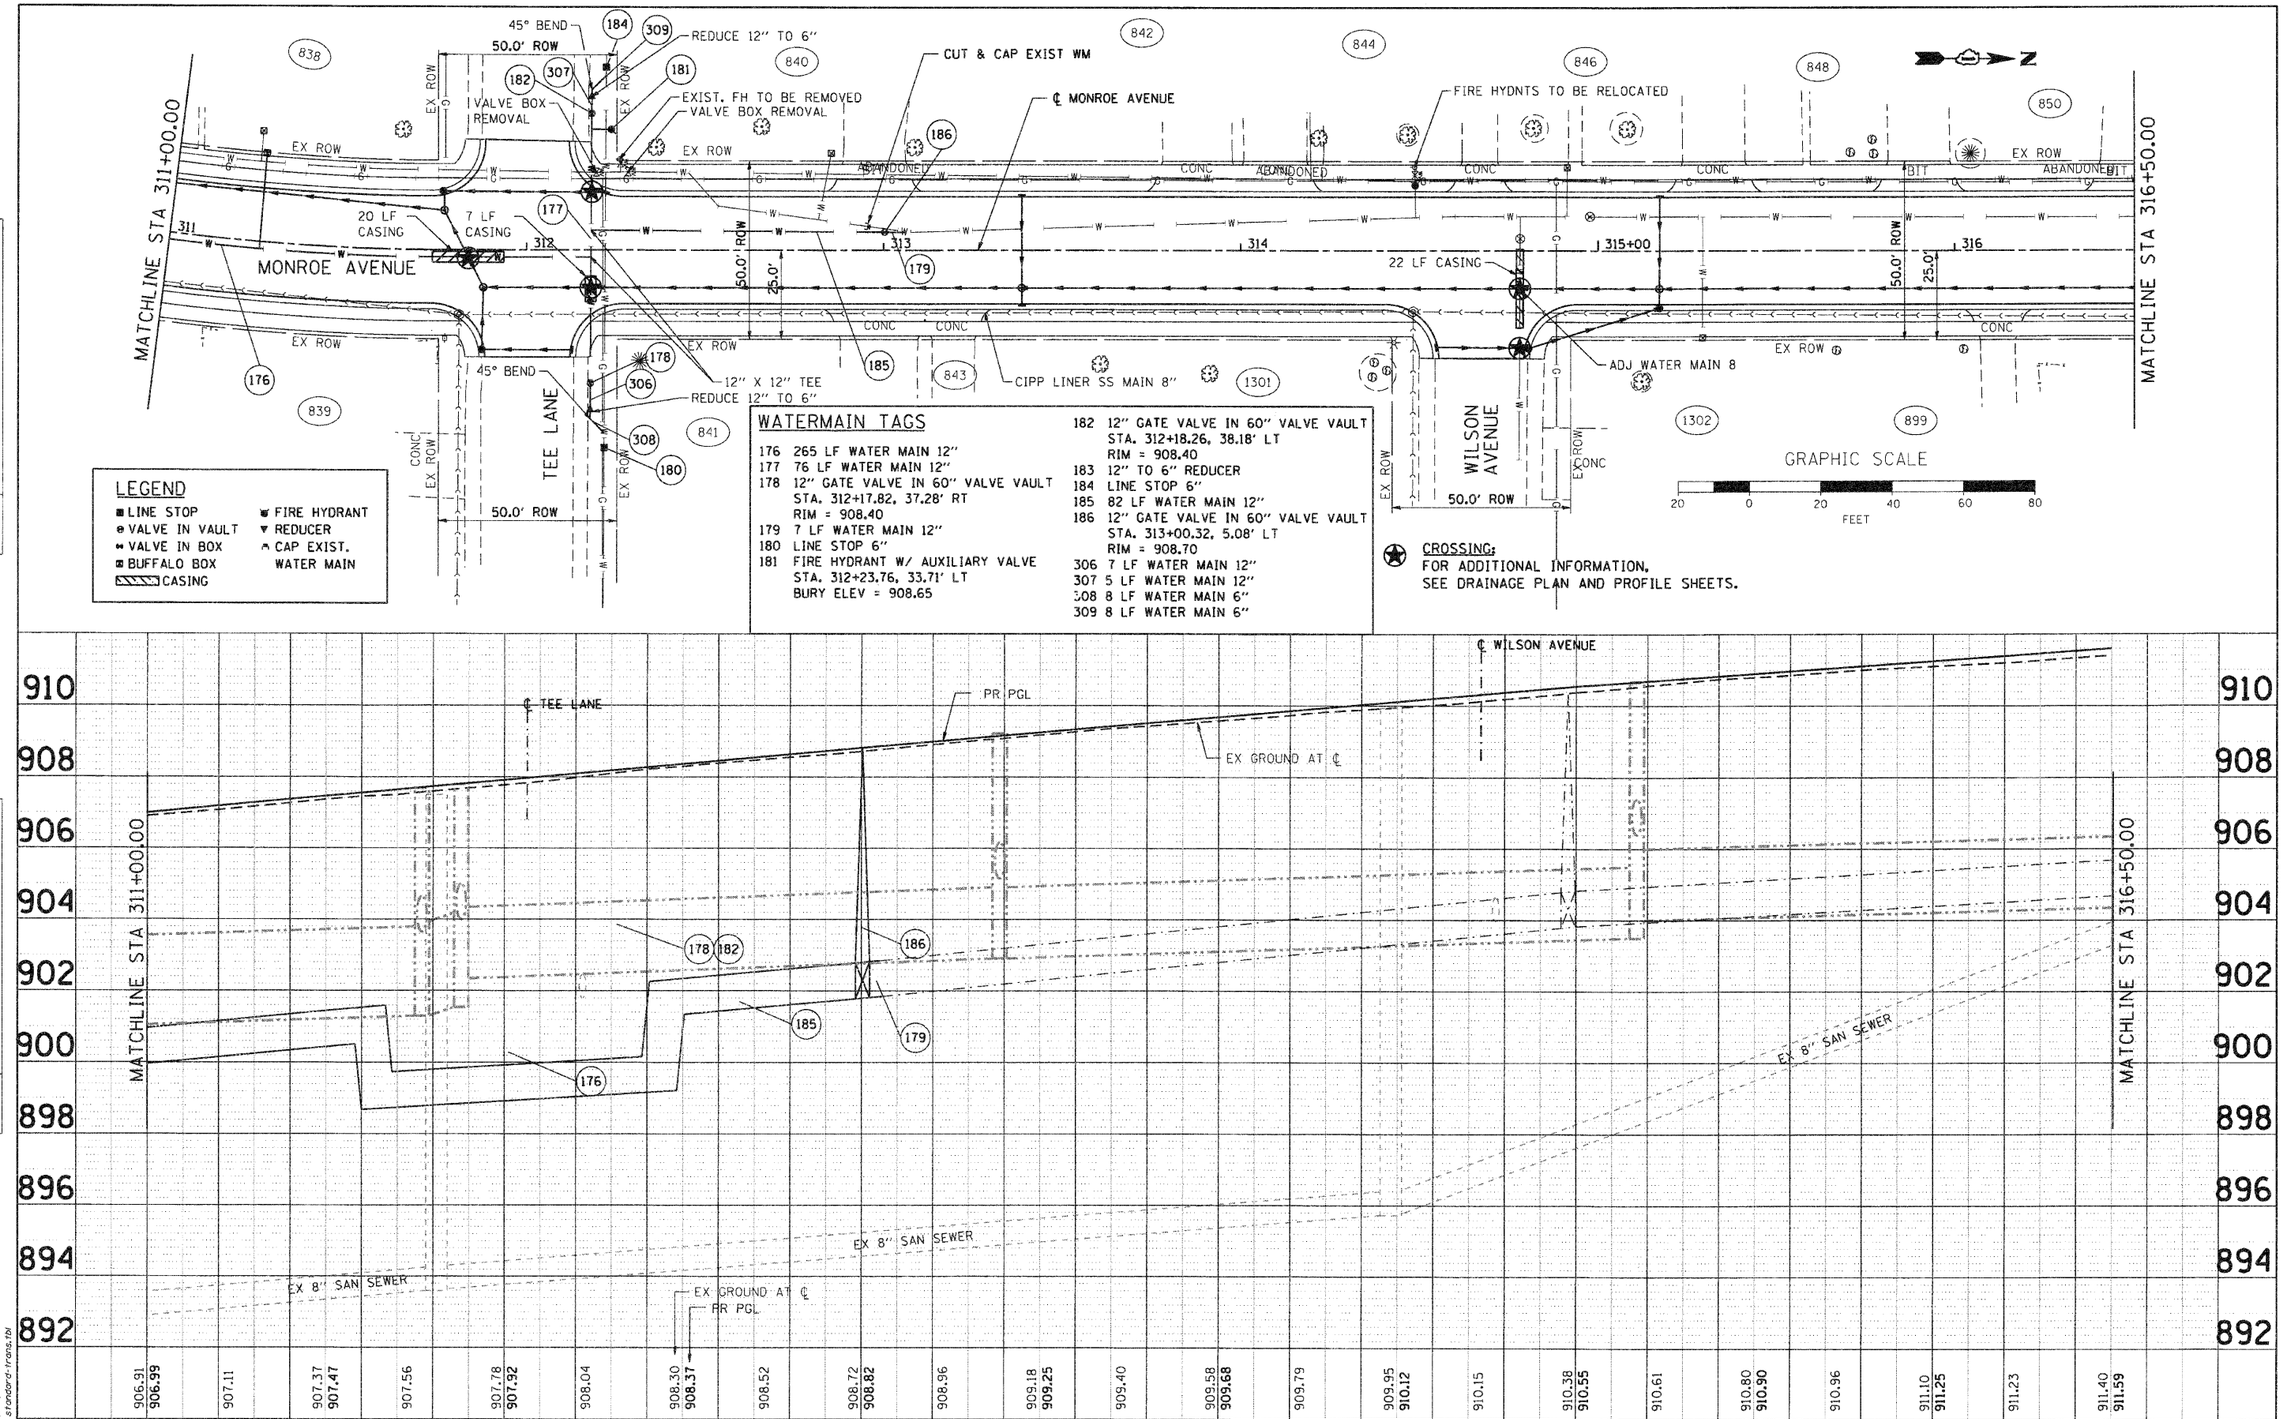

WATERMAIN TAGS

176 265 LF WATER MAIN 12"
177 76 LF WATER MAIN 12"
178 12" GATE VALVE IN 60" VALVE VAULT
STA. 312+17.82, 37.28' RT
RIM = 908.40
179 7 LF WATER MAIN 12"
180 LINE STOP 6"
181 FIRE HYDRANT W/ AUXILIARY VALVE
STA. 312+23.76, 33.71' LT
BURY ELEV = 908.65
182 12" GATE VALVE IN 60" VALVE VAULT
STA. 312+18.26, 38.18' LT
RIM = 908.40
183 12" TO 6" REDUCER
184 LINE STOP 6"
185 82 LF WATER MAIN 12"
186 12" GATE VALVE IN 60" VALVE VAULT
STA. 313+00.32, 5.08' LT
RIM = 908.70
306 7 LF WATER MAIN 12"
307 5 LF WATER MAIN 12"
308 8 LF WATER MAIN 6"
309 8 LF WATER MAIN 6"

PLAN: NOTE BOOK NO. ____ SURVEYED / PLOTTED / ALIGNMENT CHECKED / RT. OF WAY CHECKED / CADD FILE NAME / BY / DATE

PROFILE: NOTE BOOK NO. ____ SURVEYED / PLOTTED / GRADES CHECKED / B.M. NOTED / STRUCTURE NOTATNS CHKD / BY / DATE

COMPANY NAME: SEC GROUP, INC.
PROJECT CONTACT: A. JAIN
CLIENT: VILLAGE OF CARPENTERSVILLE
DATE PLOTTED: 11/1/2010 6:00:11 PM
FILE NAME: 080326-wtr-15.dgn
PLOT DRIVER: pdf.plt
PEN TABLE: standard-trans.tbl

C-91-154-07
HAZARD/MONROE/COLFVIEW
080326-wtr-15.dgn

SEC Group, Inc.
An HR Green Company
420 N. Front Street,
McHenry, IL 60050-2136
t 815.385.1778 f 815.385.1781
www.secgroupinc.com
+McHenry,IL +Rockville,IL +New Lenox,IL +Chicago,IL

USER NAME = CHartke	DESIGNED - C. PIEPER	REVISED -	
	DRAWN - R. BEST	REVISED -	
PLOT SCALE = 1" = 20'	CHECKED - T. HAMILTON	REVISED -	
PLOT DATE = 11/1/2010	DATE - 10/25/10	REVISED -	

VILLAGE OF CARPENTERSVILLE

WATERMAIN AND SANITARY SEWER PLAN AND PROFILE
MONROE AVENUE

SCALE: 1" = 20' | SHEET NO. 15 OF 20 SHEETS | STA. 311+00 TO STA. 316+50

F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
*	06-00074-00-FP	KANE	211	84
* FAU 2414, FAU 1280, FAP 343		CONTRACT NO. 63504		
FED. ROAD DIST. NO.	ILLINOIS	FED. AID PROJECT		