


PLAN	DATE
BY	
SURVEYED	
PLOTTED	
GRADES CHECKED	
STRUCTURE NOTATIONS CHECKED	
NOTE BOOK NO.	
CADD FILE NAME	

PROFILE	DATE
BY	
SURVEYED	
PLOTTED	
GRADES CHECKED	
STRUCTURE NOTATIONS CHECKED	
NOTE BOOK NO.	
CADD FILE NAME	



- STD. 701D
- ### CURB AND GUTTER GENERAL NOTES
1. Thickness: "T" = thickness of the curb or gutter
 2. Depressed curbs: The top of a curb shall be depressed where it is constructed across a sidewalk, driveway, or where directed by the Director of Community Development. The transition from full height curb to depressed curb shall be at the rate of 3" per foot.
 3. Sub-grade: Improved sub-grade shall extend 1' outside of the back of curb.
 4. Sub-base: The sub-base shall consist of 4" of compacted crushed limestone.
 5. Concrete: Shall be a 6 bag mix, attaining a strength of not less than 3500 P.S.I. in 28 days.
 6. Contraction joints: Maximum of 25' intervals, grooved or sawcut a minimum of 1/8" wide, and a minimum of 2" deep. Sawing shall be completed within 24 hours of the pour.
 7. Expansion joints: 1" thick preformed joint filler with a single 5/4"x 18" epoxy coated smooth dowel bar, fitted with a pinch cap, installed 5" on either side of any structure within the curb line, at the PT and PC of a radius, and at the end of each concrete pour. Maximum spacing of 75'.
 8. Construction joints: Use whenever the placing of concrete is held up for 30 minutes or more. Construction joints shall be installed in the same manner as an expansion joint.
 9. Steel reinforcement: 2 continuous No. 4 bars centered in the curb over all trench crossings so that the bars extend 5' beyond the trench on all sides.
- | REVISIONS | VILLAGE OF ADDISON |
|-----------|------------------------------------|
| 903 | APPROVED: 2/2/94 |
| | <i>[Signature]</i> |
| | R. ESPEDDO, P.E., VILLAGE ENGINEER |

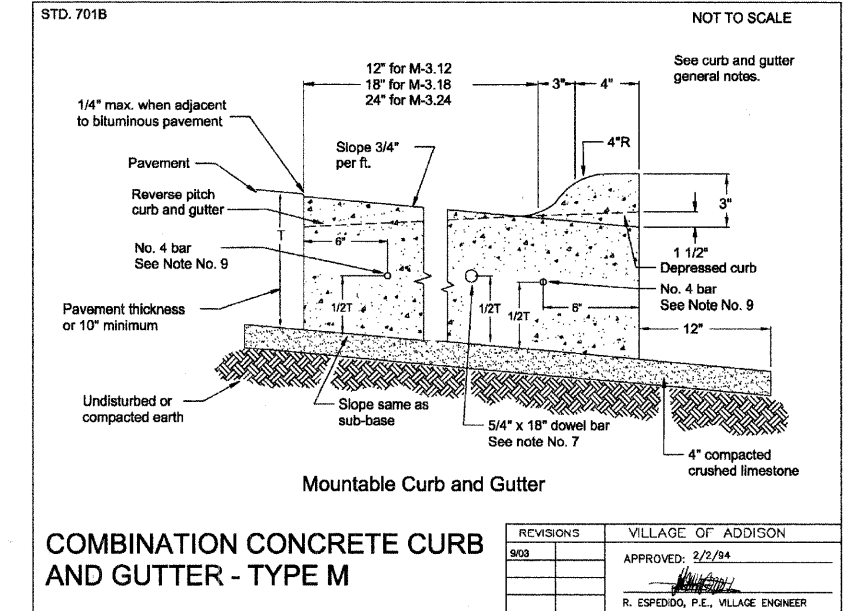