



NOTES:

- SEE "ELECTRICAL LEGEND AND ABBREVIATIONS" SHEET FOR GENERAL NOTES AND REQUIREMENTS.
- FURNISH & INSTALL ALL REQUIRED CONTROL CIRCUIT WIRING IN GALVANIZED RIGID STEEL CONDUIT FOR THE RESPECTIVE GATE OPERATOR. CONFIRM CONTROL WIRING REQUIREMENTS WITH THE RESPECTIVE GATE OPERATOR SYSTEM MANUFACTURER'S REPRESENTATIVE.
- REMOVAL OF THE EXISTING ELECTRIC SLIDE GATE WILL BE PAID FOR UNDER ITEM AR162908 - REMOVE ELECTRIC GATE.
- PROPOSED 24' ELECTRIC SLIDE GATE WILL BE PAID FOR UNDER ITEM AR162724 - ELECTRIC GATE - 24'.

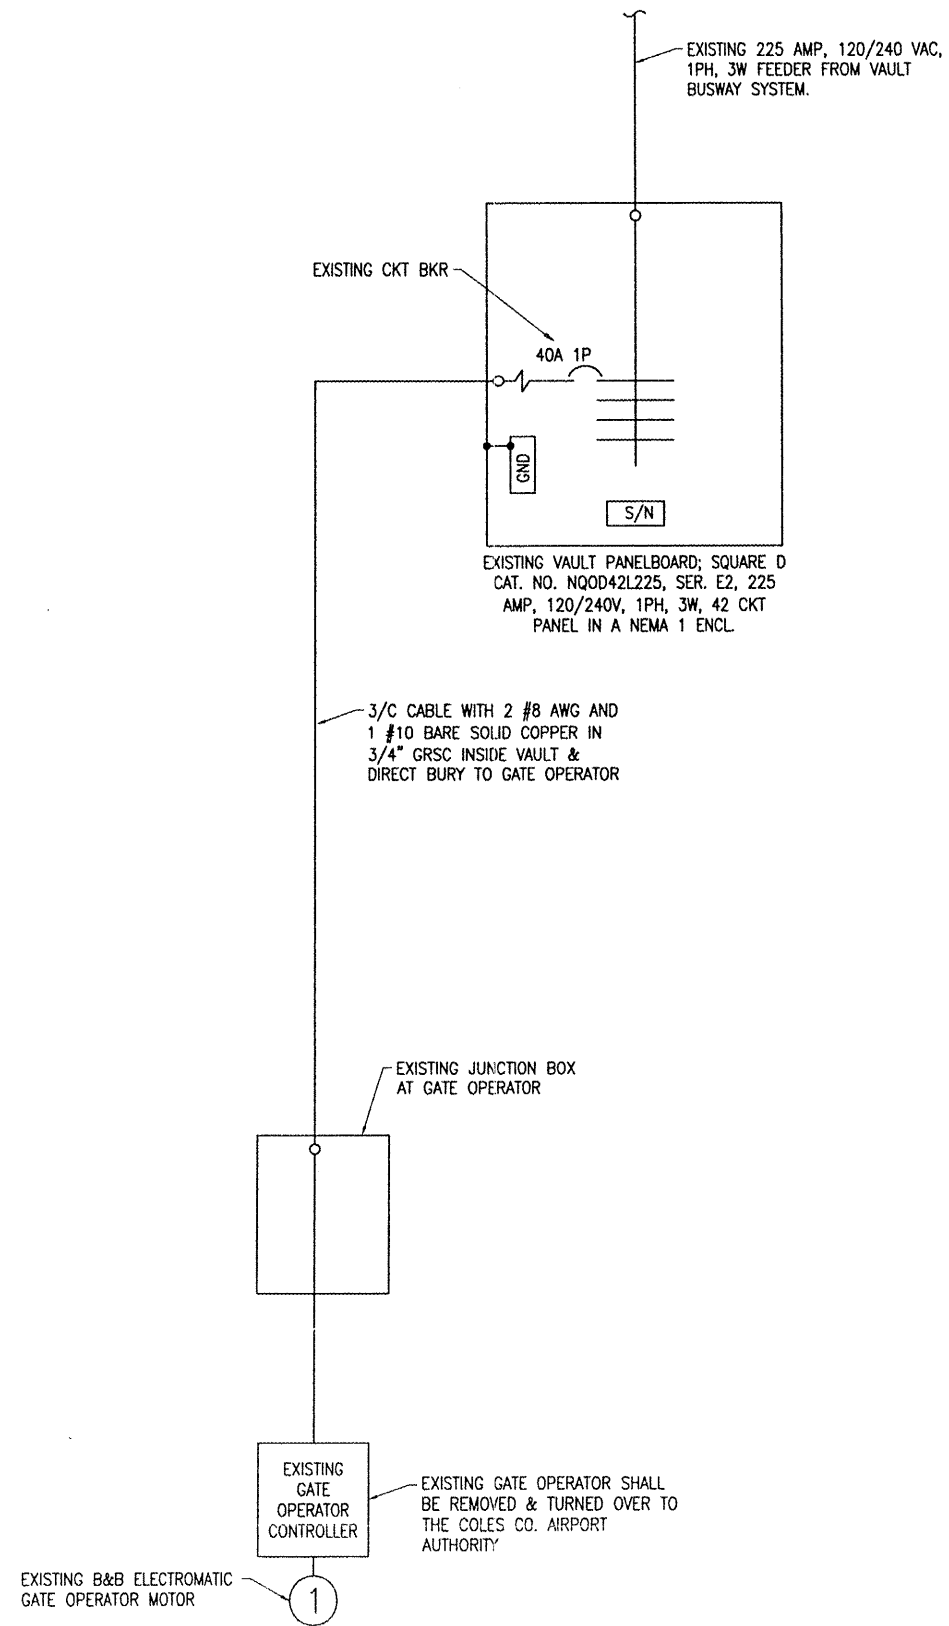

**EXISTING WEST GATE OPERATOR
ELECTRICAL ONE LINE DIAGRAM**

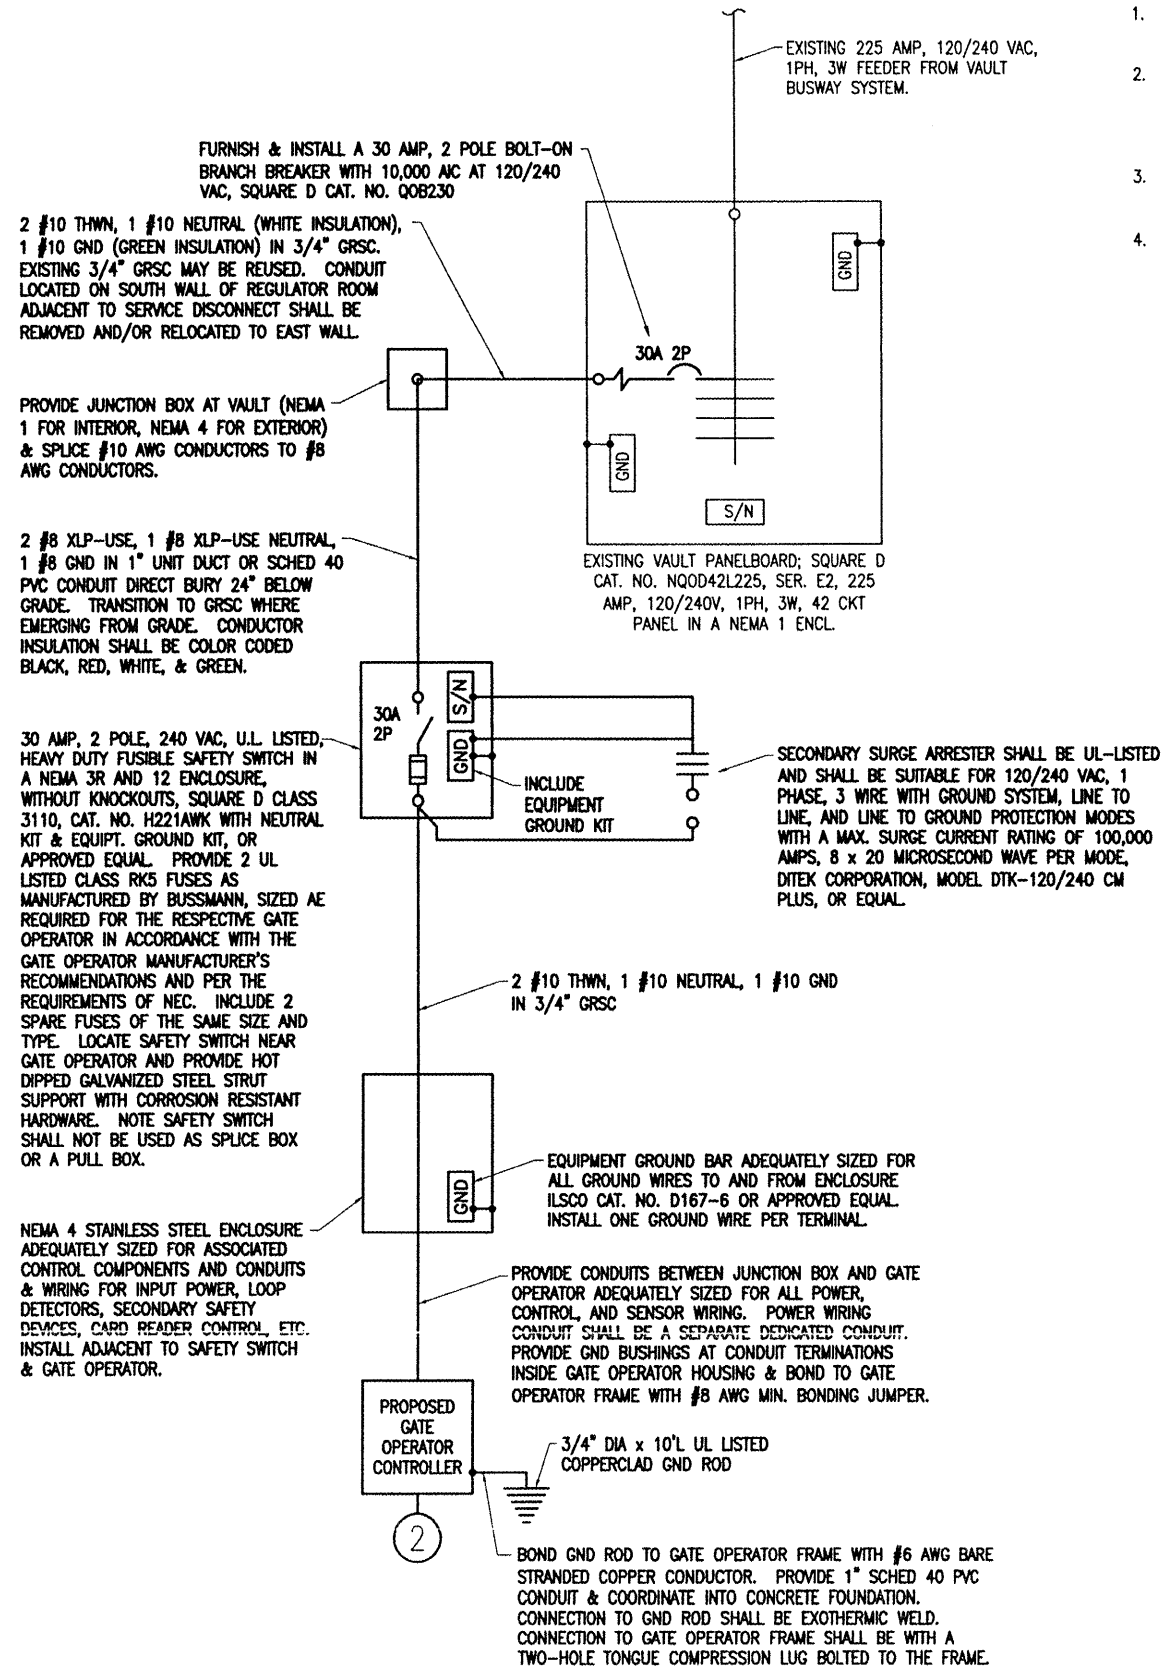

**PROPOSED WEST GATE OPERATOR
ELECTRICAL ONE LINE DIAGRAM**

BY	
REVISION	
DATE	
I.L. PROJ.: MTO-3831 A.I.P. PROJ.: 3-17-0066-B22	
Hanson Project No. 08A0147D_0800	12/30/08
Filename: E-601.DWG	KNL
Scale: NONE	MW
Date: 02/04/09	REVIEWED
	CAH
Hanson Professional Services Inc. 1525 South Sixth Street Springfield, IL 62766 Offices Nationwide	
PERIMETER FENCE INSTALLATION	WEST GATE ELECTRICAL ONE LINE DIAGRAMS
17	