


F.A.U. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
1700	05-00045-02-PV	COOK/DUPAGE	103	58
STREET LIGHTING PLAN				
FED. ROAD DIST. NO. 7 ILLINOIS FED. AID PROJECT W-80035440				

NOTES:

1. THE LIGHTING UNIT SHALL BE INSTALLED SUCH THAT THE MAST ARM AND LUMINAIRE IS ORIENTATED PERPENDICULAR TO THE LIVELY BOULEVARD CENTERLINE.
2. ALL LABOR AND MATERIALS REQUIRED TO MAKE ELECTRICAL CONNECTIONS TO THE EXISTING SPARE CIRCUIT BREAKER IN THE CABINET SHALL BE INCLUDED IN THE COST FOR UNIT DUCT, WITH 3-1/2" NO. 4 AND 1-1/2" NO. 6 GROUND 600V (XLP-TYPE USE) 1 1/4" DIA. POLYETHYLENE.
3. RELOCATING THE EXISTING LIGHTING UNIT MUST BE COMPLETED THE SAME DAY FOR THE REINSTALLED LIGHTING UNIT AND ALL EXISTING LIGHTING CONNECTED TO IT SHALL BE OPERATIONAL THE SAME EVENING.
4. THE EXISTING METAL FOUNDATION SHALL BE REUSED FOR THE RELOCATED LIGHTING UNIT. THE COST TO REMOVE AND REINSTALL THE METAL FOUNDATION SHALL BE INCLUDED AS PART OF THE RELOCATED LIGHTING UNIT. UNIT DUCT WITH 3-1/2" NO. 4 AND 1-1/2" NO. 6 GROUND 600V (XLP-TYPE USE) 1 1/4" DIA. POLYETHYLENE IS PROVIDED IN THE QUANTITIES FOR RECONNECTION TO EXISTING CONTROLLER AND LIGHTING UNIT. DIRECTIONAL BORING SHALL BE THE METHOD USED FOR INSTALLATION OF THE PROPOSED UNIT DUCT.

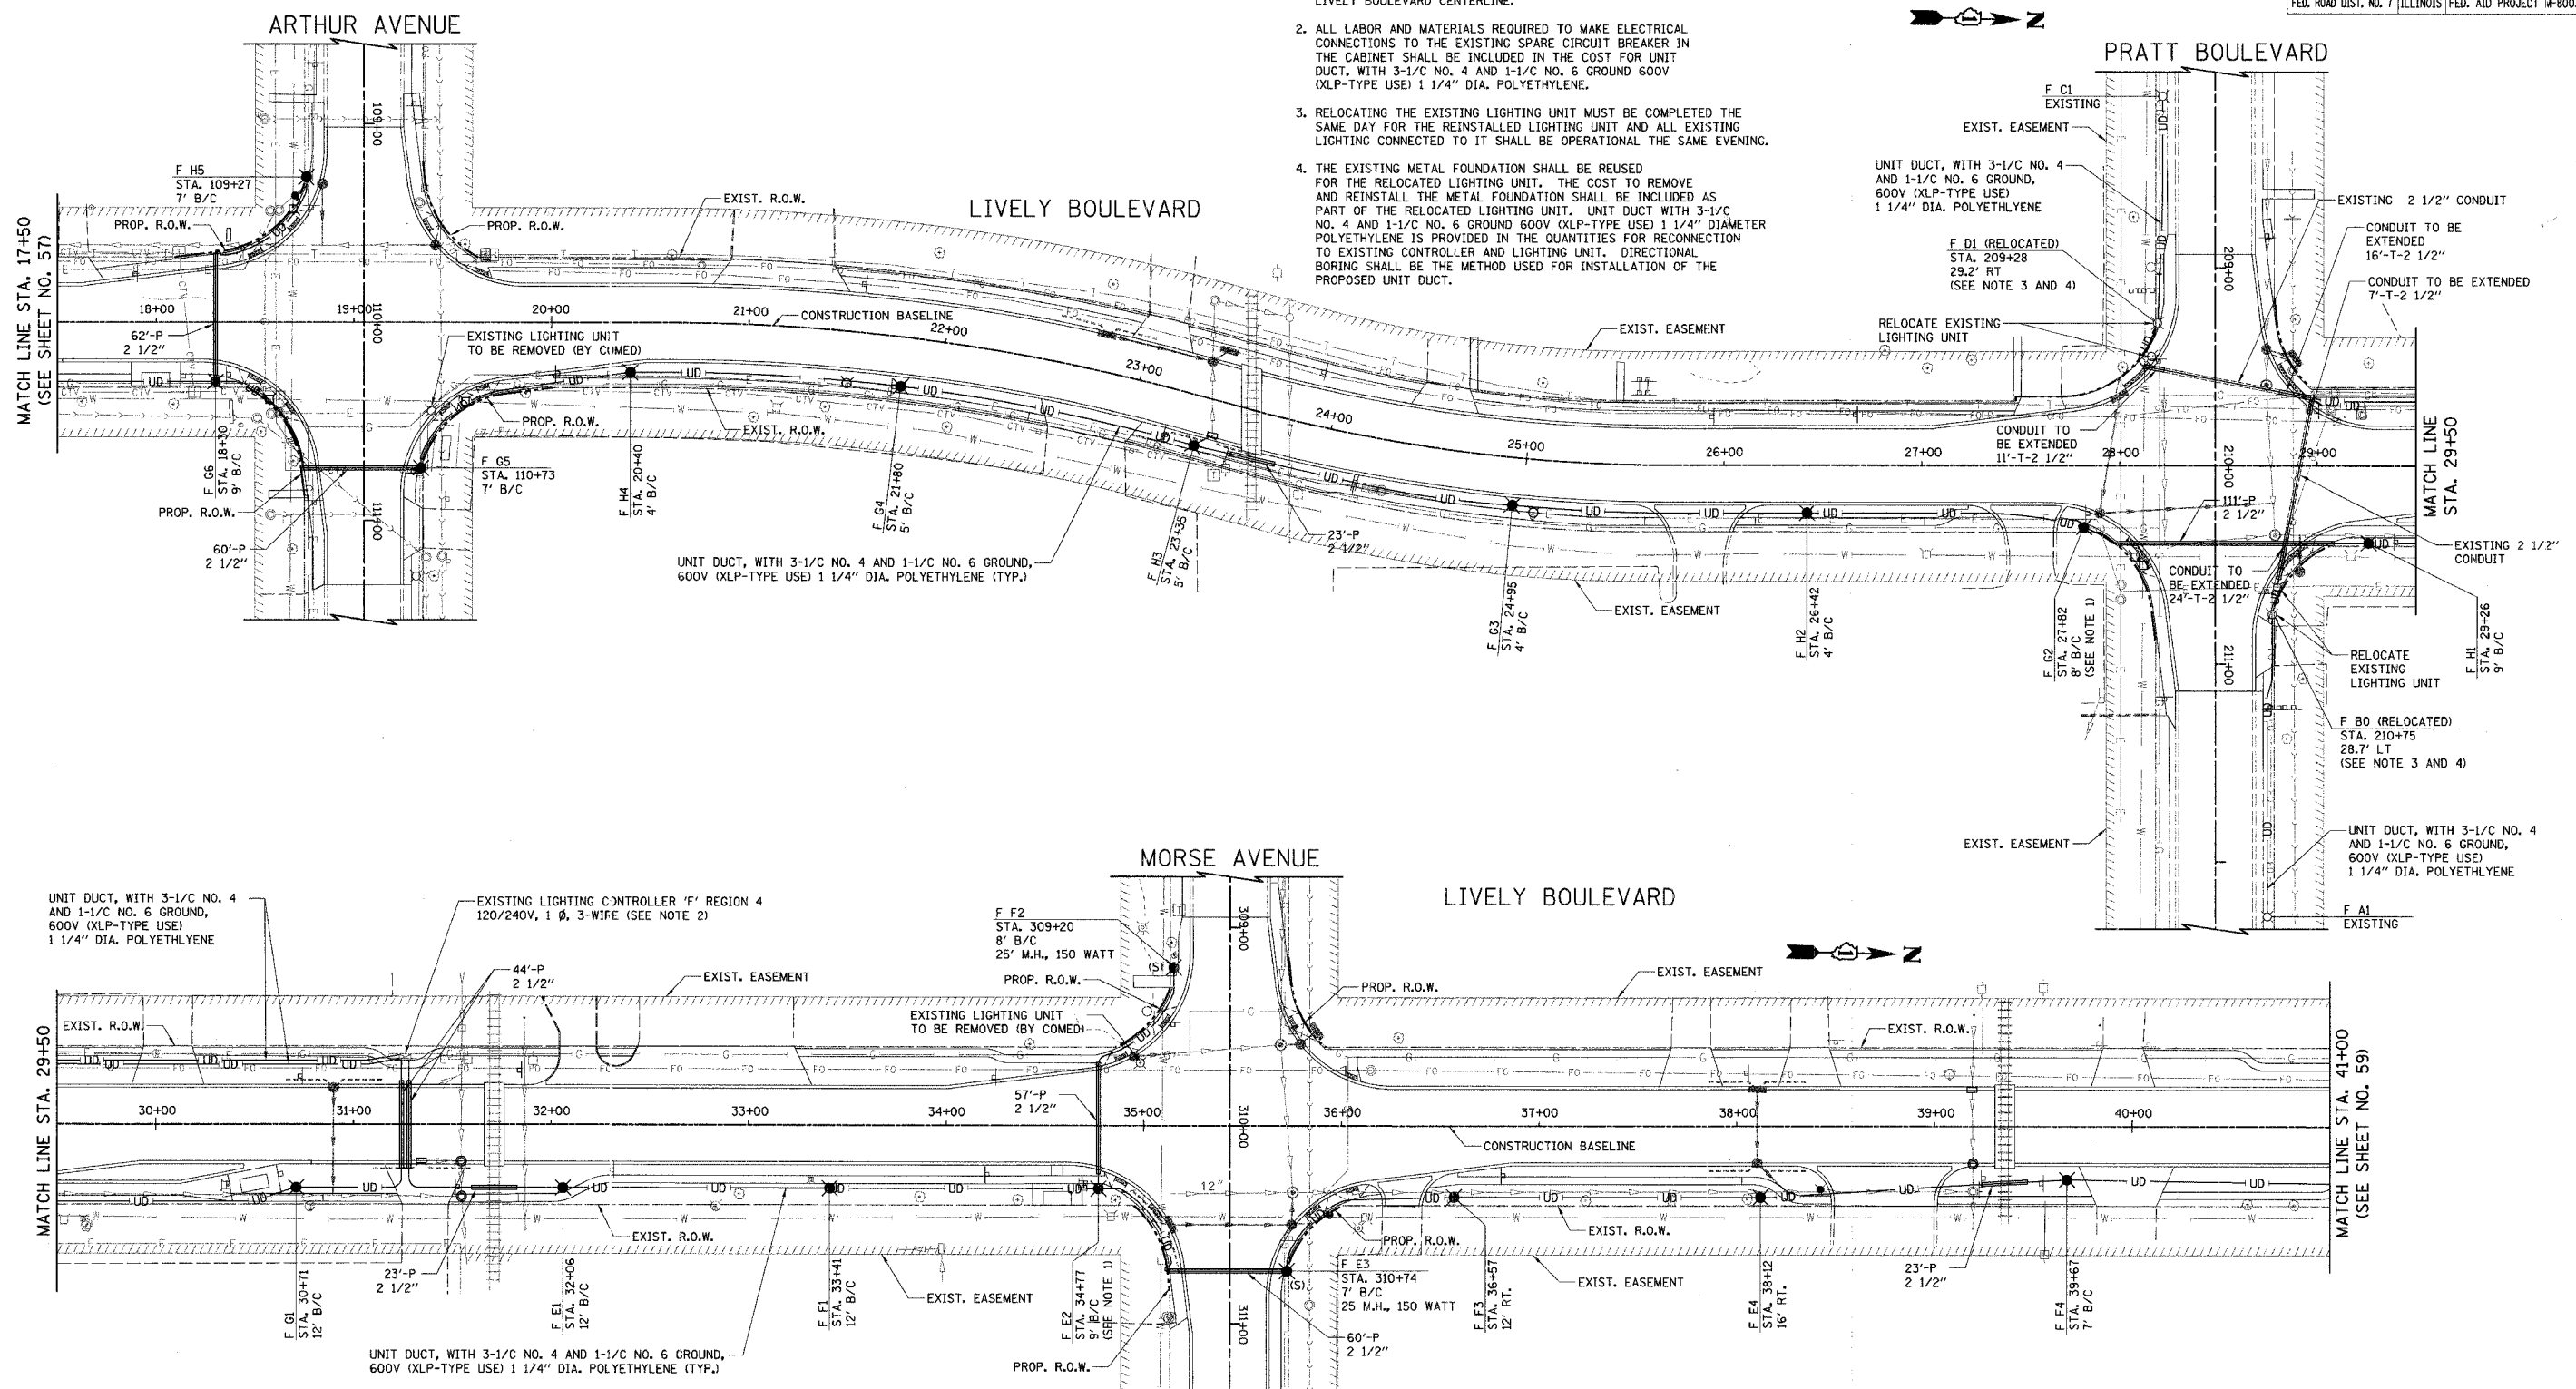

ILLINOIS DEPARTMENT OF TRANSPORTATION  
STREET LIGHTING PLAN  
LIVELY BOULEVARD  
STA. 17+50 TO STA. 41+00

DATE: 12/22/06  
DESIGNED BY: SJC  
CHECKED BY: JRV

