




RTE. NO.	SEC.	COUNTY	TOTAL SHEETS	SHEET NO.
F.A.U. 6793	*	KNOX	50	45

*06-00447-12-PV
TE-0004(097)

89486

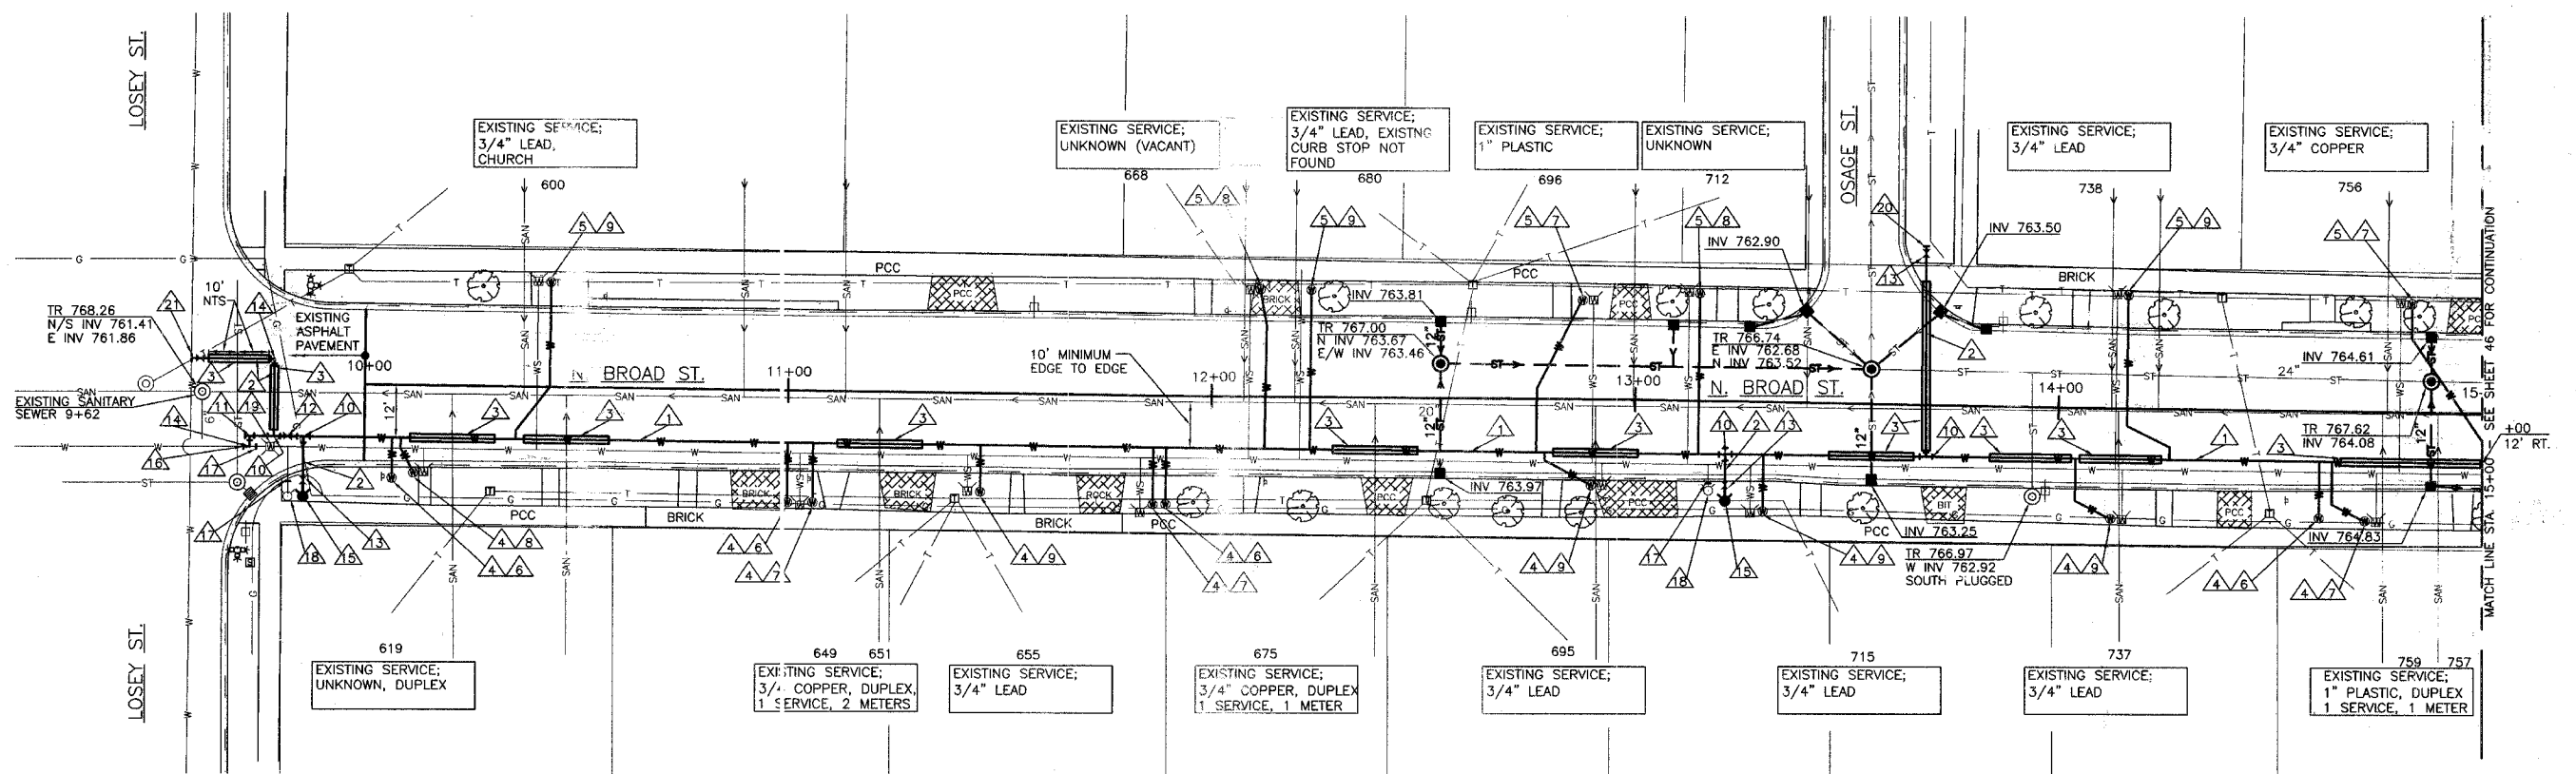

1 PLAN - N. BROAD STREET WATER MAIN

45 SCALE: 1"=20'


NOTES (THIS SHEET ONLY):

- 1. PROPOSED P.V.C. WATER MAIN, 8".
- 2. PROPOSED P.V.C. WATER MAIN, 6".
- 3. PROPOSED WATER MAIN ENCASEMENT - SEE DETAIL 8/50.
- 4. PROPOSED SERVICE CONNECTION AND CURB STOP, SHORT SIDE, TY. 1.
- 5. PROPOSED SERVICE CONNECTION AND CURB STOP, LONG SIDE, TY. 2.
- 6. NEW SERVICE FOR FUTURE CONNECTION.
- 7. CONNECT TO EXISTING SERVICE PIPE.
- 8. EXISTING GALVANIZED SERVICE PIPE TO BE REPLACED.
- 9. EXISTING LEAD SERVICE PIPE TO BE REPLACED.
- 10. PROPOSED 8" x 6" D.I. TEE.
- 11. PROPOSED 8" x 6" D.I. TEE WITH 8" BLND FLANGE FOR FUTURE CONNECTION.

NOTES (THIS SHEET ONLY):

- 12. PROPOSED 8" R.W. RATE VALVE.
- 13. PROPOSED 6" R.W. RATE VALVE.
- 14. PROPOSED 6" D. 90° ELBOW.
- 15. PROPOSED 6" FIRE HYDRANT.
- 16. CONNECT TO EXISTING WATER MAIN.
- 17. PLUG EXISTING WATER MAIN TO BE ABANDONED.
- 18. EXISTING FIRE HYDRANT TO BE REMOVED.
- 19. EXISTING VALVE TO BE ABANDONED - VALVE BOX TO BE REMOVED.
- 20. CAP & BLOCK FOR FUTURE CONNECTION.
- 21. 6"x6" TAPPING SLEEVE & VALVE.

BENCH MARK #2: NE BOLT ON HYDRANT STATION 09+80±, RT. ELEV. 770.20	BENCH MARK #3: E-NE BOLT ON HYDRANT STATION 13+25±, RT. ELEV. 769.25
--	--

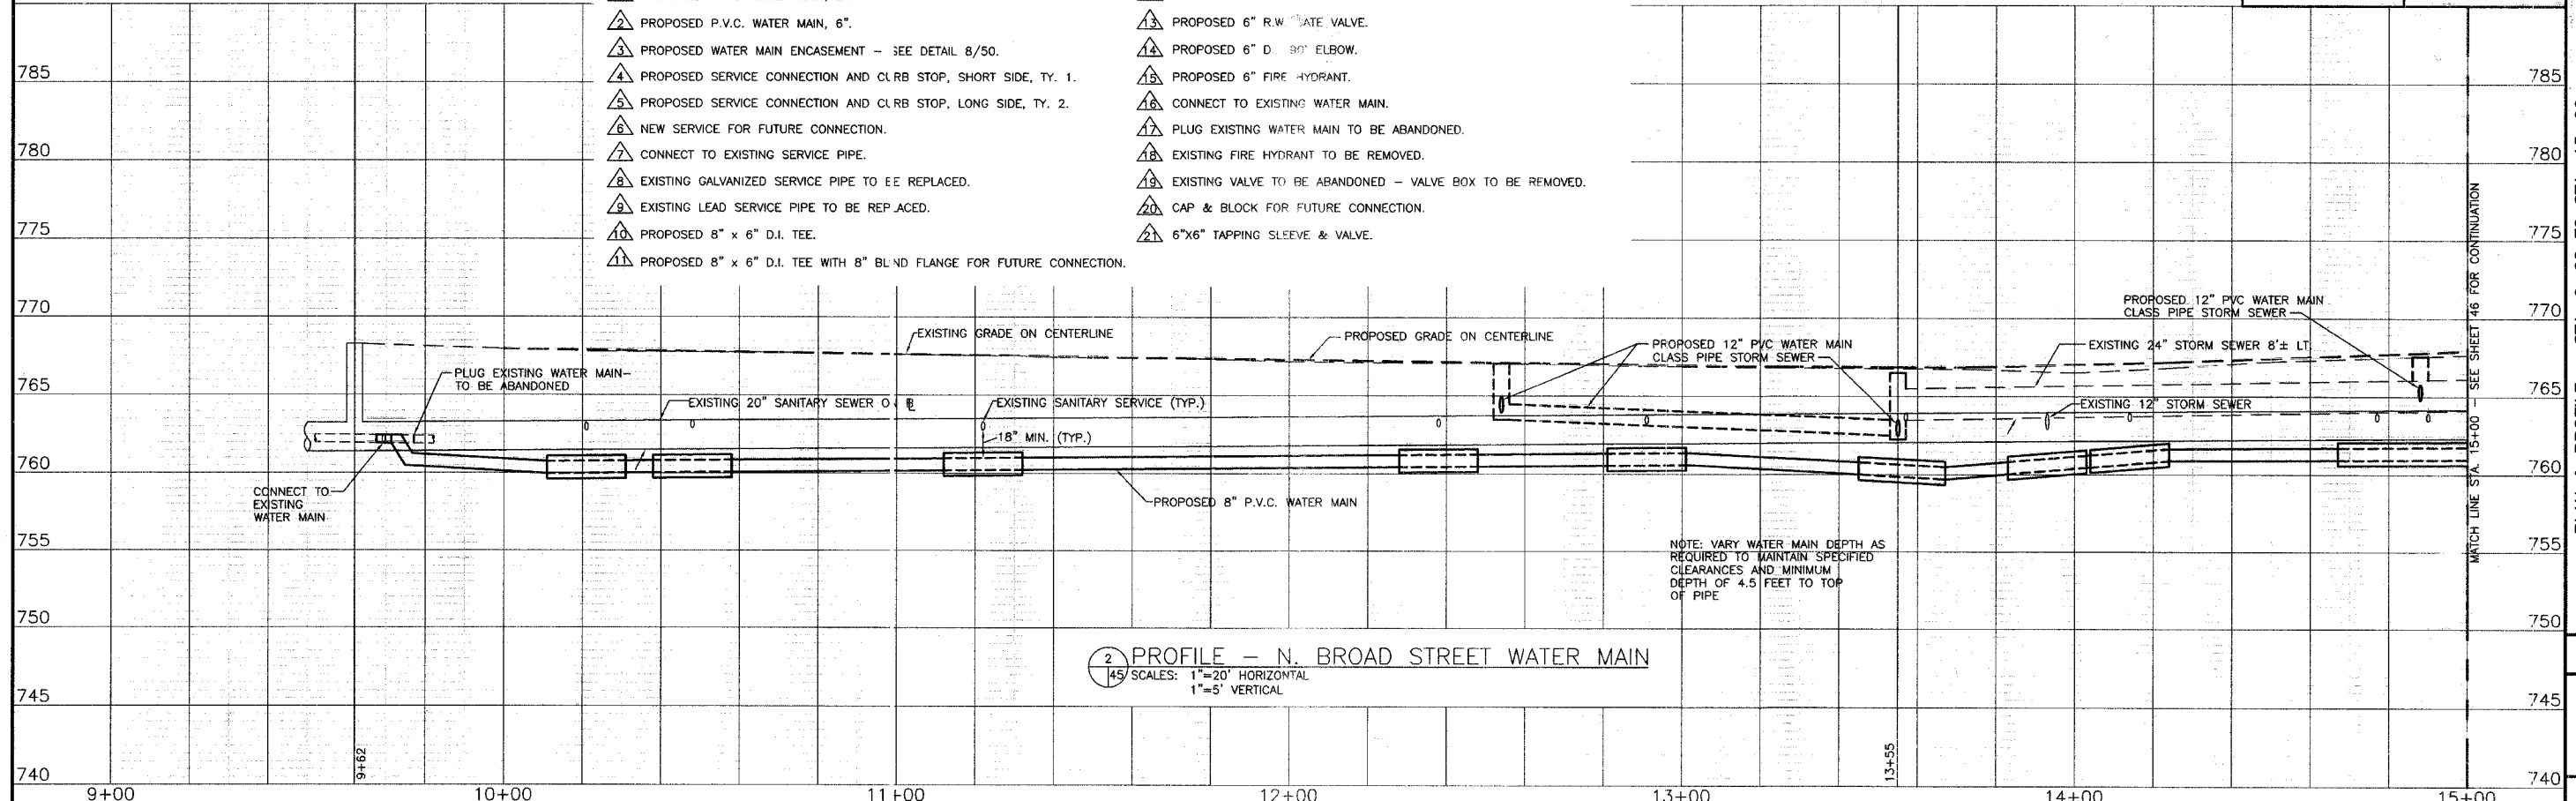

2 PROFILE - N. BROAD STREET WATER MAIN

45 SCALES: 1"=20' HORIZONTAL
1"=5' VERTICAL

NOTE: VARY WATER MAIN DEPTH AS REQUIRED TO MAINTAIN SPECIFIED CLEARANCES AND MINIMUM DEPTH OF 4.5 FEET TO TOP OF PIPE

REVISIONS
DRAWN: FCC
CHECKED: SRB
APPROVED: SWB
FILE NAME: P&P1.DWG

Brunner, Cooper & Zuck, Inc.
Structural Engineers
Land Surveyors
Professional License No. 188
188 East Simmons Street
P.O. Box 1519
Galesburg, Illinois 61601-1519
Phone: (309) 941-9292
Fax: (309) 941-5322
E-Mail: bcz@brunners.com



PLAN & PROFILE - STA. 9+62 TO STA. 15+00
WATER MAIN REPLACEMENT FOR
NORTH BROAD STREET BRICK RECONSTRUCTION
LOSEY STREET TO FREMONT STREET
GALESBURG, ILLINOIS