

DIMENSION 'E'

GRADE	'D'=25°		'D'=30°	
	UPGRADE END	DOWNGRADE END	UPGRADE END	DOWNGRADE END
0%	2 1/2"	2 1/2"	2 3/8"	2 3/8"
Over 0% to 1%	2 1/8"	2 1/8"	2"	2 1/8"
Over 1% to 2%	1 3/8"	3 5/8"	1"	3 3/4"
Over 2% to 3%	5/8"	4 3/8"	1/8"	4 5/8"
Over 3% to 4%	0"	5 1/8"		

NOTES




- The Backwall and the portion of the Wingwalls above the bonded construction joint shall be cast against the in-place beam.
- Reinforcement bars shall conform to the requirements of A.A.S.H.T.O. M-31 or M-32B, Grade 60.
- Space reinforcement in cap to miss anchor bolts.

MAXIMUM PILE LOADS

SPAN	TONS
40'	34
50'	38
60'	43

DESIGN STRESSES

f'c = 3,500 psi
fy = 60,000 psi

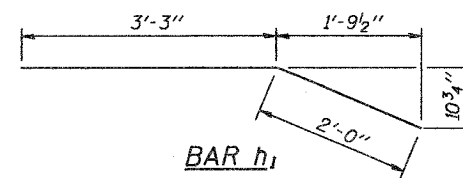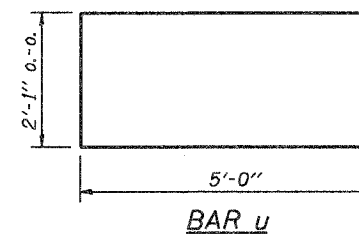

BILL OF MATERIAL FOR ONE ABUTMENT

Bar	No.	Size	Length	Shape
h	16	#4	5'-0"	—
h1	4	#4	5'-3"	—
h2	6	#4	29'-2"	—
p	10	#7	29'-2"	—
s	30	#4	9'-5"	□
u	8	#6	12'-1"	□
v	8	#4	3'-2"	—
v1	8	#4	4'-2"	—
v2	58	#4	3'-11"	—
Concrete Structures			10.7 Cu. Yds.	
Reinforcement Bars			1310 Lb.	

Illinois Department of Transportation
 PASSED APRIL 4, 2005
Thomas S. Romagosa
 Engineer of Bridge Design
 APPROVED APRIL 4, 2005
Ralph E. Anderson
 Engineer of Bridges and Structures
 1001-1-1 03/05/01

P.P.C. DECK BEAMS
 PILE BENT ABUTMENT
 24' RDWY. 27" BMS. 'D'=25° OR 30°
 STANDARD CA-2427-30