

KEYED NOTES:


① WIRE SPARE SWITCH S16 TO DISCRETE INPUT ON PLC.

NOTES:

- 1.) THE PROPOSED WORK OR ITEMS BEING MODIFIED ARE SHOWN IN BOLD. ALL OTHER ITEMS SHOWN ARE FOR INFORMATIONAL PURPOSES ONLY.
- 2.) CONTROL TOWER AND ELECTRICAL VAULT PLC'S MUST BE RECONFIGURED TO REFLECT THESE CHANGES.
- 3.) PROVIDE PLC PROGRAMMING NECESSARY TO IMPLEMENT THE CONTROL SYSTEM CHANGES AND ADDITIONS. BACK-UP EXISTING PLC LOGIC BEFORE MAKING ANY MODIFICATIONS TO SYSTEM LOGIC


REVISIONS

| NUMBER | BY | DATE |
|--------|----|------|
|        |    |      |
|        |    |      |
|        |    |      |
|        |    |      |



**BLOOMINGTON-NORMAL AIRPORT AUTHORITY  
 CENTRAL ILLINOIS REGIONAL AIRPORT  
 BLOOMINGTON, ILLINOIS**

**REPLACE AIRFIELD LIGHTING VAULT STANDBY GENERATOR  
 L-821 TOWER LIGHTING CONTROL PANEL  
 PLC-IMPROVEMENTS**

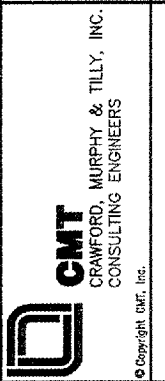

|              |                    |
|--------------|--------------------|
| DESIGN BY:   | TM                 |
| DRAWN BY:    | DLB                |
| CHECKED BY:  | <i>[Signature]</i> |
| APPROVED BY: | <i>[Signature]</i> |
| DATE:        | 1/13/06            |
| JOB No:      | 05085-06-00        |