
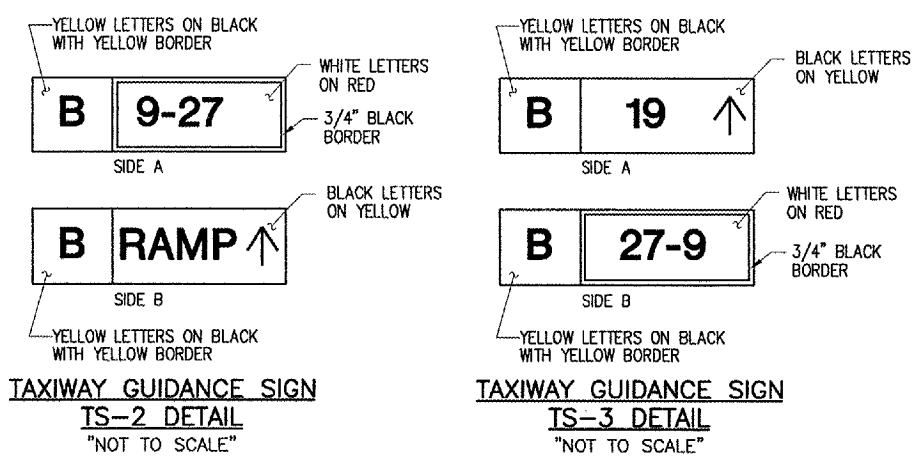


JAN 18, 2006 10:46 PM RAW
 I:\AIRPORTS\KEWANEE\810-06TXYD\AIRPORT SHEETS\R-142ELE.DWG - STA. 12+00 TO STA. 20+00

KE007

LEGEND



	EXISTING PAVEMENT
	EXISTING ELECTRICAL CABLES
	EXISTING ELECTRICAL DUCT
	PROPOSED IMPROVEMENTS
	PROPOSED ELECTRICAL DUCT
	PROPOSED 1/C NO. 8, 5KV, U.G. CABLE IN U.D.
	EXISTING DUCT MARKERS
	EXISTING CABLE MARKERS
	EXISTING STAKE MOUNTED RUNWAY LIGHT
	EXISTING BASE MOUNTED RUNWAY LIGHT
	PROPOSED STAKE MOUNTED TAXIWAY LIGHT
	PROPOSED BASE MOUNTED TAXIWAY LIGHT
	PROPOSED TAXI GUIDANCE SIGN

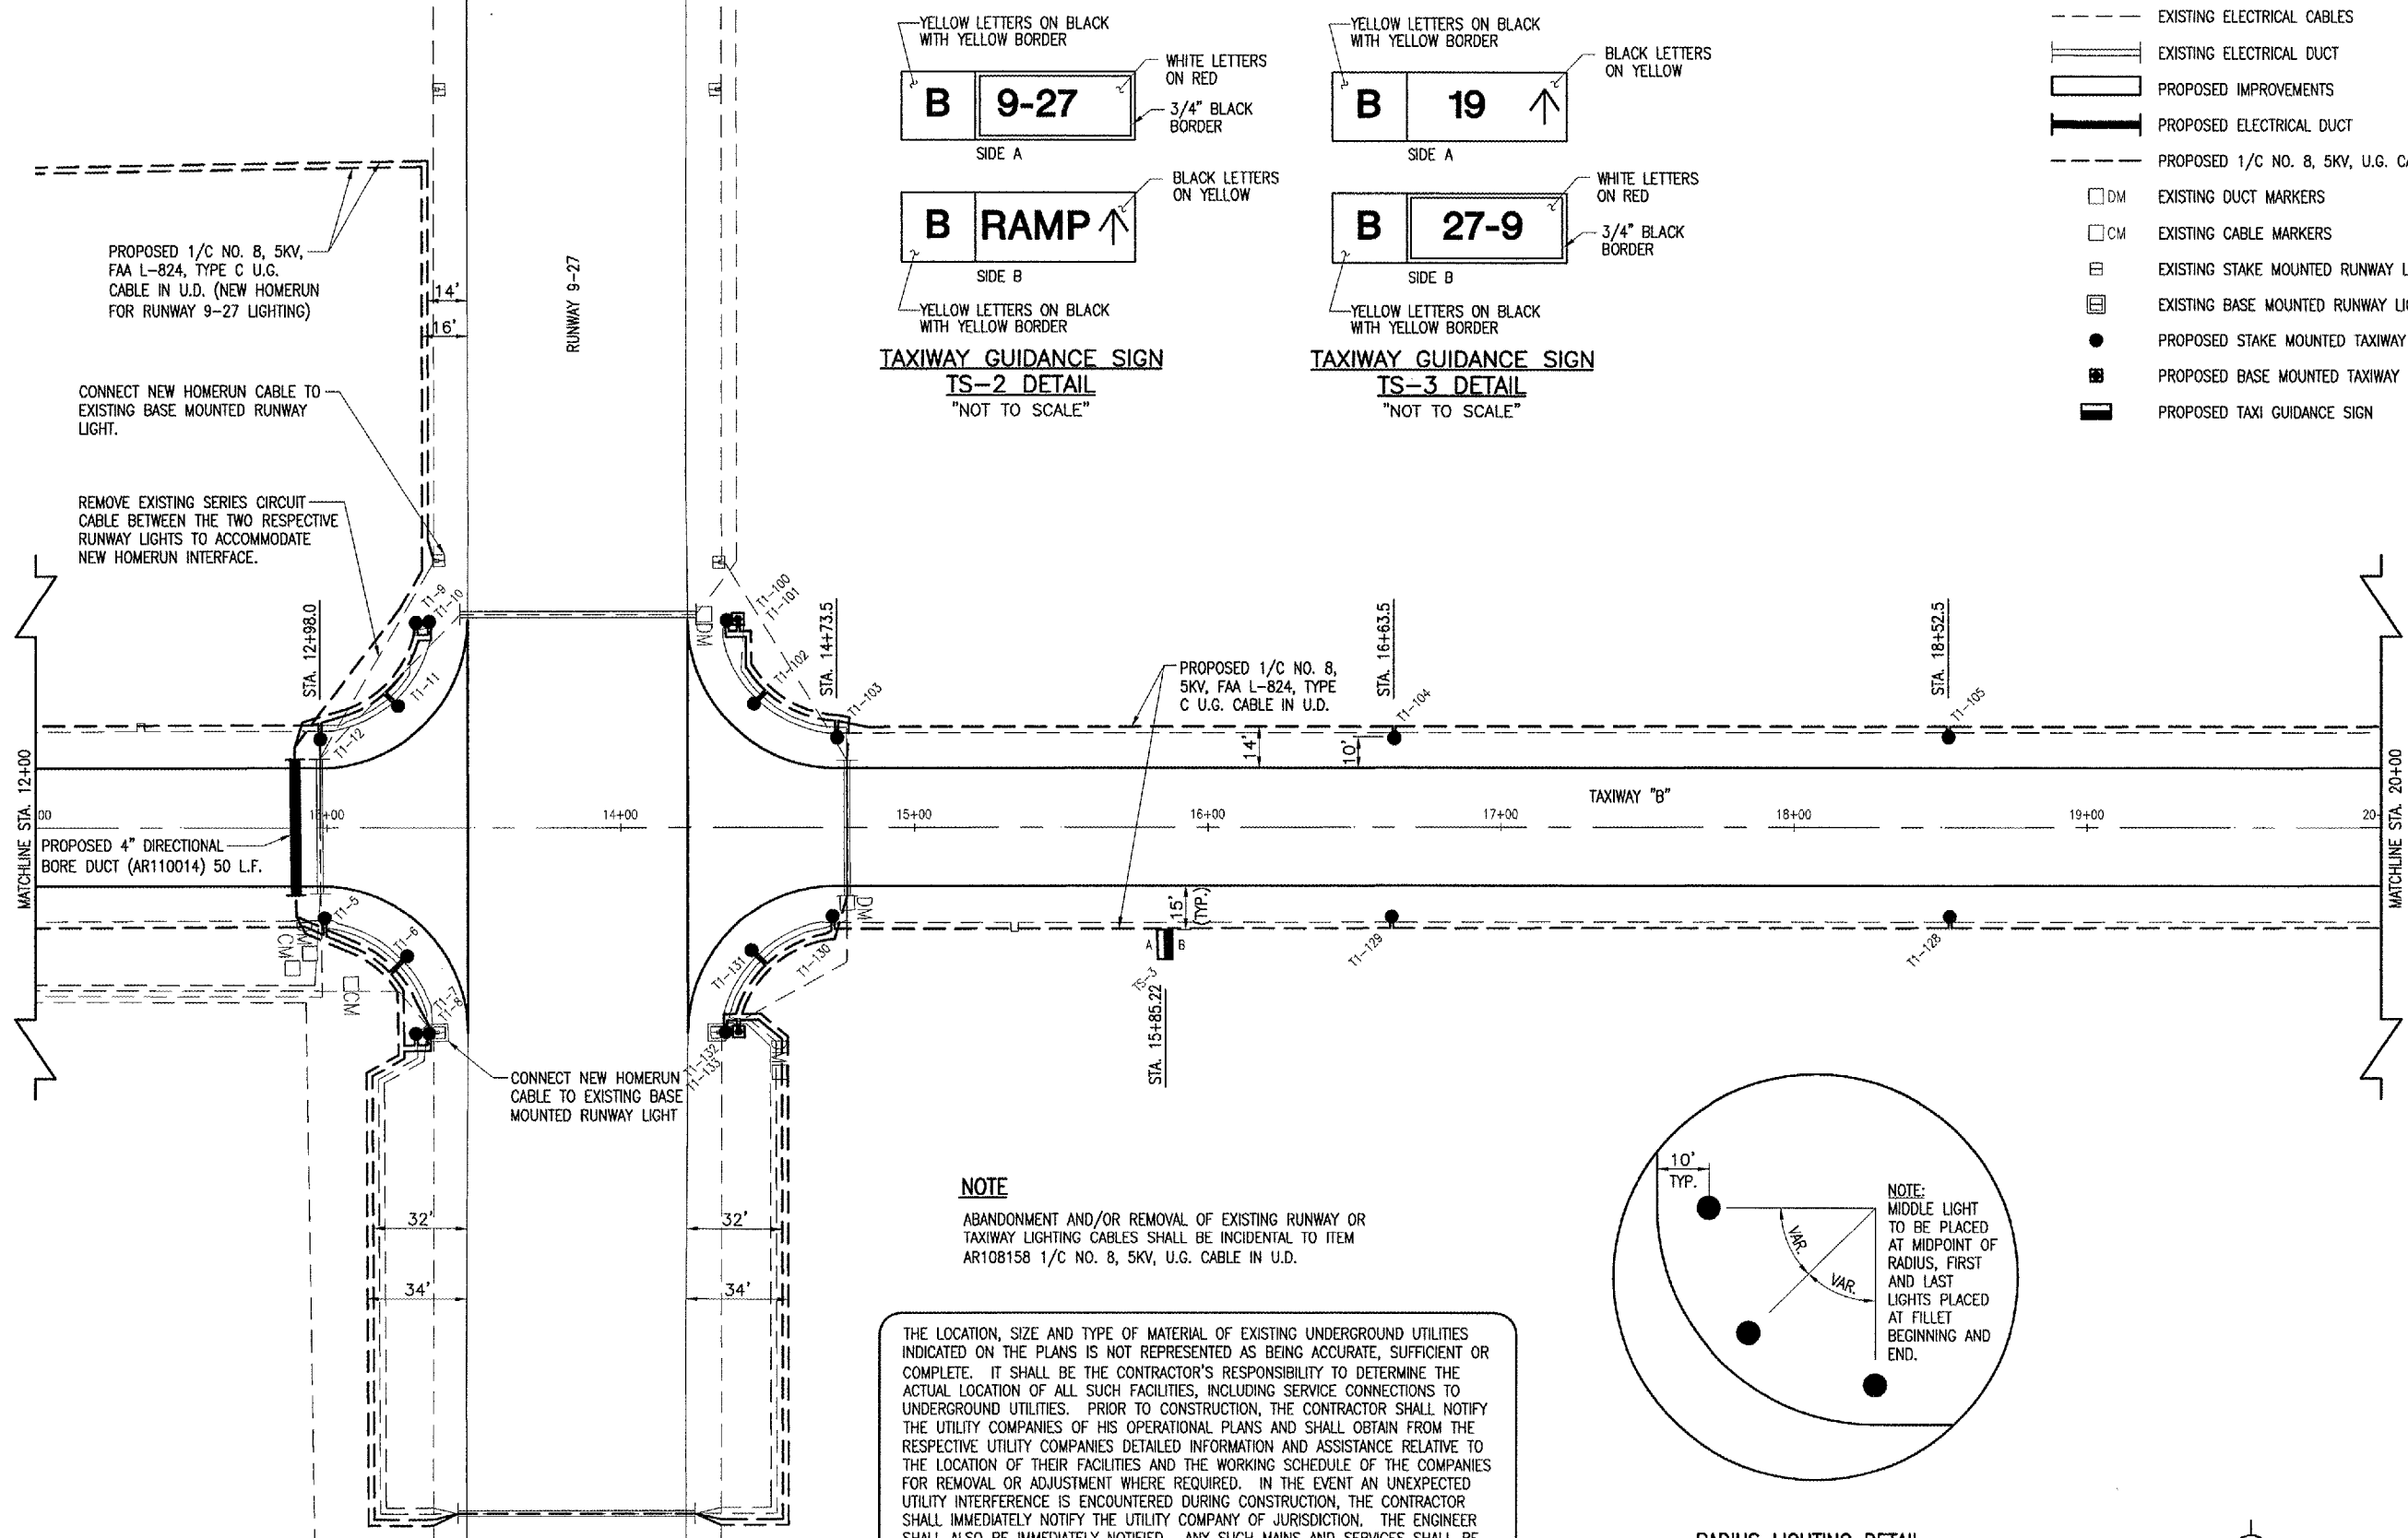

NOTE
 ABANDONMENT AND/OR REMOVAL OF EXISTING RUNWAY OR TAXIWAY LIGHTING CABLES SHALL BE INCIDENTAL TO ITEM AR108158 1/C NO. 8, 5KV, U.G. CABLE IN U.D.

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

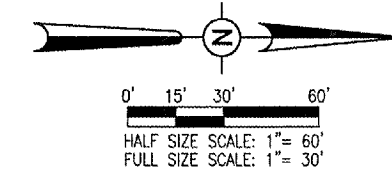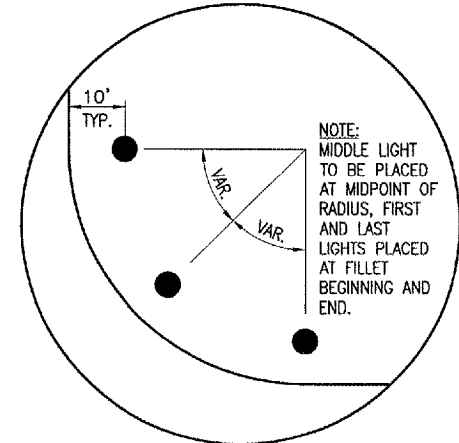

BY	
REVISION	
DATE	
KEWANEE MUNICIPAL AIRPORT KEWANEE, HENRY COUNTY, ILLINOIS	
I.L. PROJ.: E21-3533 A.I.P. PROJ.: 3-17-0058-B10	
KE Project No. 810-06TXYD 0800	LAYOUT R.A.W. 08/02/05
Drawings R-142ELE.DWG	DRAWN B.A.K. 08/02/05
Scale 1"=30'	REVIEWED C.A.H. xx/xx/xx
Date 08/02/05	
HANSON Hanson Professional Services, Inc. 3125 Dandy Trail, Suite 100 Indianapolis, Indiana 46214 Offices Nationwide	
OVERLAY TXY & APRON CONSTRUCT VAULT	
PROPOSED ELECTRICAL PLAN STA. 12+00 TO STA. 20+00	
26	
26 of 67 sheets	