
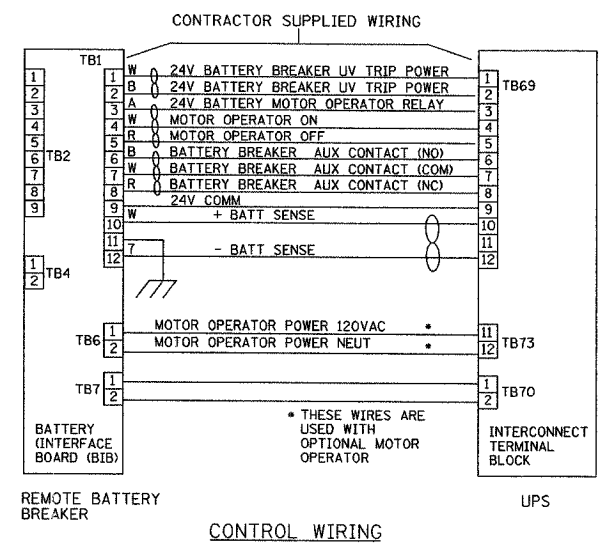

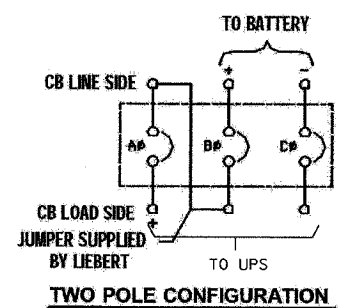
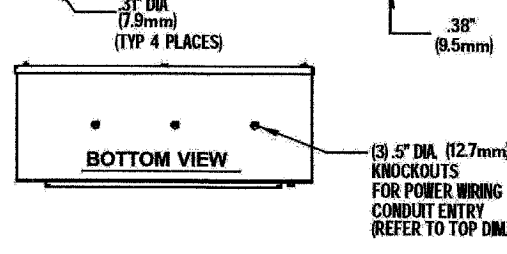
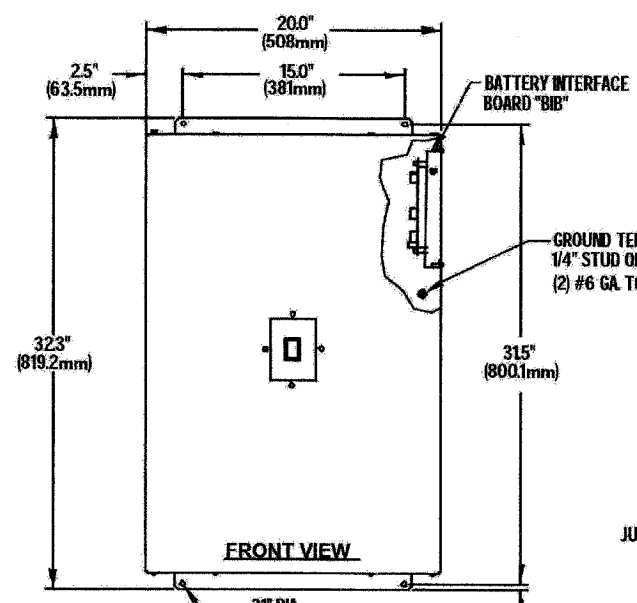


SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
2003-0311	COOK	976	916
STA. TO STA.		FED. AID PROJECT	
62583		ILLINOIS	

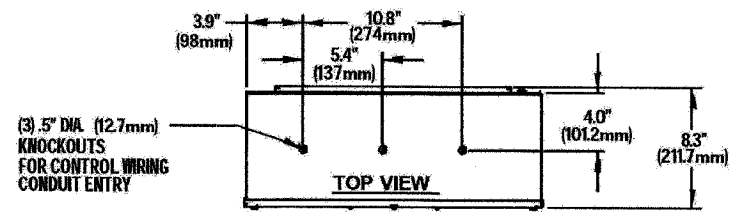

- NOTES
- NEMA 1 ENCLOSURE PROVIDED IS SUITABLE FOR WALL MOUNTING ONLY. APPROX. WEIGHT IS 60 LB.
 - HARDWARE FOR CONNECTING CABLES TO THE BREAKER SUPPLIED.
 - CIRCUIT BREAKER, SQUARE D TYPE KHL36XXX FOR 40KVA. C.B. TO BE SUPPLIED BY MANUFACTURER.
 - COLOR: IBM OFF-WHITE.
 - MOUNT ENCLOSURE AND PULL ALL CABLES INTO ENCLOSURE PRIOR TO INSTALLING "BIB" BOARD.
 - NUMBER NOT USED.
 - POSITIVE AND NEGATIVE DC POWER CABLES NEED TO ENTER FROM THE BOTTOM OF THE ENCLOSURE TO PREVENT CONTACT WITH THE "BIB" BOARD.
 - LOW VOLTAGE WIRING NEED TO ENTER FROM THE TOP OF THE ENCLOSURE.
 - LINE SIDE POWER CONNECTIONS TO LUGS: (1) #2/O PER CONNECTION FOR 40KVA UPS. LOAD SIDE POWER CONNECTIONS TO BUS BARS, SEE DETAIL.

Edwards AND Kelcey
 ONE NORTH FRANKLIN
 CHICAGO, IL 60606
 PHONE: (312) 251-3000
 FAX: (312) 251-3015
 WEB: WWW.EKCORP.COM

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION F.A.I. 94/90 (DAN RYAN EXPRESSWAY) 31st STREET to I-57 OUTLINE DRAWING REMOTE BATTERY BREAKER - 40 KVA (NPOWER)
NAME	DATE	

SCALE: NOT TO SCALE
 DATE: October 29, 2004
 DRAWN BY: SST
 CHECKED BY: CS

DT-12I

10/15/2004 11:53:37 AM