F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
90/94	2003-031I	COOK	976	968
STA.		TO STA.		
FED. ROAD DIST. NO. 1	ILLINOIS	FED. AID PROJECT		

62583

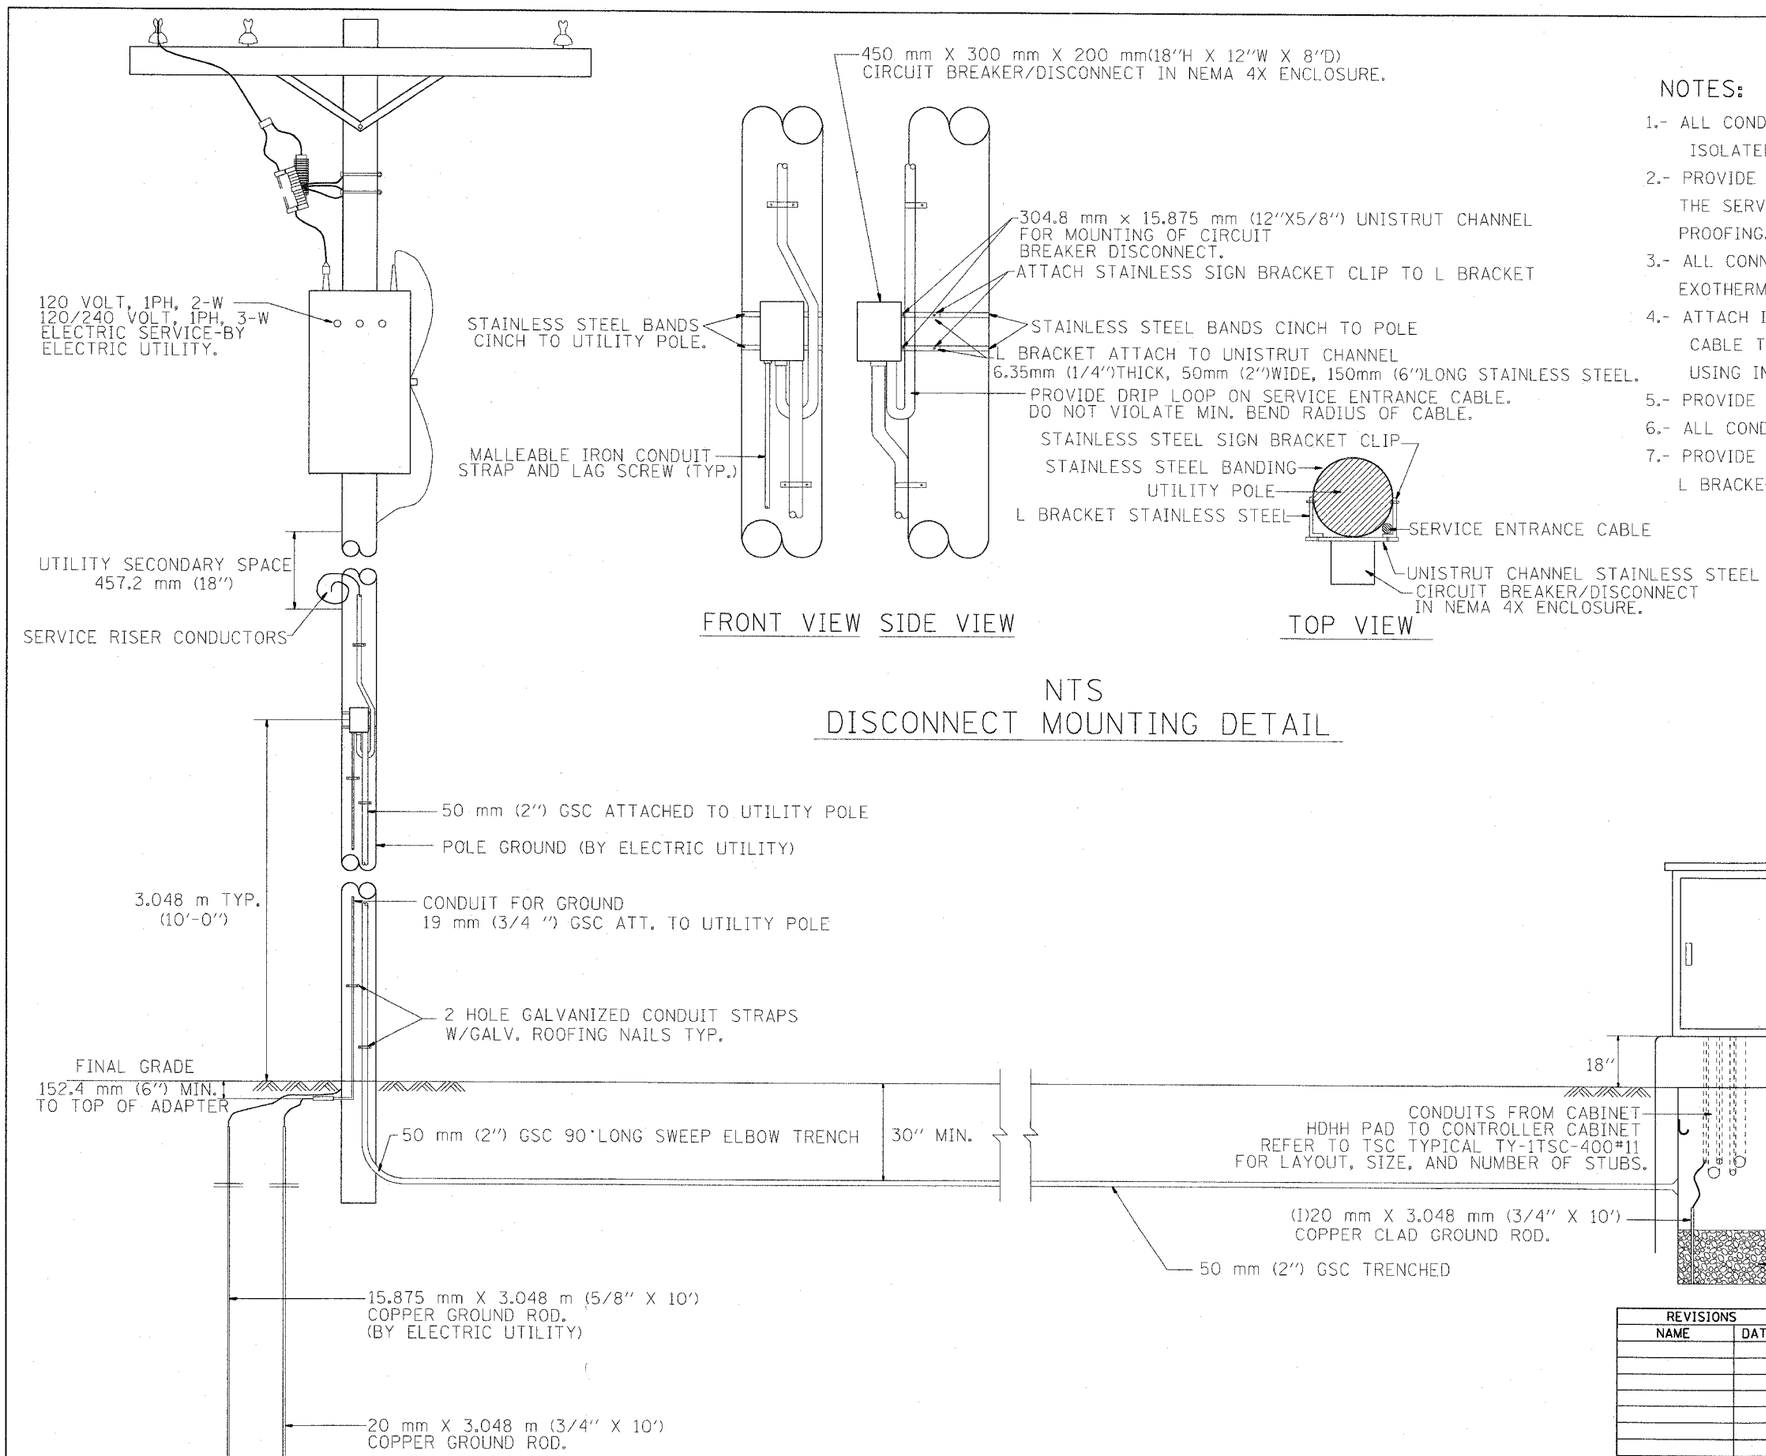

NOTES:

1.- ALL CONDUIT BUSHINGS SHALL HAVE AN ISOLATED THROAT.

2.- PROVIDE HEAT SHRINK BOOT AT THE TOP OF THE SERVICE ENTRANCE CABLE FOR MOISTURE PROOFING.

3.- ALL CONNECTIONS TO GROUND RODS SHALL BE EXOTHERMIC UNLESS OTHERWISE NOTED.

4.- ATTACH INCOMING ELECTRIC SERVICE CABLE TO UTILITY POLE EVERY 5 FEET USING INSULATED U-NAIL.

5.- PROVIDE CABLE RACK IN HANDHOLES.

6.- ALL CONDUCTORS SHALL BE COPPER.

7.- PROVIDE STAINLESS STEEL HARDWARE TO ATTACH L BRACKETS TO UNISTRUT AND TO SIGN HANGER.

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION
TRAFFIC SYSTEMS CENTER

POLE MOUNTED
DISCONNECT MOUNTING DETAILS

SCALE: VERT. HORIZ. NONE

DRAWN BY G.M.

DATE 03/30/99

CHECKED BY R.I.

RD= TYPMET.DGN
RF=

V1=40020

TRAFFIC SYSTEMS CENTER (TY-1TSC-400#20)