


LEGEND


- EXISTING LIGHT POLE, SIZE AND TYPE AS NOTED
- INSTALL LIGHT POLE, 45' M.H. AND LUMINAIRE, 400W UNLESS OTHERWISE NOTED
- RELOCATE EXISTING LIGHT POLE, MAST ARM AND LUMINAIRE (45' POLE WITH 15' MAST ARM)
- INSTALL LIGHT POLE, 35' M.H. AND LUMINAIRE, 150W
- UD4C UNIT DUCT WITH 3-1/C NO. 4 AND 1/C NO. 6 GROUND, 600V (XLP-TYPE USE) 1 1/4" POLYETHYLENE
- UD6C UNIT DUCT WITH 5-1/C NO. 4 AND 1/C NO. 6 GROUND, 600V (XLP-TYPE USE) 1 1/2" POLYETHYLENE
- 3"-10' GALVANIZED STEEL CONDUIT, PUSHED, DIAMETER AND LENGTH AS NOTED
- INSTALL LIGHTING CONTROLLER, 100 AMP, 240/480 VOLT
- EXISTING LIGHTING CONTROLLER, 100 AMP, 240/480 VOLT
- INSTALL HANDHOLE
- F INSTALL OFFSET FOUNDATION SEE SHEET

NOTE

1. POLES SHOULD BE OFFSET 7.0' FROM EDGE OF PAVEMENT, UNLESS OTHERWISE NOTED

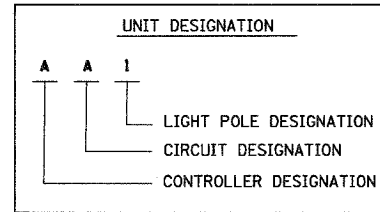

NO UNDERGROUND SPLICING ALLOWED

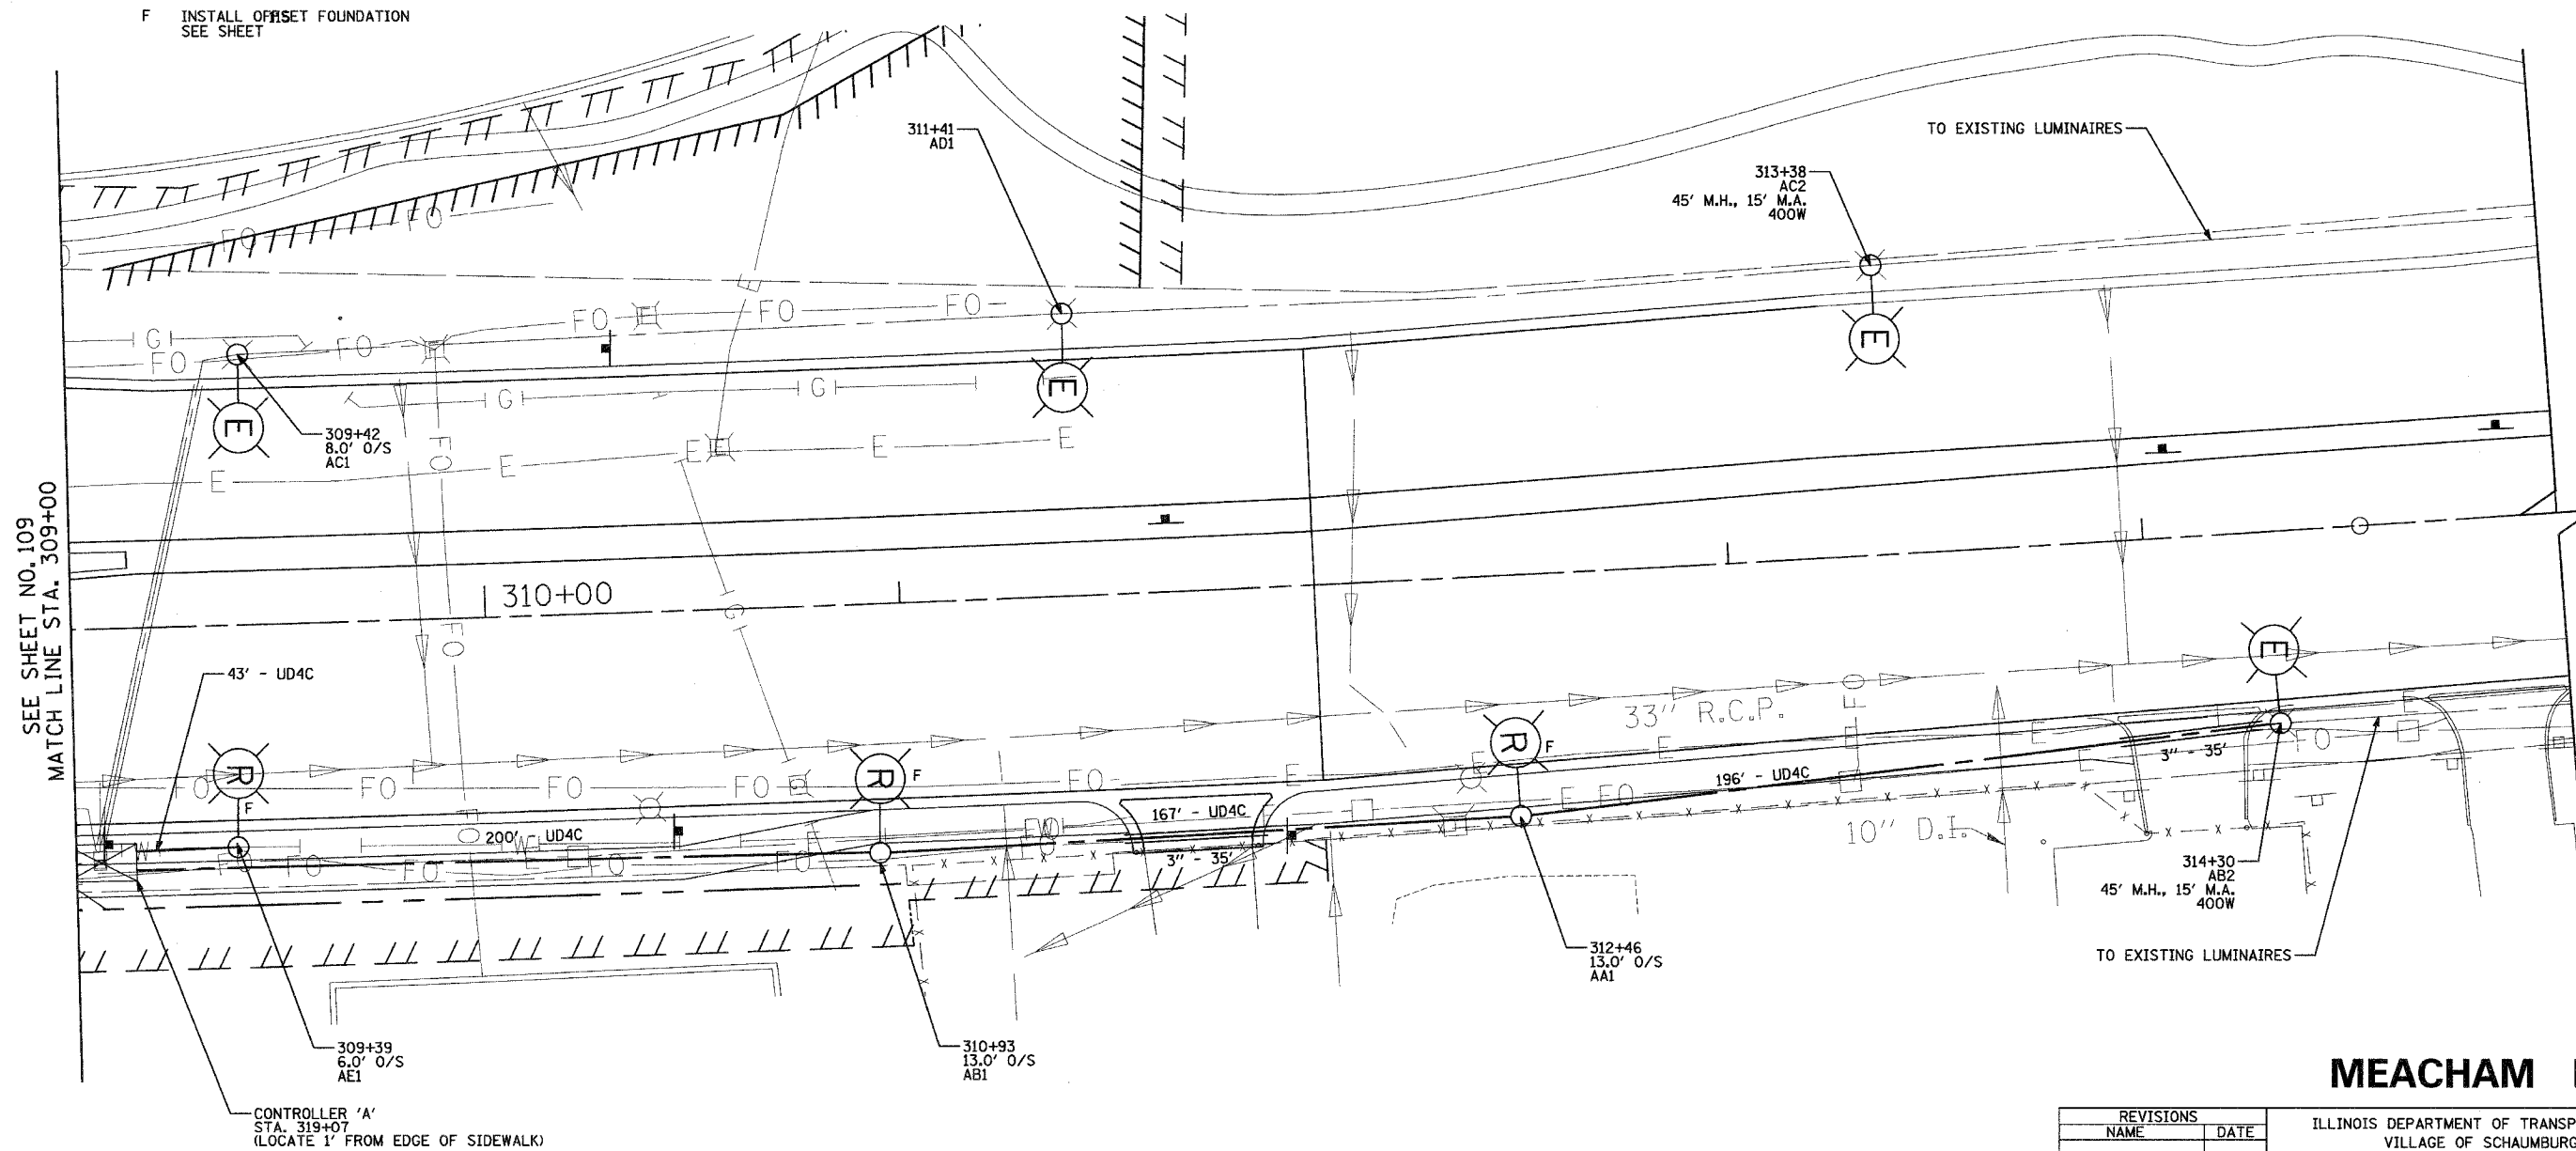


SEE SHEET NO. 109
MATCH LINE STA. 309+00

MEACHAM ROAD

ILLINOIS DEPARTMENT OF TRANSPORTATION
VILLAGE OF SCHAUMBURG
**MEACHAM ROAD
LIGHTING IMPROVEMENTS
POLE INSTALLATION PLAN
STA. 309+00 TO STA. 315+00**

REVISIONS	
NAME	DATE



SCALE: 1"=20'
DATE: DECEMBER 2004
DRAWN BY: KDM
CHECKED BY: JMV

r:\p\013268\design\lighting\0306-plan07.dgn