


EXISTING ELEVATION VIEW
MAINT BLDG POWER DISTRIBUTION
 NOT TO SCALE

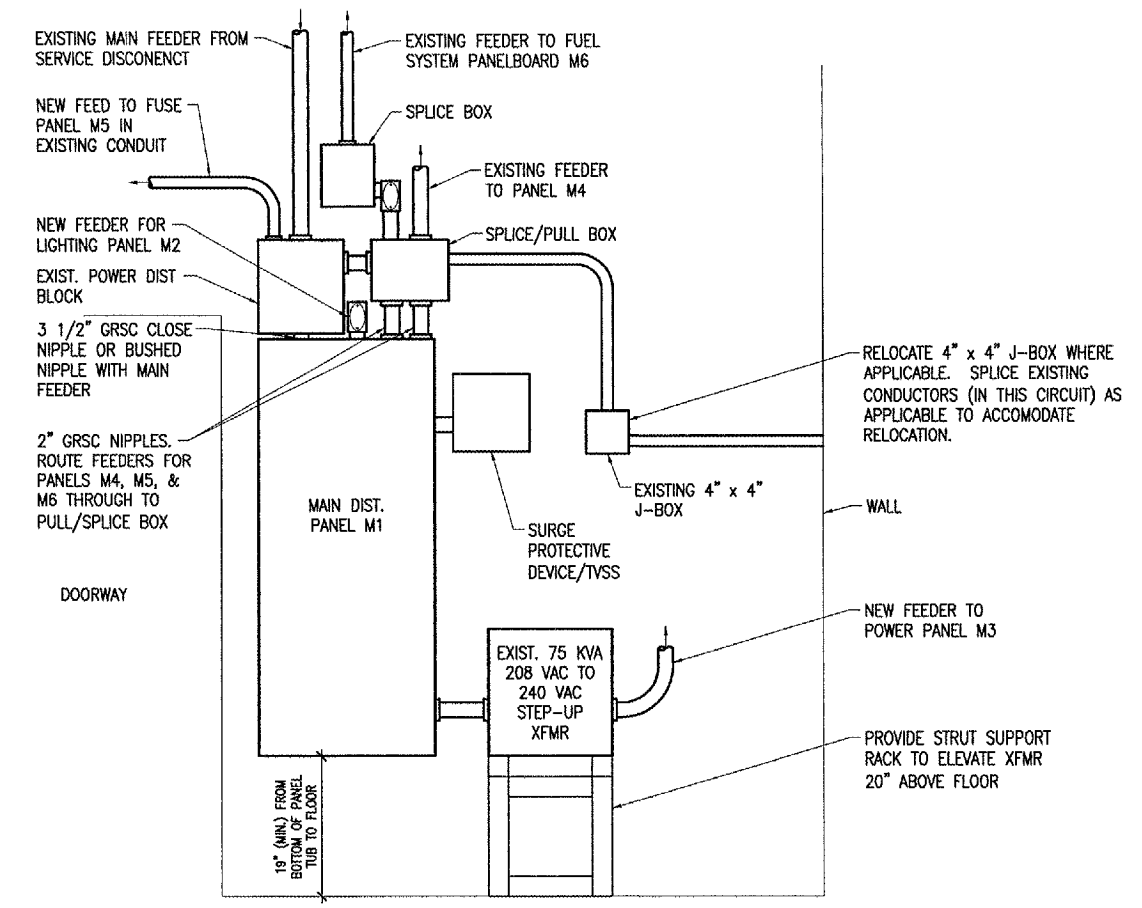

NEW ELEVATION VIEW
MAINT BLDG POWER DISTRIBUTION
 NOT TO SCALE

NOTES:

1. MAIN DIST. PANELBOARD "M1" ENCLOSURE SHALL BE 59" HIGH OR LESS. INSTALL IT DIRECTLY BELOW THE EXISTING POWER DISTRIBUTION BLOCK ENCLOSURE. MAINTAIN CLEARANCE FROM BOTTOM OF PANEL ENCLOSURE TUB TO FLOOR OF NOT LESS THAN 19" TO CONFORM TO NEC 511.
2. SEE "NEW ELECTRICAL ONE LINE DIAGRAM FOR MAINTENANCE BUILDING" FOR INFORMATION OF FEEDER CONDUCTOR & CONDUIT SIZES & TYPES.
3. ALL EQUIPMENT NOT LABELED AS EXISTING IS NEW.

WORK SHOWN ON THIS SHEET IS FOR BID ALTERNATE NO. 2

BY	
REVISION	
DATE	

MT. VERNON AIRPORT

 MT. VERNON, ILLINOIS

FILE PROJECT NO.	819-05RWYD.0800
FILE NUMBER	E-609.DWG
SCALE	NONE
DATE	
LAYOUT	KNL 12/13/04
DRAWN	MV 12/13/04
REVIEWED	CAH 01/14/05

HANSON
 Hanson Professional Services Inc.
 1526 South Sixth Street
 Springfield, Illinois 62703-2886
 Offices Nationwide

REHABILITATE
 RUNWAY 5-23
 ELEVATION VIEWS
 MAINTENANCE BUILDING
 POWER DISTRIBUTION