

LIGHT TOWER FOUNDATION DEPTH "D"

| | SOIL CONDITIONS | | | | | | | |
|--------------------|---------------------------------------|----------------------------------------|---------------------------------------|-----------------------|--------------------------|-----------------------|--|--|
| MOUNTING HEIGHT | SOFT CLAY Qu = 0.375 TON/SO. FT | MEDIUM CLAY Qu = 0.75 TON/SQ. FT | STIFF CLAY Qu = 1.50 TON/SQ. FT | LOOSE SAND Ø = 34° | MEDIUM SAND Ø = 37.5° | DENSE SAND Ø = 40° | | |
| 90 FT | 29 FT | 20 FT | 15 FT | 15 FT | 13 FT | 12 FT | | |
| (27 m) | (8.779 m) | (6.035 m) | (4.389 m) | (4.389 m) | (3.840 m) | (3.429 m) | | |
| 100 FT | 32 FT | 22 FT | 16 FT | 16 FT | 14 FT | 13 FT | | |
| (30 m) | (9.754 m) | (6.706 m) | (4.877 m) | (4.877 m) | (4.267 m) | (3,81 m) | | |
| 110 FT | 35 FT | 24 FT | 18 FT | 18 FT | 15 FT | 14 FT | | |
| (33 m) | (10.719 m) | (7.377 m) | (5.365 m) | (5.365 m) | (4.694 m) | (4.191 m) | | |
| 120 FT | 38 FT | 26 FT | 19 FT | 19 FT | 17 FT | 16 FT | | |
| (36 m) | (11.705 m) | (8.046 m) | (5.652 m) | (5 . 652 m) | (5.120 m) | (4 . 572 m) | | |

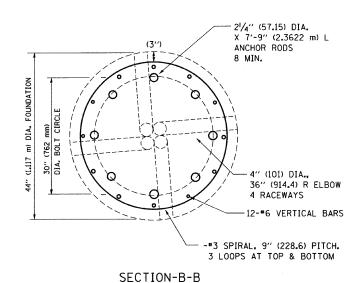

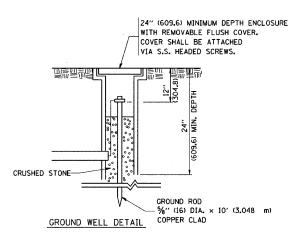

MECHANICAL CONNECTION TO ANCHOR RODS EXOTHERMIC WELD CONNECTION TO REINFORCING STEEL EXOTHERMIC WELD CONNECTION EXOTHERMIC WELD CONNECTION EXOTHERMIC WELD CONNECTION TO ANCHOR RODS EXOTHERMIC WELD EXOTHERMIC WELD TO ANCHOR RODS TO ANCHOR RODS

44" (1.117 m)

FOUNDATION


ELEVATION

SCALE: NONE

3" (76.2)

DESIGN NOTES

- (1) ALL DIMENSIONS IN INCHES (MILLIMETERS) UNLESS OTHERWISE SHOWN
- (2) THE ANCHOR RODS SHALL BE VERTICAL NO ADJUSTMENT SHALL BE ALLOWED AFTER THE FOUNDATION IS PLACED.
- (3) THE GAP BETWEEN THE FOUNDATION AND THE BASE PLATE SHALL BE ENCLOSED WITH A STAINLESS STEEL SCREEN FASTENED WITH A STAINLESS STEEL BAND.
- (4) THE TOP OF THE FOUNDATION TO 18* (450) BELOW GRADE SHALL BE FORMED.
- (5) SURFACE WATER WILL NOT BE PERMITTED TO ENTER THE HOLE AND ALL WATER WHICH MAY HAVE INFILTRATED INTO THE HOLE SHALL BE REMOVED BEFORE PLACING CONCRETE.
- (6) THE LIGHT TOWER SHALL NOT BE ERECTED UNTIL AFTER THE CONCRETE HAS BEEN CURED ACCORDING TO ARTICLE 1020.13.
- (7) ANCHOR RODS SHALL BE STRAIGHT AND SHALL BE ACCORDING TO AASHTO M 314 OR ASTM F1554, GRADE 725(GRADE 105) AND GALVANIZED ACCORDING TO ARTICLE 1006.9.
- (8) ANCHOR ROD INFORMATION SHALL BE SUBMITTED FOR APPROVAL AND SHALL BE FULLY COORDINATED FOR APPROVAL WITH TOWER MANUFACTURER REQUIREMENTS.
- (9) REINFORCEMENT BARS SHALL BE ACCORDING TO ARTICLE 1006.10
- (IO) TWO ANCHOR RODS OPPOSITE EACH OTHER SHALL HAVE THE ANCHOR ROD THREADS PEENED AFTER NUTS ARE INSTALLED.

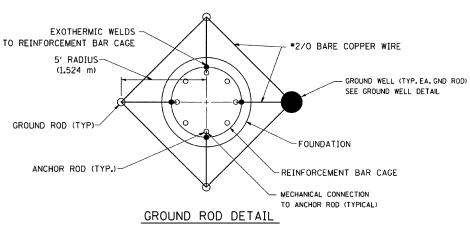

| FILE NAME = | USER NAME = gaglianobt | DESIGNED - | REVISED - R. TOMSONS 04-22-0 |
|----------------------------|-----------------------------|------------|------------------------------|
| W:\diststd\22x34\be501.dgn | | DRAWN - | REVISED - |
| | PLOT SCALE = 50.000 ' / IN. | CHECKED - | REVISED - |
| | PLOT DATE = 1/4/2008 | DATE - | REVISED - |

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

| HIGH MAST LIGHT TOWER | | F.A RTE. | SECTION | COUNTY | TOTAL | SHEET NO. | | | | |
|-----------------------------------------------------|----------------|-------------|---------|---------|----------|-------------------------------------------------|-----|-----|--|--|
| 90 FT TO 120 FT (27 mTO 36 m) FOUNDATION DETAIL | | | | | | | 246 | 232 | | |
| 30 F1 TO 120 F1 (27 IIITO 30 III) FOONDATION DETAIL | | | BE-501 | | CONTRACT | NO. | | | | |
| 1 | SHEET NO. 1 OF | 2 SHEETS | STA. | TO STA. | | FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT | | | | |