


CABLE TRENCH

CONDUIT TRENCH

**NOTE**  
 EXCESS SOIL FROM TRENCH TO BE COMPLETELY REMOVED FROM SITE AS SOON AS PRACTICABLE.  
 BLACK DIRT TO BE TAMPED & THOROUGHLY COMPACTED AS SHOWN.

STANDARD METHOD FOR BACKFILLING CABLE & CONDUIT TRENCHES IN SODDED PARKWAY & LAWNS			
CITY OF CHICAGO			
DEPT. OF STREETS & SANITATION			
DIVISION OF ELECTRICAL ENGINEERING			
REVISION	DRAWN	CHECKED	ENGINEER
A	W. E. HARR	J. J. CONNOR	J. J. CONNOR
B	ENG. IN CHARGE		
C	SUPT. OF CONE.		
D			
E			
F			
G			
H	SIZE 8 1/2 x 14"	SCALE: N	DATE: 7-14-01

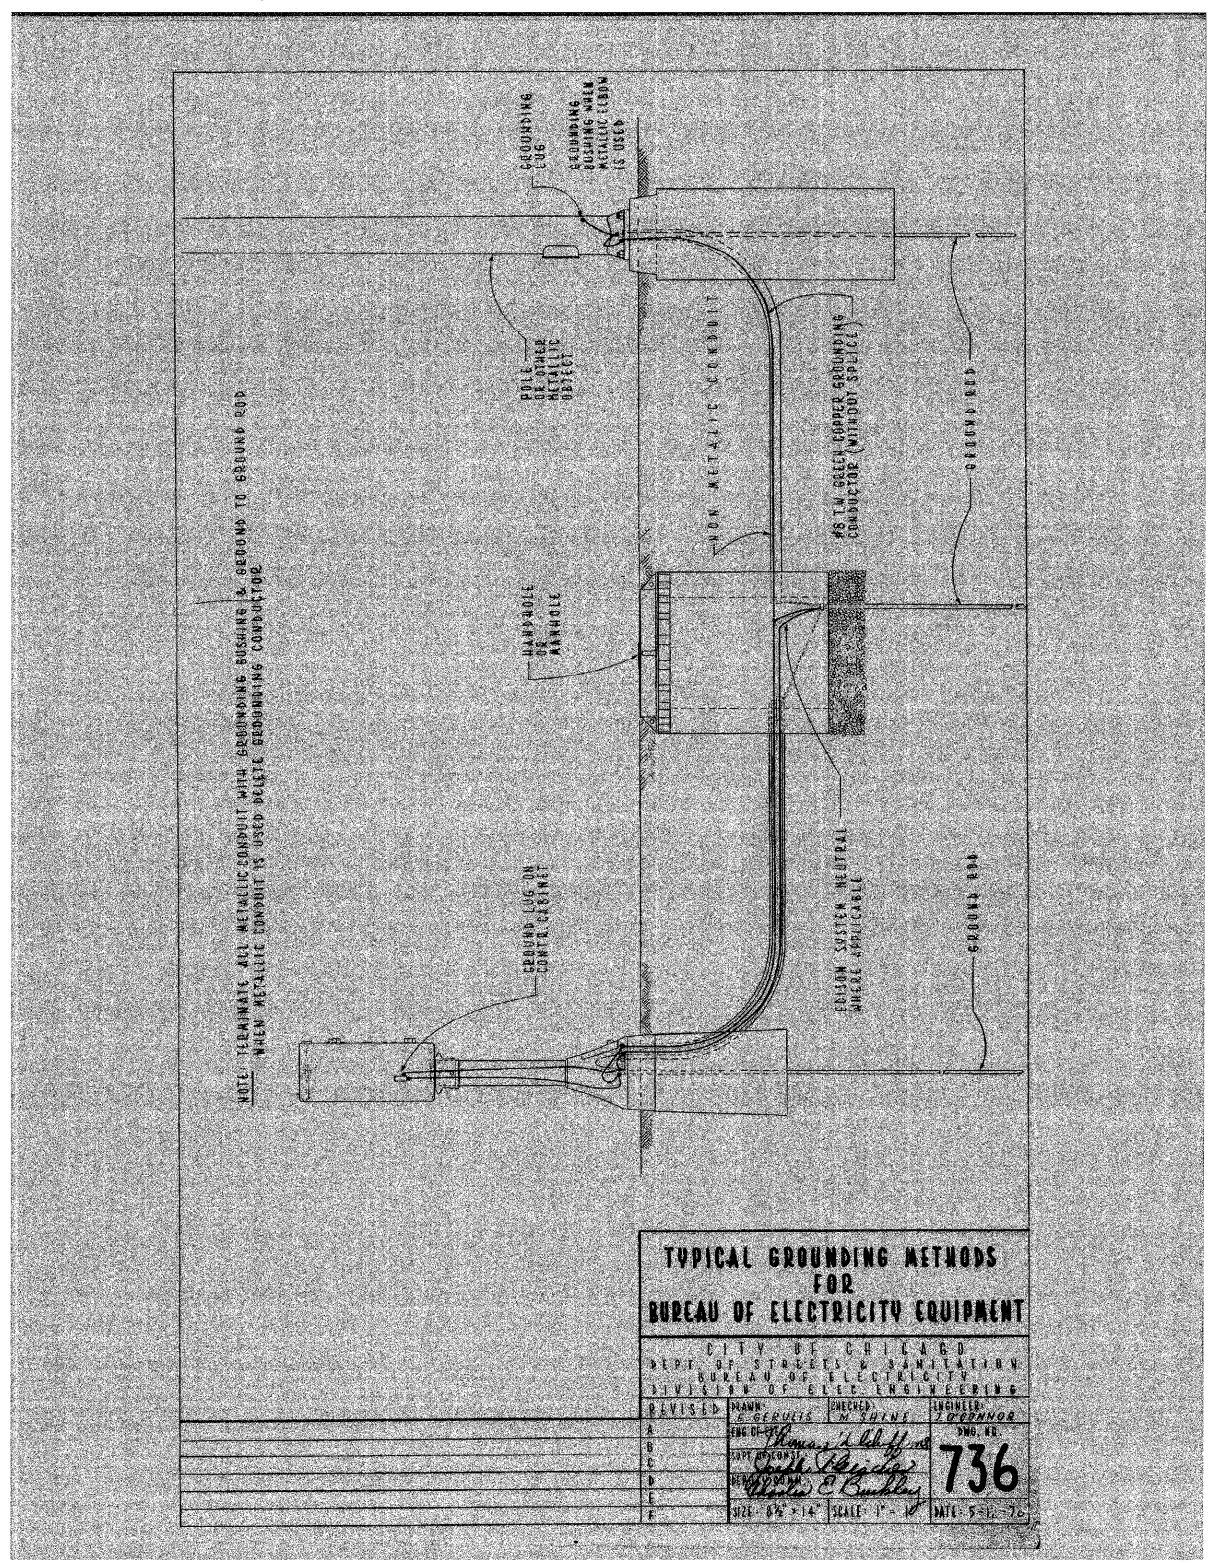

NOTE: TERMINATE ALL METALLIC CONDUIT WITH GROUNDING RUSHING & GROUND TO GROUND ROD WHEN METALLIC CONDUIT IS USED BELETE GROUNDING CONDUCTOR.

**TYPICAL GROUNDING METHODS FOR BUREAU OF ELECTRICITY EQUIPMENT**

CITY OF CHICAGO			
DEPT. OF STREETS & SANITATION			
BUREAU OF ELECTRICITY			
DIVISION OF ELECTRICAL ENGINEERING			
DESIGNED	DRAWN	CHECKED	APPROVED
	W. E. HARR	J. J. CONNOR	J. J. CONNOR
NO. 736			
DATE: 5-1-70			

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION  
 111TH STREET OVER  
 F.A.I ROUTE 57 (INTERSTATE 57)

ELECTRICAL STANDARD DETAILS

SCALE: NONE  
 DATE: 01/16/09  
 DRAWN BY: N/A  
 CHECKED BY: N/A

**TENG**  
 TENG & ASSOCIATES, INC.  
 ENGINEERS-ARCHITECTS-PLANNERS  
 205 N. MICHIGAN AVE., CHICAGO, IL 60601  
 TELEPHONE: 312.765-0000