


- LEGEND:**
- FIRE HYDRANT W/AUXILIARY VALVE AND VALVE BOX
 - VALVE VAULT
 - 8" - PROPOSED WATER MAIN
 - 8" - PROPOSED WATER MAIN (W/STEEL CASING PIPE)
 - PROPOSED STORM SEWER
 - PROPOSED COMBINED SEWER
 - PROPOSED PIPE UNDERDRAIN

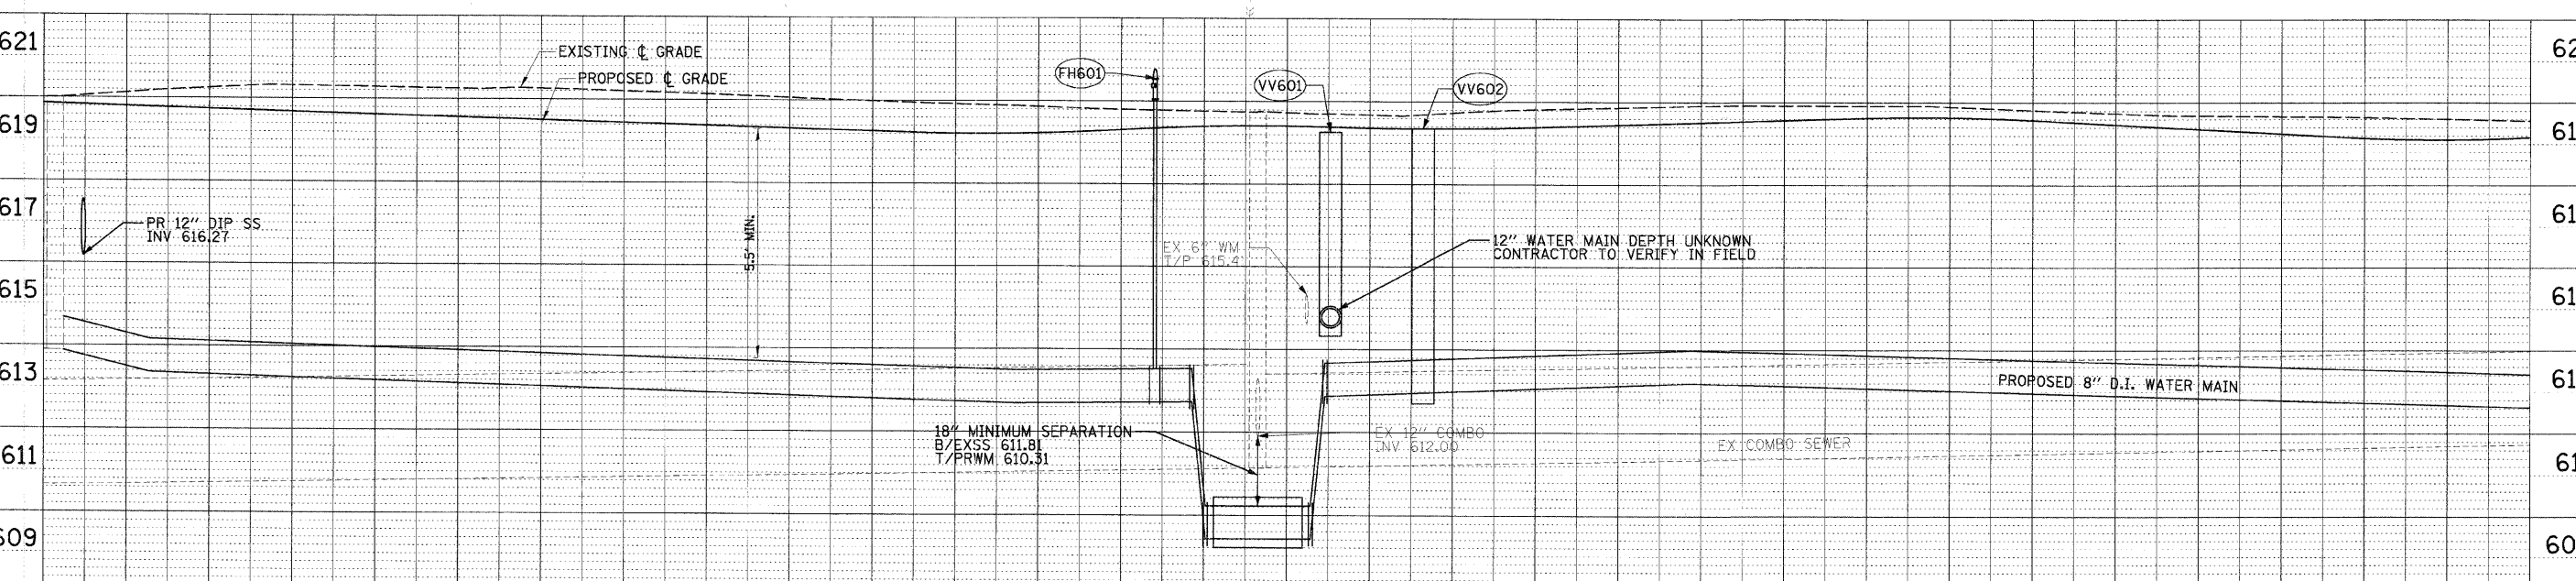

620.10 619.96	620.39 619.81	620.34 619.66	620.26 619.51	620.08 619.36	619.93 619.35	619.83 619.50	619.88 619.45	620.01 619.60	620.01 619.73	619.83 619.56	619.75 619.28	619.66 619.25
129+00	129+50	130+00	130+50	131+00	131+50	132+00	132+50	133+00	133+50	134+00	134+50	135+00

PLAN

DATE: _____

BY: _____

DESIGNED: _____

DRAWN: _____

CHECKED: _____

DATE: _____

PROFILE

DATE: _____

BY: _____

DESIGNED: _____

DRAWN: _____

CHECKED: _____

DATE: _____