




ONE LINE CIRCUIT DIAGRAM
N.T.S.

- LEGEND**
- PROP. LIGHTPOLE
 - ⊙ RELOCATED EX. LIGHTPOLE
 - ⊗ EX. LIGHTPOLE
 - PROP. ELECTRIC LINE
 - EX. ELECTRIC LINE
 - ⊠ EX. LIGHTING CONTROLLER
 - PROP. HANDHOLE
 - EX. HANDHOLE
 - POLE NUMBER
 - () LUMINAIRE CIRCUIT ID
 - EX. LIGHTING CONTROLLER ID
 - - - ROADWAY

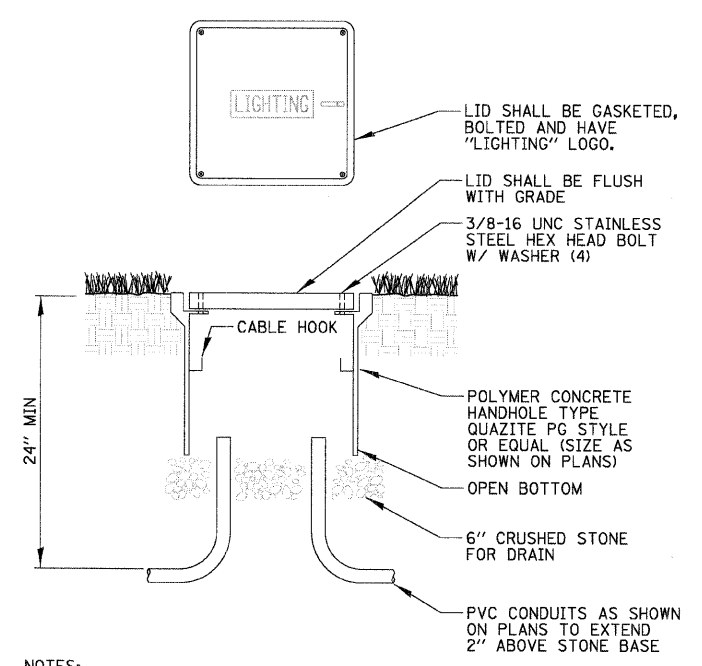

- NOTES:**
- ALL SPLICES SHALL BE WATERPROOF.
 - POLYMER CONCRETE HANDHOLE AND LID SHALL BE GREEN IN LANDSCAPED AREAS AND MATCH COLOR IN CONCRETE/BRICK AREAS.

POLYMER CONCRETE HANDHOLE
N.T.S.

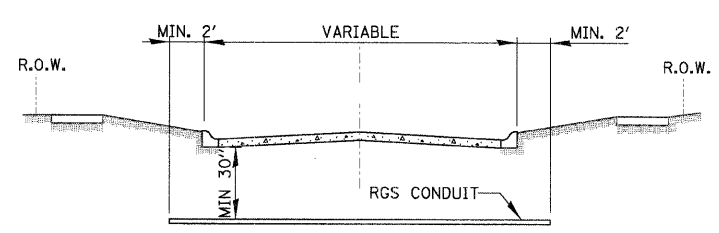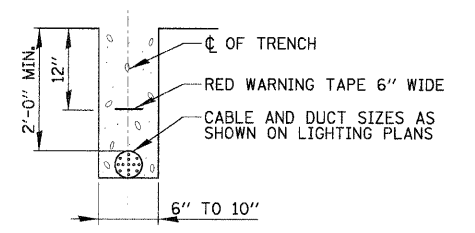

- CONDUIT SHALL BE HEAVY WALL RGS CONDUIT.
- CONDUIT SHALL EXTEND A MINIMUM OF 2 FT. BEYOND BACK OF CURB.
- CONDUIT SHALL BE A MINIMUM OF 30" BELOW CURB BOTTOM.

ELECTRIC CONDUIT INSTALLATION
N.T.S.

LUMINAIRE AND POLE SCHEDULE

LIGHT POLE IDENTIFIER	PROPOSED LUMINAIRES			CONTROLLER IDENTIFIER
	QUANTITY	WATTAGE	CKT ID	
P1	(1)	50W	3	R
P2	(1)	50W	3	R
P3	(1)	50W	3	R
P4	(1)	50W	3	R
P5	(1)	50W	3	Q
P6	(1)	50W	3	Q
P7	(1)	50W	3	Q
P8	(1)	50W	3	Q
P9	(1)	50W	3	C
P10	(1)	50W	3	C
P11	(1)	50W	3	C
P12	(1)	50W	3	C
P13	(1)	50W	9	B
P14	(1)	50W	9	B
P15	(1)	50W	9	B
P16	(1)	50W	9	B