


NOTE:
 1) POLES TO BE OFFSET 15' FROM EDGE OF PAVEMENT, FURTHER IF IN FLOWLINE OF DITCH. IN THAT CASE, MOVE FURTHER BACK AND OUT OF THE FLOWLINE OR AS DIRECTED BY THE ENGINEER. IF OBSTACLES ARE ENCOUNTERED, THE POLE WILL BE RELOCATED TO AN APPROPRIATE LOCATION AS DIRECTED BY THE ENGINEER.


2) WHERE THE ELECTRIC SERVICE FROM THE POWER COMPANY IS UNDERGROUND, THE TOP OF THE CUSTOMER OWNED METER POLE SHALL BE INSTALLED 6'-6" ABOVE GRADE.

3) DISTANCE FROM TRANSFORMER TO CONTROLLER NOT TO EXCEED 250 FT. SEE SHEET NO. 13.

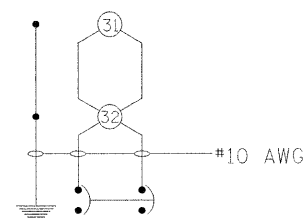


20 AMP, 2 POLE
CIRCUIT BREAKER

CIRCUIT NO. 3-1

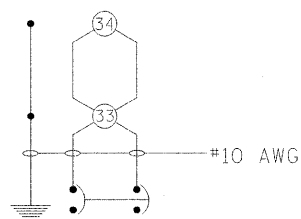


20 AMP, 2 POLE
CIRCUIT BREAKER

CIRCUIT NO. 3-2

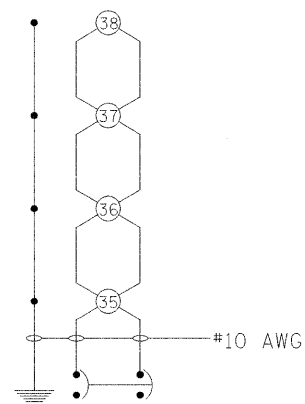

20 AMP, 2 POLE
CIRCUIT BREAKER

CIRCUIT NO. 3-3

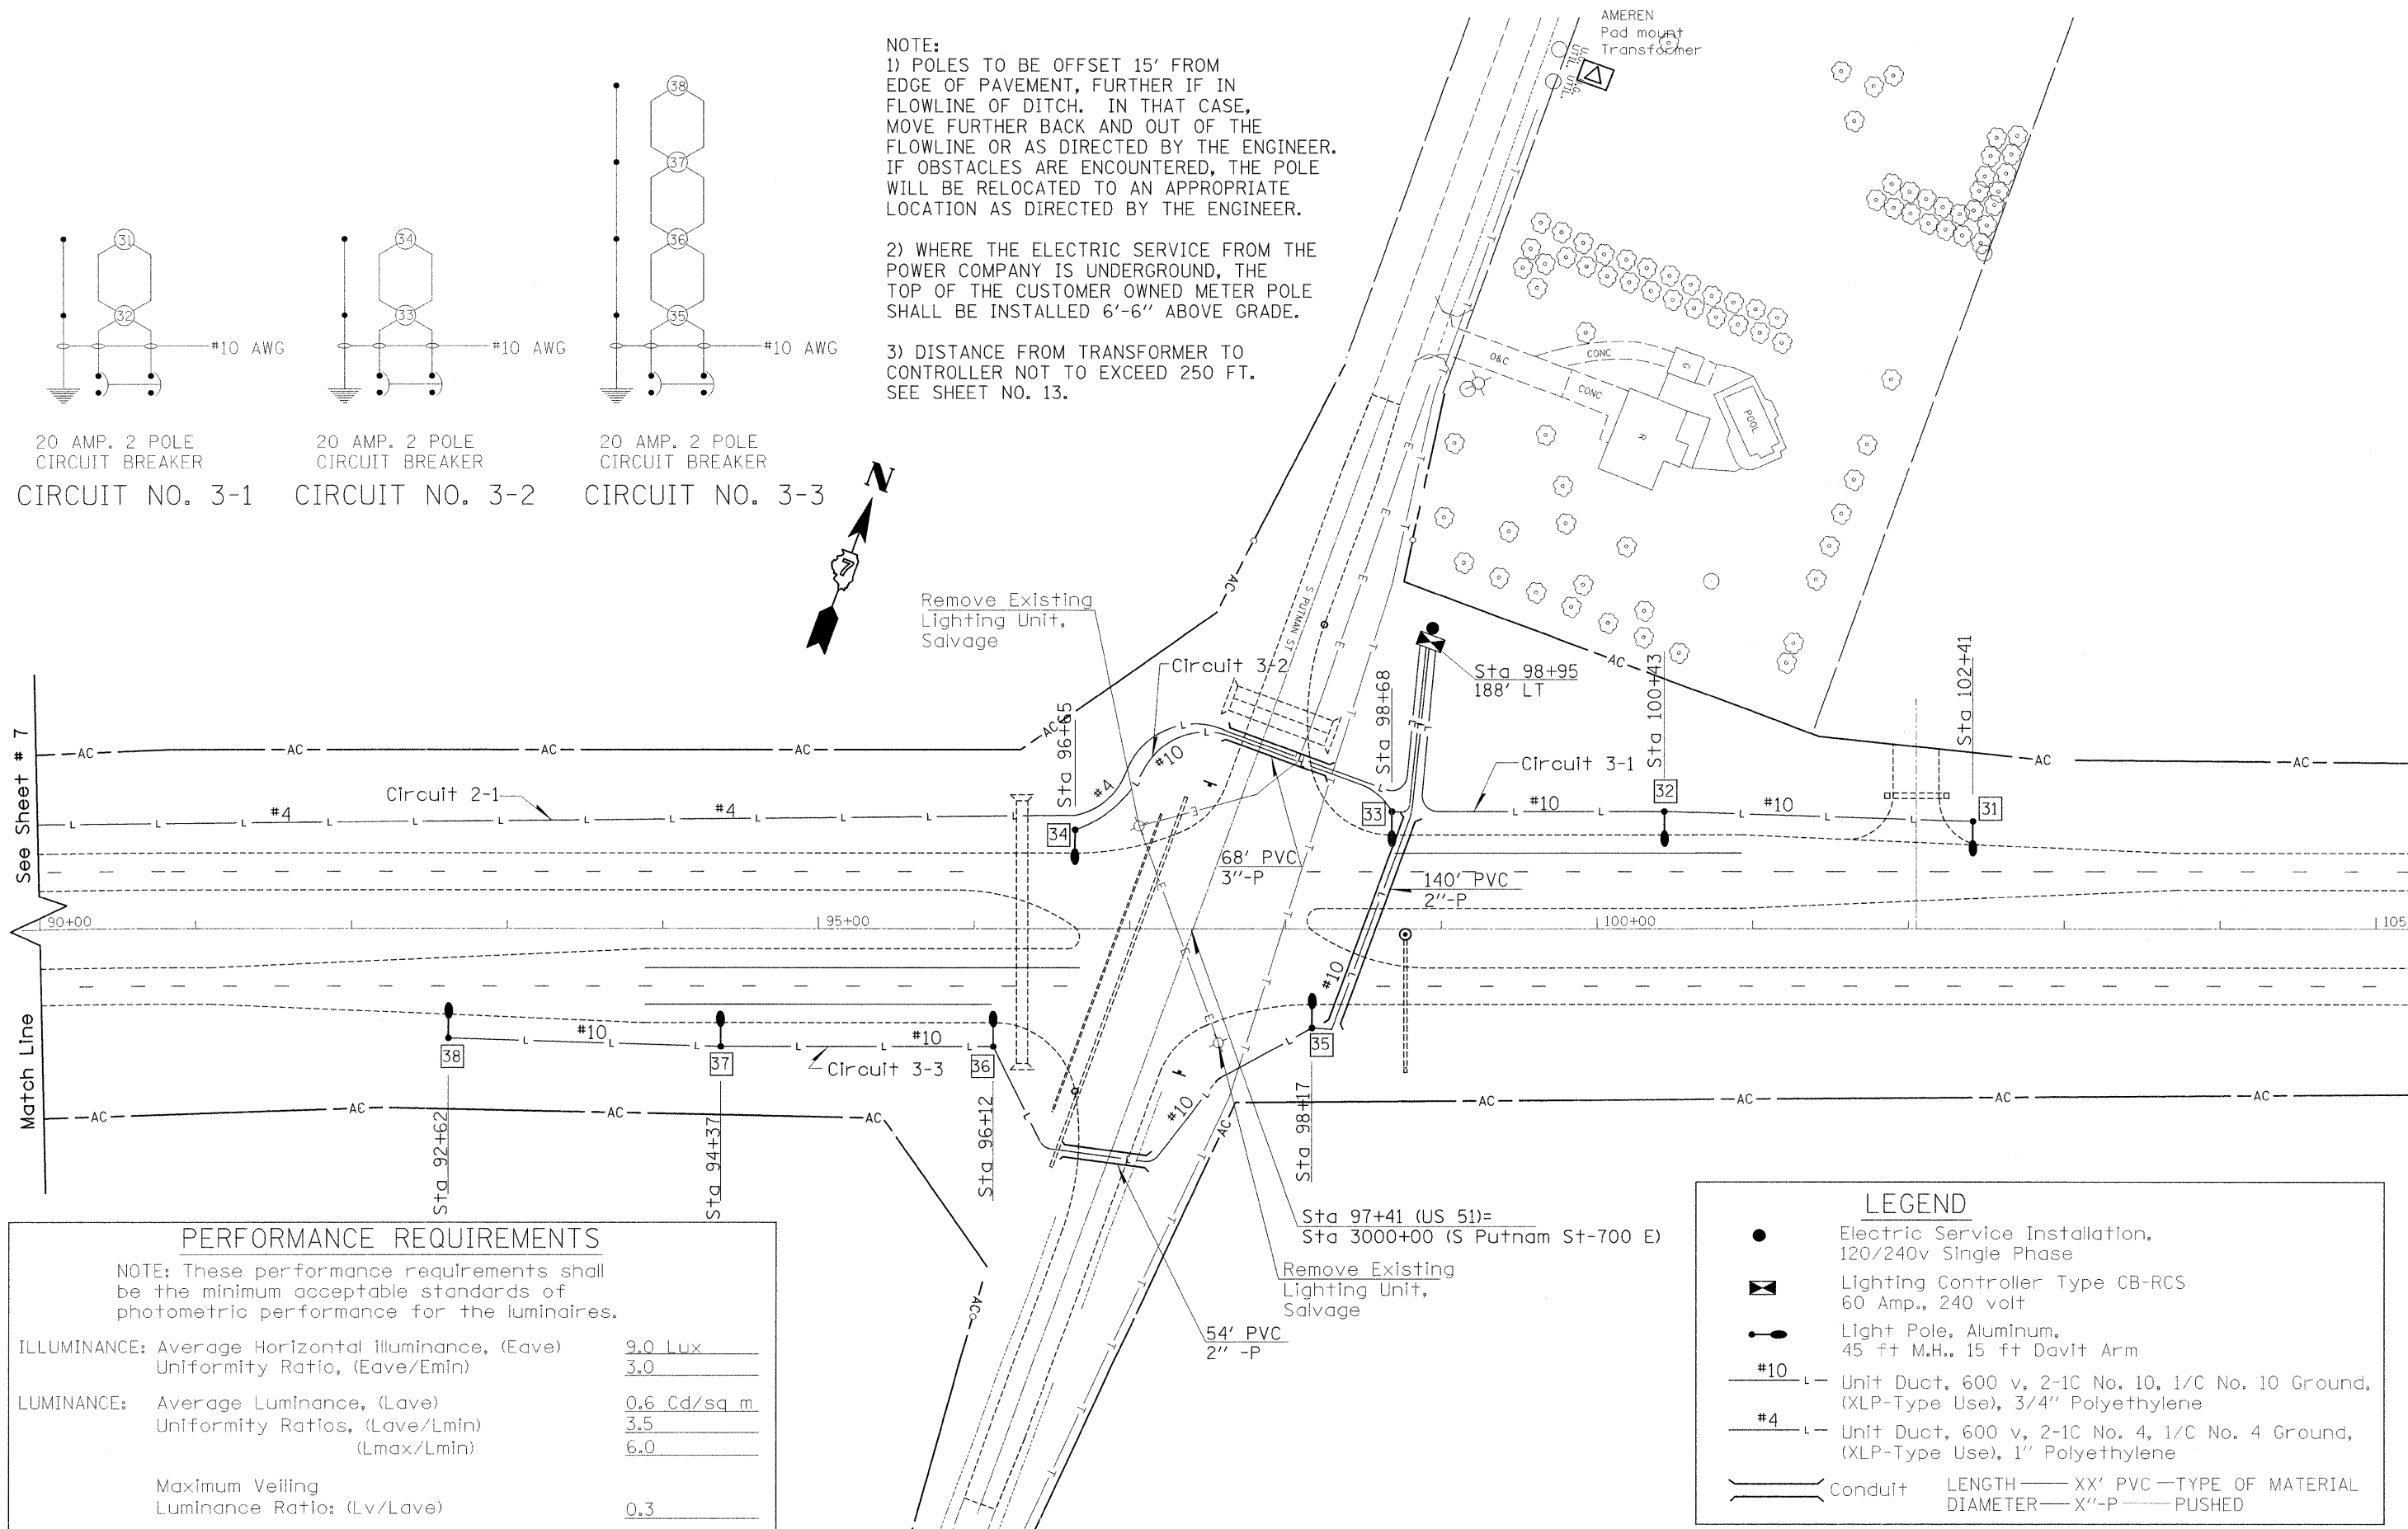

See Sheet # 7

Match Line

PERFORMANCE REQUIREMENTS

NOTE: These performance requirements shall be the minimum acceptable standards of photometric performance for the luminaires.

ILLUMINANCE: Average Horizontal illuminance, (Eave)	9.0 Lux
Uniformity Ratio, (Eave/Emin)	3.0
LUMINANCE: Average Luminance, (Lave)	0.6 Cd/sq m
Uniformity Ratios, (Lave/Lmin)	3.5
(Lmax/Lmin)	6.0
Maximum Veiling Luminance Ratio: (Lv/Lave)	0.3

LEGEND

- Electric Service Installation, 120/240v Single Phase
- ⊠ Lighting Controller Type CB-RCS 60 Amp., 240 volt
- ⊙ Light Pole, Aluminum, 45 ft M.H., 15 ft Davit Arm
- #10 Unit Duct, 600 v, 2-1C No. 10, 1/C No. 10 Ground, (XLP-Type Use), 3/4" Polyethylene
- #4 Unit Duct, 600 v, 2-1C No. 4, 1/C No. 4 Ground, (XLP-Type Use), 1" Polyethylene
- Conduit LENGTH — XX' PVC — TYPE OF MATERIAL
DIAMETER — X"-P — PUSHED