


## TYPICAL SPLICE DETAIL

N.T.S.

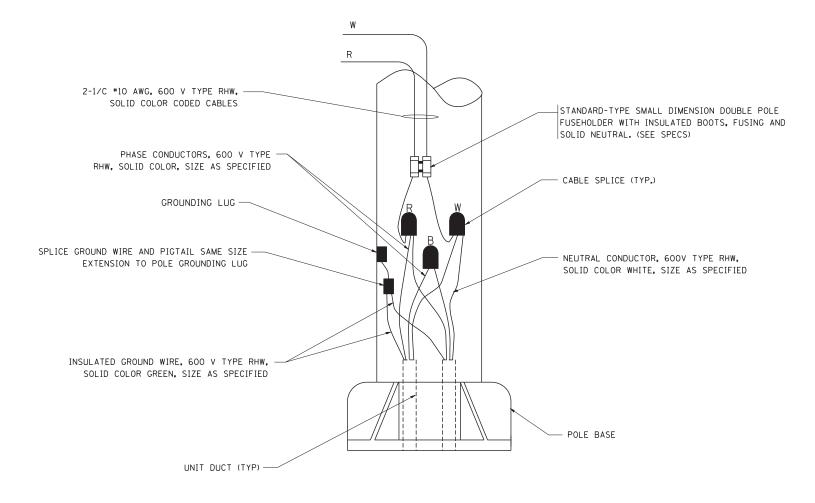

TYPICAL WIRING IN TRENCH DETAIL
N.T.S.

30" (762) MINIMUM COVER 12" (305) MAXIMUM WIDTH EXCEPT AS APPROVED BY THE ENGINEER

12" (305)

WARNING TAPE AS SPECIFIED

UNIT DUCT OR OTHER RACEWAY
AND WIRING AS PER PLANS. COMPLETE

WITH INTERNAL INSULATED EQUIPMENT GROUND WIRE.

## POLE WIRING DETAIL

N.T.S.

									L	1-24
FILE NAME =	USER NAME = gaglianobt	DESIGNED -	REVISED - 08-08-03		MISC. ELECTRICAL DETAILS	F.A	SECTION	COUNTY	TOTAL SH	HEET
W:\diststd\22x34\be702.dgn		DRAWN -	REVISED -	STATE OF ILLINOIS		2754	1616B	соок	404 2	256
	PLOT SCALE = 50.000 '/ IN.	CHECKED -	REVISED -	DEPARTMENT OF TRANSPORTATION	SHEET A		BE-702	CONTRACT NO. 60J14		<i>-</i>
1	PLOT DATE = 1/4/2008	DATE -	REVISED -		SCALE: NONE SHEET NO. 1 OF 1 SHEETS STA. TO STA.	FFD. ROZ		AID PROJECT		-