
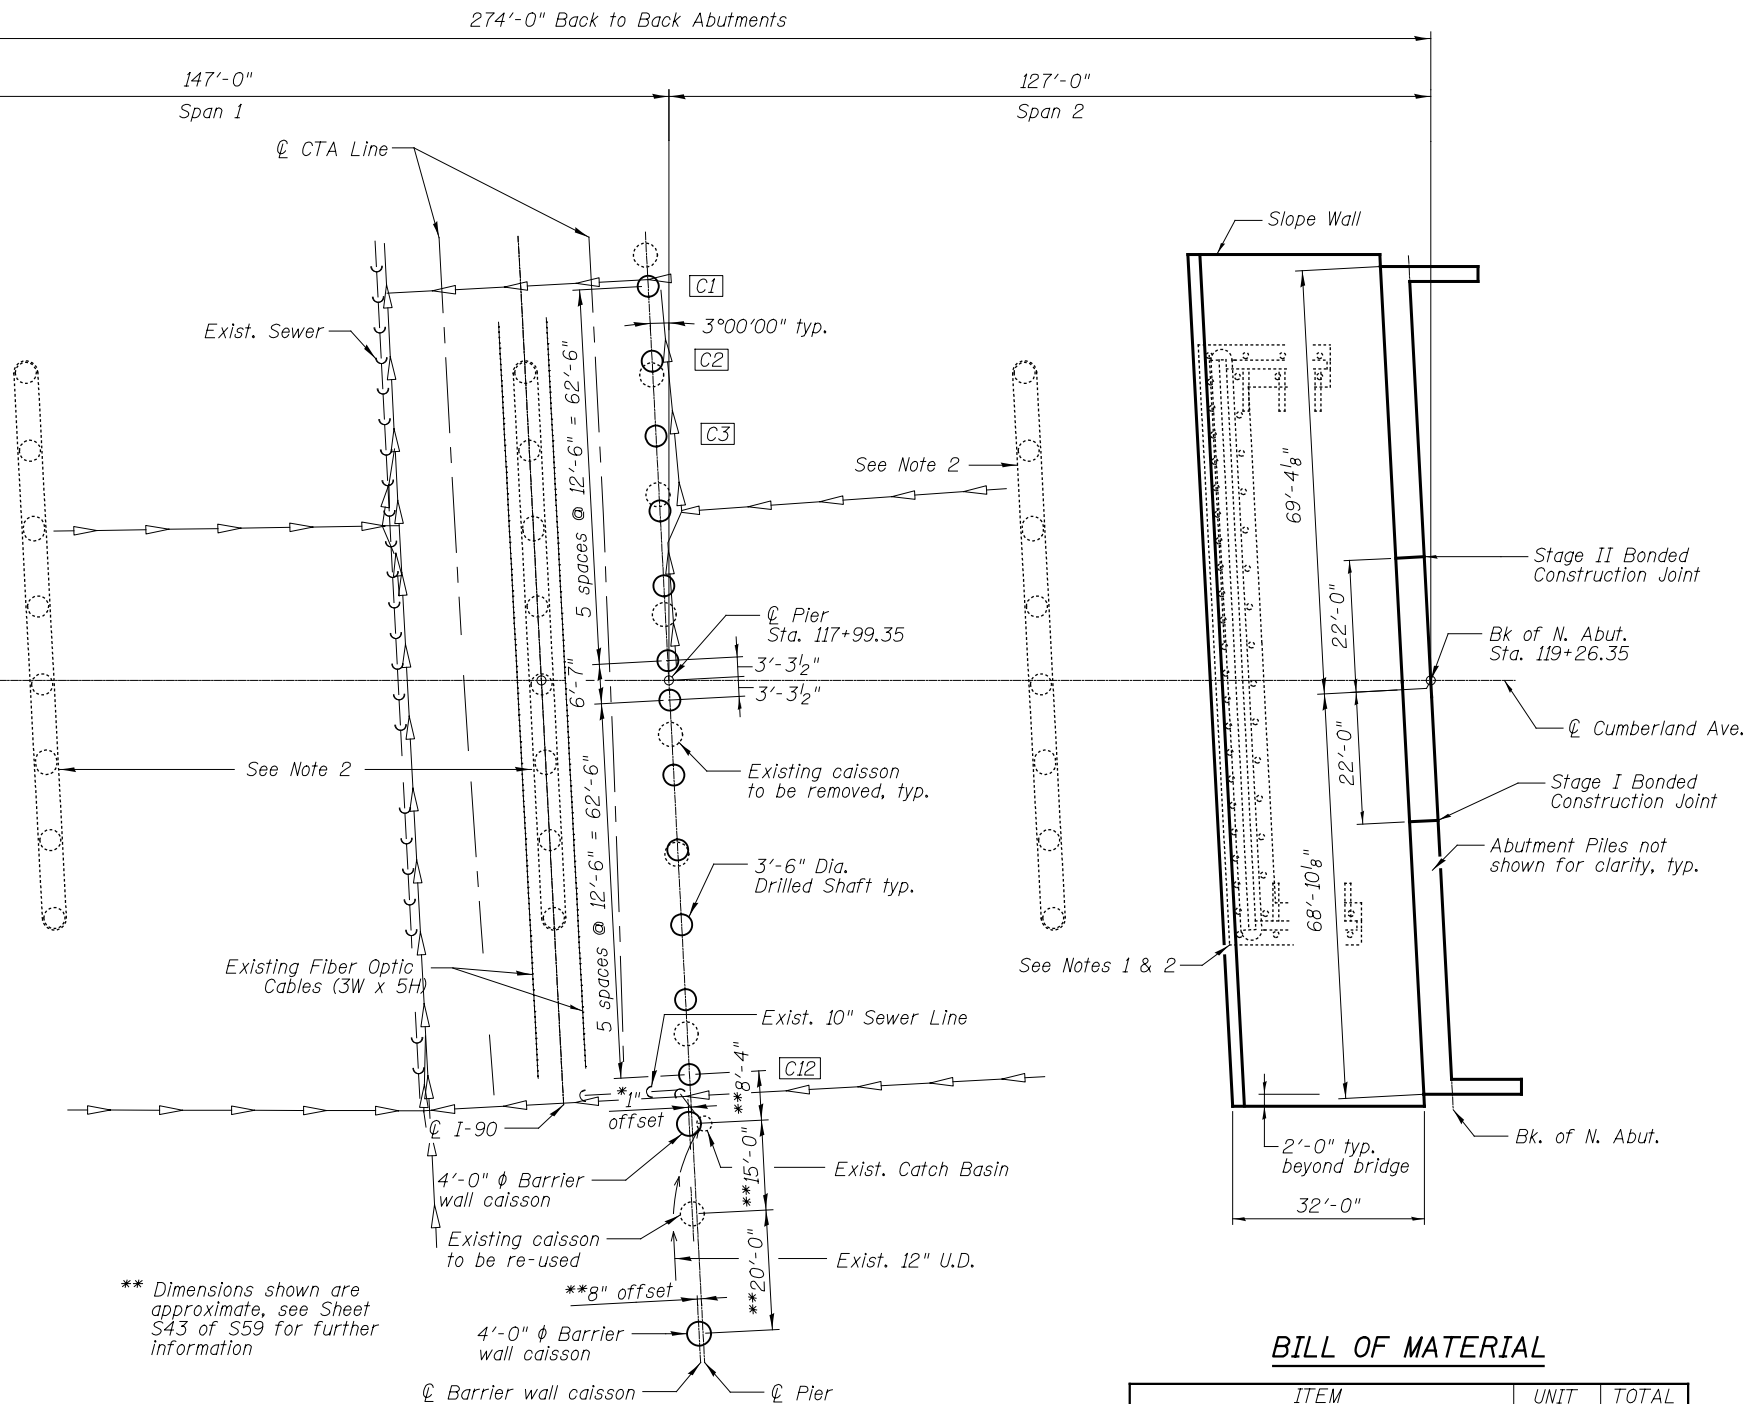


SECTION THRU CONCRETE SLOPEWALL

SECTION A-A

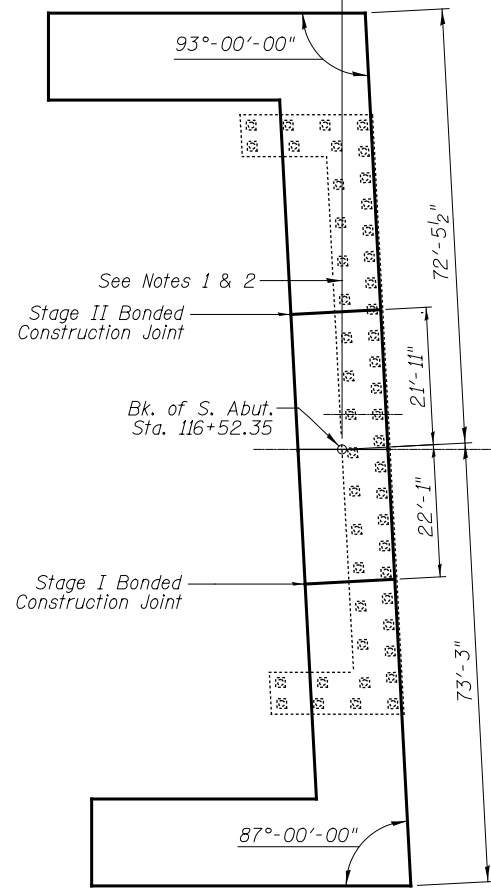

FOOTING LAYOUT PLAN

BILL OF MATERIAL

ITEM	UNIT	TOTAL
Slope Wall 4"	Sq. Yd.	562

NOTES:

1. Abutment, barrier wall caissons and retaining wall piles in conflict with proposed foundation shall be removed in their entirety and the ensuing cavity shall be filled with sand.
2. See Sheet S5 for Removal Details.
3. Slope wall shall be reinforced with welded wire fabric, 6 in. x 6 in. - W4.0 x W4.0, weighing 58 lbs. per 100 sq. ft.

** Dimensions shown are approximate, see Sheet S43 of S59 for further information