



NOTES:

1. SEE DRAWING E-1 FOR ELECTRICAL SYMBOL LIST AND ABBREVIATIONS. SEE DRAWING E-2 FOR ELECTRICAL GENERAL NOTES.
2. AERIAL CABLE MUST HAVE A MINIMUM CLEARANCE OF 20'-0" TO GRADE AT ALL LOCATIONS.
3. CONTRACTOR HAS THE OPTION TO SUBSTITUTE THE UNIT DUCT WITH ELECTRIC CABLE IN CONDUIT. NO ADDITIONAL PAYMENT WILL BE ALLOWED FOR ANY ADDITIONAL MATERIALS AS A RESULT OF THIS SUBSTITUTION.

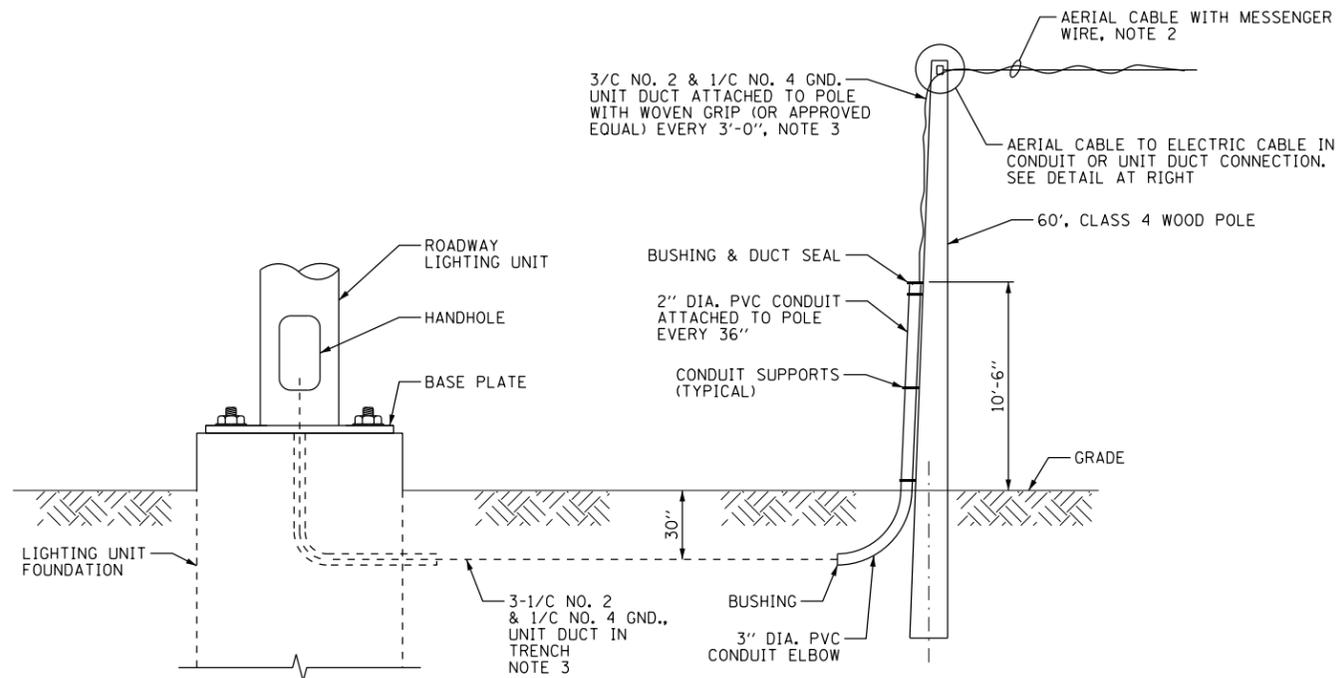

NOTE: DETAIL FOR WOOD POLE TO ROADWAY LIGHTING CONTROLLER WIRING CONNECTION IS SIMILAR.

**WOOD POLE TO ROADWAY LIGHTING UNIT
WIRING CONNECTION DETAIL**
N.T.S.

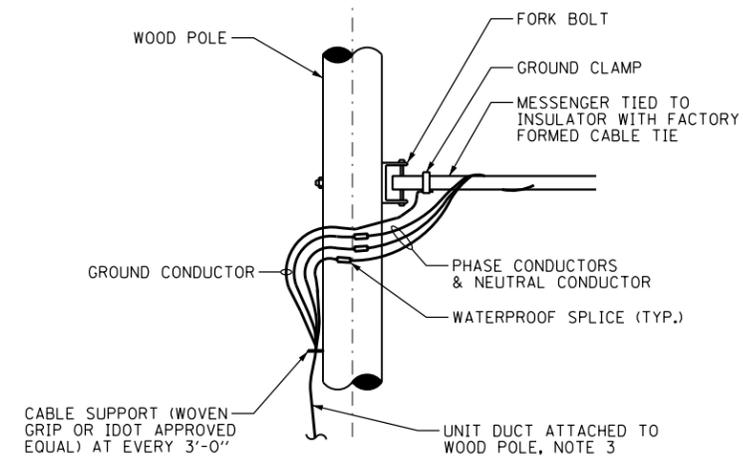

**AERIAL CABLE TO ELECTRIC
CABLE ASSEMBLY CONNECTION DETAIL**
N.T.S.

FILE NAME = D160M61-SHT-E60.dgn	USER NAME = michal_bartusiewicz	DESIGNED - JLW	REVISED -
SHT.PLAN	PLOT SCALE = 2.0000' / in.	DRAWN - CJM	REVISED -
DT60M61-SHT-E60.dgn 3/15/2013 2:27:37 PM	PLOT DATE = 3/15/2013	CHECKED - KMY	REVISED -
		DATE - 03/13/2013	REVISED -

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
330	103R-4	COOK	877	471
E-60			CONTRACT NO. 60M61	
ILLINOIS FED. AID PROJECT				