

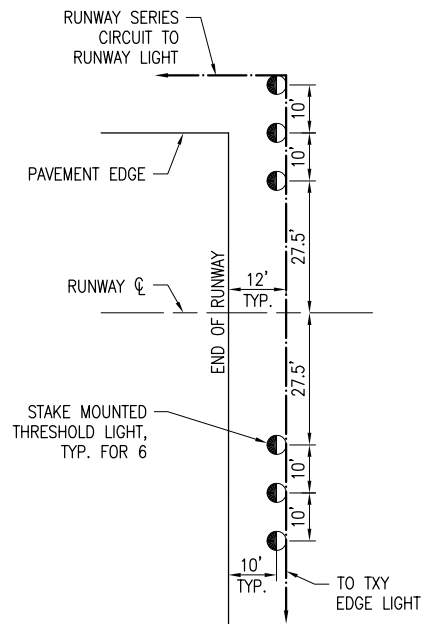
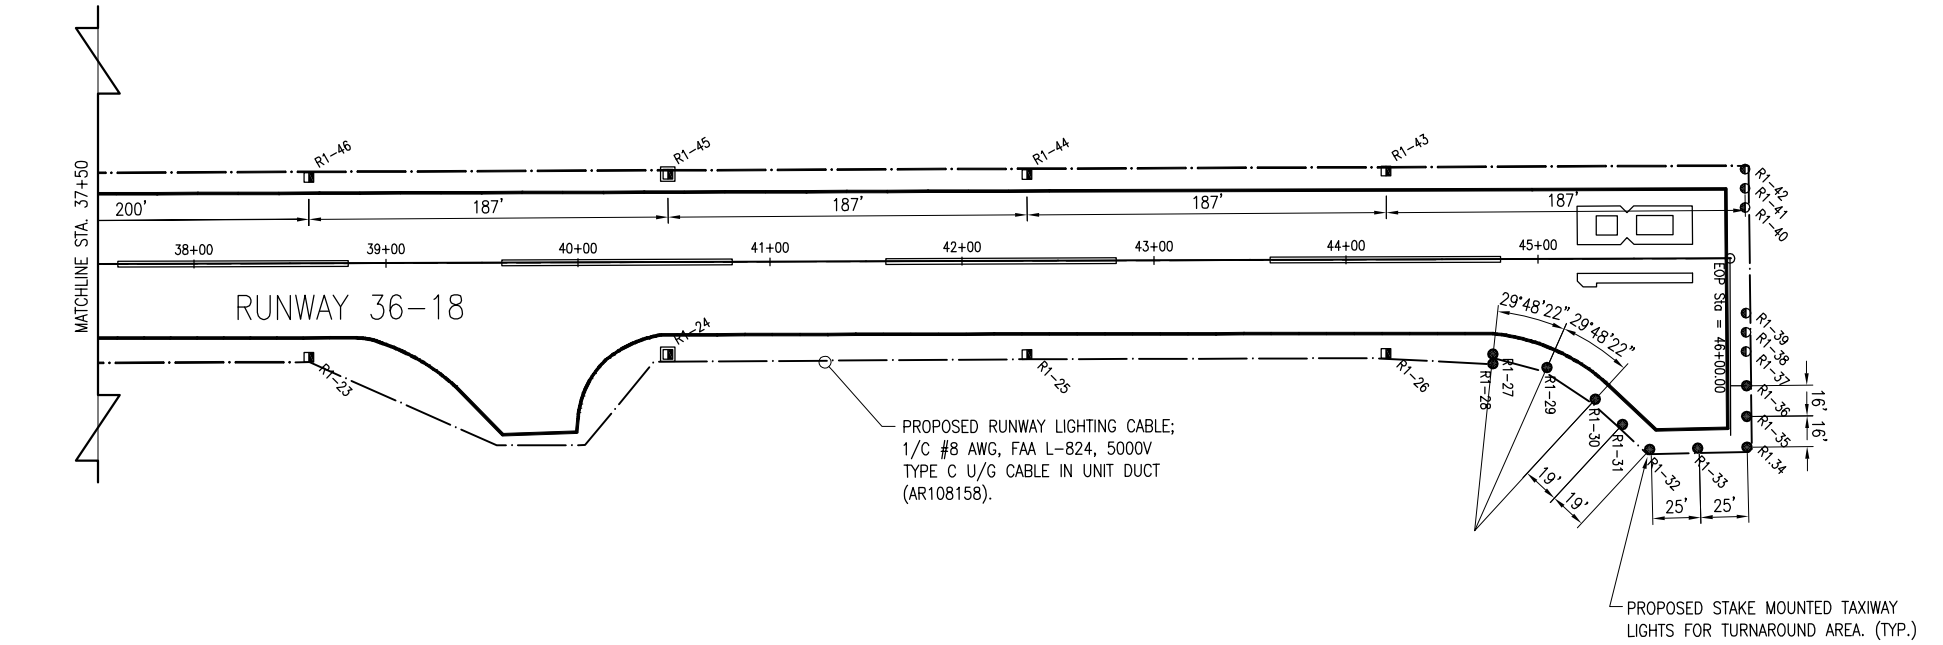


- LEGEND**
- EXISTING PAVEMENT
  - EXISTING BUILDING
  - PROPOSED ELECTRICAL DUCT
  - EXISTING ELECTRICAL DUCT
  - EXISTING ELECTRICAL CABLE
  - PROPOSED 1/2" #8 AWG, FAA L-824, 5000 VOLT TYPE C UNDERGROUND CABLE IN UNIT DUCT
  - PROPOSED 3-1/2" #6 XLP-USE 600V UG CABLE IN UNIT DUCT
  - PROPOSED STAKE MOUNTED TAXIWAY LIGHT
  - PROPOSED BASE MOUNTED TAXIWAY LIGHT
  - PROPOSED STAKE MOUNTED RUNWAY LIGHT
  - PROPOSED BASE MOUNTED RUNWAY LIGHT
  - PROPOSED STAKE MOUNTED THRESHOLD LIGHT
  - PROPOSED BASE MOUNTED THRESHOLD LIGHT
  - PROPOSED TAXI GUIDANCE SIGN

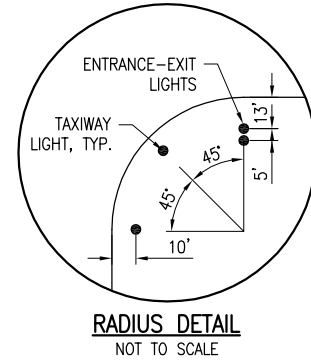

REVISION	DATE	UPDATE PER	IDA REVIEW
03/09/12			

SHELBY COUNTY AIRPORT  
SHELBYVILLE, ILLINOIS

IL PROJ.: 2H0-4149  
A.I.P. PROJ.: 3-17-0093-B11

Hanson Proj. No.	10A0047
Filename	AS_SHOWN
Scale	02/18/12
Date	
LAYOUT	KNL 02/06/12
DRAWN	CWS 02/07/12
REVIEWED	CAH/KNL 02/23/12

**HANSON**  
Professional Services Inc. 2012  
Hanson Professional Services Inc.  
1525 South Sixth Street  
Springfield, Illinois 62703-2986  
Ph: (217) 788-2450 Fax: (217) 788-2503  
www.hanson-inc.com  
Offices Nationwide

CONSTRUCT VAULT,  
LIGHT TAXIWAY &  
INSTALL NAVAIDS

PROPOSED ELECTRICAL PLAN  
STA. 26+75 TO STA. 46+00