



F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
323	(145,146)L	EDGAR	9	6

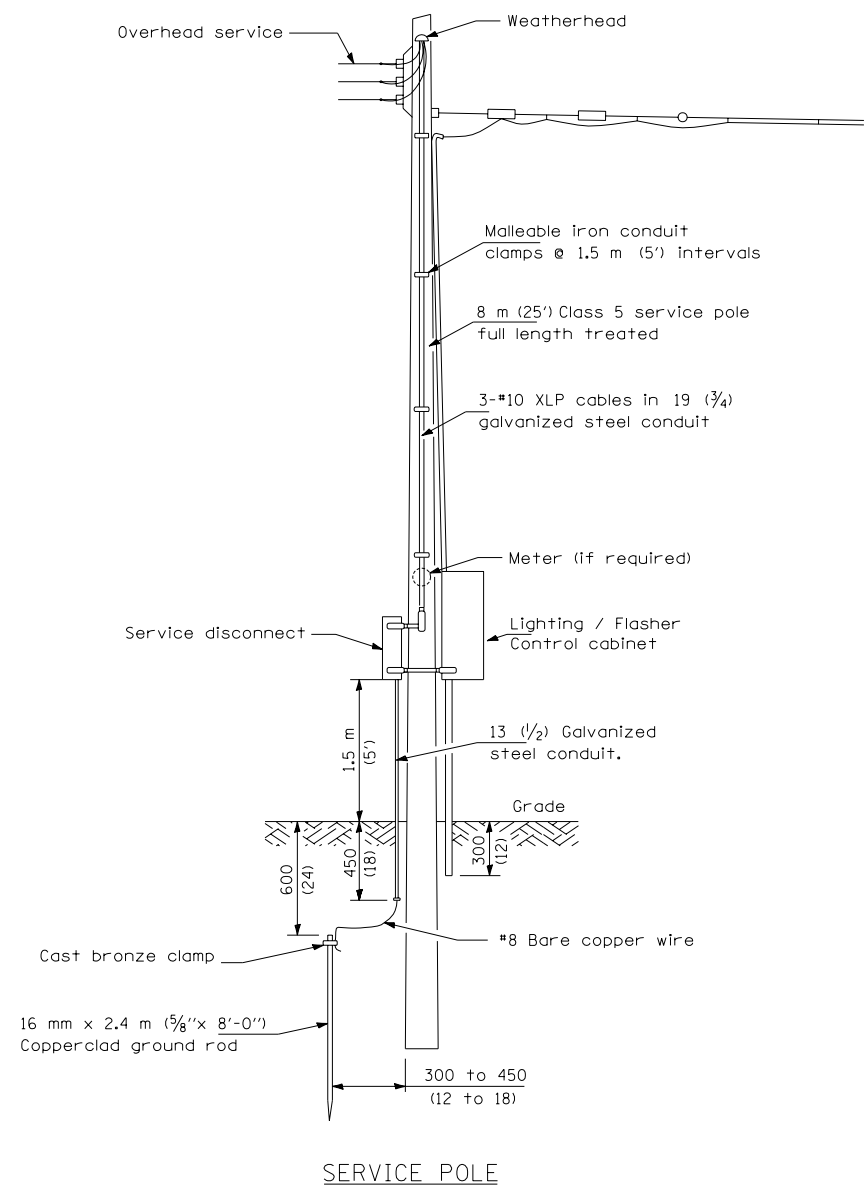

NOTE: Flashing Beacon components shall be installed per standard 880001.

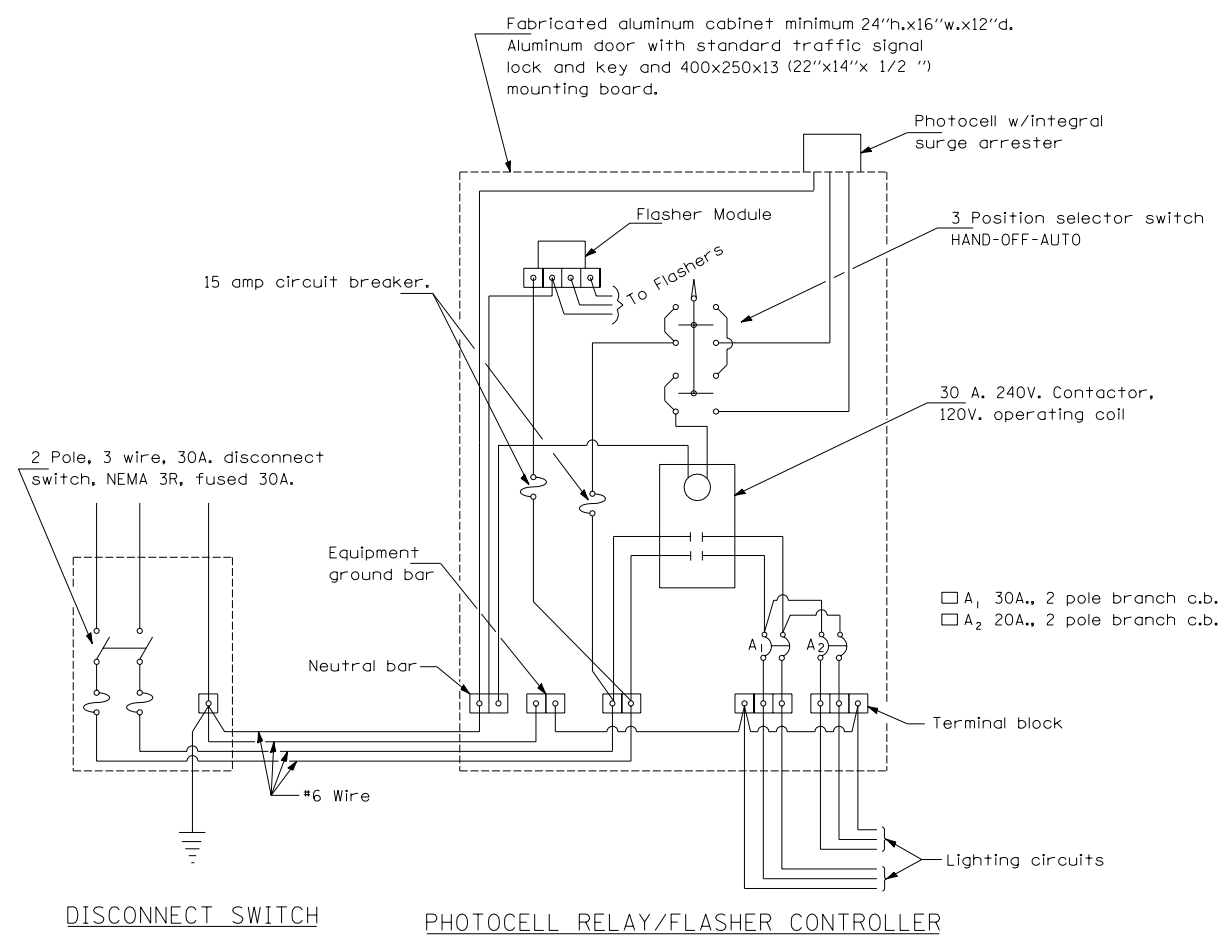

GENERAL NOTES

All equipment shall be U.L. Listed.
All dimensions are in millimeters unless otherwise shown.

**CONTROL INSTALLATION
SERVICE POLE MOUNTED**

120/240V., 1 PHASE, 3 WIRE SERVICE