


F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
559	10-00101-00-LT	COOK	15	5

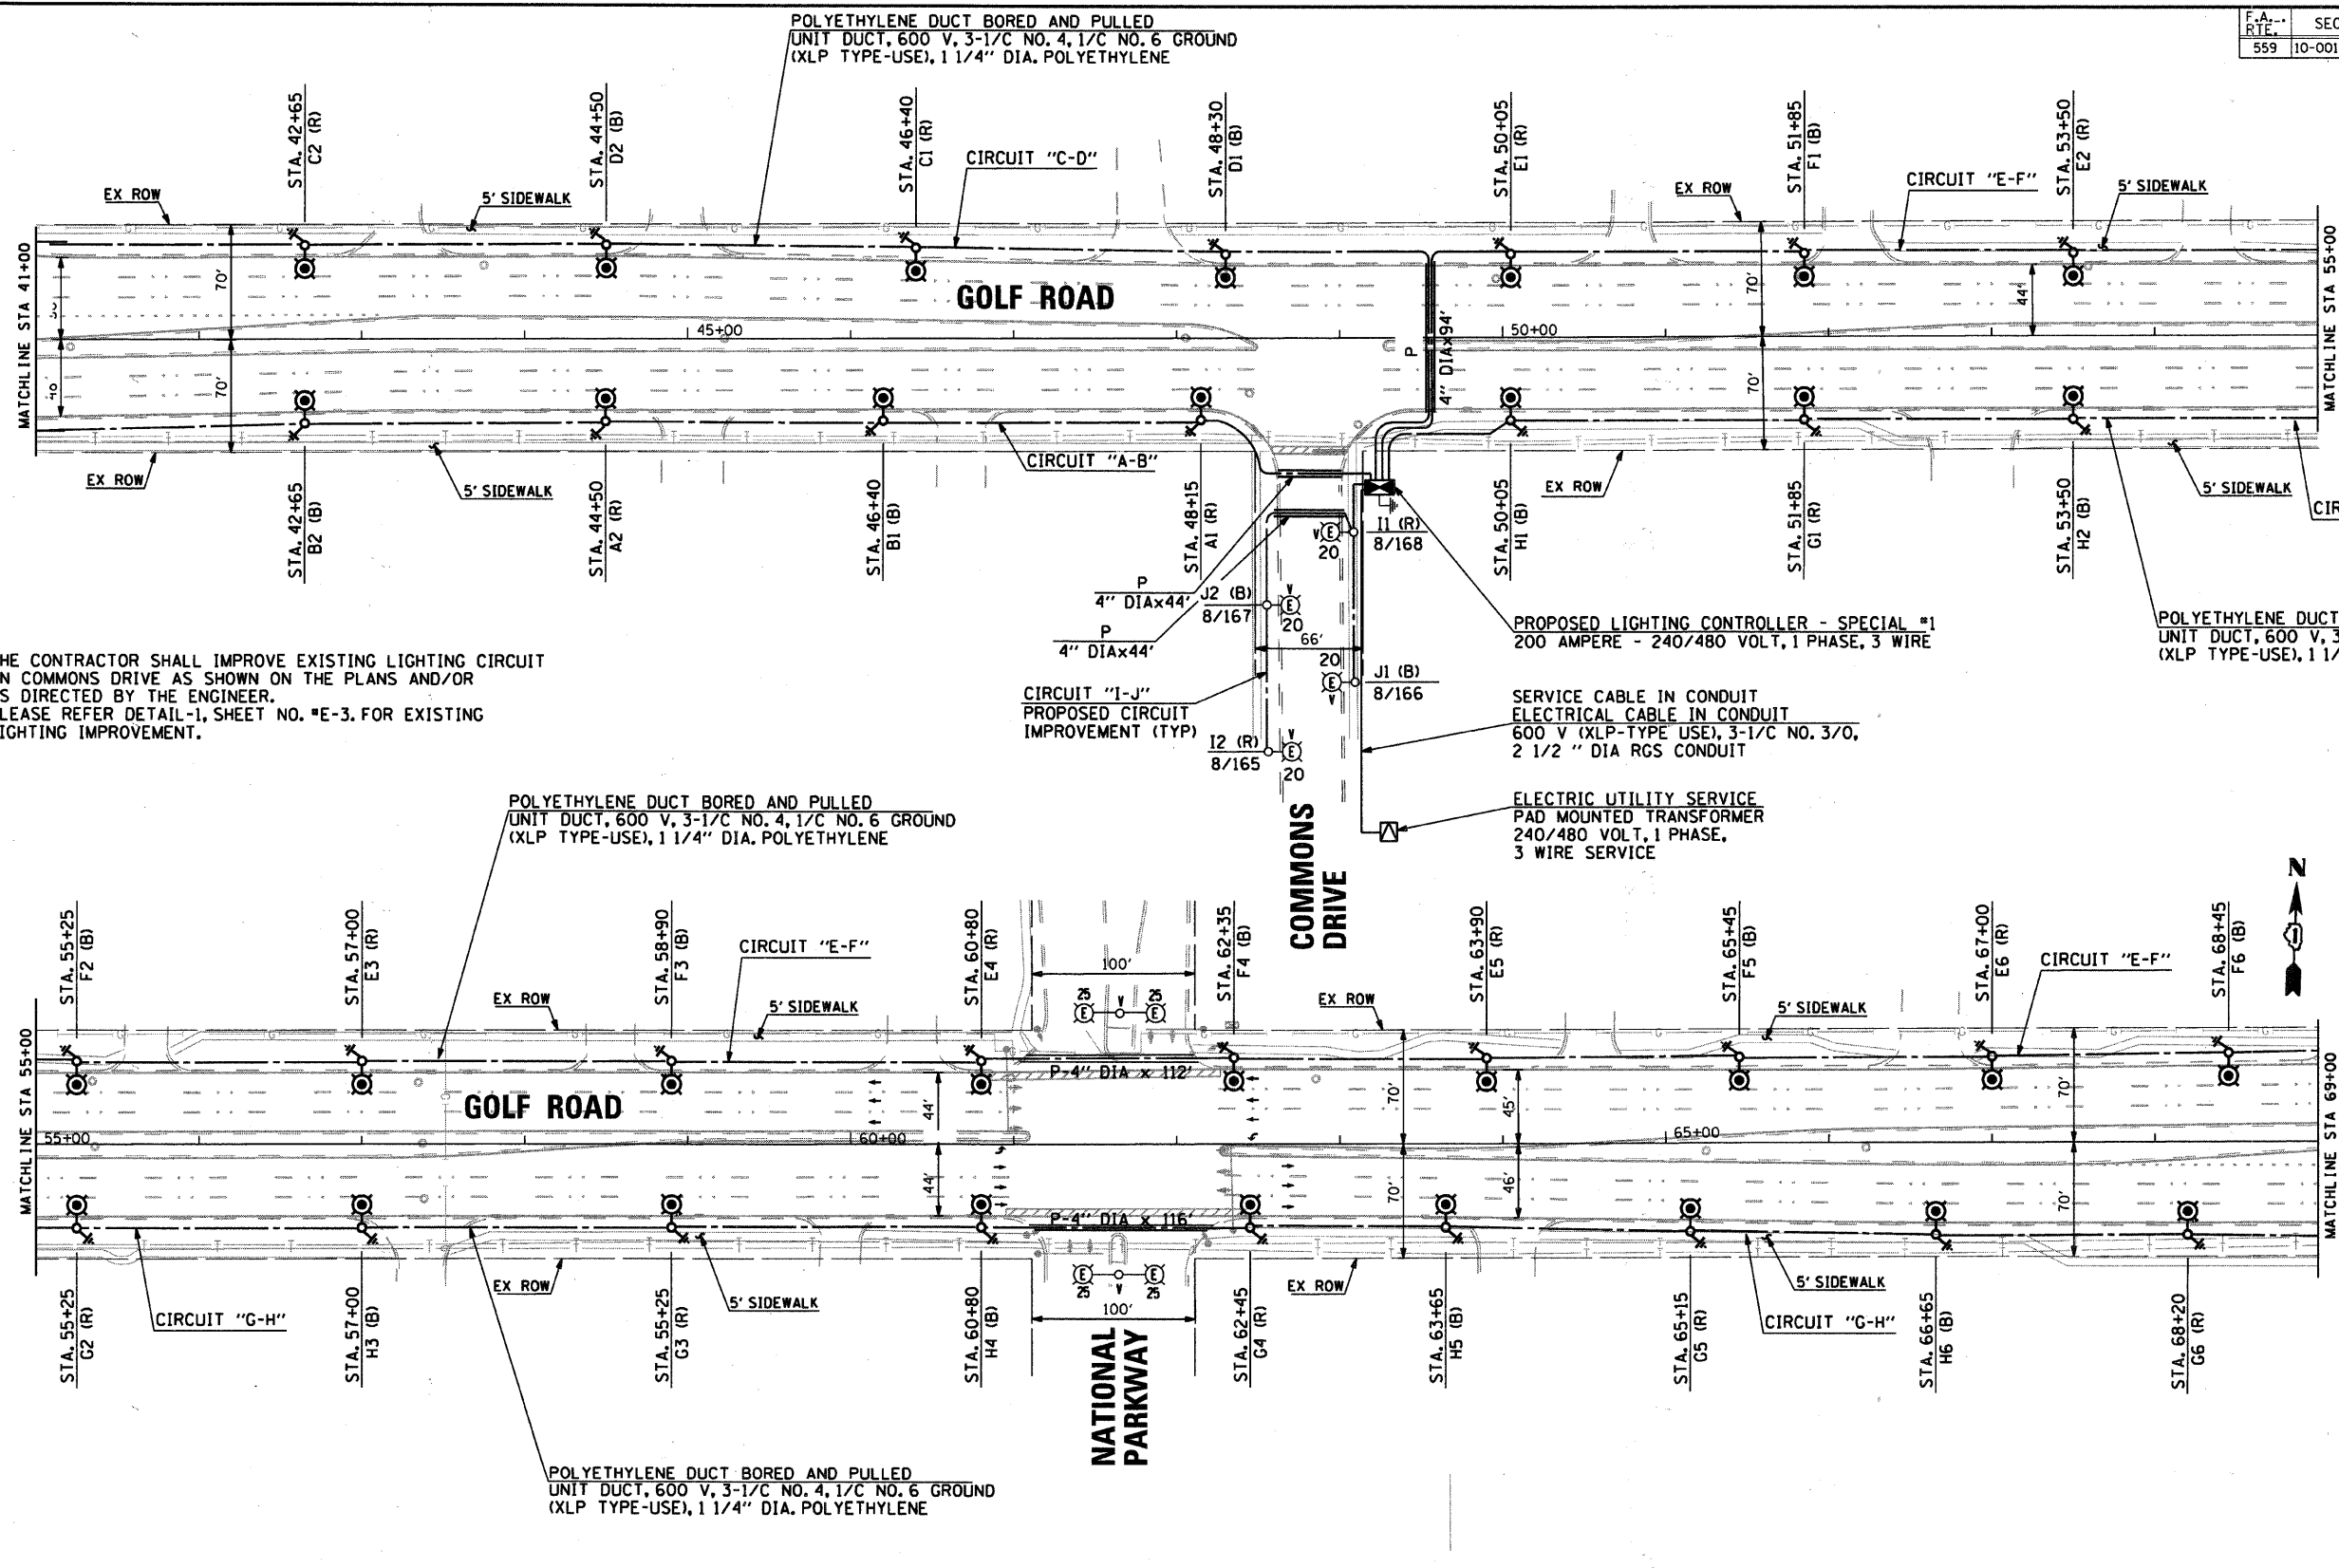

\* THE CONTRACTOR SHALL IMPROVE EXISTING LIGHTING CIRCUIT ON COMMONS DRIVE AS SHOWN ON THE PLANS AND/OR AS DIRECTED BY THE ENGINEER. PLEASE REFER DETAIL-1, SHEET NO. \*E-3. FOR EXISTING LIGHTING IMPROVEMENT.

POLYETHYLENE DUCT BORED AND PULLED UNIT DUCT, 600 V, 3-1/C NO. 4, 1/C NO. 6 GROUND (XLP TYPE-USE), 1 1/4" DIA. POLYETHYLENE

POLYETHYLENE DUCT BORED AND PULLED UNIT DUCT, 600 V, 3-1/C NO. 4, 1/C NO. 6 GROUND (XLP TYPE-USE), 1 1/4" DIA. POLYETHYLENE

3/7/2011

C:\SUNJOY\Projects\Village of Schaumburg\Golf Road\LEC\_3329\_38proposed2.dgn



**Sunjoy Inc.**  
 Area Lighting  
 Consulting Engineers  
 212 TIMBERCREST DRIVE  
 SCHAUMBURG, ILLINOIS  
 60193-1572

REVISIONS	
NAME	DATE
SUNJOY INC.	9/18/10

VILLAGE OF SCHAUMBURG, ILLINOIS  
 DEPARTMENT OF ENGINEERING AND PUBLIC WORKS  
 IL ROUTE 58 (GOLF ROAD) LIGHTING IMPROVEMENTS  
 BASSWOOD ROAD TO I-290 UNDERPASS  
**PROPOSED ROADWAY LIGHTING**  
 STA. 41 + 00 TO STA. 69 + 00

SCALE: 1" = 50'  
 DATE: 10-05-09

DRAWN BY: HKO  
 CHECKED BY: JS

