

**STANDARD BAR SPLICER ASSEMBLY**


| Minimum Lap Lengths    |         |         |         |         |         |
|------------------------|---------|---------|---------|---------|---------|
| Bar size to be spliced | Table 1 | Table 2 | Table 3 | Table 4 | Table 5 |
| 3, 4                   | 1'-5"   | 1'-11"  | 2'-1"   | 2'-4"   | 2'-3"   |
| 5                      | 1'-9"   | 2'-5"   | 2'-7"   | 2'-11"  | 2'-10"  |
| 6                      | 2'-1"   | 2'-11"  | 3'-1"   | 3'-6"   | 3'-4"   |
| 7                      | 2'-9"   | 3'-10"  | 4'-2"   | 4'-8"   | 4'-6"   |
| 8                      | 3'-8"   | 5'-1"   | 5'-5"   | 6'-2"   | 5'-10"  |
| 9                      | 4'-7"   | 6'-5"   | 6'-10"  | 7'-9"   | 7'-5"   |

- Table 1: Black bar, 0.8 Class C
- Table 2: Black bar, Top bar lap, 0.8 Class C
- Table 3: Epoxy bar, 0.8 Class C
- Table 4: Epoxy bar, Top bar lap, 0.8 Class C
- Table 5: Epoxy bar, Top bar lap, Class B

Threaded splicer bar length = min. lap length + 1 1/2" + thread length


\* Epoxy not required on Bar Splicer Assembly components used in conjunction with black bars.

| Location       | Bar size | No. assemblies required | Table for minimum lap length |
|----------------|----------|-------------------------|------------------------------|
| Top of slab    | #4       | 12                      | 3                            |
| Bottom of slab | #5       | 20                      | 3                            |
|                |          |                         |                              |
|                |          |                         |                              |

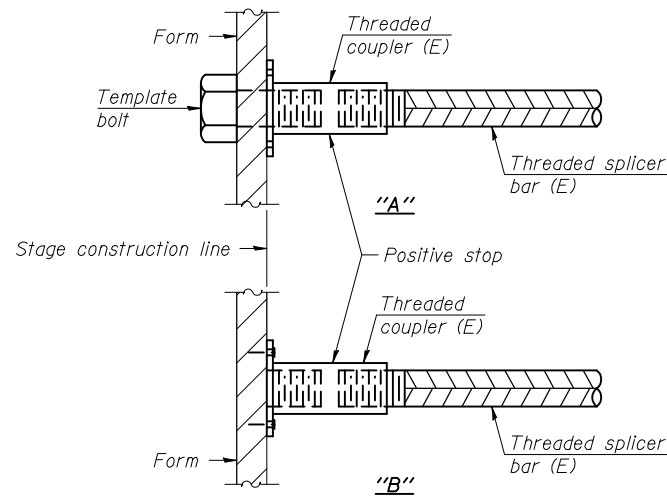


**INSTALLATION AND SETTING METHODS**

"A": Set bar splicer assembly by means of a template bolt.  
 "B": Set bar splicer assembly by nailing to wood forms or cementing to steel forms.  
 (E): Indicates epoxy coating.

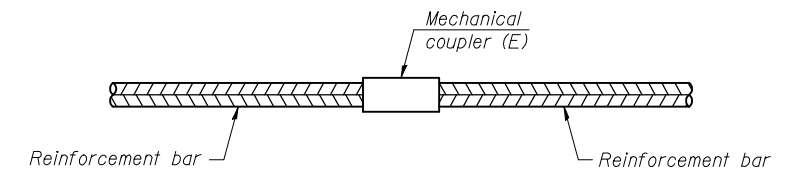


**STANDARD MECHANICAL SPLICER**

| Location | Bar size | No. assemblies required |
|----------|----------|-------------------------|
|          |          |                         |
|          |          |                         |
|          |          |                         |
|          |          |                         |

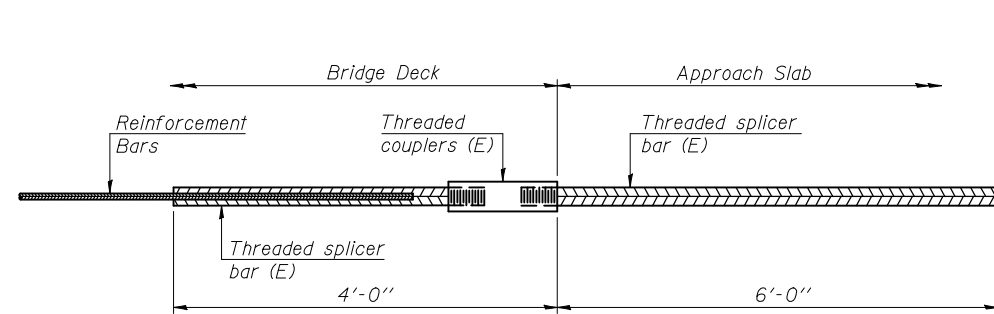

**BAR SPLICER ASSEMBLY FOR #5 BAR ON INTEGRAL OR SEMI-INTEGRAL ABUTMENTS**

No. required =

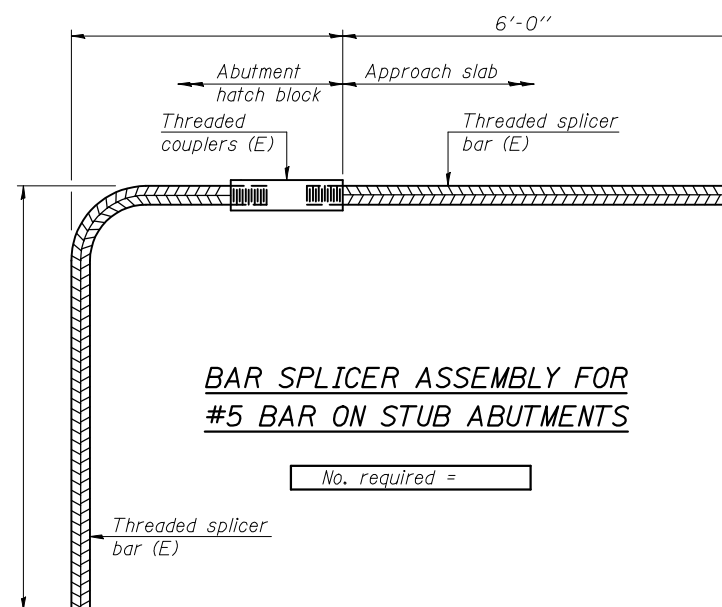

**BAR SPLICER ASSEMBLY FOR #5 BAR ON STUB ABUTMENTS**

No. required =

**NOTES**

Splicer bars shall be deformed with threaded ends and have a minimum 60 ksi yield strength.  
 All reinforcement shall be lapped and tied to the splicer bars.  
 Bar splicer assemblies shall be epoxy coated according to the requirements for reinforcement bars. See Section 508 of the Standard Specifications.  
 See special provision for Mechanical Splicers.  
 See approved list of bar splicer assemblies and mechanical splicers for alternatives.

BSD-1

7-1-10

|                        |          |  |
|------------------------|----------|--|
| DESIGNED <i>DAB</i>    | EXAMINED | DATE - MARCH 14, 2011                      |
| CHECKED <i>VHV</i>     | PASSED   | <br>ACTING ENGINEER OF STRUCTURAL SERVICES |
| DRAWN <i>baliva</i>    |          |  |
| CHECKED <i>DAB VHV</i> |          |  |

**STATE OF ILLINOIS  
DEPARTMENT OF TRANSPORTATION**

**BAR SPLICER ASSEMBLY AND MECHANICAL SPLICER DETAILS  
LOCATION 2  
SN 020-8034**

|                    |                             |        |                           |           |
|--------------------|-----------------------------|--------|---------------------------|-----------|
| F.A.P. RTE.        | SECTION                     | COUNTY | TOTAL SHEETS              | SHEET NO. |
| 760                | POSTING MITIGATION FY2011-1 | DEWITT | 23                        | 13        |
| CONTRACT NO. 70894 |                             |        | ILLINOIS FED. AID PROJECT |           |