


TYPICAL SIDEWALK REPLACEMENT DETAIL


(NOT TO SCALE)

NOTES:

1. USE 1/2" PREMOULDED JOINT FILLER AT SIDEWALK AND STRUCTURE INTERFACES. SIDEWALK SHALL CONFORM TO SECTION 424 - PORTLAND CEMENT CONCRETE SIDEWALK OF THE ILLINOIS STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.
2. REQUIRED MIN. COMPRESSIVE STRENGTH OF CONC. = 3500 PSI @ 14 DAYS
3. CONTRACTOR MUST SAWCUT EXISTING SIDEWALK AT EXISTING TOOL JOINT

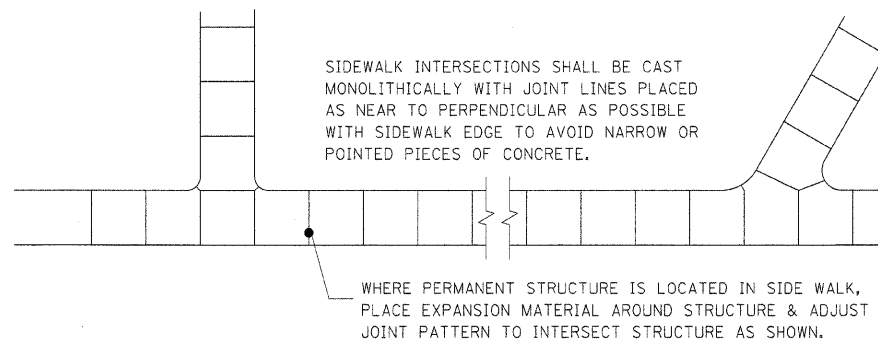


TYPICAL SIDEWALK JOINT LAYOUT

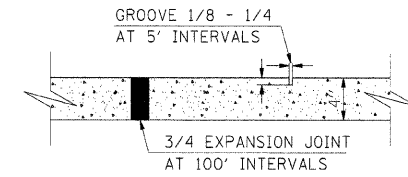

TYPICAL SIDEWALK JOINT DETAIL

APPLIES TO NEW SIDEWALK & SIDEWALK REPLACEMENT

NOTE:
ONE-HALF INCH EXPANSION JOINT TO BE PLACED BETWEEN THE SIDEWALK AND ANY STRUCTURE, DRIVEWAY, CURB & GUTTER, ETC.

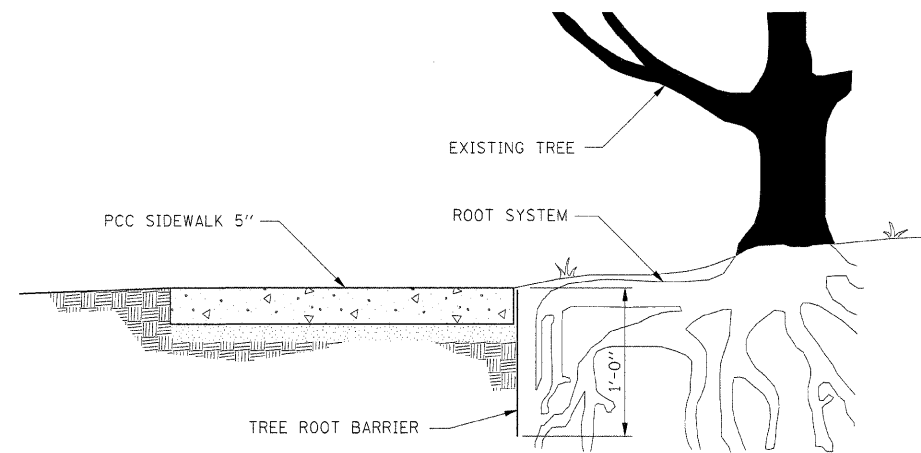

ROOT BARRIER DETAIL

(SEE SCHEDULE OF QUANTITIES FOR LOCATIONS)

FILE NAME =	USER NAME = IE Consultants	DESIGNED -	REVISED -	VILLAGE OF SHERMAN	SIDEWALK DETAILS				F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
G:\507009-01\cadd\2010\7009-01.Detail\01.S		DRAWN -	REVISED -						08-00014-00-SW	SANGAMON	26	8	
PLOT SCALE = 10.0000' / 1"		CHECKED -	REVISED -		SCALE: SHEET NO. OF SHEETS STA. TO STA.				FED. ROAD DIST. NO.	ILLINOIS FED. AID PROJECT	CONTRACT NO. 93486		
PLOT DATE = 2/14/2011		DATE -	REVISED -										