


NOTES:

- 1. HEAVY DUTY 60 AMP, 600 VAC, 2 POLE OR 3 POLE WITH S/N & GND, NON-FUSIBLE SAFETY SWITCH IN A NEMA 3R & 12 ENCLOSURE, SQUARE D CLASS 3110, CAT. NO. HU362AWK WITH SNO610 & GTK0610, OR APPROVED EQUAL. INSTALL AT PLASI. NOTE 60 AMP SAFETY SWITCH REQUIRED TO ACCOMMODATE 4 AWG CONDUCTORS FOR LUG TERMINATIONS & WIRE BENDING SPACE. INCLUDE LEGEND PLATE. SEE "LEGEND PLATE SCHEDULES" FOR INFORMATION.

2 #3 THWN, 1 #3 NEUTRAL,
1 #8 GND IN 3" GRSC FROM
VAULT PANEL "A"

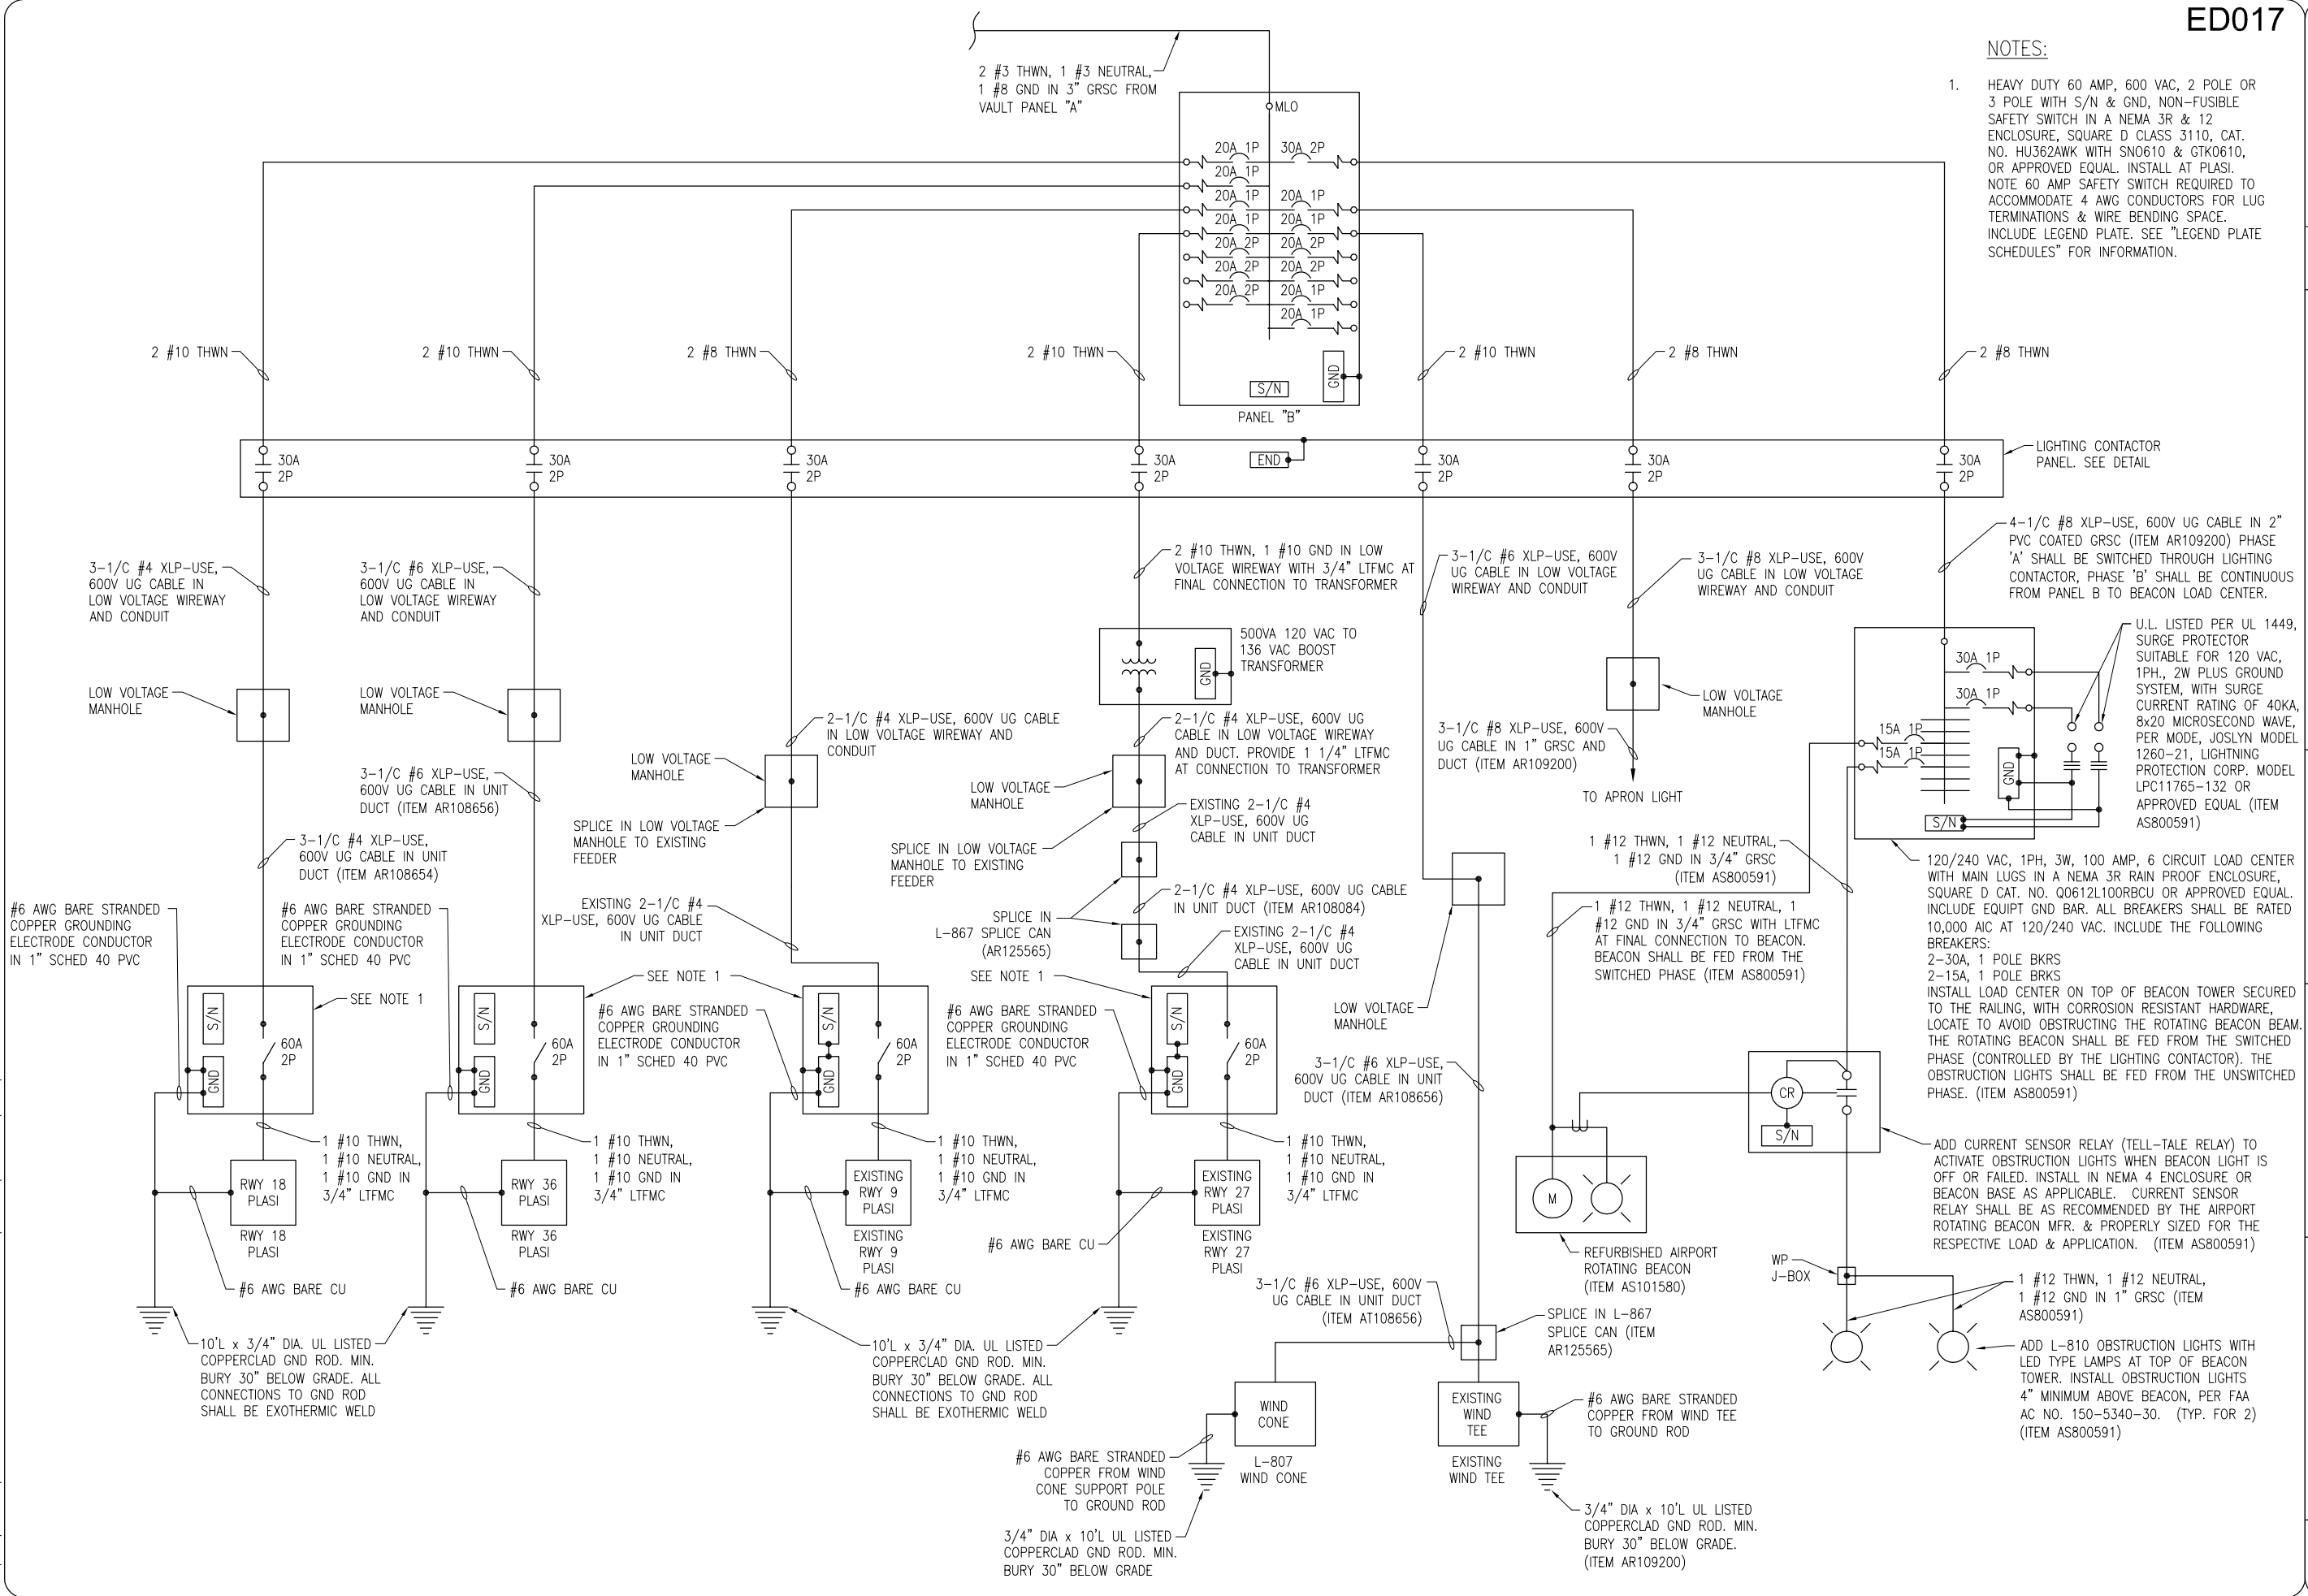

REVISION	DATE

EDGAR COUNTY AIRPORT
PARIS, ILLINOIS

A.I.P. PROJ.: 3-17-0077-B13

IL PROJ.: PRG-4018

Hanson Proj. No. 10A00553	File Name: E-602.DWG	Scale: NONE	Date: 03/10/11
LAYOUT	DRAWN	RSS	MAM
REVIEWED			



CONSTRUCT CROSSWIND
RUNWAY 18-36

PROPOSED AIRPORT VAULT
ONE-LINE DIAGRAM (SHEET 2)

MAR 11, 2011 10:16 AM MMRANDE
P:\ELEC PROJECTS\2011\4100-000 EDGAR COUNTY ELECTRICAL VAULT DRAWINGS\PRODUCTION\PLANS\E-602.DWG