

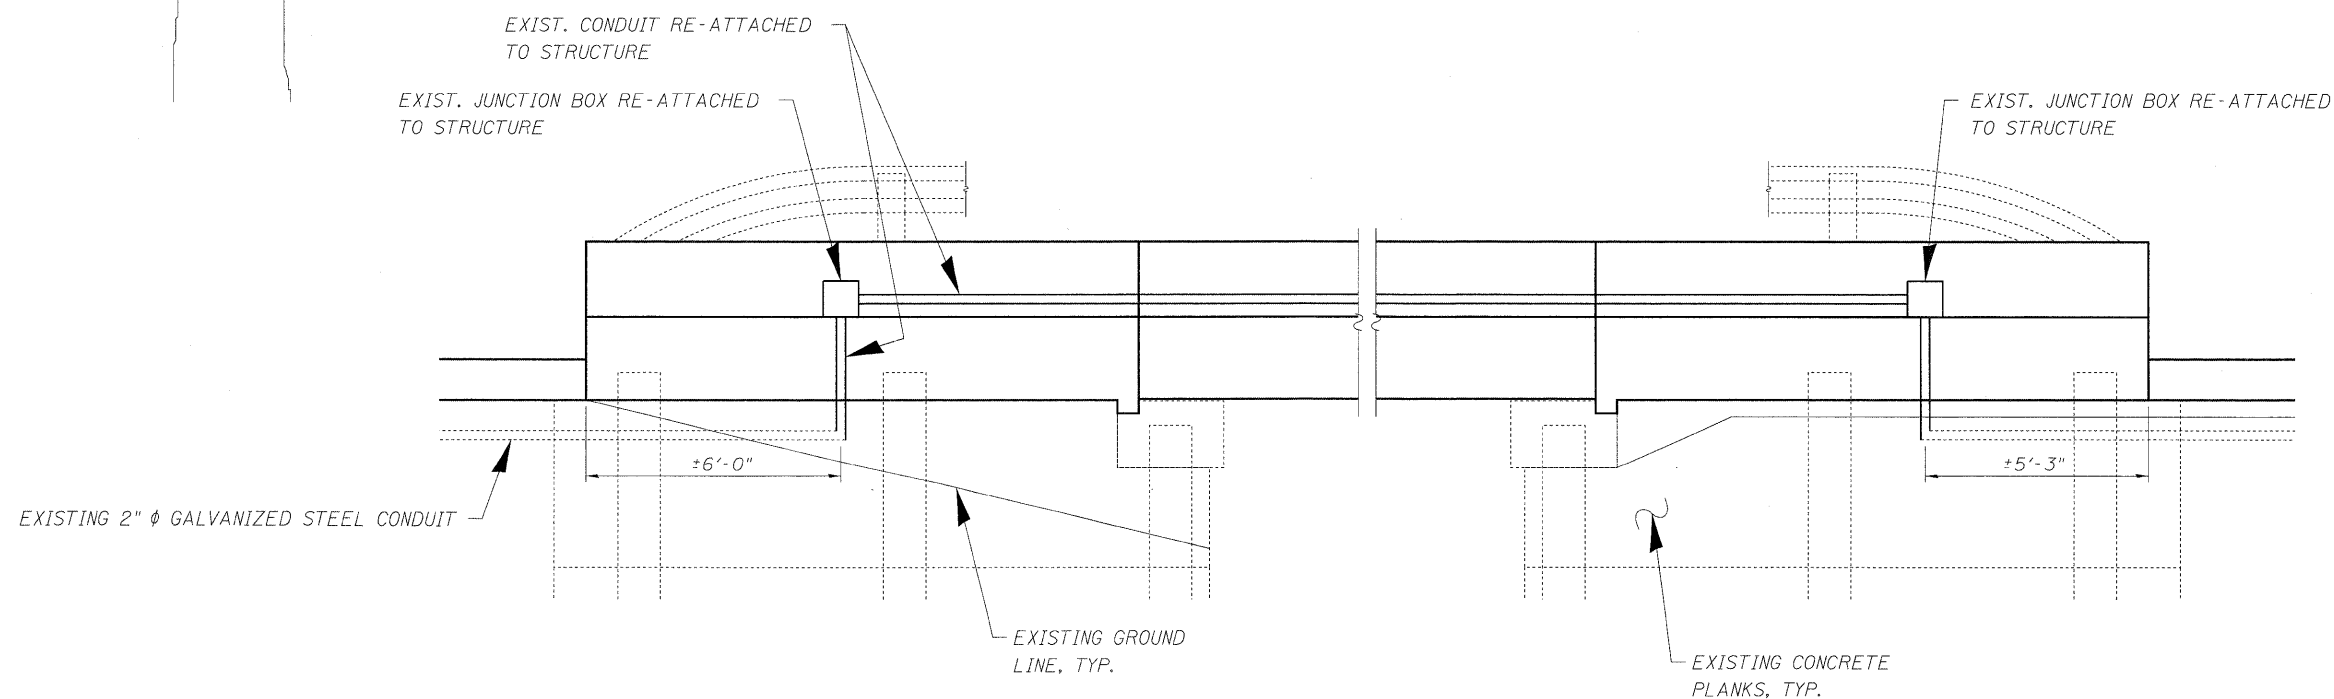




**NOTES**

1. REMOVE EXISTING CONDUIT & EXISTING JUNCTION BOXES FROM THE EXISTING PARAPET WALL, AND MAINTAIN EXISTING ELECTRIC SERVICE DURING THE INSTALLATION OF THE BRIDGE SCOPE OF WORK. AFTER THE BRIDGE WORK IS COMPLETE, THE CONTRACTOR SHALL RE-ATTACH THE EXISTING SYSTEM TO THE NEW PARAPET WALL. COST SHALL BE INCLUDED IN REMOVE EXISTING CONDUIT ATTACHED TO STRUCTURE AND REMOVE EXISTING JUNCTION BOX. THE PAY ITEMS FOR CONDUIT ATTACHED TO STRUCTURE, 2" DIA., GALVANIZED STEEL AND JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 12"x12"x6" ARE TO BE USED ONLY IF THE ENGINEER DETERMINES THAT REPLACEMENT ITEMS ARE NECESSARY.

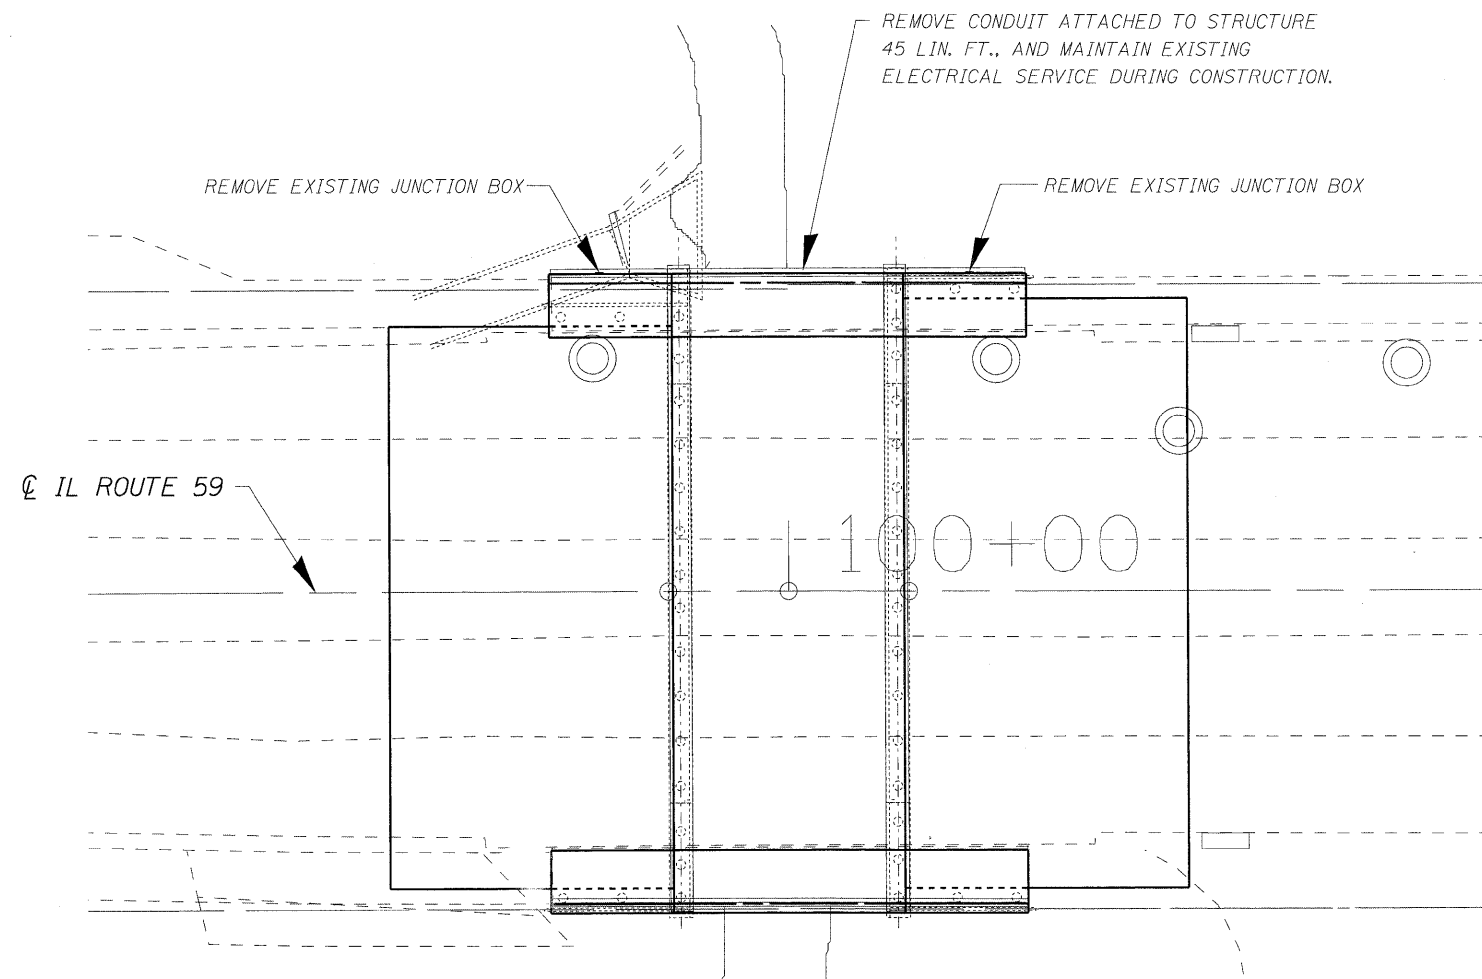

**LOWCO, INC.**  
CONSULTING ENGINEERS  
1560 WALK ST., SUITE 222  
NAPERVILLE, ILLINOIS 60563 PH: (630) 577-9100

DESIGNED - MJY	REVISED -
DRAWN - SLV	REVISED -
CHECKED - MJY	REVISED -
DATE - 03/26/2010	REVISED -

**STATE OF ILLINOIS  
DEPARTMENT OF TRANSPORTATION**

**ELECTRICAL PLAN  
IL ROUTE 59 OVER FLINT CREEK TRIBUTARY**

SCALE: 1" = 30' SHEET NO. 1 OF 1 SHEETS STA. 98+00 TO STA. 101+60

F.A.P. RTE. 338	SECTION 108 B-1	COUNTY LAKE	TOTAL SHEETS 40	SHEET NO. 12
D-91-289-09		CONTRACT NO. 60F92		
FED. ROAD DIST. NO.		ILLINOIS FED. AID PROJECT		