



SLOPE STEPS DETAIL
TYPICAL CROSS-SECTION EMBANKMENT
CONSTRUCTION ON SIDEHILL

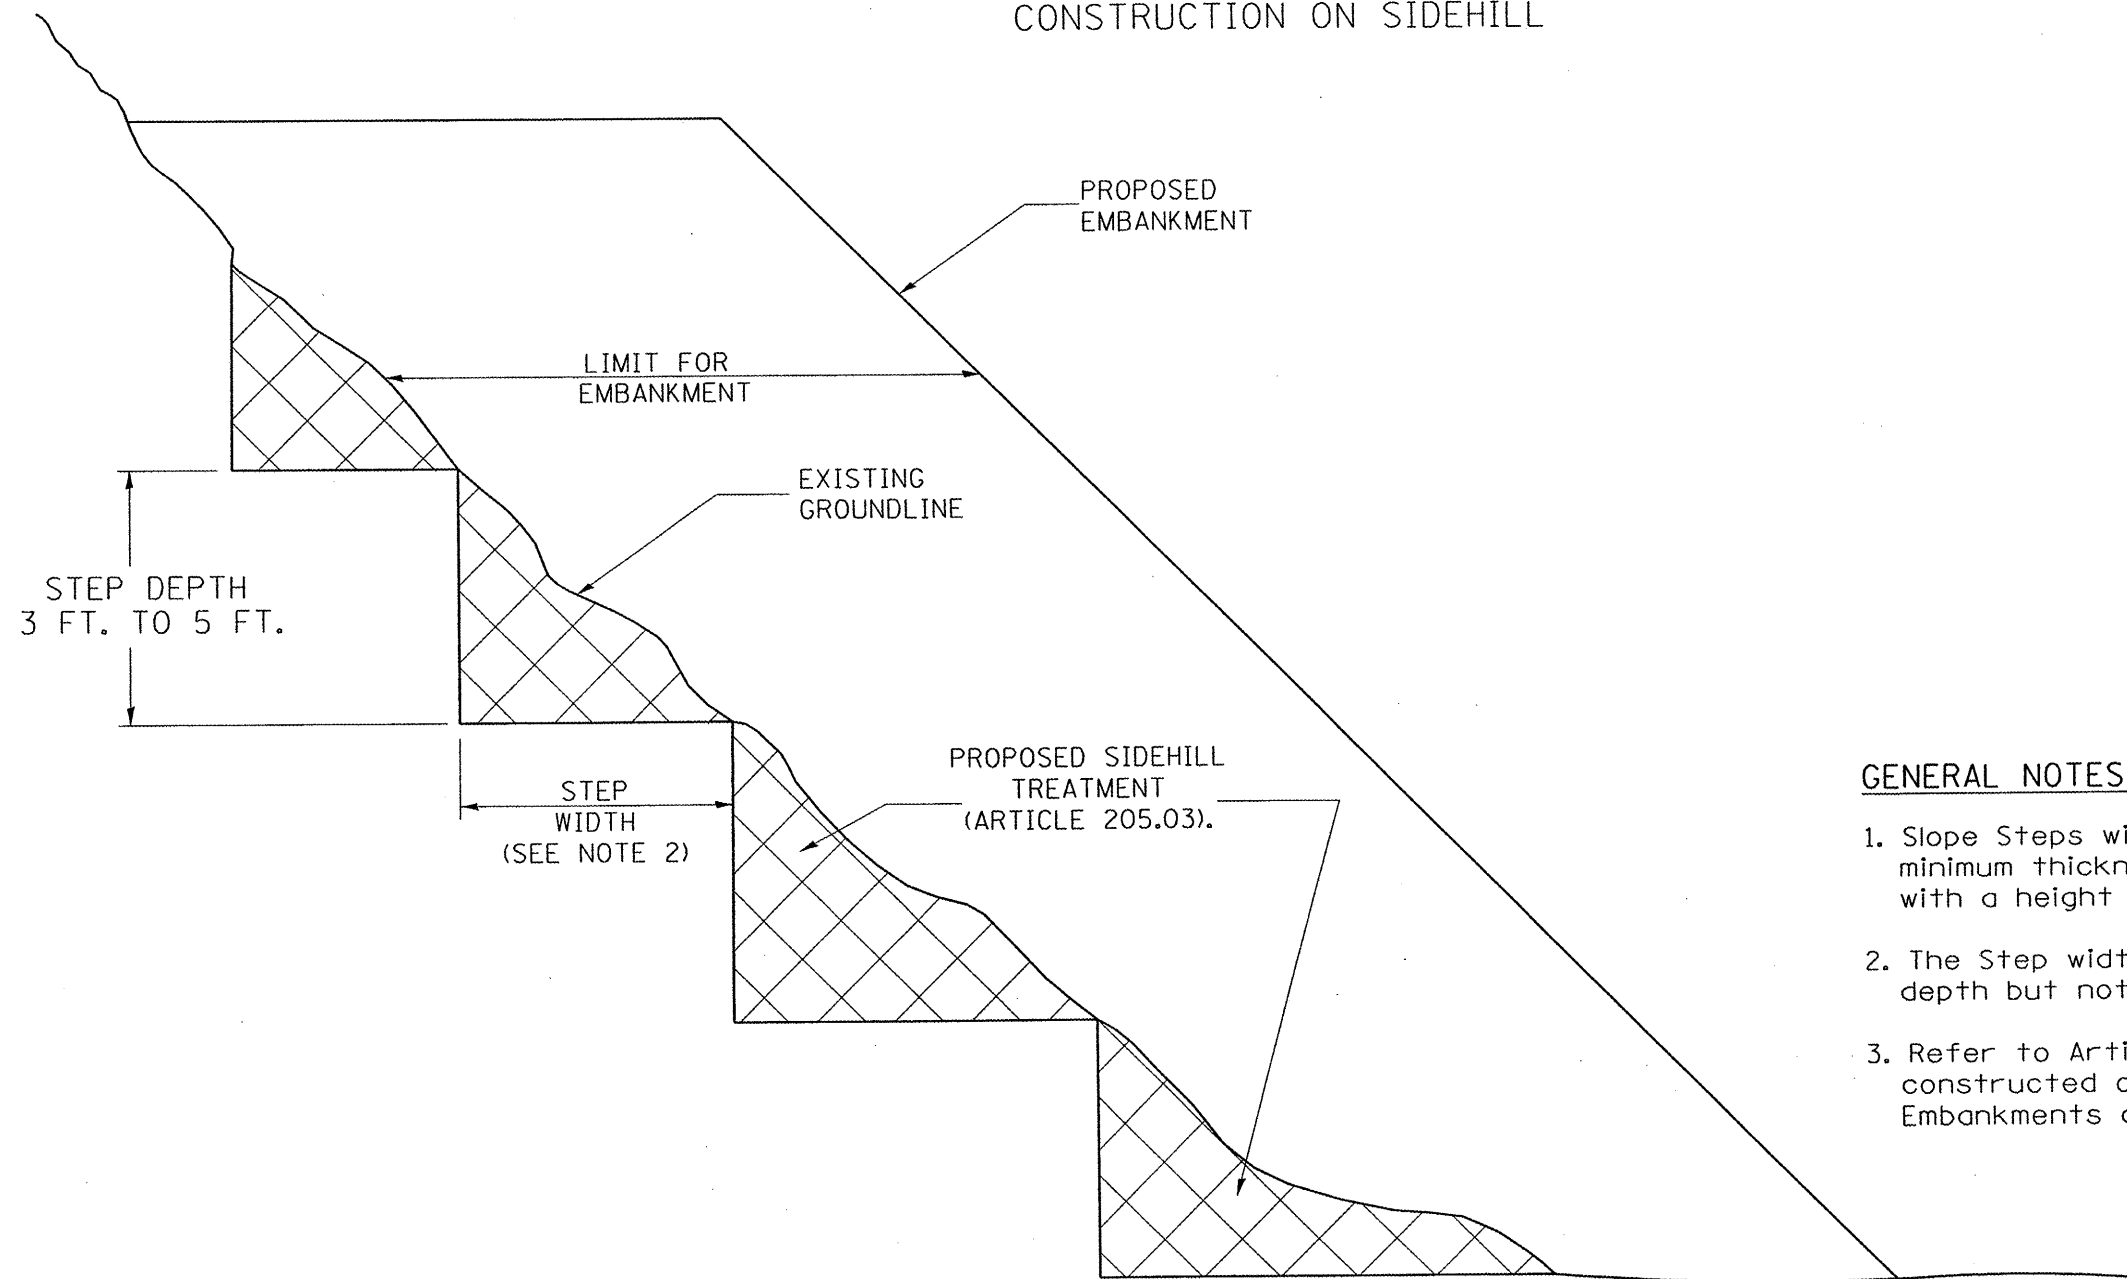

GENERAL NOTES:

1. Slope Steps will be required for all 300(12) minimum thickness "silver fills" and on a fills with a height of 3.0m(10').
2. The Step width shall be twice the Step depth but not less than 6 feet.
3. Refer to Article 205.03 for Embankment to be constructed on Hillside or Slopes, or if existing Embankments are to be widened.

REPLACEMENT MATERIAL:



STANDARD EMBANKMENT
(IN ACCORDANCE WITH
205 OF THE STANDARD SPECIFACATION).

All dimensions are in millimeters
(inches) unless otherwise noted.



FILE NAME =
#FILE#

PLOT SCALE = #SCALE#
PLOT DATE = #DATE#
PLOT TIME = #TIME#

DESIGNED - RAW
DRAWN - RAW
CHECKED - RJA
DATE -

REVISED -
REVISED -
REVISED -
REVISED -

SPECIAL DETAILS
SLOPE STEPS DETAIL

NO SCALE CADD STD 205001-D4

| F.A.U. RTE. | SECTION | COUNTY | TOTAL SHEETS | SHEET NO. |
|---|----------------|----------|--------------------|-----------|
| 6775 | 04-00141-00-FP | TAZEWELL | 187 | 100 |
| FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT | | | CONTRACT NO. 89352 | |