



METAL SHELL PILE TABLE

Designation and outside diameter	Wall thickness t	Weight per foot (Lbs./ft.)	Inside volume (yd. ³ /ft.)
PP12	0.179''	22.60	0.0274
PP12 ·	0.250′′	31.37	0.0267
PP14	0.250''	36.71	0.0368
PP14	0.312''	45.61	0.0361



END PLATE ATTACHMENT




When called for on the plans, the Contractor shall furnish metal shell pile shoes consisting of a single piece conical pile point as shown. The pile shoes shall be cast in one piece steel according to either ASTM A 148 Grade 90-60 or AASHTO M 103 Grade 65-35 and shall provide full bearing over the full circumference of the metal shell pile. The pile shoe shall have tapered leads to assure proper alignment and fitting and shall be secured to the pile with a circumferential weld.


METAL SHELL PILE SHOE ATTACHMENT

(See Note A)

			i
DESIGNED	-	A.S.L.	
CHECKED		S.W.M.	1
DRAWN	-	D.A.B.	
			1
CHECKED		D.T.M.]
E NC			
F-MS			10-1-0

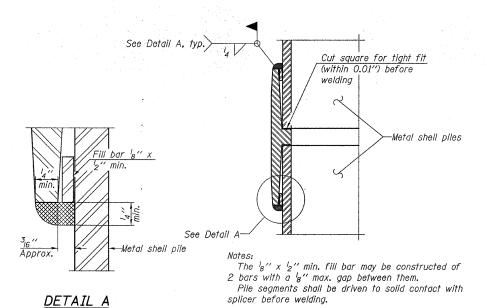


WELDED COMMERCIAL SPLICE

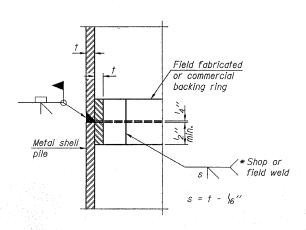


COMPLETE PENETRATION WELD SPLICE


* Field fabricated backing ring may be made from pile shell by removing segment to allow reducing circumference and vertically rejoin with partial joint penetration weld.

The metal shell piles shall be according to ASTM A 252 Grade 3.

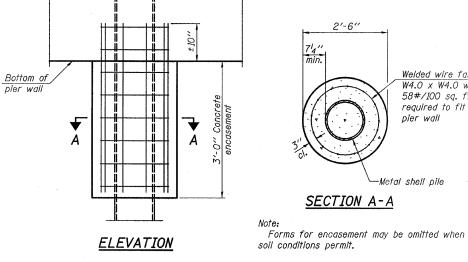



CONCRETE ENCASEMENT AT PIERS

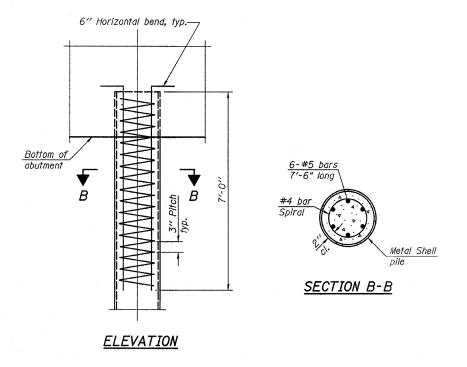

METAL SHELL REINFORCEMENT AT ABUTMENTS

METAL SHELL PILE DETAILS STRUCTURE NO. 097-3265



SHEET	NO. 7
9 SHE	NO.7 EETS

7	T.R.	SECT	TION		COUNTY	TOTAL SHEETS	SHEET NO.
	269 07-03119-00-BR			WHITE	12	10	
•	EMMA ROAD DISTRICT			CONTRACT NO. 99370			
	FED. RO	DAD DIST. NO.	ILLINOIS	FED. A	ID PROJECT BROS	-193(35)	