


CONSTRUCTION PLANS - ISSUED APRIL 16, 2021

REHABILITATE RUNWAY 17-35 PAVEMENT & LIGHTING

ST. LOUIS REGIONAL AIRPORT AUTHORITY  
ST. LOUIS REGIONAL AIRPORT (ALN)  
EAST ALTON, MADISON COUNTY, ILLINOIS

IDA PROJECT NO. : ALN-4812  
SBG PROJECT NO. : 3-17-SBGP-TBD

LOCATION MAP

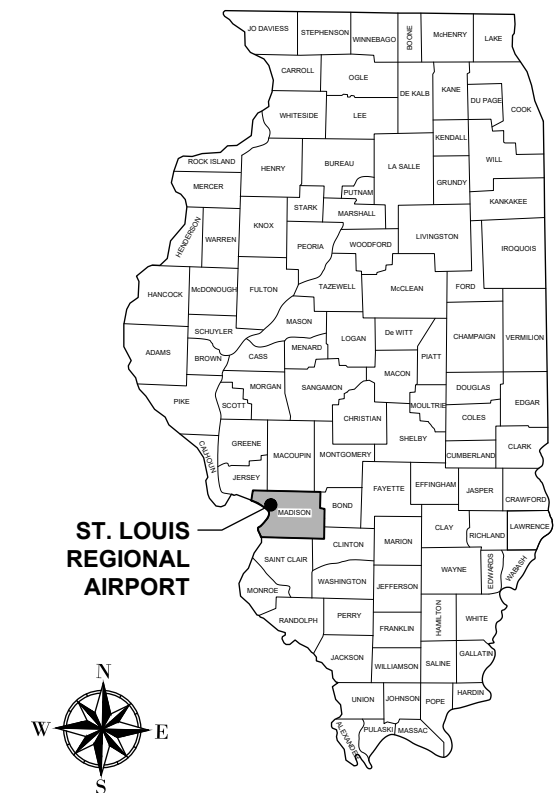

VICINITY MAP



GENERAL PROJECT LOCATION

SCOPE OF WORK:

THIS PROJECT CONSISTS OF A REHABILITATION OF THE RUNWAY 17-35 PAVEMENT AND LIGHTING. THIS PROJECT WILL INCLUDE BITUMINOUS PAVING, PAVEMENT GROOVING, SHOULDER ADJUSTMENT, REMOVAL AND INSTALLATION OF AIRFIELD LIGHTING AND SIGNS, PAVEMENT MARKING, EROSION CONTROL ITEMS AND INCIDENTALS.

NOTICE TO CONTRACTORS AND BIDDERS

THESE CONSTRUCTION PLANS RELY UPON THE SPECIAL PROVISIONS AND THE SPECIFICATIONS TO PROVIDE FOR A COMPLETE DESCRIPTION OF THE WORK AND CONSTRUCTION REQUIREMENTS. THE PLANS SHALL ONLY BE USED IN COMBINATION WITH ALL CONTRACT DOCUMENTS.

APR 20, 2021 1:31 PM ST.LOJL201547  
I:\17\0BS\17A0086504\CAD\AIRPORT\SHHEETIG-001-C\VR

No.	Issue/Description	Sheets Changed	Date	By

EXP. 11/30/2021

*Kevin N. Lightfoot*  
Kevin N. Lightfoot, P.E.  
Electrical Engineer

04/16/2021  
Date

**HANSON**  
HANSON PROFESSIONAL SERVICES INC.  
1525 South Sixth Street  
Springfield, Illinois 62703-2886  
Telephone: 217.788.2450  
Fax: 217.788.2503

EXP. 11/30/2021

*Jaycen R. Herndon*  
Jaycen R. Herndon, P.E.  
Civil Engineer

04/16/2021  
Date

**St. Louis Regional Airport**  
ST. LOUIS REGIONAL AIRPORT AUTHORITY  
8 Terminal Drive  
East Alton, Illinois 62024  
Telephone: 618.259.2531  
Fax: 618.259.7669

*David C. Miller*  
David C. Miller  
Director of Aviation


4/14/2021  
Date









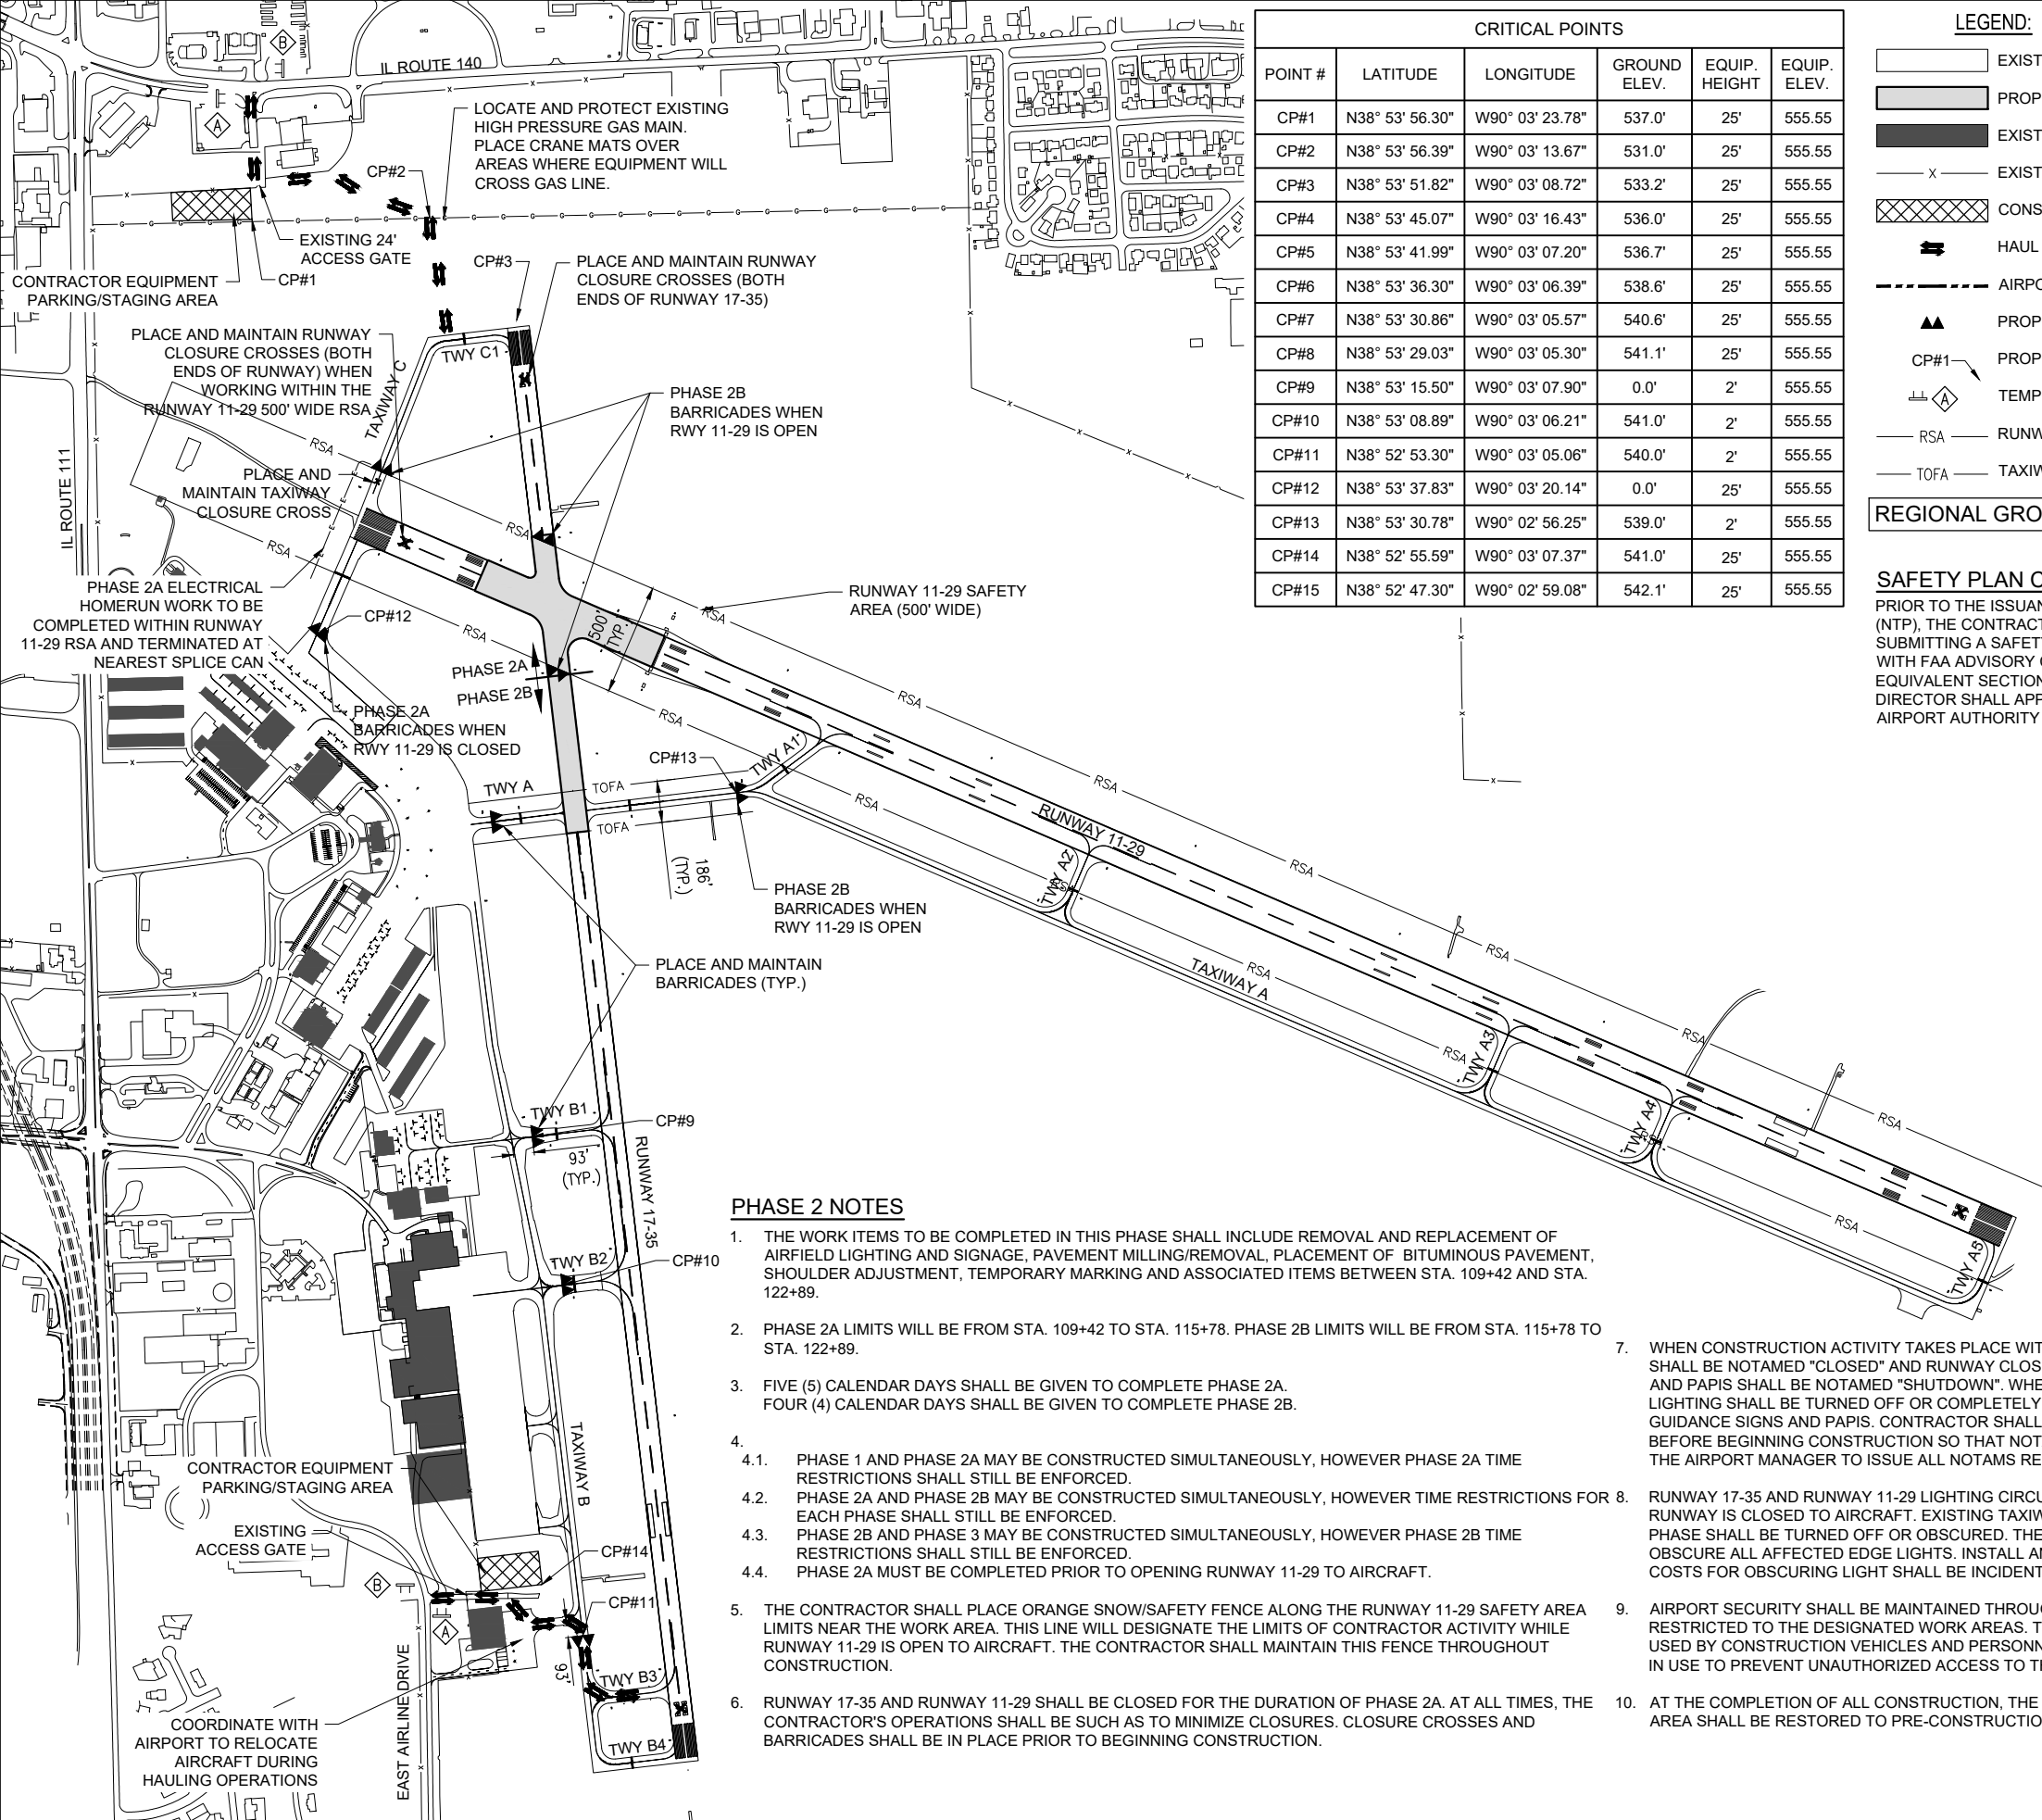


CRITICAL POINTS					
POINT #	LATITUDE	LONGITUDE	GROUND ELEV.	EQUIP. HEIGHT	EQUIP. ELEV.
CP#1	N38° 53' 56.30"	W90° 03' 23.78"	537.0'	25'	555.55
CP#2	N38° 53' 56.39"	W90° 03' 13.67"	531.0'	25'	555.55
CP#3	N38° 53' 51.82"	W90° 03' 08.72"	533.2'	25'	555.55
CP#4	N38° 53' 45.07"	W90° 03' 16.43"	536.0'	25'	555.55
CP#5	N38° 53' 41.99"	W90° 03' 07.20"	536.7'	25'	555.55
CP#6	N38° 53' 36.30"	W90° 03' 06.39"	538.6'	25'	555.55
CP#7	N38° 53' 30.86"	W90° 03' 05.57"	540.6'	25'	555.55
CP#8	N38° 53' 29.03"	W90° 03' 05.30"	541.1'	25'	555.55
CP#9	N38° 53' 15.50"	W90° 03' 07.90"	0.0'	2'	555.55
CP#10	N38° 53' 08.89"	W90° 03' 06.21"	541.0'	2'	555.55
CP#11	N38° 52' 53.30"	W90° 03' 05.06"	540.0'	2'	555.55
CP#12	N38° 53' 37.83"	W90° 03' 20.14"	0.0'	25'	555.55
CP#13	N38° 53' 30.78"	W90° 02' 56.25"	539.0'	2'	555.55
CP#14	N38° 52' 55.59"	W90° 03' 07.37"	541.0'	25'	555.55
CP#15	N38° 52' 47.30"	W90° 02' 59.08"	542.1'	25'	555.55

**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- EXISTING BUILDINGS
- EXISTING FENCE
- CONSTRUCTION STAGING AREA
- HAUL ROUTE
- AIRPORT PROPERTY LINE
- PROPOSED BARRICADES
- PROPOSED CRITICAL POINTS
- TEMPORARY CONSTRUCTION SIGN
- RUNWAY SAFETY AREA (500' WIDE)
- TAXIWAY OBJECT FREE AREA (186' WIDE)

REGIONAL GROUND FREQUENCY = 120.20

**SAFETY PLAN COMPLIANCE DOCUMENT**  
 PRIOR TO THE ISSUANCE OF A CONSTRUCTION NOTICE-TO-PROCEED (NTP), THE CONTRACTOR SHALL BE RESPONSIBLE FOR PREPARING AND SUBMITTING A SAFETY PLAN COMPLIANCE DOCUMENT IN ACCORDANCE WITH FAA ADVISORY CIRCULAR 150/5370-2G, PARAGRAPH 2.4.2, OR EQUIVALENT SECTION IN SUBSEQUENT/CURRENT ISSUE. THE AIRPORT DIRECTOR SHALL APPROVE THIS DOCUMENT AND SUBMIT TO THE AIRPORT AUTHORITY FOR APPROVAL PRIOR TO THE NTP ISSUANCE.

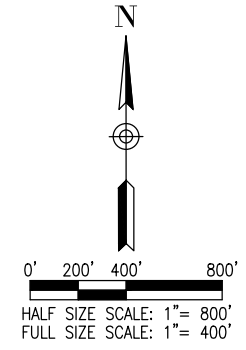

**PHASE 2 NOTES**

1. THE WORK ITEMS TO BE COMPLETED IN THIS PHASE SHALL INCLUDE REMOVAL AND REPLACEMENT OF AIRFIELD LIGHTING AND SIGNAGE, PAVEMENT MILLING/REMOVAL, PLACEMENT OF BITUMINOUS PAVEMENT, SHOULDER ADJUSTMENT, TEMPORARY MARKING AND ASSOCIATED ITEMS BETWEEN STA. 109+42 AND STA. 122+89.
2. PHASE 2A LIMITS WILL BE FROM STA. 109+42 TO STA. 115+78. PHASE 2B LIMITS WILL BE FROM STA. 115+78 TO STA. 122+89.
3. FIVE (5) CALENDAR DAYS SHALL BE GIVEN TO COMPLETE PHASE 2A. FOUR (4) CALENDAR DAYS SHALL BE GIVEN TO COMPLETE PHASE 2B.
4.
  - 4.1. PHASE 1 AND PHASE 2A MAY BE CONSTRUCTED SIMULTANEOUSLY, HOWEVER PHASE 2A TIME RESTRICTIONS SHALL STILL BE ENFORCED.
  - 4.2. PHASE 2A AND PHASE 2B MAY BE CONSTRUCTED SIMULTANEOUSLY, HOWEVER TIME RESTRICTIONS FOR EACH PHASE SHALL STILL BE ENFORCED.
  - 4.3. PHASE 2B AND PHASE 3 MAY BE CONSTRUCTED SIMULTANEOUSLY, HOWEVER PHASE 2B TIME RESTRICTIONS SHALL STILL BE ENFORCED.
  - 4.4. PHASE 2A MUST BE COMPLETED PRIOR TO OPENING RUNWAY 11-29 TO AIRCRAFT.
5. THE CONTRACTOR SHALL PLACE ORANGE SNOW/SAFETY FENCE ALONG THE RUNWAY 11-29 SAFETY AREA LIMITS NEAR THE WORK AREA. THIS LINE WILL DESIGNATE THE LIMITS OF CONTRACTOR ACTIVITY WHILE RUNWAY 11-29 IS OPEN TO AIRCRAFT. THE CONTRACTOR SHALL MAINTAIN THIS FENCE THROUGHOUT CONSTRUCTION.
6. RUNWAY 17-35 AND RUNWAY 11-29 SHALL BE CLOSED FOR THE DURATION OF PHASE 2A. AT ALL TIMES, THE CONTRACTOR'S OPERATIONS SHALL BE SUCH AS TO MINIMIZE CLOSURES. CLOSURE CROSSES AND BARRICADES SHALL BE IN PLACE PRIOR TO BEGINNING CONSTRUCTION.
7. WHEN CONSTRUCTION ACTIVITY TAKES PLACE WITHIN THE RUNWAY 11-29 SAFETY AREA, RUNWAY 11-29 SHALL BE NOTAMED "CLOSED" AND RUNWAY CLOSURE CROSSES SHALL BE PLACED PER THE PLAN. THE NDB AND PAPI'S SHALL BE NOTAMED "SHUTDOWN". WHENEVER THE RUNWAY IS CLOSED, ALL ASSOCIATED LIGHTING SHALL BE TURNED OFF OR COMPLETELY COVERED, INCLUDING THE RUNWAY EDGE LIGHTS, GUIDANCE SIGNS AND PAPI'S. CONTRACTOR SHALL COORDINATE WITH THE AIRPORT AT LEAST 7 DAYS BEFORE BEGINNING CONSTRUCTION SO THAT NOTAMS MAY BE COORDINATED. IT IS THE RESPONSIBILITY OF THE AIRPORT MANAGER TO ISSUE ALL NOTAMS REQUIRED THROUGHOUT THE CONTRACT TIME.
8. RUNWAY 17-35 AND RUNWAY 11-29 LIGHTING CIRCUITS AND NAVAIDS SHALL BE TURNED OFF WHILE THE RUNWAY IS CLOSED TO AIRCRAFT. EXISTING TAXIWAY EDGE LIGHTS WITHIN THE CLOSED PORTIONS OF THIS PHASE SHALL BE TURNED OFF OR OBSCURED. THE CONTRACTOR SHALL PROVIDE APPROVED MATERIALS TO OBSCURE ALL AFFECTED EDGE LIGHTS. INSTALL AND MAINTAIN THE MATERIALS DURING CONSTRUCTION. ALL COSTS FOR OBSCURING LIGHT SHALL BE INCIDENTAL TO THE PROJECT.
9. AIRPORT SECURITY SHALL BE MAINTAINED THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESTRICTED TO THE DESIGNATED WORK AREAS. THE CONTRACTOR SHALL ENSURE THAT ACCESS POINTS USED BY CONSTRUCTION VEHICLES AND PERSONNEL ARE MONITORED WHEN OPEN AND LOCKED WHEN NOT IN USE TO PREVENT UNAUTHORIZED ACCESS TO THE AIRPORT MOVEMENT AREA.
10. AT THE COMPLETION OF ALL CONSTRUCTION, THE HAUL ROUTE AND CONSTRUCTION EQUIPMENT PARKING AREA SHALL BE RESTORED TO PRE-CONSTRUCTION CONDITIONS PER THE SPECIFICATIONS.

**HANSON**  
 Engineering | Planning | Allied Services  
 Hanson Professional Services Inc.  
 1525 S. 6th Street  
 Springfield, IL 62703  
 phone: 217-788-2450  
 fax: 217-788-2503  
 Offices Nationwide  
 www.hanson-inc.com

Illinois Licensed  
 Professional Service Corporation  
 #184-001084



**ST. LOUIS REGIONAL AIRPORT**  
 8 Terminal Drive  
 East Alton, Illinois 62024



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE RUNWAY 17-35 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION	REV	
			DES	DWN


ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: G-004-SFY.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**PROPOSED SAFETY AND PHASING PLAN - PHASE 2**

**FOR BID**

MAY 07, 2021 12:17 PM STOLZ01547  
 I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEETG-004-SFY

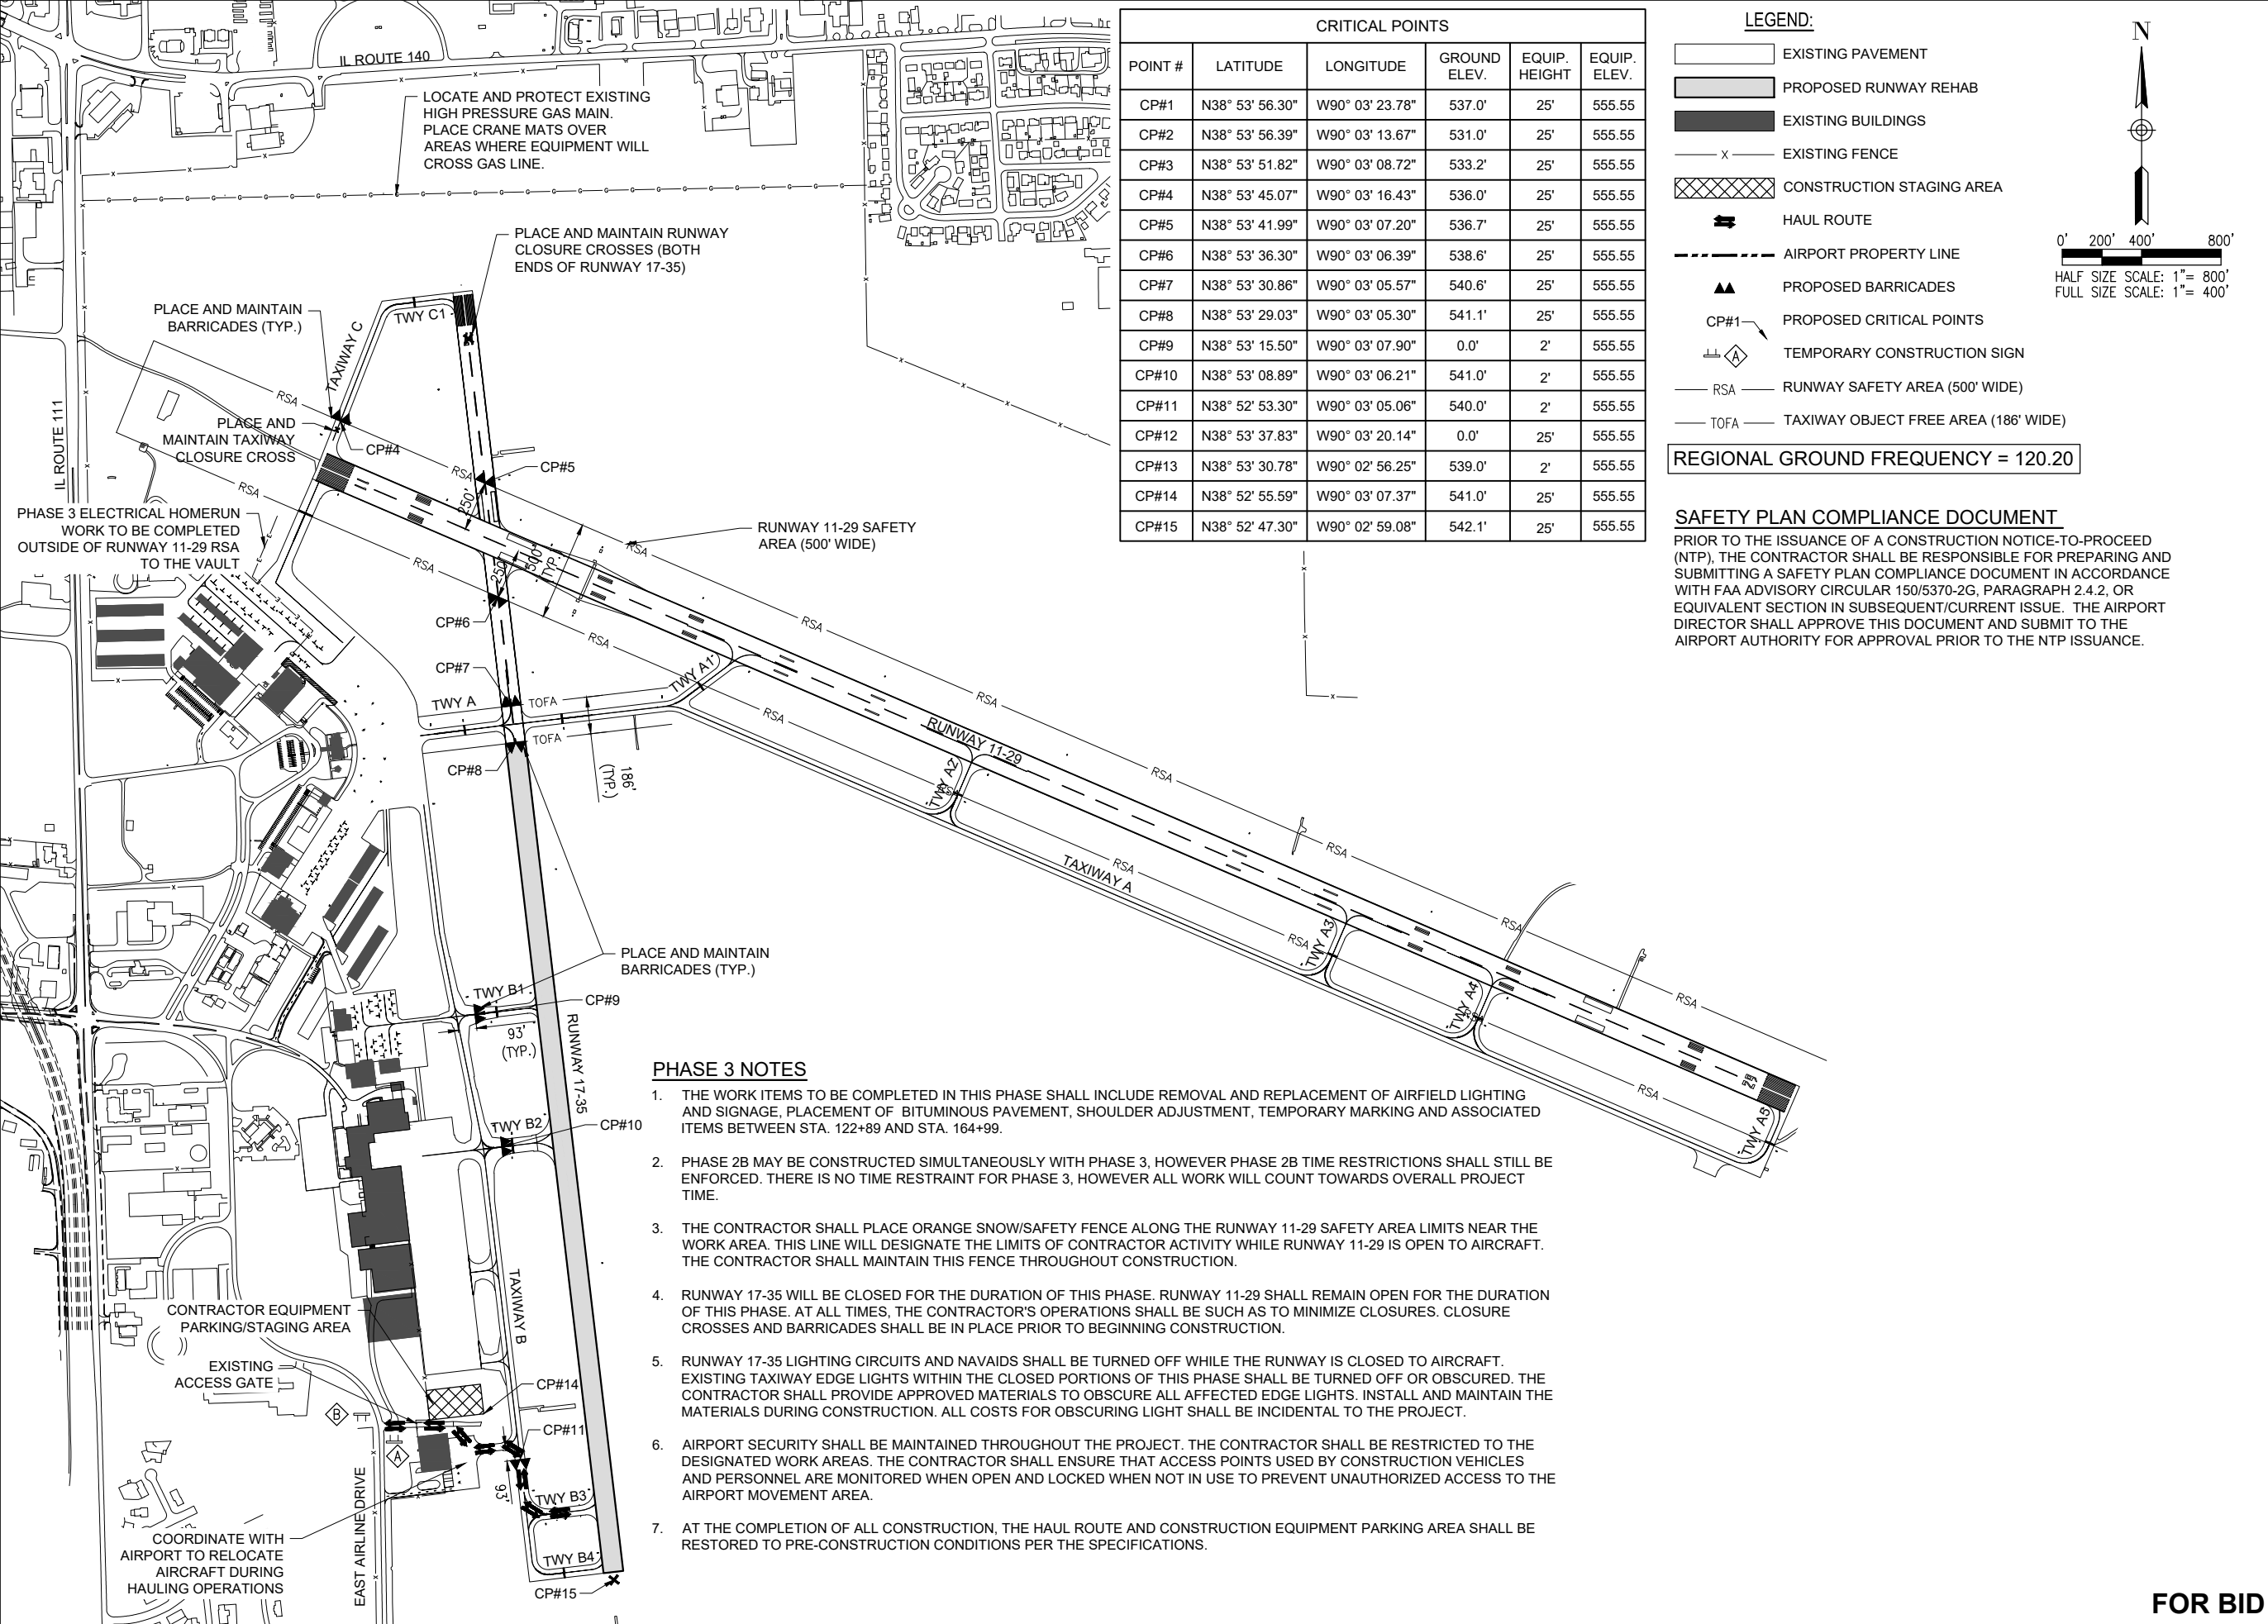

**CRITICAL POINTS**


POINT #	LATITUDE	LONGITUDE	GROUND ELEV.	EQUIP. HEIGHT	EQUIP. ELEV.
CP#1	N38° 53' 56.30"	W90° 03' 23.78"	537.0'	25'	555.55
CP#2	N38° 53' 56.39"	W90° 03' 13.67"	531.0'	25'	555.55
CP#3	N38° 53' 51.82"	W90° 03' 08.72"	533.2'	25'	555.55
CP#4	N38° 53' 45.07"	W90° 03' 16.43"	536.0'	25'	555.55
CP#5	N38° 53' 41.99"	W90° 03' 07.20"	536.7'	25'	555.55
CP#6	N38° 53' 36.30"	W90° 03' 06.39"	538.6'	25'	555.55
CP#7	N38° 53' 30.86"	W90° 03' 05.57"	540.6'	25'	555.55
CP#8	N38° 53' 29.03"	W90° 03' 05.30"	541.1'	25'	555.55
CP#9	N38° 53' 15.50"	W90° 03' 07.90"	0.0'	2'	555.55
CP#10	N38° 53' 08.89"	W90° 03' 06.21"	541.0'	2'	555.55
CP#11	N38° 52' 53.30"	W90° 03' 05.06"	540.0'	2'	555.55
CP#12	N38° 53' 37.83"	W90° 03' 20.14"	0.0'	25'	555.55
CP#13	N38° 53' 30.78"	W90° 02' 56.25"	539.0'	2'	555.55
CP#14	N38° 52' 55.59"	W90° 03' 07.37"	541.0'	25'	555.55
CP#15	N38° 52' 47.30"	W90° 02' 59.08"	542.1'	25'	555.55

**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- EXISTING BUILDINGS
- EXISTING FENCE
- CONSTRUCTION STAGING AREA
- HAUL ROUTE
- AIRPORT PROPERTY LINE
- PROPOSED BARRICADES
- CP#1 PROPOSED CRITICAL POINTS
- TEMPORARY CONSTRUCTION SIGN
- RSA RUNWAY SAFETY AREA (500' WIDE)
- TOFA TAXIWAY OBJECT FREE AREA (186' WIDE)

**REGIONAL GROUND FREQUENCY = 120.20**

**SAFETY PLAN COMPLIANCE DOCUMENT**  
 PRIOR TO THE ISSUANCE OF A CONSTRUCTION NOTICE-TO-PROCEED (NTP), THE CONTRACTOR SHALL BE RESPONSIBLE FOR PREPARING AND SUBMITTING A SAFETY PLAN COMPLIANCE DOCUMENT IN ACCORDANCE WITH FAA ADVISORY CIRCULAR 150/5370-2G, PARAGRAPH 2.4.2, OR EQUIVALENT SECTION IN SUBSEQUENT/CURRENT ISSUE. THE AIRPORT DIRECTOR SHALL APPROVE THIS DOCUMENT AND SUBMIT TO THE AIRPORT AUTHORITY FOR APPROVAL PRIOR TO THE NTP ISSUANCE.

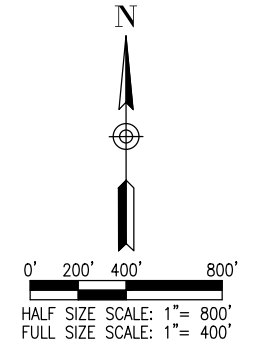

*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE RUNWAY 17-35 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: G-004-SFY.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE


**PROPOSED SAFETY AND PHASING PLAN - PHASE 3**

**PHASE 3 NOTES**

1. THE WORK ITEMS TO BE COMPLETED IN THIS PHASE SHALL INCLUDE REMOVAL AND REPLACEMENT OF AIRFIELD LIGHTING AND SIGNAGE, PLACEMENT OF BITUMINOUS PAVEMENT, SHOULDER ADJUSTMENT, TEMPORARY MARKING AND ASSOCIATED ITEMS BETWEEN STA. 122+89 AND STA. 164+99.
2. PHASE 2B MAY BE CONSTRUCTED SIMULTANEOUSLY WITH PHASE 3, HOWEVER PHASE 2B TIME RESTRICTIONS SHALL STILL BE ENFORCED. THERE IS NO TIME RESTRAINT FOR PHASE 3, HOWEVER ALL WORK WILL COUNT TOWARDS OVERALL PROJECT TIME.
3. THE CONTRACTOR SHALL PLACE ORANGE SNOW/SAFETY FENCE ALONG THE RUNWAY 11-29 SAFETY AREA LIMITS NEAR THE WORK AREA. THIS LINE WILL DESIGNATE THE LIMITS OF CONTRACTOR ACTIVITY WHILE RUNWAY 11-29 IS OPEN TO AIRCRAFT. THE CONTRACTOR SHALL MAINTAIN THIS FENCE THROUGHOUT CONSTRUCTION.
4. RUNWAY 17-35 WILL BE CLOSED FOR THE DURATION OF THIS PHASE. RUNWAY 11-29 SHALL REMAIN OPEN FOR THE DURATION OF THIS PHASE. AT ALL TIMES, THE CONTRACTOR'S OPERATIONS SHALL BE SUCH AS TO MINIMIZE CLOSURES. CLOSURE CROSSES AND BARRICADES SHALL BE IN PLACE PRIOR TO BEGINNING CONSTRUCTION.
5. RUNWAY 17-35 LIGHTING CIRCUITS AND NAVAIDS SHALL BE TURNED OFF WHILE THE RUNWAY IS CLOSED TO AIRCRAFT. EXISTING TAXIWAY EDGES LIGHTS WITHIN THE CLOSED PORTIONS OF THIS PHASE SHALL BE TURNED OFF OR OBSCURED. THE CONTRACTOR SHALL PROVIDE APPROVED MATERIALS TO OBSCURE ALL AFFECTED EDGE LIGHTS. INSTALL AND MAINTAIN THE MATERIALS DURING CONSTRUCTION. ALL COSTS FOR OBSCURING LIGHT SHALL BE INCIDENTAL TO THE PROJECT.
6. AIRPORT SECURITY SHALL BE MAINTAINED THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESTRICTED TO THE DESIGNATED WORK AREAS. THE CONTRACTOR SHALL ENSURE THAT ACCESS POINTS USED BY CONSTRUCTION VEHICLES AND PERSONNEL ARE MONITORED WHEN OPEN AND LOCKED WHEN NOT IN USE TO PREVENT UNAUTHORIZED ACCESS TO THE AIRPORT MOVEMENT AREA.
7. AT THE COMPLETION OF ALL CONSTRUCTION, THE HAUL ROUTE AND CONSTRUCTION EQUIPMENT PARKING AREA SHALL BE RESTORED TO PRE-CONSTRUCTION CONDITIONS PER THE SPECIFICATIONS.

MAY 07, 2021 12:17 PM STOLZ01547  
 I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\G-004-SFY

**FOR BID**

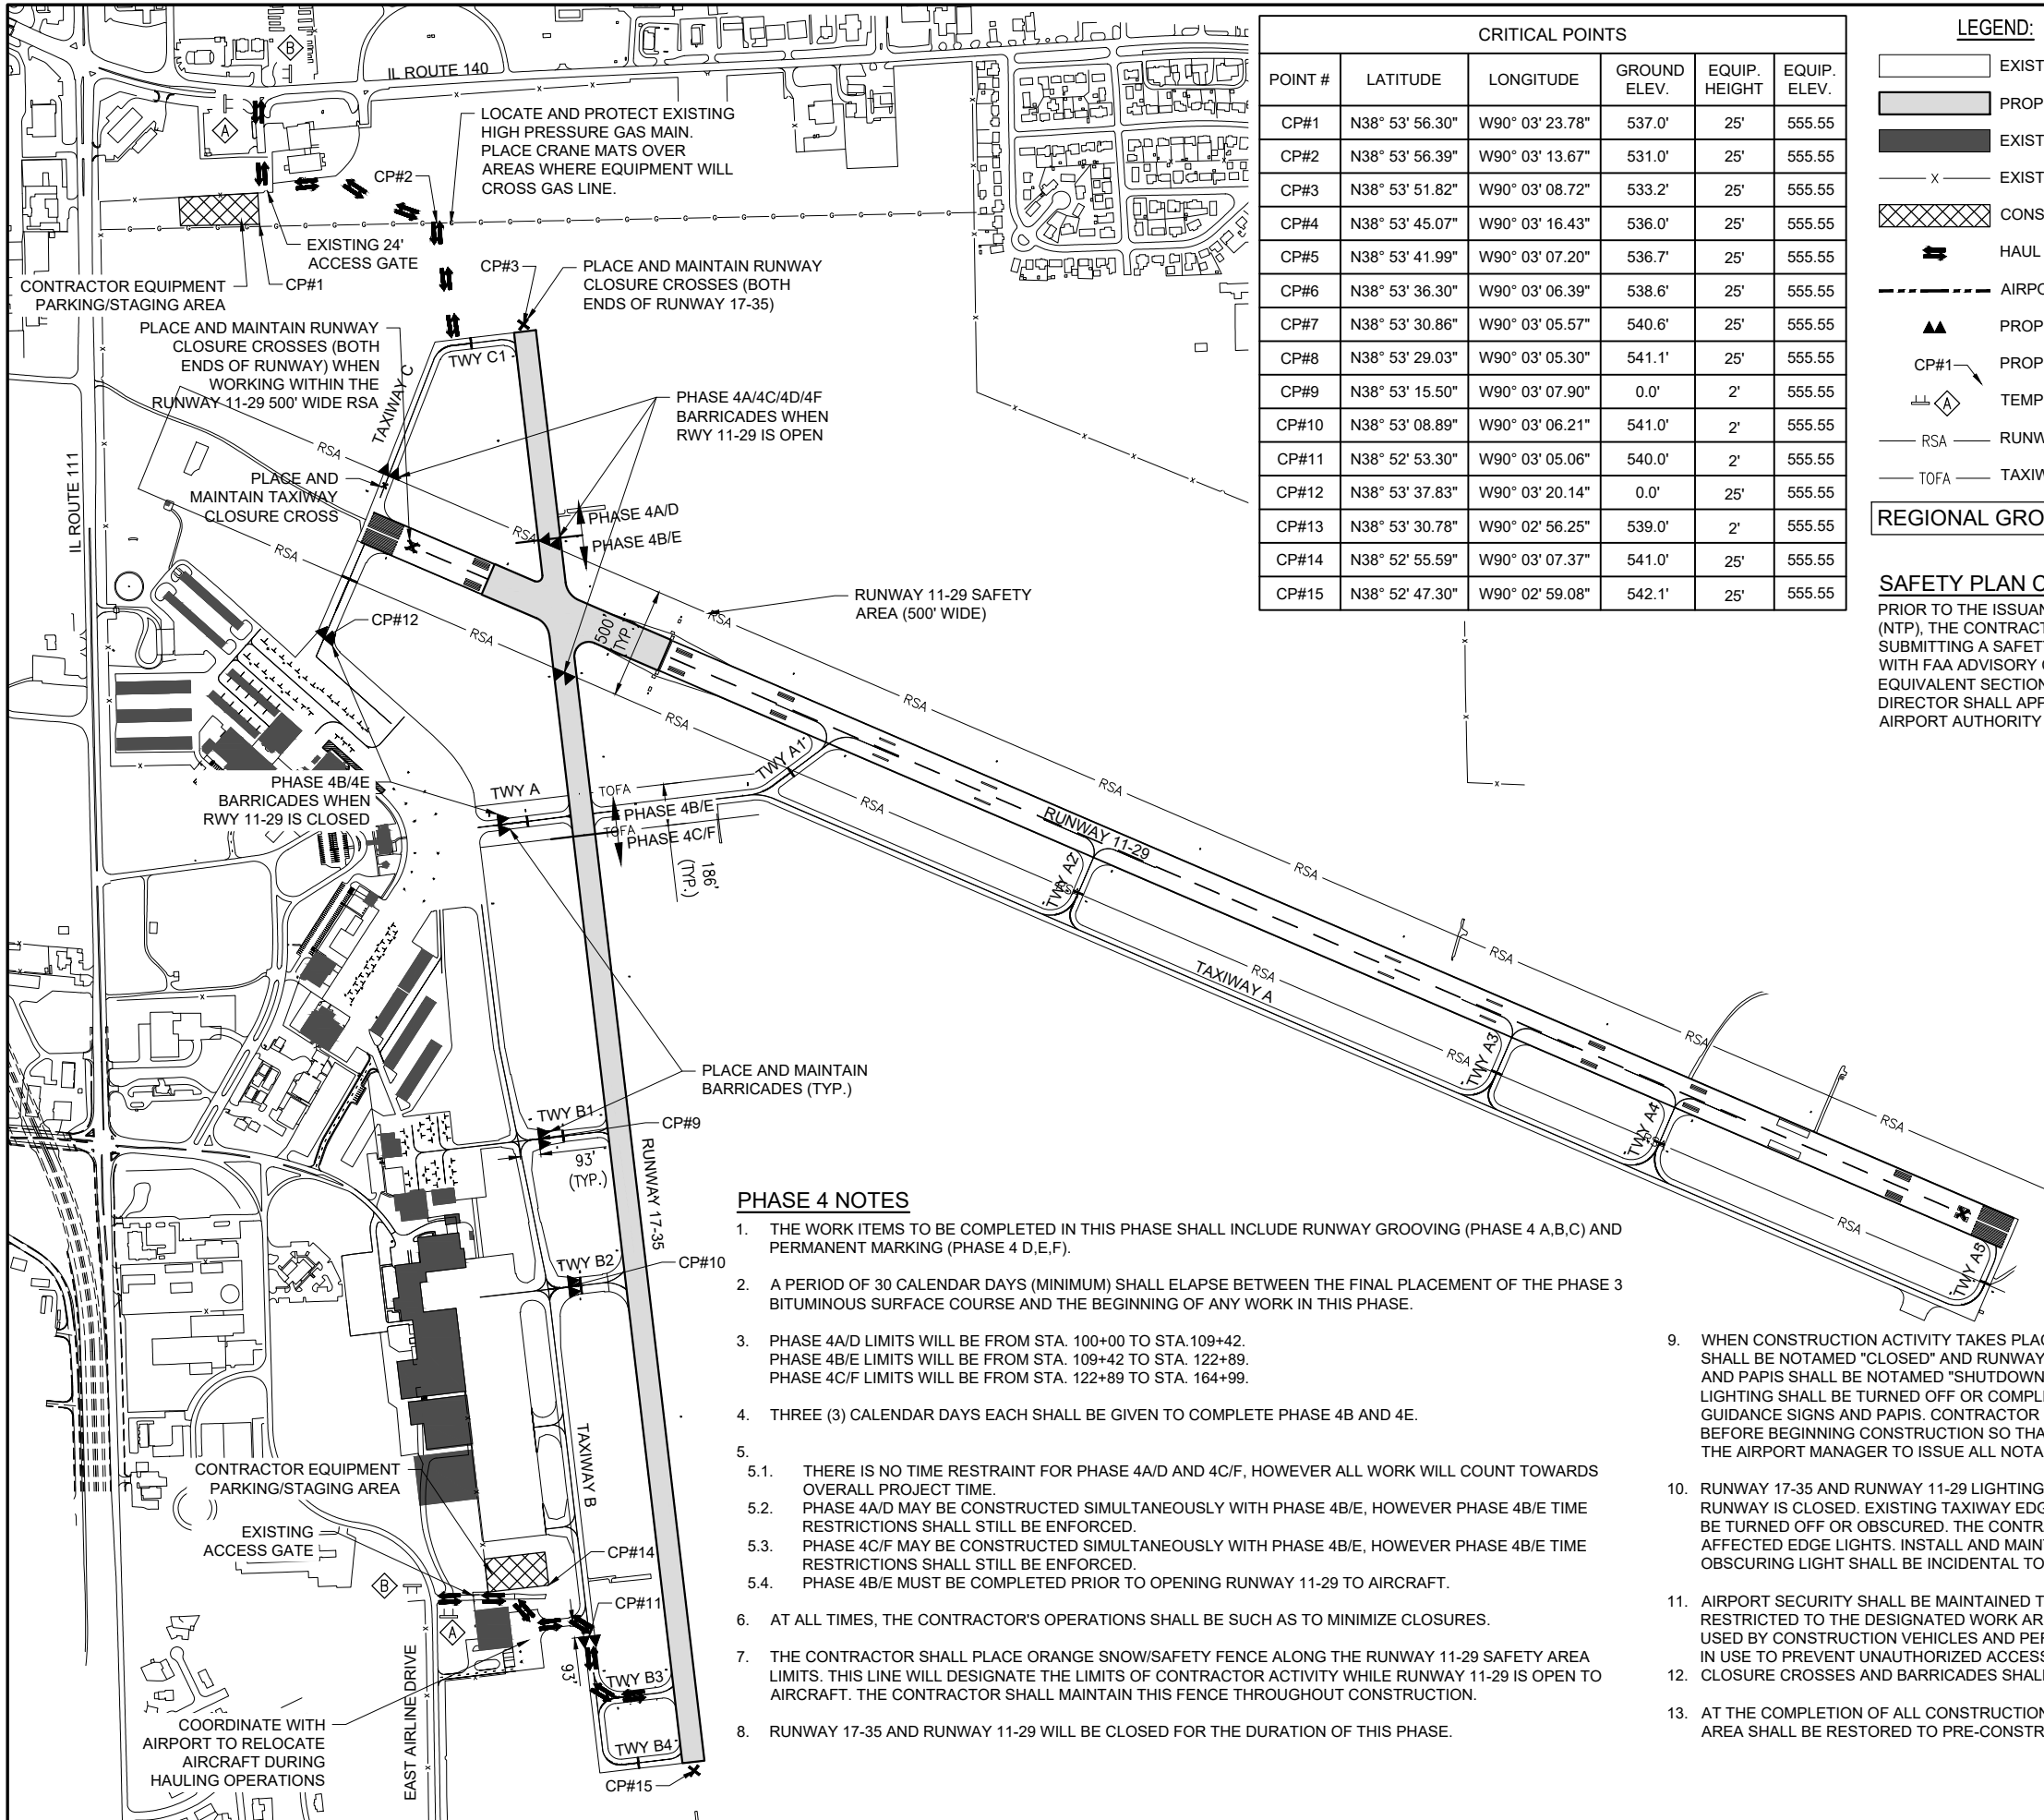


CRITICAL POINTS					
POINT #	LATITUDE	LONGITUDE	GROUND ELEV.	EQUIP. HEIGHT	EQUIP. ELEV.
CP#1	N38° 53' 56.30"	W90° 03' 23.78"	537.0'	25'	555.55
CP#2	N38° 53' 56.39"	W90° 03' 13.67"	531.0'	25'	555.55
CP#3	N38° 53' 51.82"	W90° 03' 08.72"	533.2'	25'	555.55
CP#4	N38° 53' 45.07"	W90° 03' 16.43"	536.0'	25'	555.55
CP#5	N38° 53' 41.99"	W90° 03' 07.20"	536.7'	25'	555.55
CP#6	N38° 53' 36.30"	W90° 03' 06.39"	538.6'	25'	555.55
CP#7	N38° 53' 30.86"	W90° 03' 05.57"	540.6'	25'	555.55
CP#8	N38° 53' 29.03"	W90° 03' 05.30"	541.1'	25'	555.55
CP#9	N38° 53' 15.50"	W90° 03' 07.90"	0.0'	2'	555.55
CP#10	N38° 53' 08.89"	W90° 03' 06.21"	541.0'	2'	555.55
CP#11	N38° 52' 53.30"	W90° 03' 05.06"	540.0'	2'	555.55
CP#12	N38° 53' 37.83"	W90° 03' 20.14"	0.0'	25'	555.55
CP#13	N38° 53' 30.78"	W90° 02' 56.25"	539.0'	2'	555.55
CP#14	N38° 52' 55.59"	W90° 03' 07.37"	541.0'	25'	555.55
CP#15	N38° 52' 47.30"	W90° 02' 59.08"	542.1'	25'	555.55

**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- EXISTING BUILDINGS
- EXISTING FENCE
- CONSTRUCTION STAGING AREA
- HAUL ROUTE
- AIRPORT PROPERTY LINE
- PROPOSED BARRICADES
- PROPOSED CRITICAL POINTS
- TEMPORARY CONSTRUCTION SIGN
- RSA - RUNWAY SAFETY AREA (500' WIDE)
- TOFA - TAXIWAY OBJECT FREE AREA (186' WIDE)

REGIONAL GROUND FREQUENCY = 120.20

**SAFETY PLAN COMPLIANCE DOCUMENT**  
 PRIOR TO THE ISSUANCE OF A CONSTRUCTION NOTICE-TO-PROCEED (NTP), THE CONTRACTOR SHALL BE RESPONSIBLE FOR PREPARING AND SUBMITTING A SAFETY PLAN COMPLIANCE DOCUMENT IN ACCORDANCE WITH FAA ADVISORY CIRCULAR 150/5370-2G, PARAGRAPH 2.4.2, OR EQUIVALENT SECTION IN SUBSEQUENT/CURRENT ISSUE. THE AIRPORT DIRECTOR SHALL APPROVE THIS DOCUMENT AND SUBMIT TO THE AIRPORT AUTHORITY FOR APPROVAL PRIOR TO THE NTP ISSUANCE.

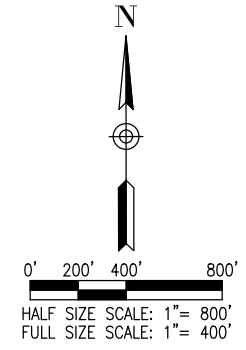

**PHASE 4 NOTES**

1. THE WORK ITEMS TO BE COMPLETED IN THIS PHASE SHALL INCLUDE RUNWAY GROOVING (PHASE 4 A,B,C) AND PERMANENT MARKING (PHASE 4 D,E,F).
2. A PERIOD OF 30 CALENDAR DAYS (MINIMUM) SHALL ELAPSE BETWEEN THE FINAL PLACEMENT OF THE PHASE 3 BITUMINOUS SURFACE COURSE AND THE BEGINNING OF ANY WORK IN THIS PHASE.
3. PHASE 4A/D LIMITS WILL BE FROM STA. 100+00 TO STA. 109+42. PHASE 4B/E LIMITS WILL BE FROM STA. 109+42 TO STA. 122+89. PHASE 4C/F LIMITS WILL BE FROM STA. 122+89 TO STA. 164+99.
4. THREE (3) CALENDAR DAYS EACH SHALL BE GIVEN TO COMPLETE PHASE 4B AND 4E.
5. 5.1. THERE IS NO TIME RESTRAINT FOR PHASE 4A/D AND 4C/F, HOWEVER ALL WORK WILL COUNT TOWARDS OVERALL PROJECT TIME.  
 5.2. PHASE 4A/D MAY BE CONSTRUCTED SIMULTANEOUSLY WITH PHASE 4B/E, HOWEVER PHASE 4B/E TIME RESTRICTIONS SHALL STILL BE ENFORCED.  
 5.3. PHASE 4C/F MAY BE CONSTRUCTED SIMULTANEOUSLY WITH PHASE 4B/E, HOWEVER PHASE 4B/E TIME RESTRICTIONS SHALL STILL BE ENFORCED.  
 5.4. PHASE 4B/E MUST BE COMPLETED PRIOR TO OPENING RUNWAY 11-29 TO AIRCRAFT.
6. AT ALL TIMES, THE CONTRACTOR'S OPERATIONS SHALL BE SUCH AS TO MINIMIZE CLOSURES.
7. THE CONTRACTOR SHALL PLACE ORANGE SNOW/SAFETY FENCE ALONG THE RUNWAY 11-29 SAFETY AREA LIMITS. THIS LINE WILL DESIGNATE THE LIMITS OF CONTRACTOR ACTIVITY WHILE RUNWAY 11-29 IS OPEN TO AIRCRAFT. THE CONTRACTOR SHALL MAINTAIN THIS FENCE THROUGHOUT CONSTRUCTION.
8. RUNWAY 17-35 AND RUNWAY 11-29 WILL BE CLOSED FOR THE DURATION OF THIS PHASE.
9. WHEN CONSTRUCTION ACTIVITY TAKES PLACE WITHIN THE RUNWAY 11-29 SAFETY AREA, RUNWAY 11-29 SHALL BE NOTAMED "CLOSED" AND RUNWAY CLOSURE CROSSES SHALL BE PLACED PER THE PLAN. THE NDB AND PAPI SHALL BE NOTAMED "SHUTDOWN". WHENEVER THE RUNWAY IS CLOSED, ALL ASSOCIATED LIGHTING SHALL BE TURNED OFF OR COMPLETELY COVERED, INCLUDING THE RUNWAY EDGE LIGHTS, GUIDANCE SIGNS AND PAPI. CONTRACTOR SHALL COORDINATE WITH THE AIRPORT AT LEAST 7 DAYS BEFORE BEGINNING CONSTRUCTION SO THAT NOTAMS MAY BE COORDINATED. IT IS THE RESPONSIBILITY OF THE AIRPORT MANAGER TO ISSUE ALL NOTAMS REQUIRED THROUGHOUT THE CONTRACT TIME.
10. RUNWAY 17-35 AND RUNWAY 11-29 LIGHTING CIRCUITS AND NAVAIDS SHALL BE TURNED OFF WHILE THE RUNWAY IS CLOSED. EXISTING TAXIWAY EDGE LIGHTS WITHIN THE CLOSED PORTIONS OF THIS PHASE SHALL BE TURNED OFF OR OBSURED. THE CONTRACTOR SHALL PROVIDE APPROVED MATERIALS TO OBSCURE ALL AFFECTED EDGE LIGHTS. INSTALL AND MAINTAIN THE MATERIALS DURING CONSTRUCTION. ALL COSTS FOR OBSCURING LIGHT SHALL BE INCIDENTAL TO THE PROJECT.
11. AIRPORT SECURITY SHALL BE MAINTAINED THROUGHOUT THE PROJECT. THE CONTRACTOR SHALL BE RESTRICTED TO THE DESIGNATED WORK AREAS. THE CONTRACTOR SHALL ENSURE THAT ACCESS POINTS USED BY CONSTRUCTION VEHICLES AND PERSONNEL ARE MONITORED WHEN OPEN AND LOCKED WHEN NOT IN USE TO PREVENT UNAUTHORIZED ACCESS TO THE AIRPORT MOVEMENT AREA.
12. CLOSURE CROSSES AND BARRICADES SHALL BE IN PLACE PRIOR TO BEGINNING CONSTRUCTION.
13. AT THE COMPLETION OF ALL CONSTRUCTION, THE HAUL ROUTE AND CONSTRUCTION EQUIPMENT PARKING AREA SHALL BE RESTORED TO PRE-CONSTRUCTION CONDITIONS PER THE SPECIFICATIONS.

**HANSON**  
 Engineering | Planning | Allied Services  
 Hanson Professional Services Inc.  
 1525 S. 6th Street  
 Springfield, IL 62703  
 phone: 217-788-2450  
 fax: 217-788-2503  
 Offices Nationwide  
 www.hanson-inc.com

Illinois Licensed  
 Professional Service Corporation  
 #184-001084



**ST. LOUIS REGIONAL AIRPORT**  
 8 Terminal Drive  
 East Alton, Illinois 62024



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: G-004-SFY.DWG

DESIGN BY: JRH 3/18/2021

DRAWN BY: JRH 4/16/2021

REVIEWED BY: BSS 4/16/2021

**PROPOSED SAFETY  
 AND PHASING PLAN -  
 PHASE 4**

**FOR BID**

MAY 07, 2021 12:18 PM STOLZ01547  
 I:\17 JOBS\17A008504\CAD\AIRPORT\TSHEET\G-004-SFY



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: G-501-SFY.DWG

DESIGN BY: JRH 3/18/2021

DRAWN BY: JRH 4/16/2021


REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**CONSTRUCTION  
SAFETY DETAILS  
AND NOTES -  
SHEET 1**

**SAFETY NOTES**

- FOLLOWING ARE THE CONSTRUCTION SAFETY PROCEDURES THAT THE CONTRACTOR SHALL FOLLOW THROUGHOUT THIS PROJECT. ADDITIONAL REQUIREMENTS ARE SHOWN ON THE CONSTRUCTION SAFETY AND PHASING PLAN SHEET AND THIS SHEET.
- ALL PROVISIONS OF THE LATEST EDITION OF FAA ADVISORY CIRCULAR AC 150/5370-2 (CURRENT EDITION), "OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION", APPLY TO THIS CONTRACT, EXCEPT AS MODIFIED BY THIS SAFETY PLAN, OR AS MODIFIED BY THE OWNER THROUGH THE RESIDENT ENGINEER/TECHNICIAN AT THE PRECONSTRUCTION CONFERENCE, OR DURING THE COURSE OF THE CONTRACT.
- THE CONTRACTORS SHALL MINIMIZE DISRUPTION OF STANDARD OPERATING PROCEDURES FOR AERONAUTICAL ACTIVITY BY REMAINING WITHIN THE PRESCRIBED STAGING, CONSTRUCTION, AND PHASING AREAS PRESENTED ON THE CONSTRUCTION SAFETY AND PHASING PLAN SHEETS.
- NO UNAUTHORIZED PERSONNEL SHALL ENTER ANY AREA OF THE AIRPORT THAT COULD POTENTIALLY BE HAZARDOUS. THE AIRPORT MANAGER RESERVES THE RIGHT TO SUSPEND OPERATIONS IN ORDER TO MAINTAIN SAFETY AT THE AIRPORT.
- CONTRACTOR EQUIPMENT, VEHICLES, AND PROJECT MATERIALS SHALL BE STORED IN THE EQUIPMENT PARKING/STAGING AREA SHOWN ON THE PLAN VIEW, EXCEPT AS OTHERWISE PROVIDED FOR AT THE PRECONSTRUCTION CONFERENCE.
- ALL CONSTRUCTION EQUIPMENT OPERATING IN THE PRESCRIBED CONSTRUCTION AREA IS REQUIRED TO DISPLAY A CHECKERBOARD FLAG PROPERLY LOCATED OR A ROTATING BEACON (STROBE) AS SPECIFIED IN AC 150/5210-5, "PAINTING, MARKING, AND LIGHTING OF VEHICLES USED ON AN AIRPORT" LATEST EDITION.
- NO CONSTRUCTION MATERIAL STOCKPILES SHALL BE LOCATED WITHIN 250' OF ANY ACTIVE RUNWAY, WITHIN 93' OF ANY OTHER ACTIVE AIRPORT OPERATIONS AREA, OR PENETRATE A PART 77 IMAGINARY SURFACE (PROVIDED BY THE RESIDENT ENGINEER/TECHNICIAN) EXTENDING OUT AND UPWARDS FROM ALL SIDES OF AN ACTIVE RUNWAY.
- CLOSED AIRFIELD PHASING AREAS, OPEN TRENCHES, AND STOCKPILED MATERIALS AT THE CONSTRUCTION SITE SHALL BE PROMINENTLY MARKED WITH LIGHTED BARRICADES WITH STEADY BURNING OR FLASHING RED LIGHTS AS SPECIFIED IN 150/5370-2, "OPERATIONAL SAFETY ON AIRPORT DURING CONSTRUCTION, LATEST EDITION. LIGHTED BARRICADES MUST BE NO TALLER THAN 18" (EXCLUSIVE OF SUPPLEMENTARY LIGHTS AND FLAGS) ON THE TAXIWAYS AND COMPLY WITH ADVISORY CIRCULAR 150/5370-2, LATEST EDITION. CONTRACTOR SHALL NIGHT CHECK BARRICADES DAILY FOR PROPER OPERATION.
- NO OPEN TRENCHES WITHIN 250' OF AN ACTIVE RUNWAY CENTERLINE OR WITHIN 93' OF ANY AIRPORT OPERATIONS AREA WILL BE PERMITTED UNLESS PROPERLY MARKED. OTHER TRENCHES SHALL BE MAINTAINED SAFE, I.E., BARRICADED OR COVERED WITH STEEL PLATES IN ALL OTHER AREAS.
- OPEN TRENCHES, EXCAVATIONS, AND STOCKPILED MATERIALS AT THE CONSTRUCTION SITE SHOULD BE PROMINENTLY MARKED WITH ORANGE FLAGS AND LIGHTED WITH FLASHING RED LIGHTS DURING HOURS OF RESTRICTED VISIBILITY AND/OR DARKNESS.
- NO CONSTRUCTION EQUIPMENT GREATER THAN 25' TALL WILL BE PERMITTED ON THE AIRPORT. HOWEVER OTHER EQUIPMENT TALLER THAN 25' MAY BE PERMITTED WITH THE APPROVAL OF THE AIRPORT MANAGER AND AIRSPACE APPROVAL BY THE FAA.
- NO OPEN FLAME WELDING OR TORCH CUTTING OPERATION IS PERMITTED UNLESS ADEQUATE FIRE AND SAFETY PRECAUTIONS ARE PROVIDED AND HAVE BEEN APPROVED BY THE AIRPORT MANAGER NO FLARE POTS ARE ALLOWED ON THE PROJECT.
- SOIL, DEBRIS, AND LOOSE MATERIAL DROPPED OR TRUCKED ONTO AIRPORT ROADS, TAXIWAYS, AND SOD SURFACES, OR WHICH CAN BE BLOWN ONTO SUCH SURFACES, SHALL BE IMMEDIATELY SWEEPED, PICKED UP AND REMOVED, OR PLACED INTO CLOSED CONTAINERS. ANY DAMAGE TO AIRPORT PROPERTY SHALL BE REPAIRED IMMEDIATELY AT NO COST TO THE OWNER.
- EACH CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND MAINTAINING AIRPORT LIGHTING AND NAVIGATIONAL ELECTRICAL SYSTEMS DURING CONSTRUCTION. A CONTACT PERSON AND TELEPHONE NUMBER FOR 24 HOUR EMERGENCY IMMEDIATE REPAIR SHALL BE SUBMITTED TO THE AIRPORT MANAGER AND RESIDENT ENGINEER/TECHNICIAN. HAUL ROUTES CROSSING PAVEMENT, DRAINAGE, MISCELLANEOUS, STRUCTURES AND/OR AIRFIELD CABLES SHALL BE PROTECTED FROM DAMAGE.
- ALL AIRCRAFT AND AIRPORT OPERATIONS HAVE THE RIGHT-OF-WAY. CONTRACTOR TO YIELD TO VEHICLES AND REMAIN CLEAR AT ALL TIMES.
- CONTRACTOR SHALL PLACE, SECURE, AND MAINTAIN LIGHTED BARRICADES AND CLOSURE CROSSES WHEN A RUNWAY/TAXIWAY/APRON IS CLOSED OR AS REQUIRED BY THE PLANS AND DESIGNATED BY THE RESIDENT ENGINEER/TECHNICIAN.
- CONTRACTOR SHALL MARK HAZARDOUS AREA WITH STEADY-BURNING OR FLASHING RED LIGHTS DURING PERIODS OF LOW VISIBILITY AS REQUIRED.
- THE CONTRACTOR SHALL PERIODICALLY PERFORM ONSITE INSPECTIONS THROUGHOUT THE DURATION OF THE PROJECT WITH THE IMMEDIATE REMEDY OF ANY DIFFERENCES, WHETHER CAUSED BY NEGLIGENCE, OVERSIGHT, OR PROJECT SCOPE CHANGE.
- CONTRACTOR SHALL MOVE MAINTENANCE OF TRAFFIC COMPONENTS AT THE WRITTEN DIRECTION OF THE RESIDENT ENGINEER/TECHNICIAN AT NO ADDITIONAL COST.
- CONTRACTOR SHALL NOT REMOVE THE BARRICADES WITHOUT THE APPROVAL BY THE RESIDENT ENGINEER/TECHNICIAN.
- CONTRACTOR SHALL MAINTAIN FLASHERS, SIGNS AND/OR BARRICADES AS REQUIRED BY THE PLANS, CITY OR COUNTY REGULATIONS OR CONTRACTOR ACTIVITIES. CONTRACTOR SHALL OBTAIN ANY AND ALL REQUIRED LOCAL PERMITS UNLESS SPECIFIED OTHERWISE.
- THE CONTRACTOR SHALL UTILIZE WATER AND/OR CHEMICALS APPROVED BY THE RESIDENT ENGINEER/TECHNICIAN AS NECESSARY TO CONTROL DUST.
- NO CONSTRUCTION VEHICLES SHALL BE DRIVEN ACROSS ANY ACTIVE RUNWAY, INCLUDING TURF RUNWAYS. CONSTRUCTION EQUIPMENT OR CONSTRUCTION ACTIVITY WILL NOT BE PERMITTED WITHIN 250' OF ANY ACTIVE RUNWAY CENTERLINE OR WITHIN 93' OF ANY OTHER ACTIVE AIRPORT TAXIWAY OR APRON. HOWEVER, CONSTRUCTION MAY BE PERMITTED IN THESE AREAS IF THE CONTRACTOR HAS GAINED APPROVAL FROM THE AIRPORT MANAGER AT LEAST 7 DAYS IN ADVANCE OF THE SCHEDULED CONSTRUCTION PERIOD AND THE OPERATIONAL AREA IS CLOSED TO TRAFFIC AND PROPER NOTAMS ARE ISSUED BY THE AIRPORT MANAGER TO THE APPROPRIATE FLIGHT SERVICE STATION.
- UNLESS SPECIFIED OTHERWISE, COST FOR THE ABOVE IS TO BE CONSIDERED INCIDENTAL TO THE PROJECT. SEPARATE PAYMENT SHALL NOT BE MADE.

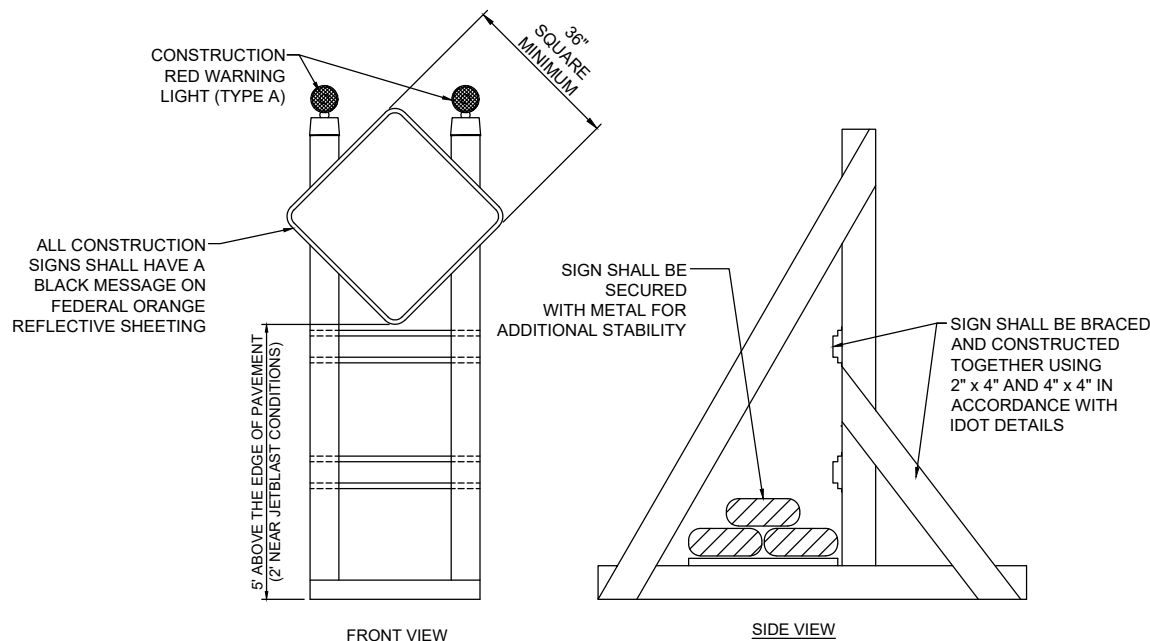

**SIGNAGE NOTES**

- ALL CONSTRUCTION SIGNS AND TRAFFIC CONTROL DEVICES SHALL CONFORM TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES INCLUDING THE ILLINOIS SUPPLEMENT (LATEST EDITION) AND THE FAA ADVISORY CIRCULARS (LATEST EDITION) UNLESS NOTED OTHERWISE. THE FAA OR MORE STRINGENT SPECIFICATIONS SHALL GOVERN.
- UNLESS OTHERWISE SPECIFIED, CONSTRUCTION SIGNS SHALL BE MOUNTED ON PORTABLE OR NON-PORTABLE SUPPORTS. A PORTABLE SUPPORT IS DEFINED AS A TYPICAL SIGN STANDARD AS SHOWN ON THIS SHEET, OR A SMALL LIGHT WEIGHT TRAILER. A NON-PORTABLE SUPPORT IS DEFINED AS DRIVEN METAL OR WOOD POST. ALL SIGNS, REGARDLESS OF THE TYPE OF SUPPORTS USED, SHALL BE MOUNTED SUCH THAT THE MESSAGE ON THE SIGN IS LEVEL IN THE HORIZONTAL PLANE AFTER PLACEMENT. THE COST OF CONSTRUCTION WARNING LIGHTS SHALL BE INCLUDED IN THE COST OF THE CONSTRUCTION SIGNS.
- CONSTRUCTION RED WARNING LIGHT: THESE ARE PORTABLE, LENS DIRECTED, ENCLOSED LIGHTS. THE COLOR OF THE LIGHT EMITTED SHALL BE RED. THEY ARE TO BE USED IN A LOW INTENSITY FLASHING MODE (TYPE A).
- THE LIGHTING SHALL BE MAINTAINED IN OPERATION DURING THE HOURS OF DARKNESS BETWEEN 1/2 HOUR AFTER SUNSET AND 1/2 HOUR BEFORE SUNRISE AND WHEN CONDITIONS EXIST WHICH TEND TO OBSCURE VISION.
- COST FOR PROVIDING, PLACING, MAINTAINING, AND REMOVING SIGNS SHALL BE INCLUDED IN ITEM AR150540 HAUL ROUTE.



W20-3  
48" x 48"



W20-3  
48" x 48"

**CONSTRUCTION SIGNS**

NOT TO SCALE





*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: G-501-SFY.DWG


DESIGN BY: JRH 4/12/2021

DRAWN BY: JRH 4/16/2021

REVIEWED BY: BSS 4/16/2021

SHEET TITLE

CONSTRUCTION  
SAFETY DETAILS  
AND NOTES -  
SHEET 2

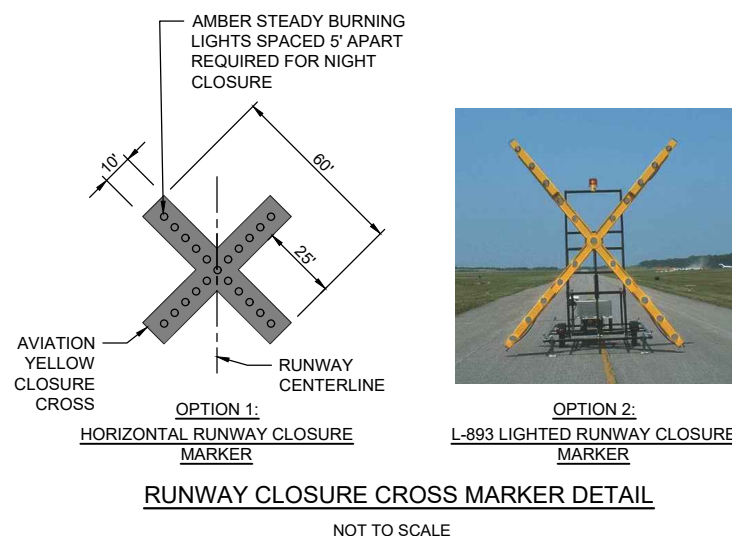

**RUNWAY CLOSURE CROSS MARKER DETAIL**


NOT TO SCALE



**OPTION 2:  
L-893 LIGHTED RUNWAY CLOSURE  
MARKER**

**CLOSURE CROSS NOTES**

1. RUNWAY CLOSURE CROSS MARKINGS SHALL BE LIGHTED DURING DARKNESS AND PERIODS OF REDUCED VISIBILITY. THE LIGHTED MARKERS SHALL BE PLACED OVER THE RUNWAY NUMERALS OR IMMEDIATELY OFF THE END OF THE RUNWAY ON THE EXTENDED CENTERLINE, AS DIRECTED BY THE RESIDENT ENGINEER/TECHNICIAN.
2. THE CONTRACTOR SHALL PROVIDE THE RUNWAY CLOSURE CROSSES BY ONE OF TWO OPTIONS:  
  
OPTION 1: TEMPORARY CLOSURE CROSS MARKINGS SHALL BE CONSTRUCTED OF PLYWOOD, SNOW FENCE OR APPROVED FABRIC AND SHALL BE SECURED TO PAVEMENT BY SANDBAGS OR OTHER APPROVED METHOD.  
  
OPTION 2: THE CONTRACTOR SHALL PROVIDE TWO (2) L-893 LIGHTED RUNWAY CLOSURE MARKERS, MEETING THE REQUIREMENTS IN FAA ADVISORY CIRCULAR 150/5345-55 AND SHALL BE IN PLACE AND OPERATING WHENEVER THE RUNWAY IS CLOSED AND REMOVED WHEN THE RUNWAY IS RE-OPENED.
3. TAXIWAY CLOSURE CROSSES SHALL MEET OPTION 1 IN THE ABOVE NOTE.
4. THE CONTRACTOR SHALL MAKE FREQUENT INSPECTION OF THE LIGHTED CROSSES AND MAKE PROMPT REPAIRS AS NECESSARY.
5. THE CONTRACTOR SHALL BE ON-CALL FOR 24-HOUR EMERGENCY MAINTENANCE WHEN LIGHTED CROSSES ARE BEING USED.
6. LIGHTED MARKERS SHALL BE SECURED FROM WIND EFFECTS BY THE CONTRACTOR AS RECOMMENDED BY THE MANUFACTURER.
7. COST FOR PROVIDING, PLACING, OPERATING, MAINTAINING, RELOCATING AND REMOVING CLOSURE CROSSES SHALL BE INCLUDED IN THE COST OF THE TRAFFIC MAINTENANCE.

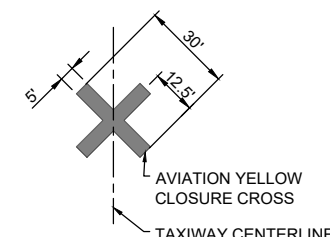


**TAXIWAY CLOSURE CROSS MARKER DETAIL**

NOT TO SCALE

**BARRICADE NOTES**

1. ALL CONSTRUCTION SIGNS AND TRAFFIC CONTROL DEVICES SHALL CONFORM TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES INCLUDING THE ILLINOIS SUPPLEMENT (LATEST EDITION) AND THE FAA ADVISORY CIRCULARS (LATEST EDITION) UNLESS NOTED OTHERWISE. THE FAA OR MORE STRINGENT SPECIFICATIONS SHALL GOVERN.
2. BARRICADES SHALL BE "LOW-PROFILE" WITH A MAXIMUM HEIGHT OF 18" ABOVE GROUND, EXCLUSIVE OF ASSOCIATED WARNING LIGHTS AND FLAGS.
3. BARRICADES SHALL BE SPACED END TO END THE WIDTH OF THE PAVEMENT, WITH GAPS BETWEEN BARRICADES NOT TO EXCEED 4' WIDE. BARRICADES ARE TO BE SET BACK 66' FROM THE ACTIVE TAXIWAY CENTERLINE OR AS SHOWN ON THE PLANS.
4. CONSTRUCTION RED WARNING LIGHT: THESE ARE PORTABLE, LENS DIRECTED, ENCLOSED LIGHTS. THE COLOR OF THE LIGHT EMITTED SHALL BE RED. THEY MAY BE USED IN EITHER A STEADY BURN (TYPE C) OR LOW INTENSITY FLASHING MODE (TYPE A) UNLESS NOTED OTHERWISE.
5. THE LIGHTING SHALL BE MAINTAINED IN OPERATION DURING THE HOURS OF DARKNESS BETWEEN 1/2 HOUR BEFORE SUNSET AND 1/2 HOUR AFTER SUNRISE AND WHEN CONDITIONS EXIST WHICH TEND TO OBSCURE VISION.
6. BARRICADES SHALL BE SECURED TO THE GROUND BY APPROVED METHODS TO PREVENT MOVEMENT BY PROP WASH, JET BLAST OR OTHER WIND CURRENTS.
7. THE ONLY COLOR COMBINATION ON BARRICADES IS ORANGE AND WHITE. THE ORANGE STRIPES SHALL BE ENCAPSULATED LENS REFLECTIVE SHEETING. THE WHITE STRIPES SHALL BE EITHER ENCAPSULATED OR ENCLOSED LENS REFLECTIVE SHEETING AND MUST BE IN ACCEPTABLE CONDITION.
8. COST FOR PROVIDING, PLACING, MAINTAINING, AND REMOVING BARRICADES SHALL BE PAID FOR UNDER ITEM AR150520 - MOBILIZATION.

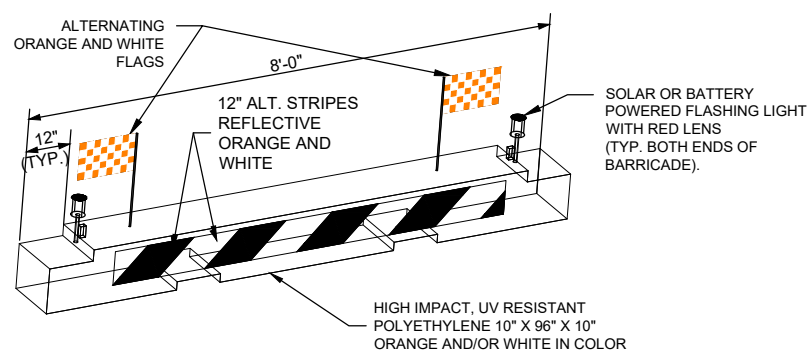

**LOW-PROFILE BARRICADE DETAIL**

NOT TO SCALE

DETAIL ABOVE REPRESENTS ONE OPTION FOR LOW-PROFILE BARRICADES. OTHER OPTIONS MAY BE UTILIZED AS LONG AS THEY MEET THE REQUIREMENTS OF THE PROJECT, INCLUDING BARRICADE NOTE 1.



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/21

REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-T  
 IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	R

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: C-302-TYP.DWG


DESIGN BY: JRH 3/18/2021

DRAWN BY: JRH 4/16/2021


REVIEWED BY: BSS 4/16/2021

SHEET TITLE


TYPICAL SECTIONS

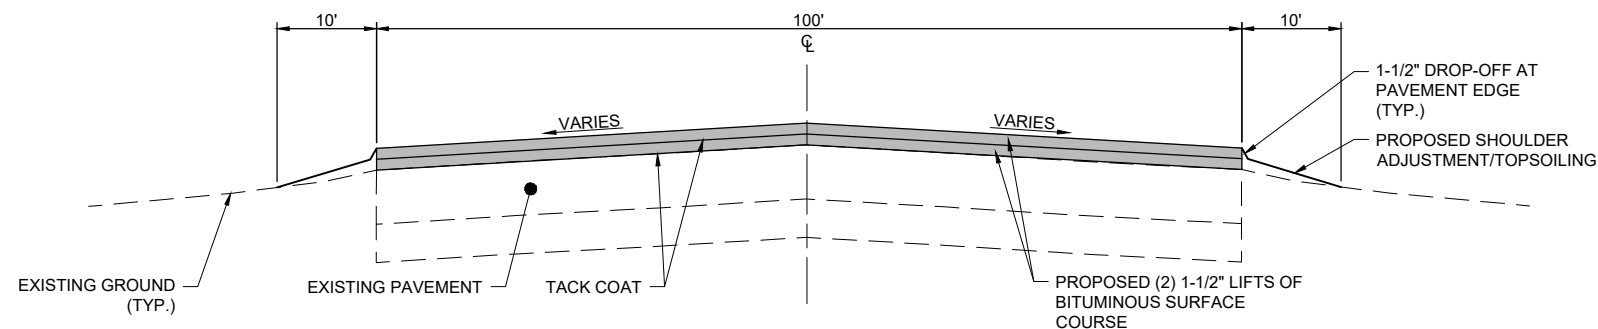


TYPICAL SECTION - RUNWAY 17-35  
 NOT TO SCALE

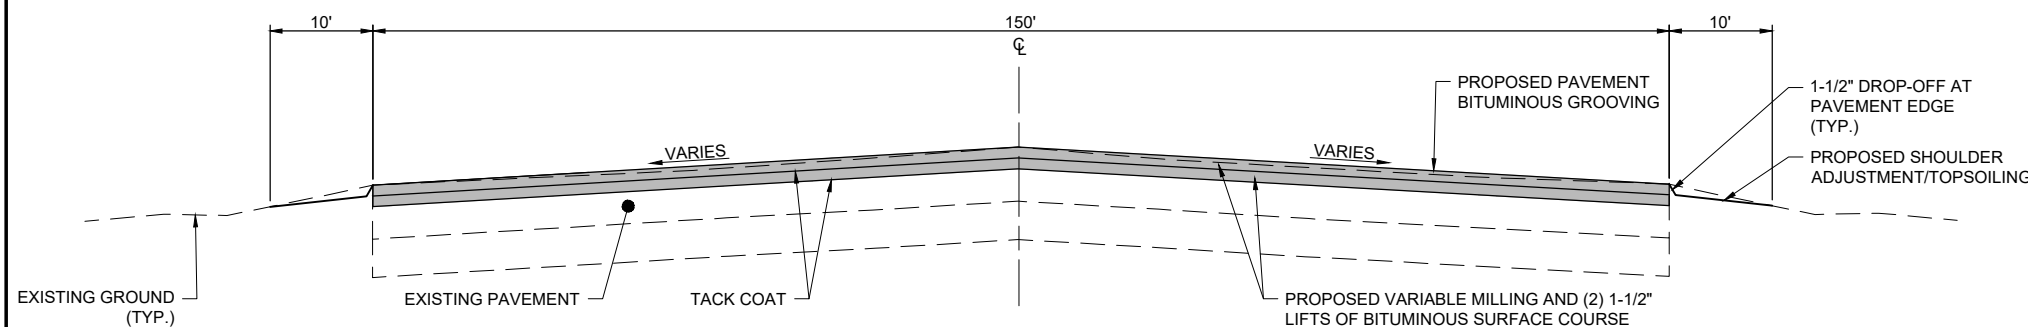


TYPICAL SECTION - RUNWAY 11-29  
 NOT TO SCALE

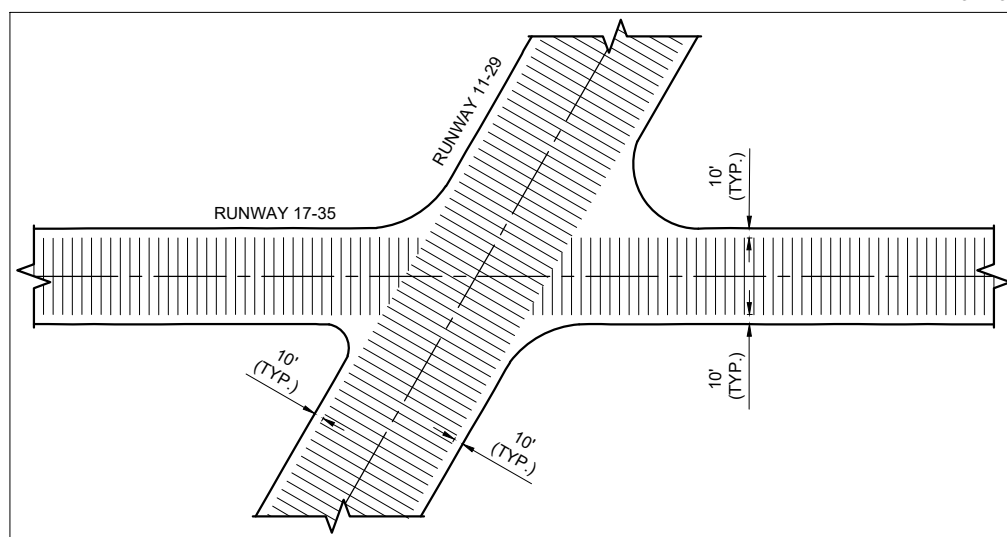

GROOVING PLAN - INTERSECTION DETAIL  
 NOT TO SCALE

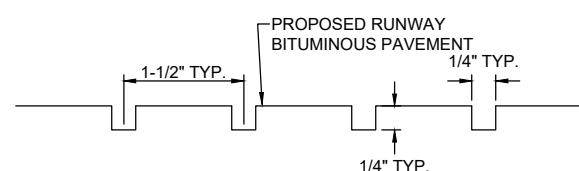

GROOVING DETAIL  
 NOT TO SCALE

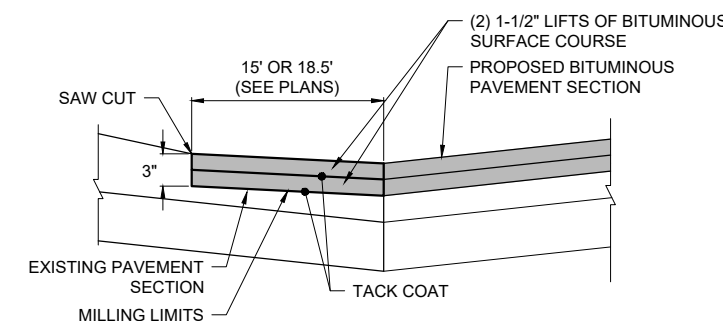

BUTT JOINT DETAIL  
 NOT TO SCALE

BITUMINOUS PAVEMENT GROOVING NOTES

1. A PERIOD OF 30 CALENDAR DAYS MINIMUM SHALL ELAPSE BETWEEN THE FINAL PLACEMENT OF THE BITUMINOUS SURFACE COURSE AND THE GROOVING OPERATIONS.
2. THE PROPOSED GROOVES WILL BE CUT PERPENDICULAR TO THE RUNWAY CENTERLINE AND WILL TERMINATE 10' FROM THE RUNWAY PAVEMENT EDGE.
3. THE GROOVES WILL BE 1/4" WIDE, 1/4" DEEP AND PLACED ON 1 1/2" CENTERS
4. TOLERANCES ON THE GROOVING WILL BE 3" IN ALIGNMENT FOR 75', ±1/16" IN DEPTH, +1/16" IN WIDTH, -1/8" IN GROOVE SPACING.
5. GROOVES SHALL BE SAWED NO LESS THAN 6" AND NO MORE THAN 18" FROM AN IN-PAVEMENT LIGHT OR STRUCTURE.
6. GROOVES SHALL NOT BE CLOSER THAN 3" OR MORE THAN 9" FROM TRANSVERSE JOINTS IN CONCRETE PAVEMENTS.
7. ALL SOLID MATERIAL GENERATED FROM GROOVING OPERATIONS WILL BE PICKED UP AND DISPOSED OF AT AN APPROVED LAND FILL OFF THE AIRPORT SITE, AT THE CONTRACTOR'S OWN EXPENSE.
8. NO MATERIAL WHICH IS HARMFUL TO VEGETATION WILL BE FLUSHED FROM THE GROOVED PAVEMENT ONTO THE TURFED SHOULDER, BUT WILL BE PICKED UP AND HAULED TO A LOCATION OFF THE AIRPORT SITE AT THE CONTRACTOR'S OWN EXPENSE.
9. AT THE END OF EACH WORK DAY THE RUNWAY WILL BE FLUSHED, CLEANED AND CLEARED OF ALL MATERIAL GENERATED BY THE GROOVING OPERATION.

BUTT JOINT CONSTRUCTION NOTES

1. ALL BITUMINOUS PAVEMENT MILLING AREAS FOR PROPOSED BUTT JOINTS WILL BE LOCATED AND MARKED BY THE RESIDENT ENGINEER/TECHNICIAN.
2. THE PAVEMENT SURFACE WILL THEN BE MILLED TO A DEPTH OF 3 INCHES AT THE BUTT END AND WILL TAPER TO A 3 INCH DEPTH WHEN MEASURED FROM THE PROPOSED PAVEMENT SURFACE AT THE OPPOSITE END. THE PLANER MUST BE CAPABLE OF MILLING THE SURFACE TO THE DESIRED ELEVATIONS AND GRADES.
3. ANY ADJACENT PAVEMENT DAMAGED BY THE MILLING OPERATIONS WILL BE REPAIRED AT THE CONTRACTOR'S OWN EXPENSE.
4. BUTT JOINTS WILL BE PAVED WITH THE RESPECTIVE LIFTS OF SURFACE COURSE ON RUNWAY.
5. THE MILLING, TACK COAT AND BITUMINOUS PAVING SHALL BE PAID FOR UNDER THEIR RESPECTIVE PAY ITEMS. THE SAW-CUT AND OTHER ASSOCIATED WORK SHALL BE INCIDENTAL.

FOR BID



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-121-CON.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021


SHEET TITLE

**PROPOSED  
CONSTRUCTION  
PLAN - STA. 99+00 TO  
STA. 115+00**

**FOR BID**

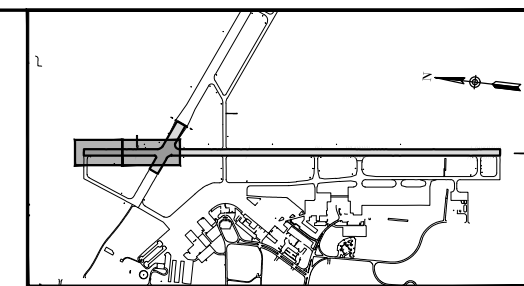

KEYMAP





0' 20' 40' 80'  
HALF SIZE SCALE: 1"= 80'  
FULL SIZE SCALE: 1"= 40'

**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED SAWCUT
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

**KEYNOTES**

- (A) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (NOT SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. FIELD VERIFY LOCATION & ELEVATION.
- (B) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. EXIST TOC - XXX.XX

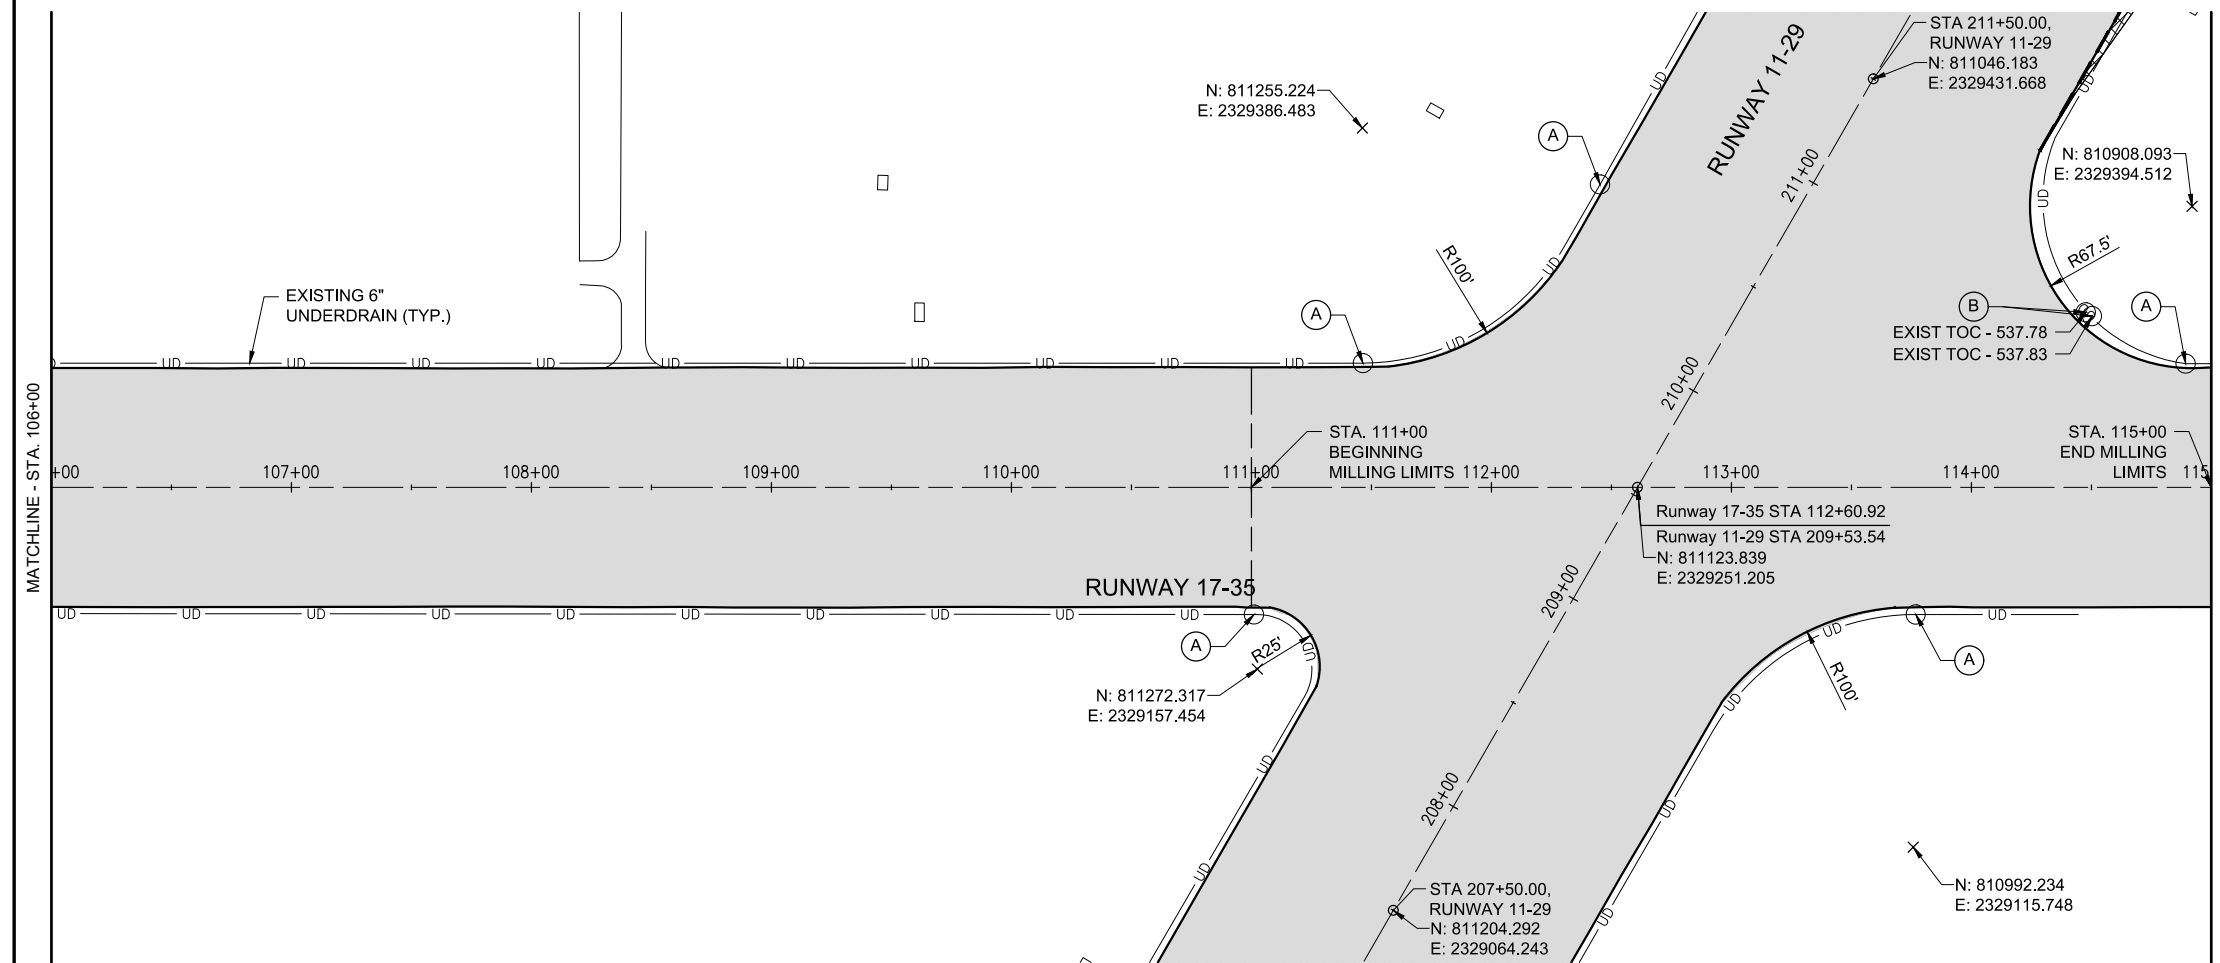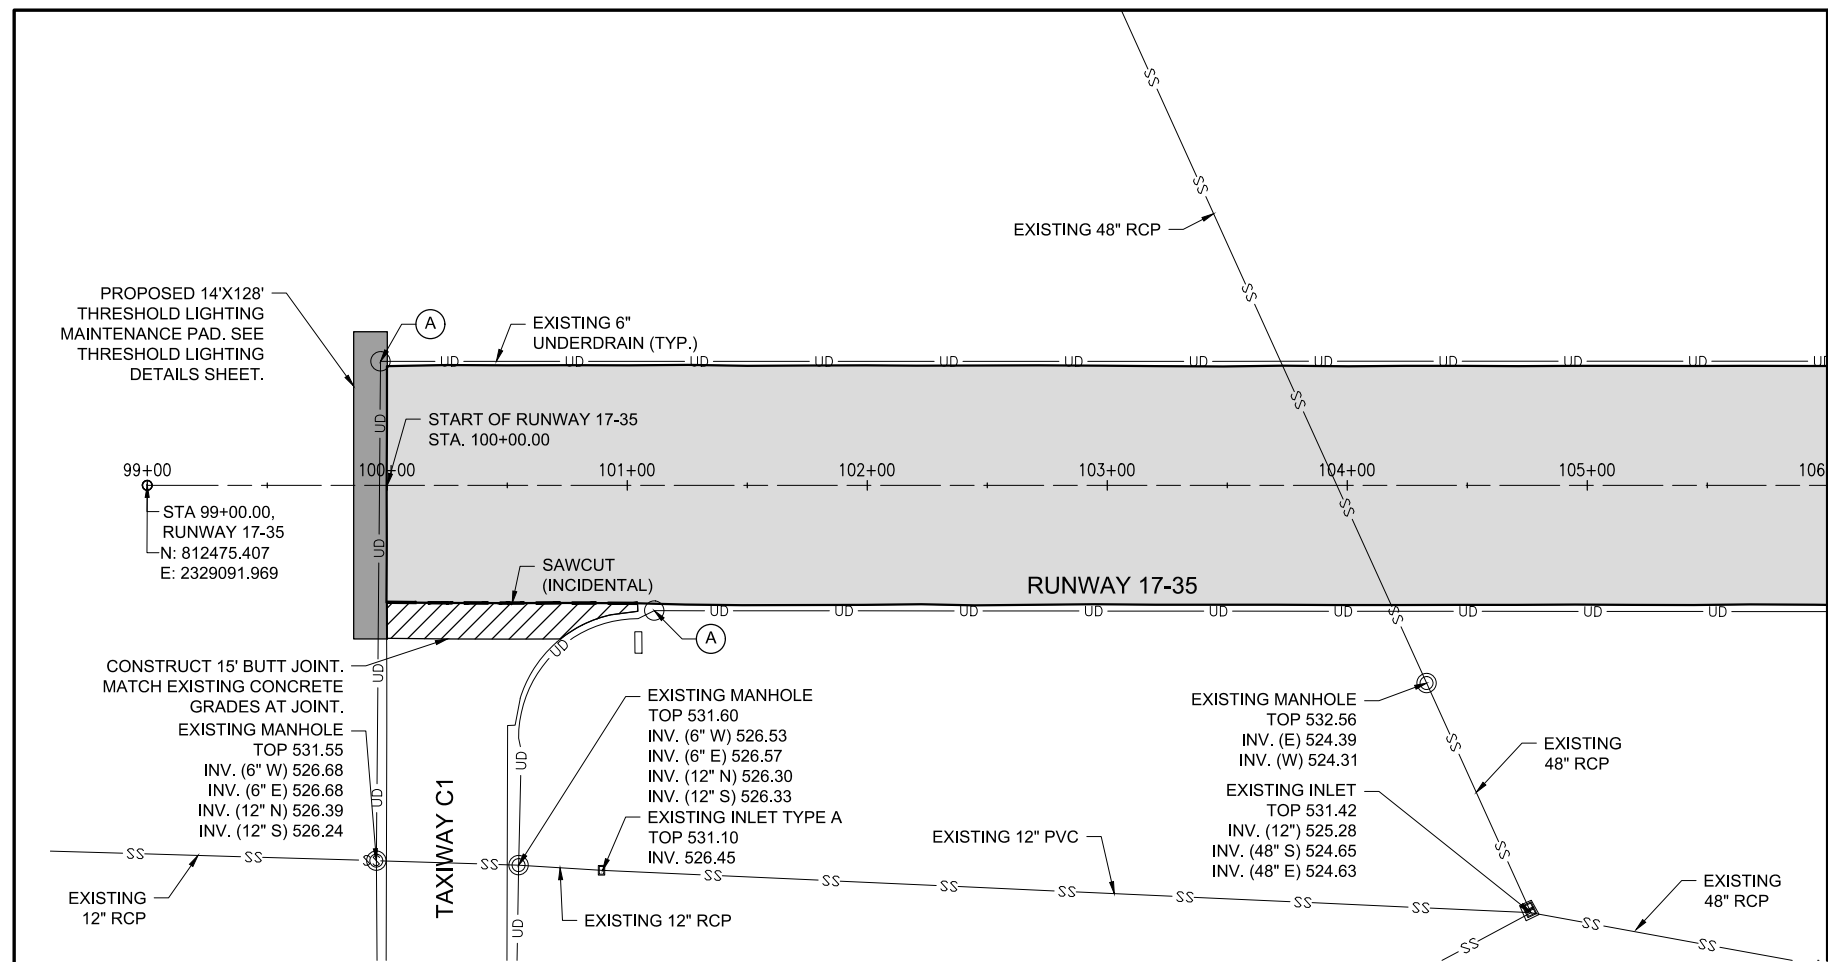

APR 19, 2021 2:35 PM HERNDON01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEETC-121.CGN



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-121-CON.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021



SHEET TITLE

PROPOSED  
CONSTRUCTION  
PLAN - STA. 115+00  
TO STA. 133+00

**FOR BID**

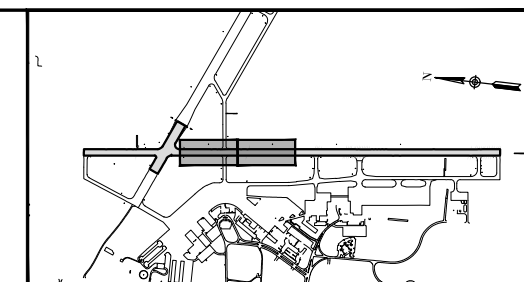

KEYMAP




**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED SAWCUT
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

**KEYNOTES**

- (A) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (NOT SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. FIELD VERIFY LOCATION & ELEVATION.
- (B) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. EXIST TOC - XXX.XX

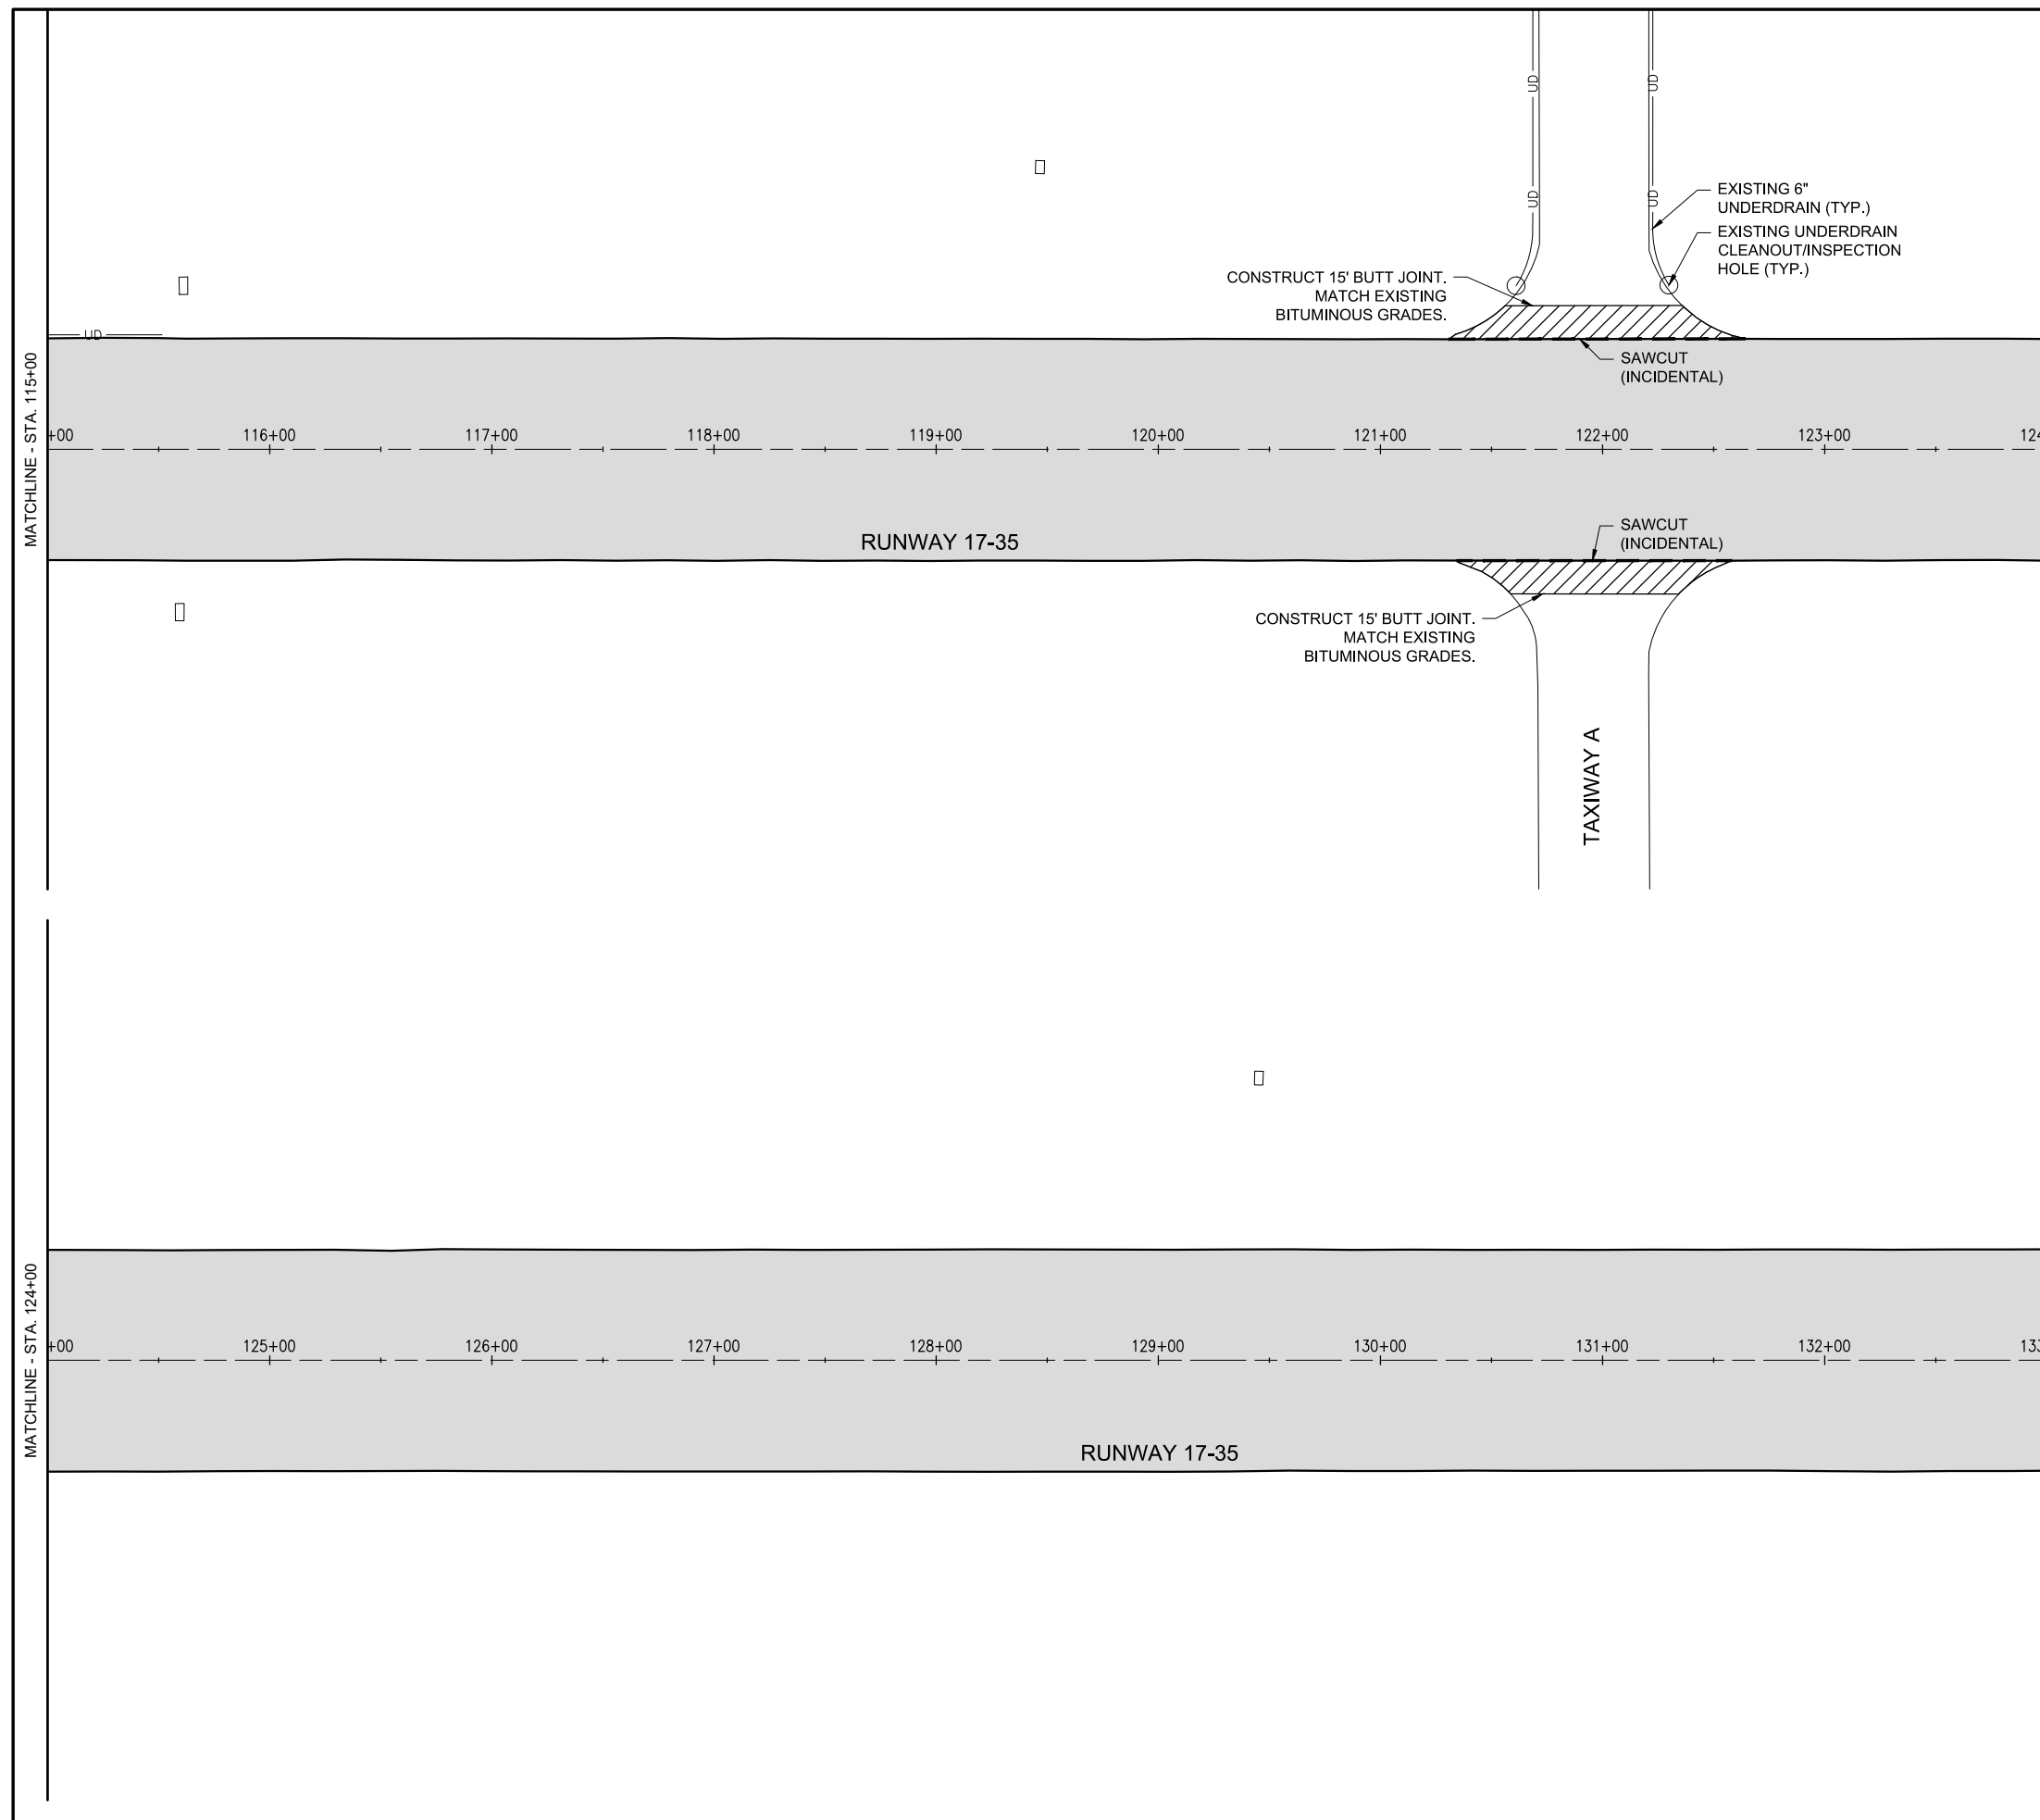

APR 19, 2021 2:35 PM HERNDON1562  
I:\17\JOBS\17A008504\CAD\AIRPORT\TSSHEETC-121-CON





*Jaycen Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812



Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-121-CON.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED  
CONSTRUCTION  
PLAN - STA. 133+00  
TO STA. 151+00

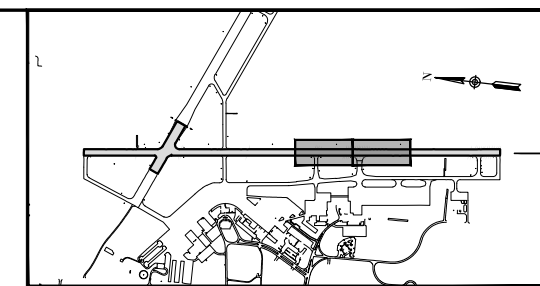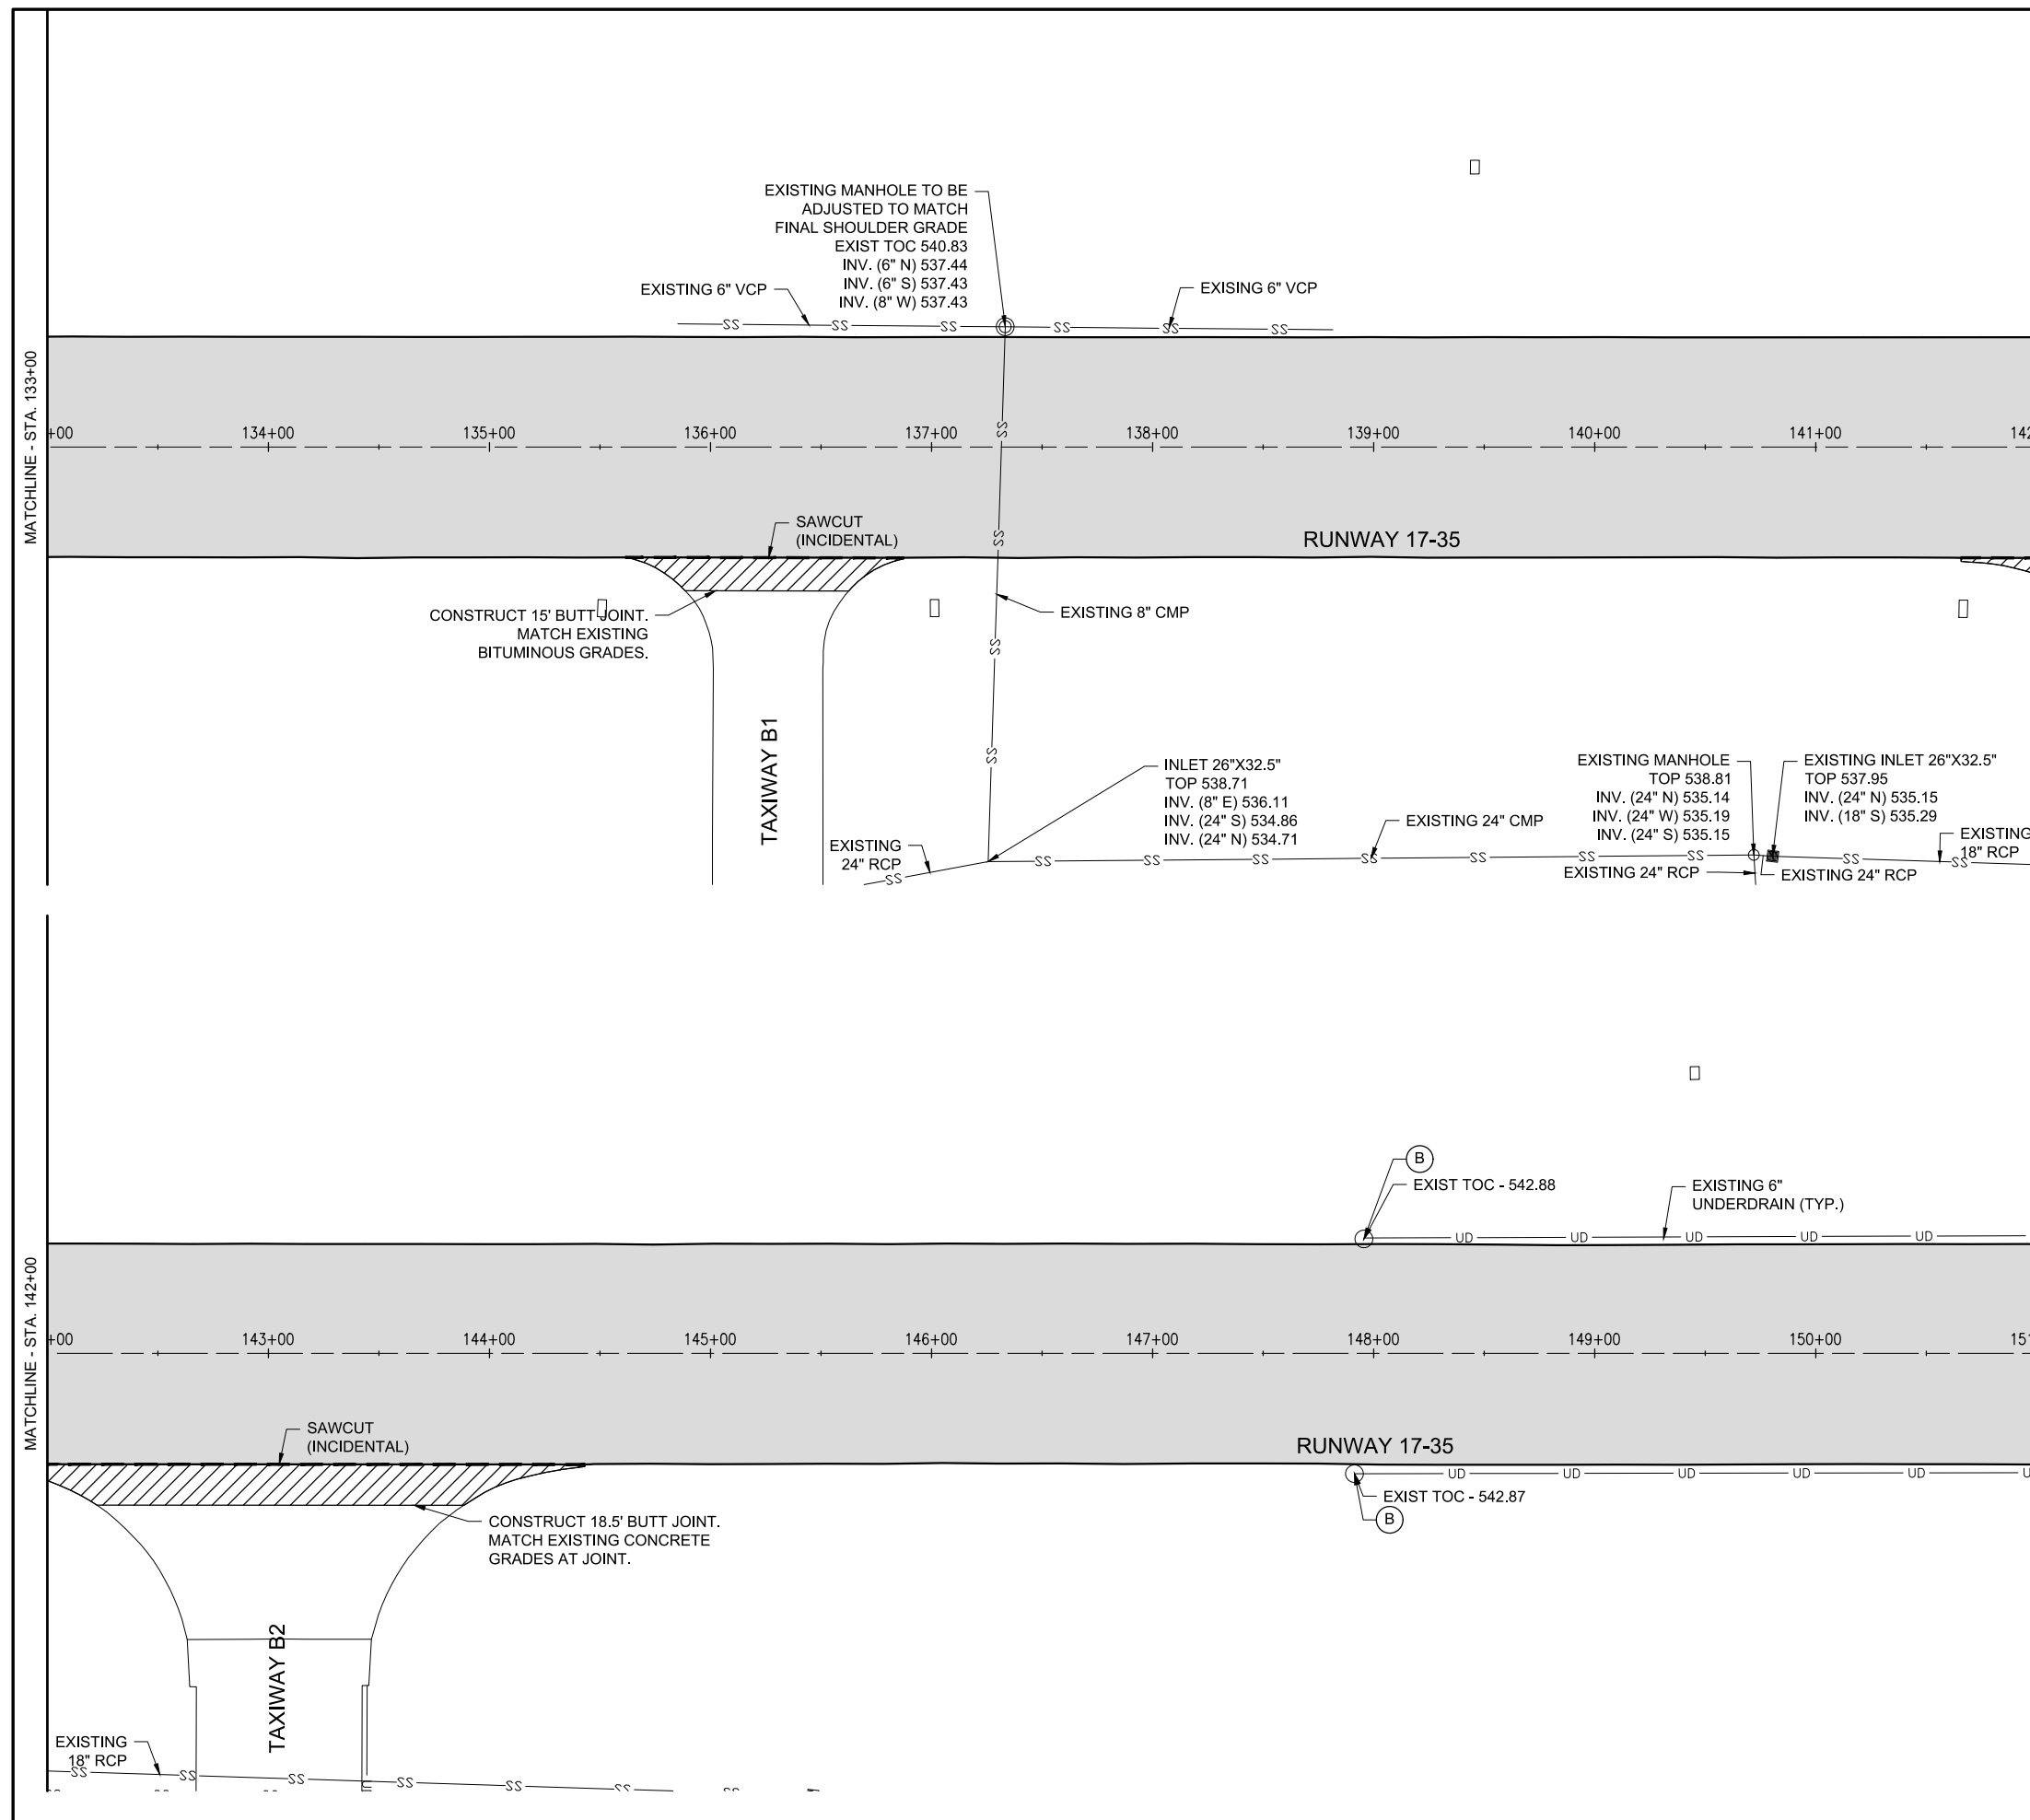

KEYMAP



**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED SAWCUT
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

**KEYNOTES**

- (A) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (NOT SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. FIELD VERIFY LOCATION & ELEVATION.
- (B) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. EXIST TOC - XXX.XX

APR 19, 2021 2:36 PM HERND01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHETC-121-CON

**FOR BID**





*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-121-CON.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021

SHEET TITLE




PROPOSED  
CONSTRUCTION  
PLAN - STA. 205+50  
TO STA. 215+50

KEYNOTES

- (A) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (NOT SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. FIELD VERIFY LOCATION & ELEVATION.
- (B) EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE (SURVEYED) TO BE ADJUSTED TO MATCH FINAL SHOULDER GRADE. EXIST TOC - XXX.XX

LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED BITUMINOUS PAVEMENT REMOVAL
- PROPOSED SAWCUT
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

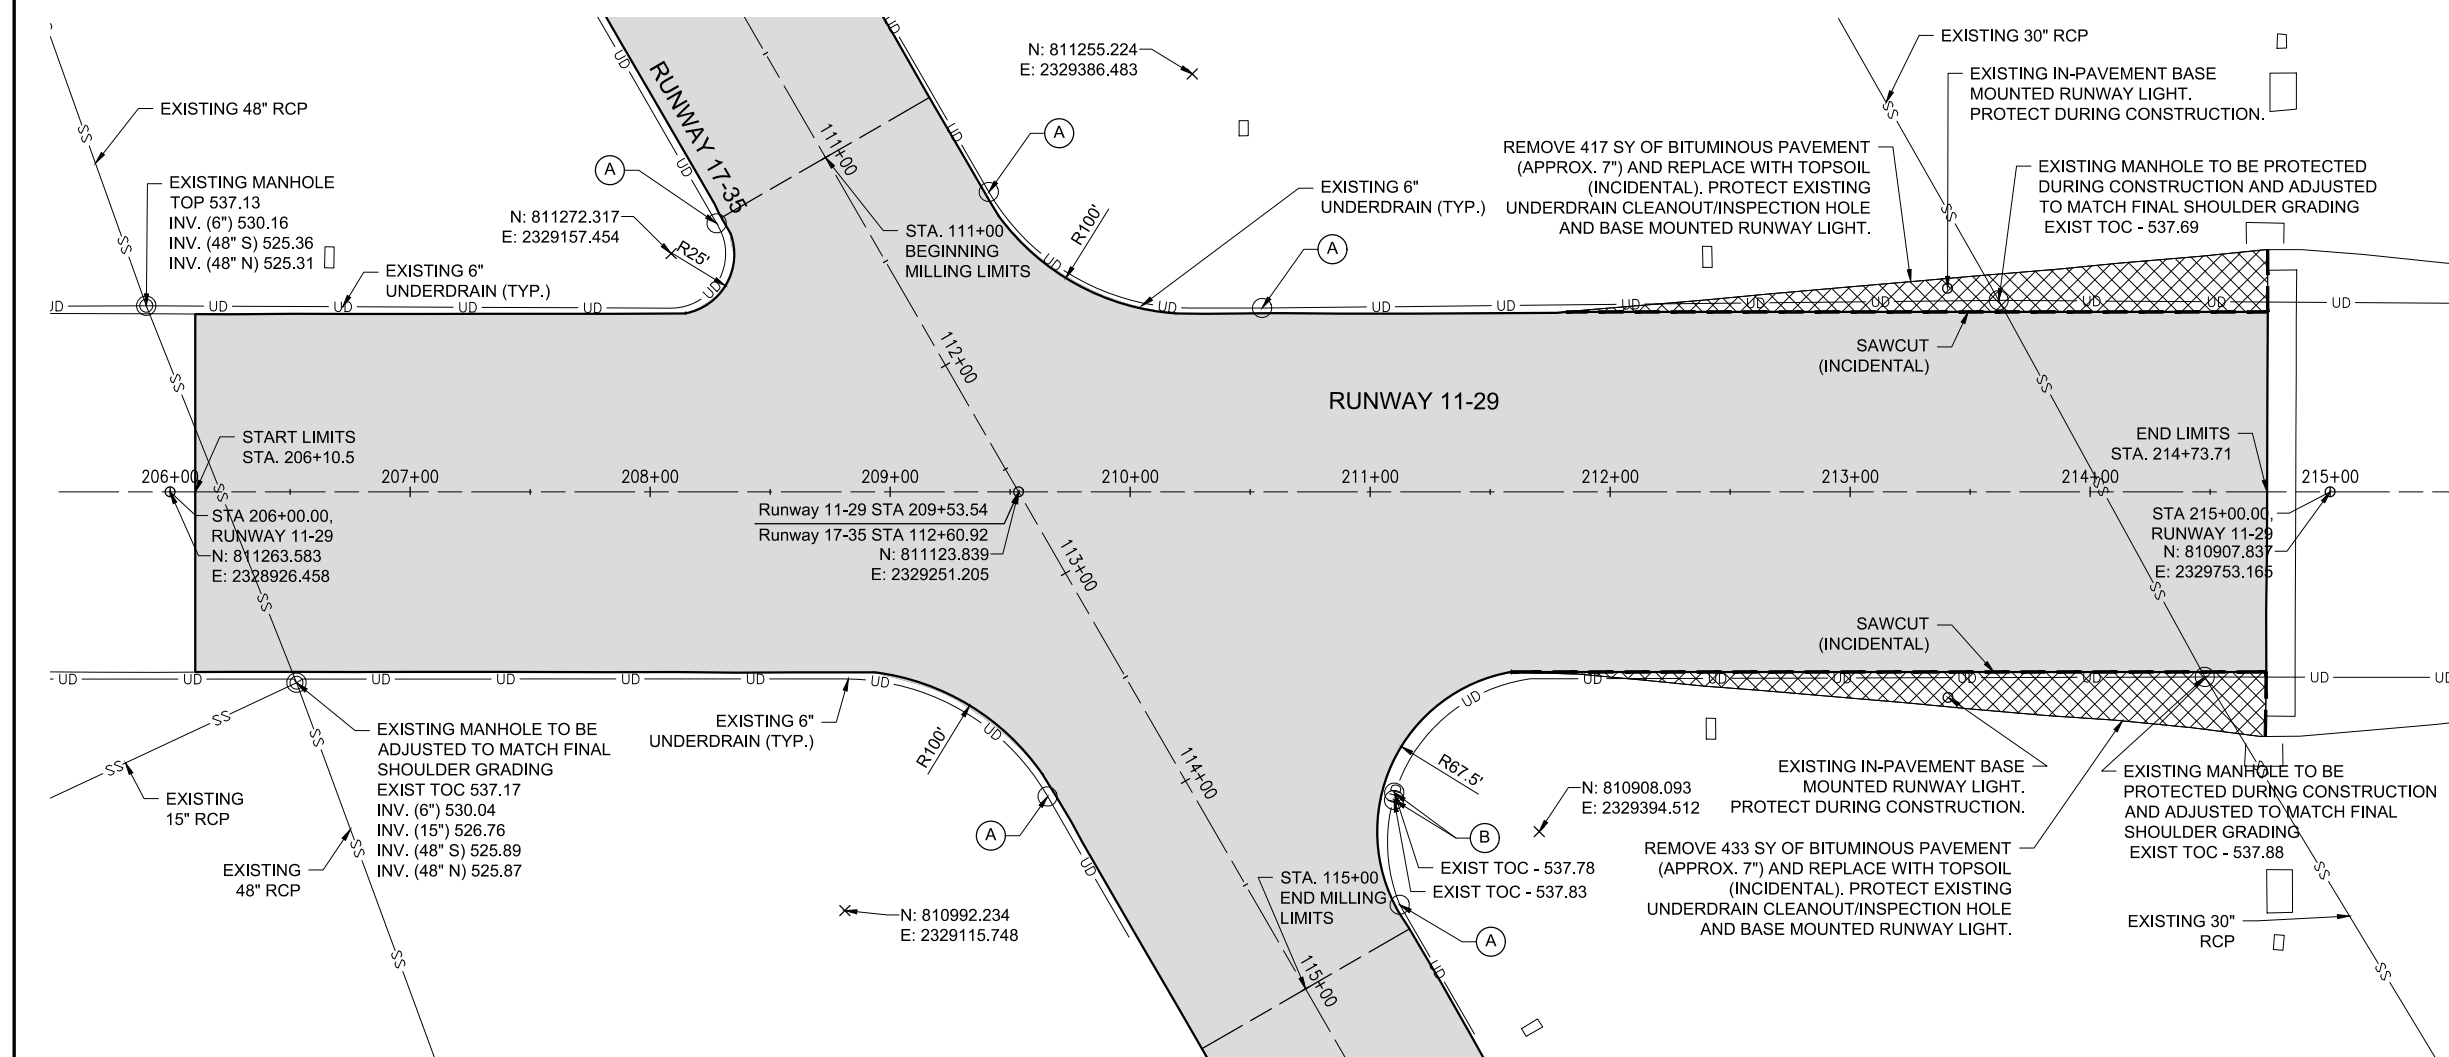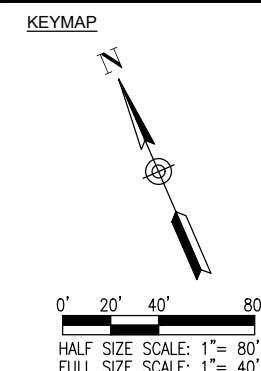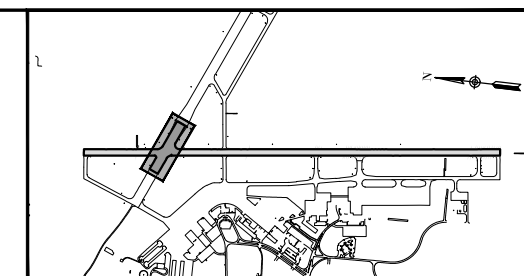

APR 19, 2021 2:36 PM HERNDON1562  
I:\17.JOBS\17A008504\CAD\AIRPORT\TSHEETC-121-CON

FOR BID



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-181-STK.DWG  
 DESIGN BY: JRH 4/12/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**PROPOSED  
 VARIABLE MILLING  
 PLAN**

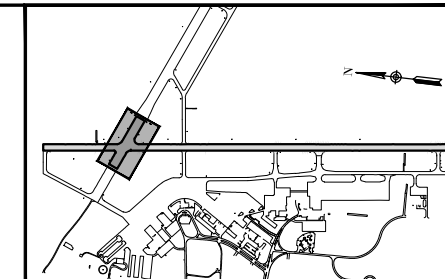

KEYMAP

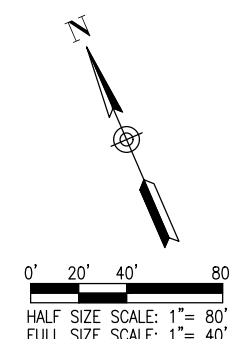


**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

NO.	MIN. MILL DEPTH	MAX. MILL DEPTH	COLOR
1	-4"	-5"	Red
2	-3"	-4"	Yellow
3	-2"	-3"	Green
4	-1"	-2"	Blue
5	0"	-1"	Purple

**NOTES:**

- THIS PLAN SHEET IS INTENDED TO BE PRINTED IN COLOR FOR BEST VISIBILITY.
- FOLLOWING THE PROJECT AWARD, THE ENGINEER CAN PROVIDE THE RELEVANT AUTOCAD AND CIVIL 3D SURFACE MODEL FILES TO THE AWARDED CONTRACTOR UPON REQUEST TO ASSIST WITH CONSTRUCTION LAYOUT.

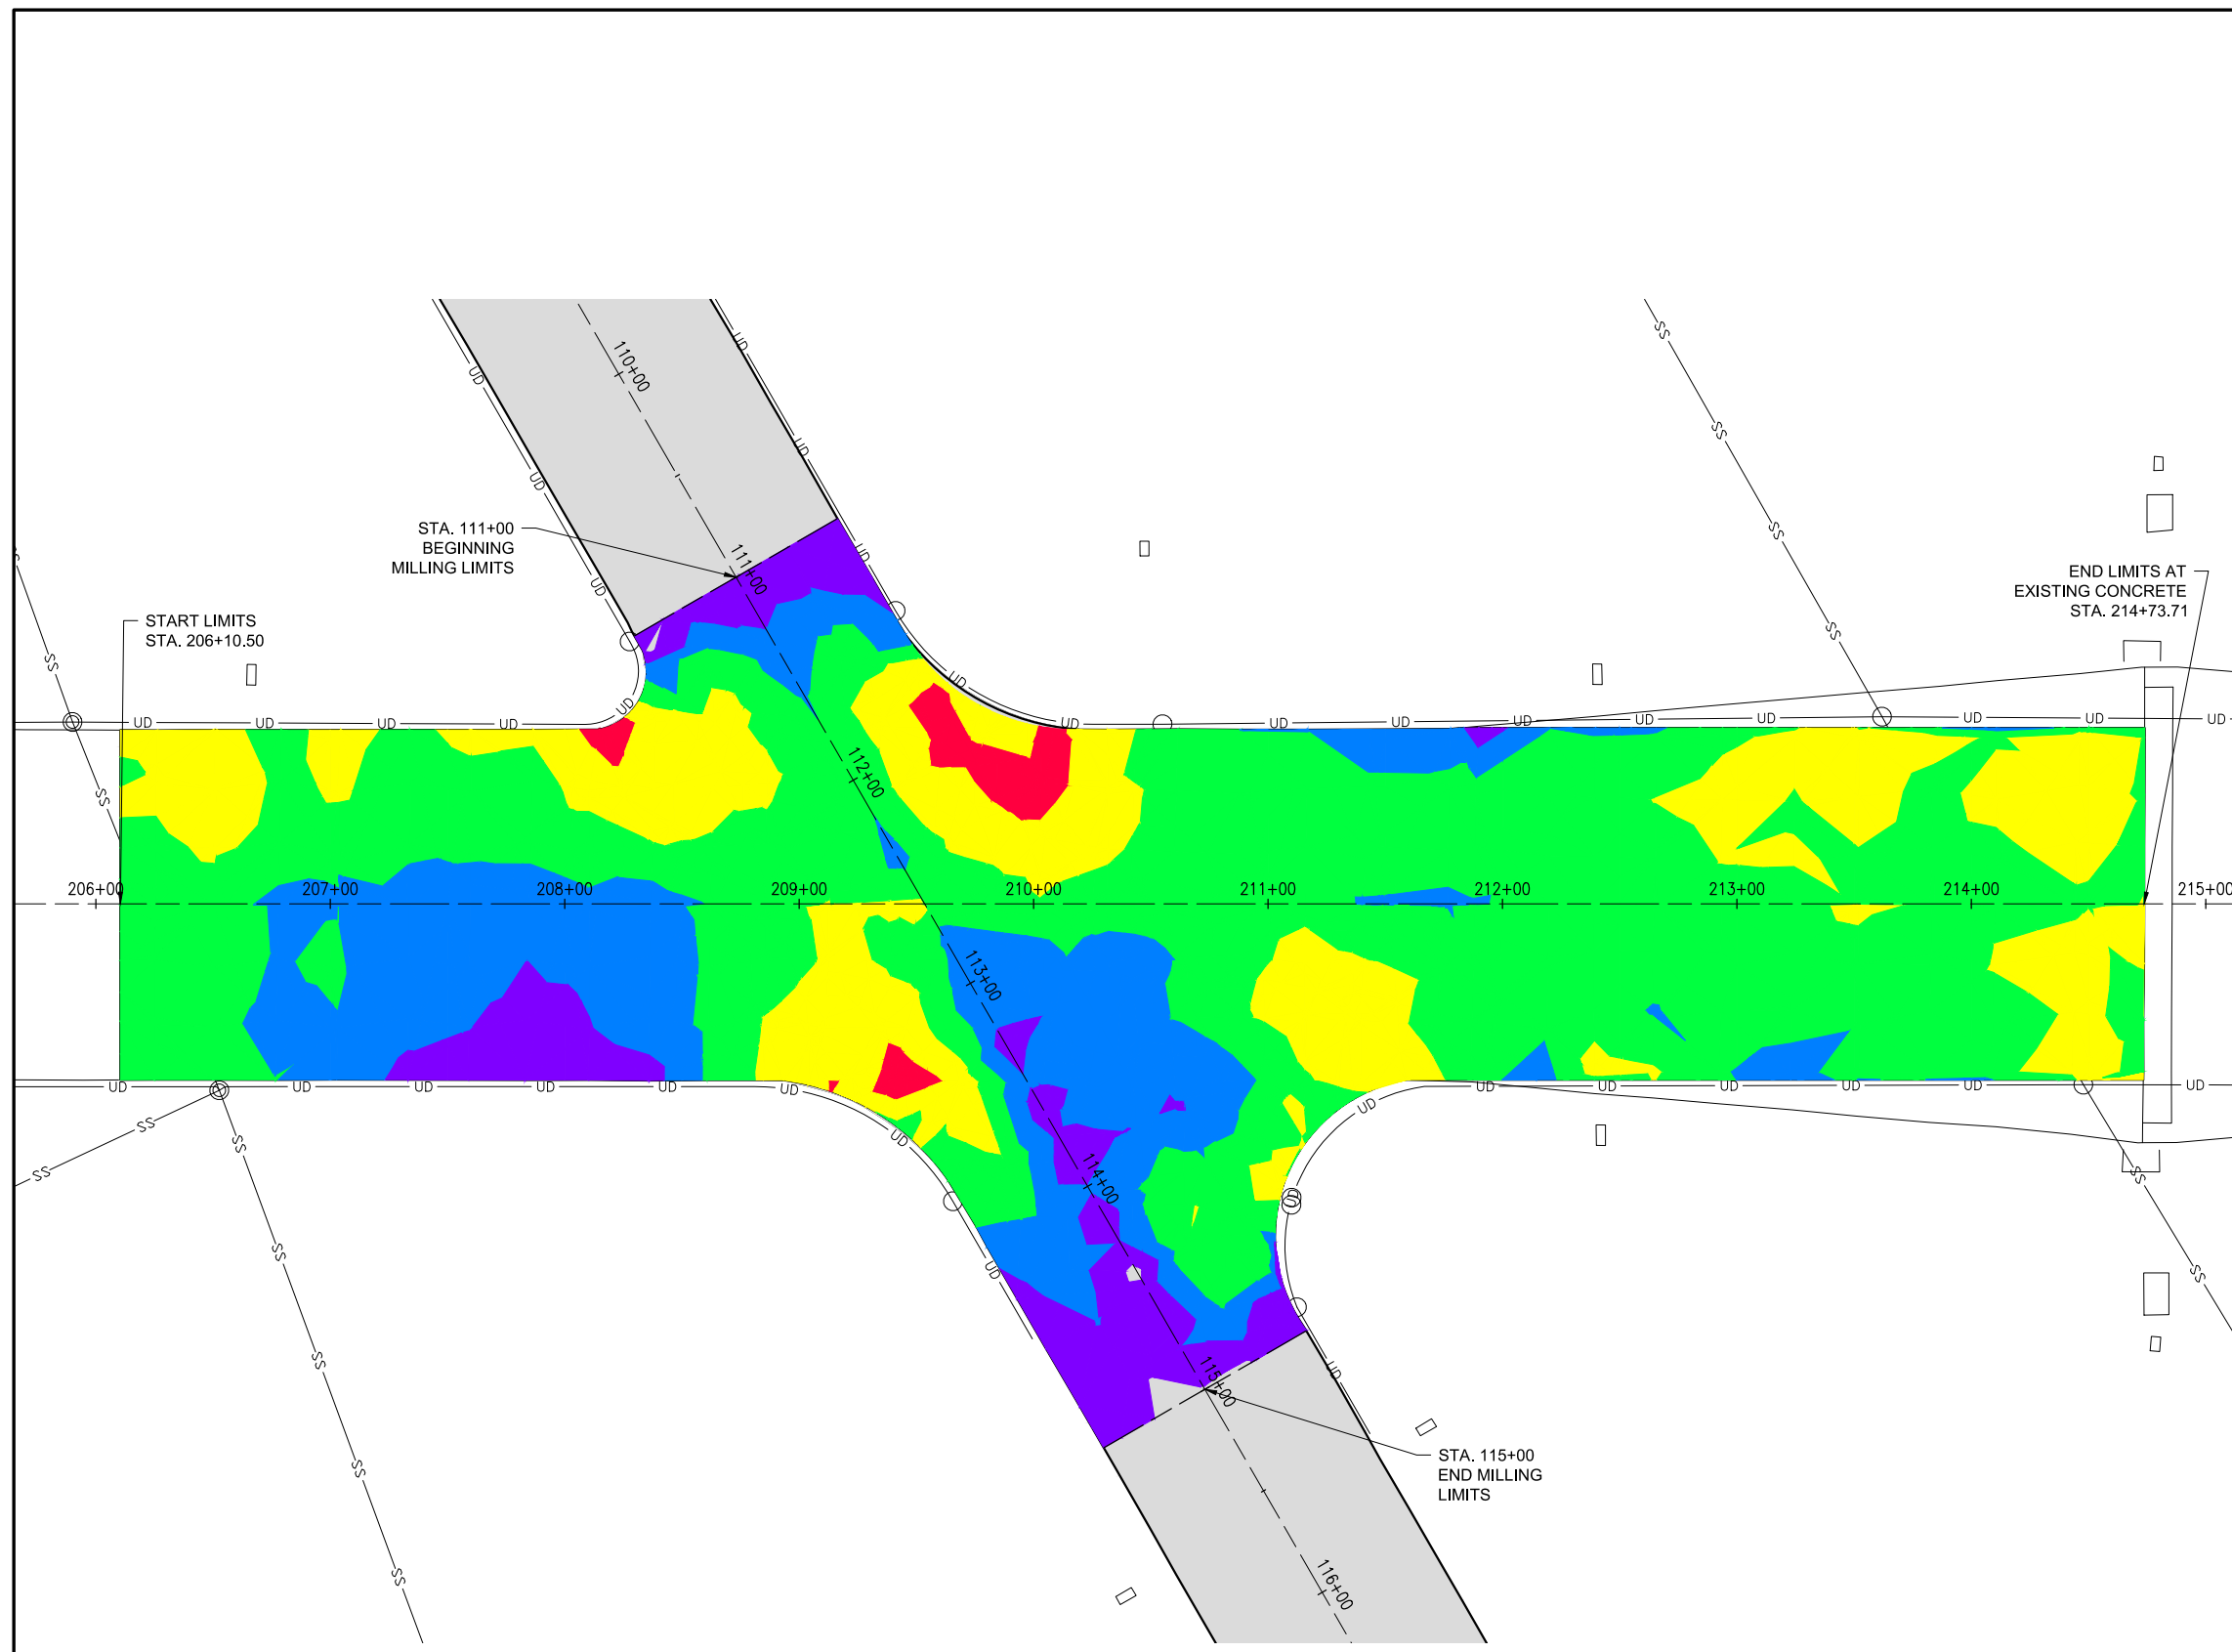

APR 19, 2021 2:37 PM HERND01562  
 I:\17 JOBS\17A008504\CAD\AIRPORT\181-STK

**FOR BID**







*Jaycen Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812



Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-701-PNP.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED PLAN &  
 PROFILE - STA.  
 106+00 TO STA.  
 115+00

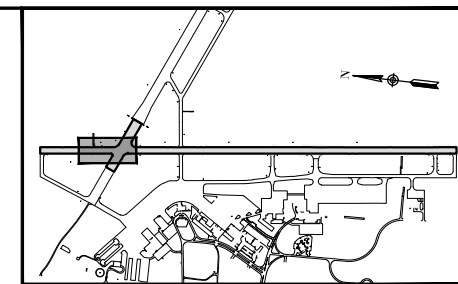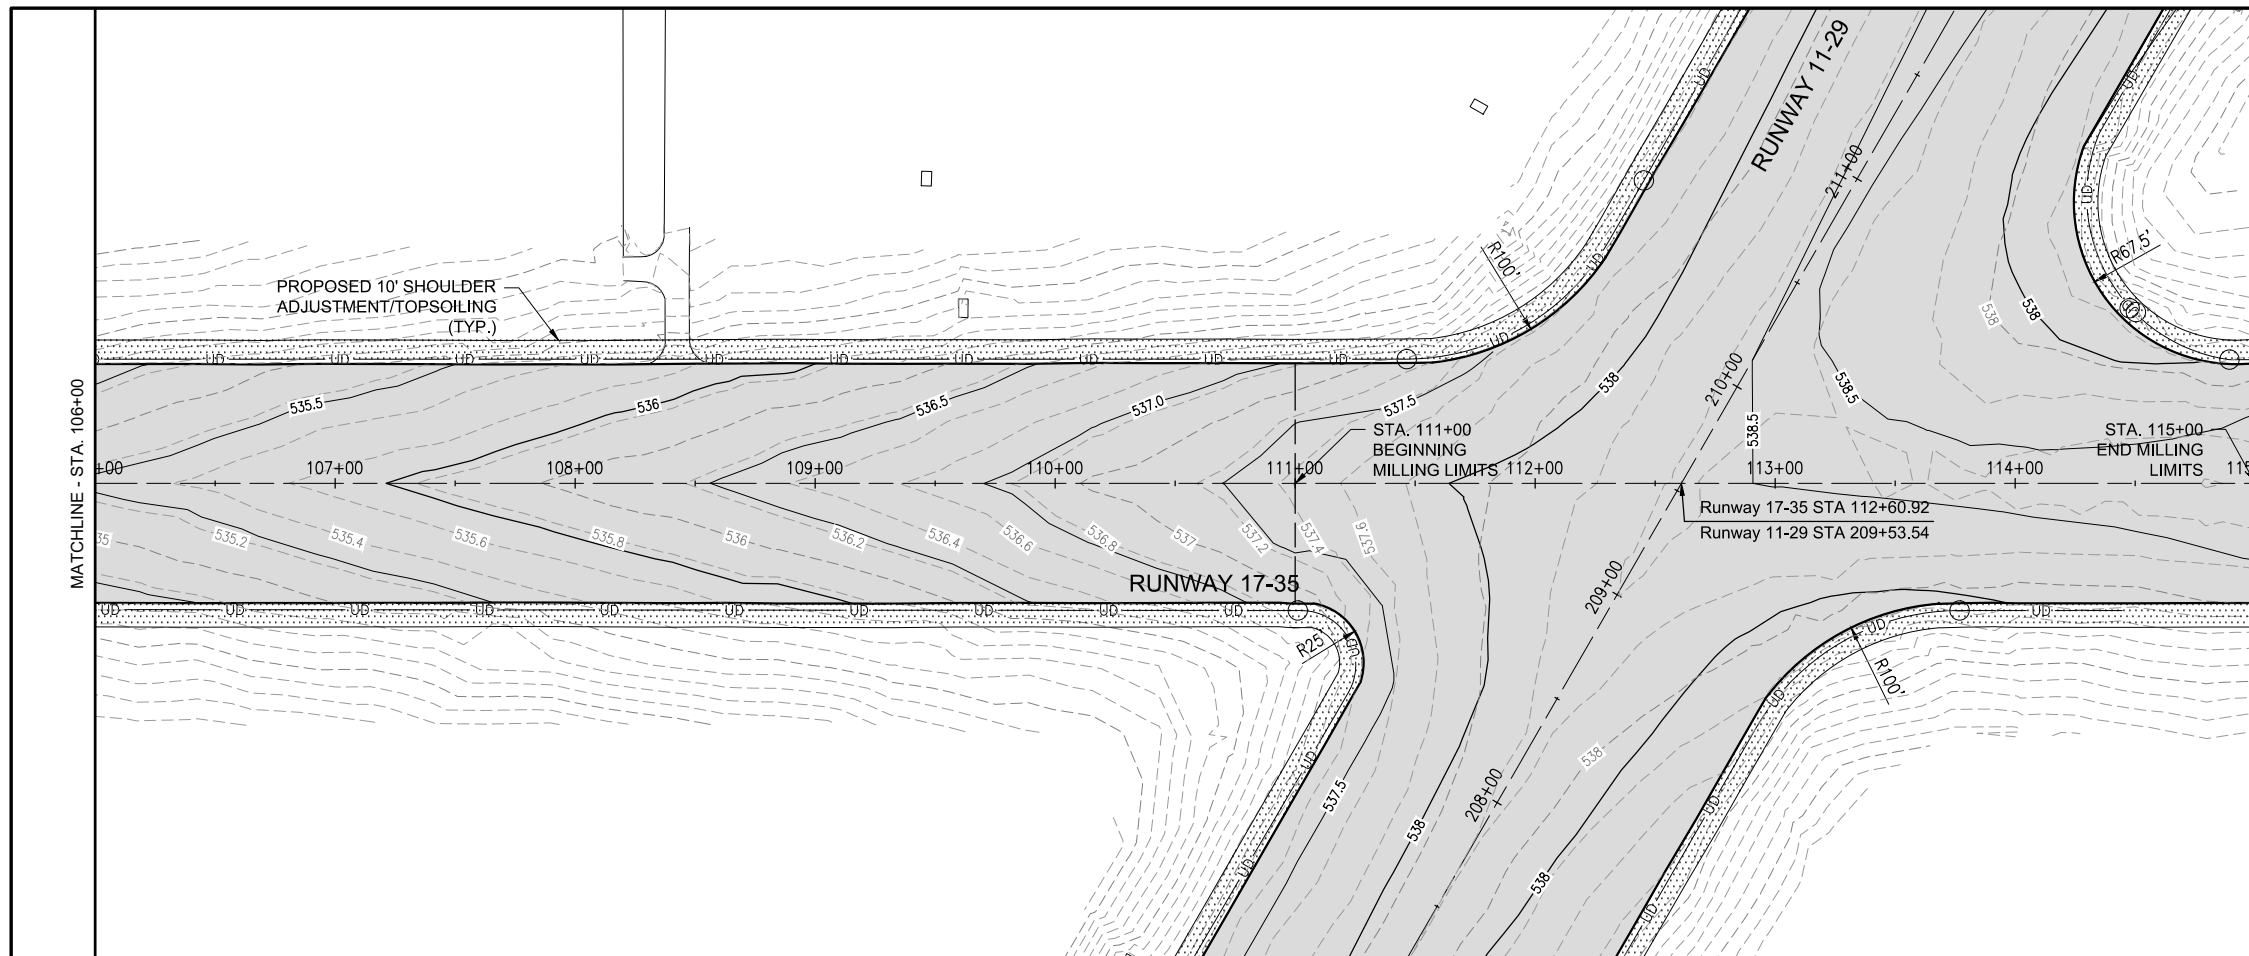


KEYMAP



LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

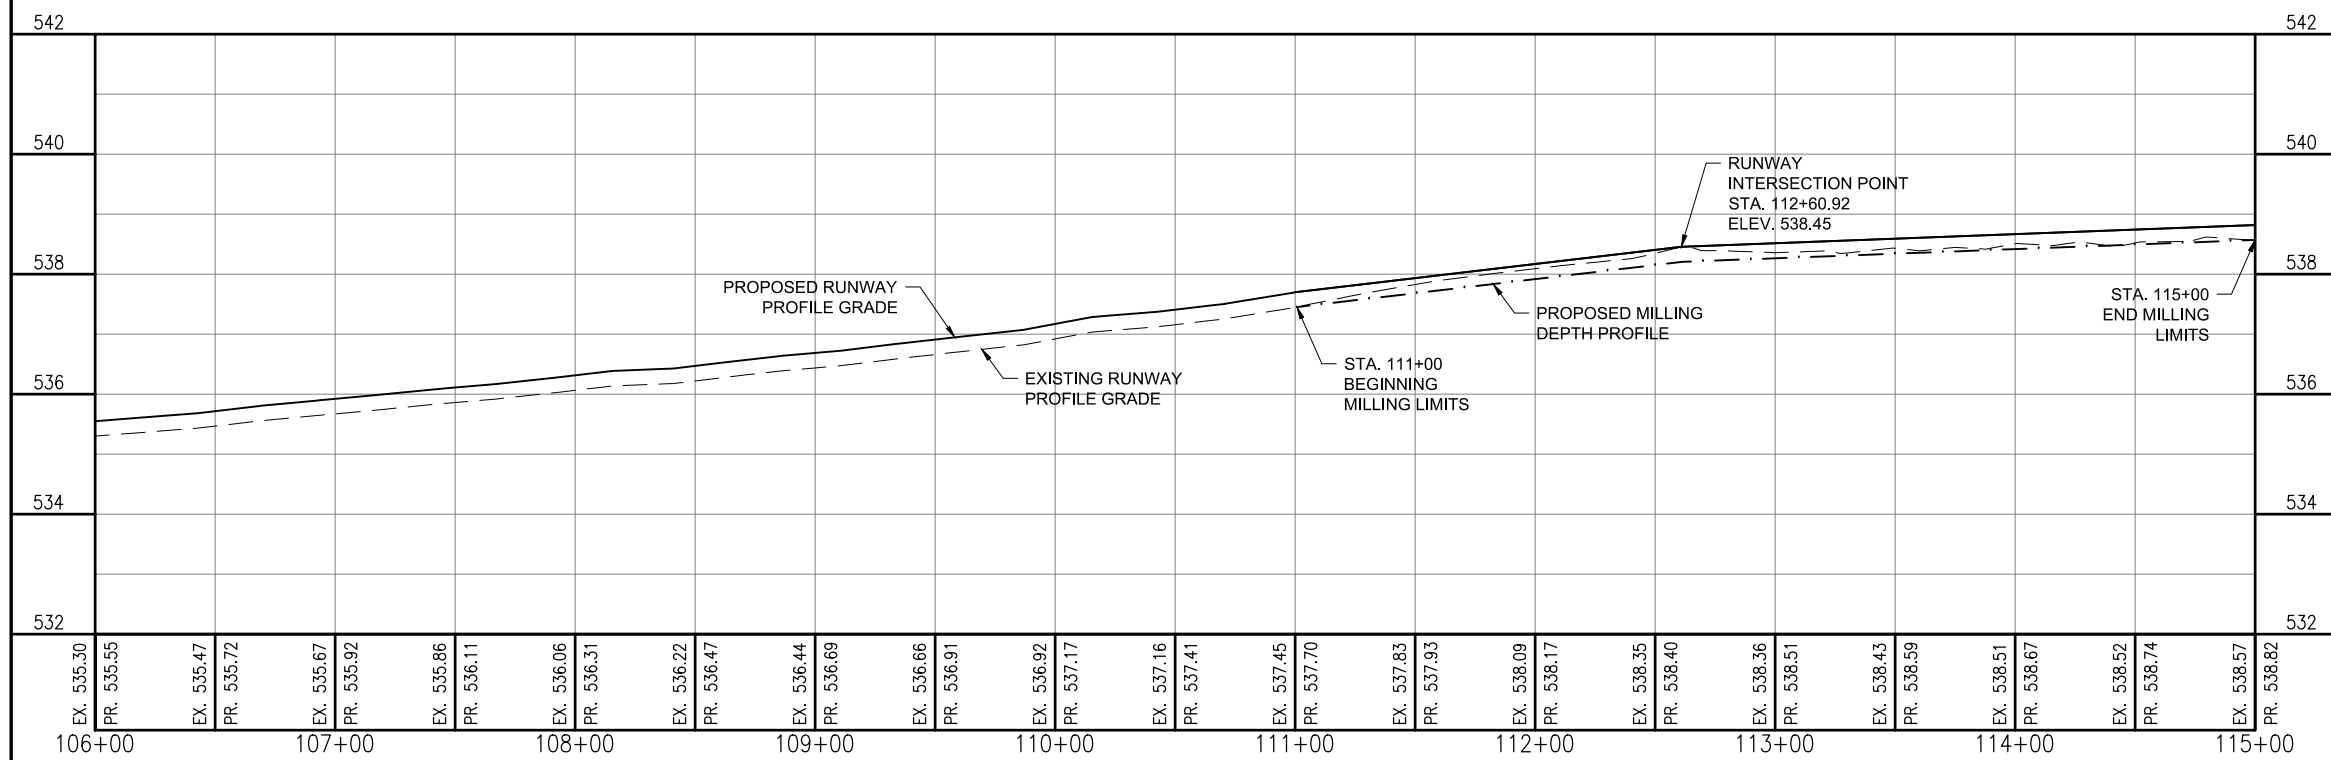

APR 19, 2021 2:38 PM HERNDO1562 I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-701-PNP

FOR BID



*Jaycen Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812


Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-701-PNP.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED PLAN &  
 PROFILE - STA.  
 115+00 TO STA.  
 124+00


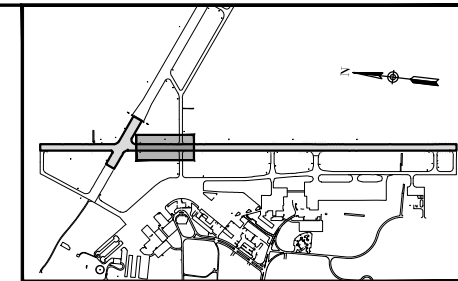


KEYMAP



LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

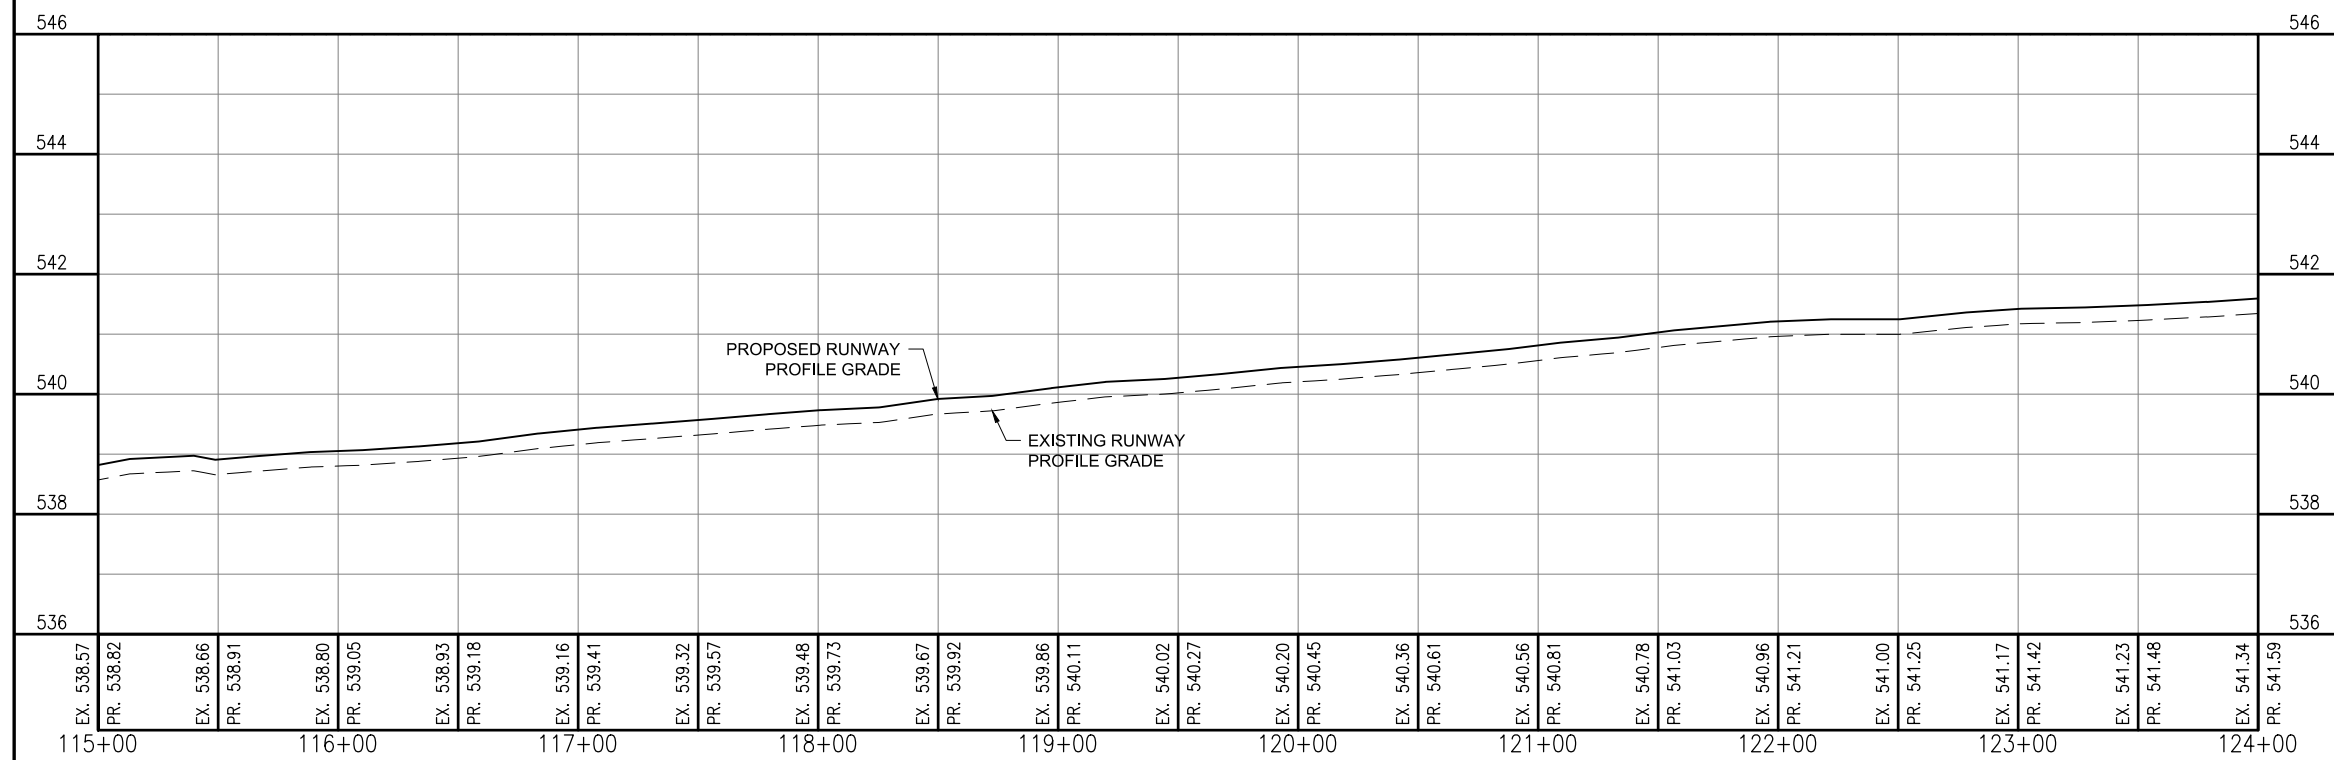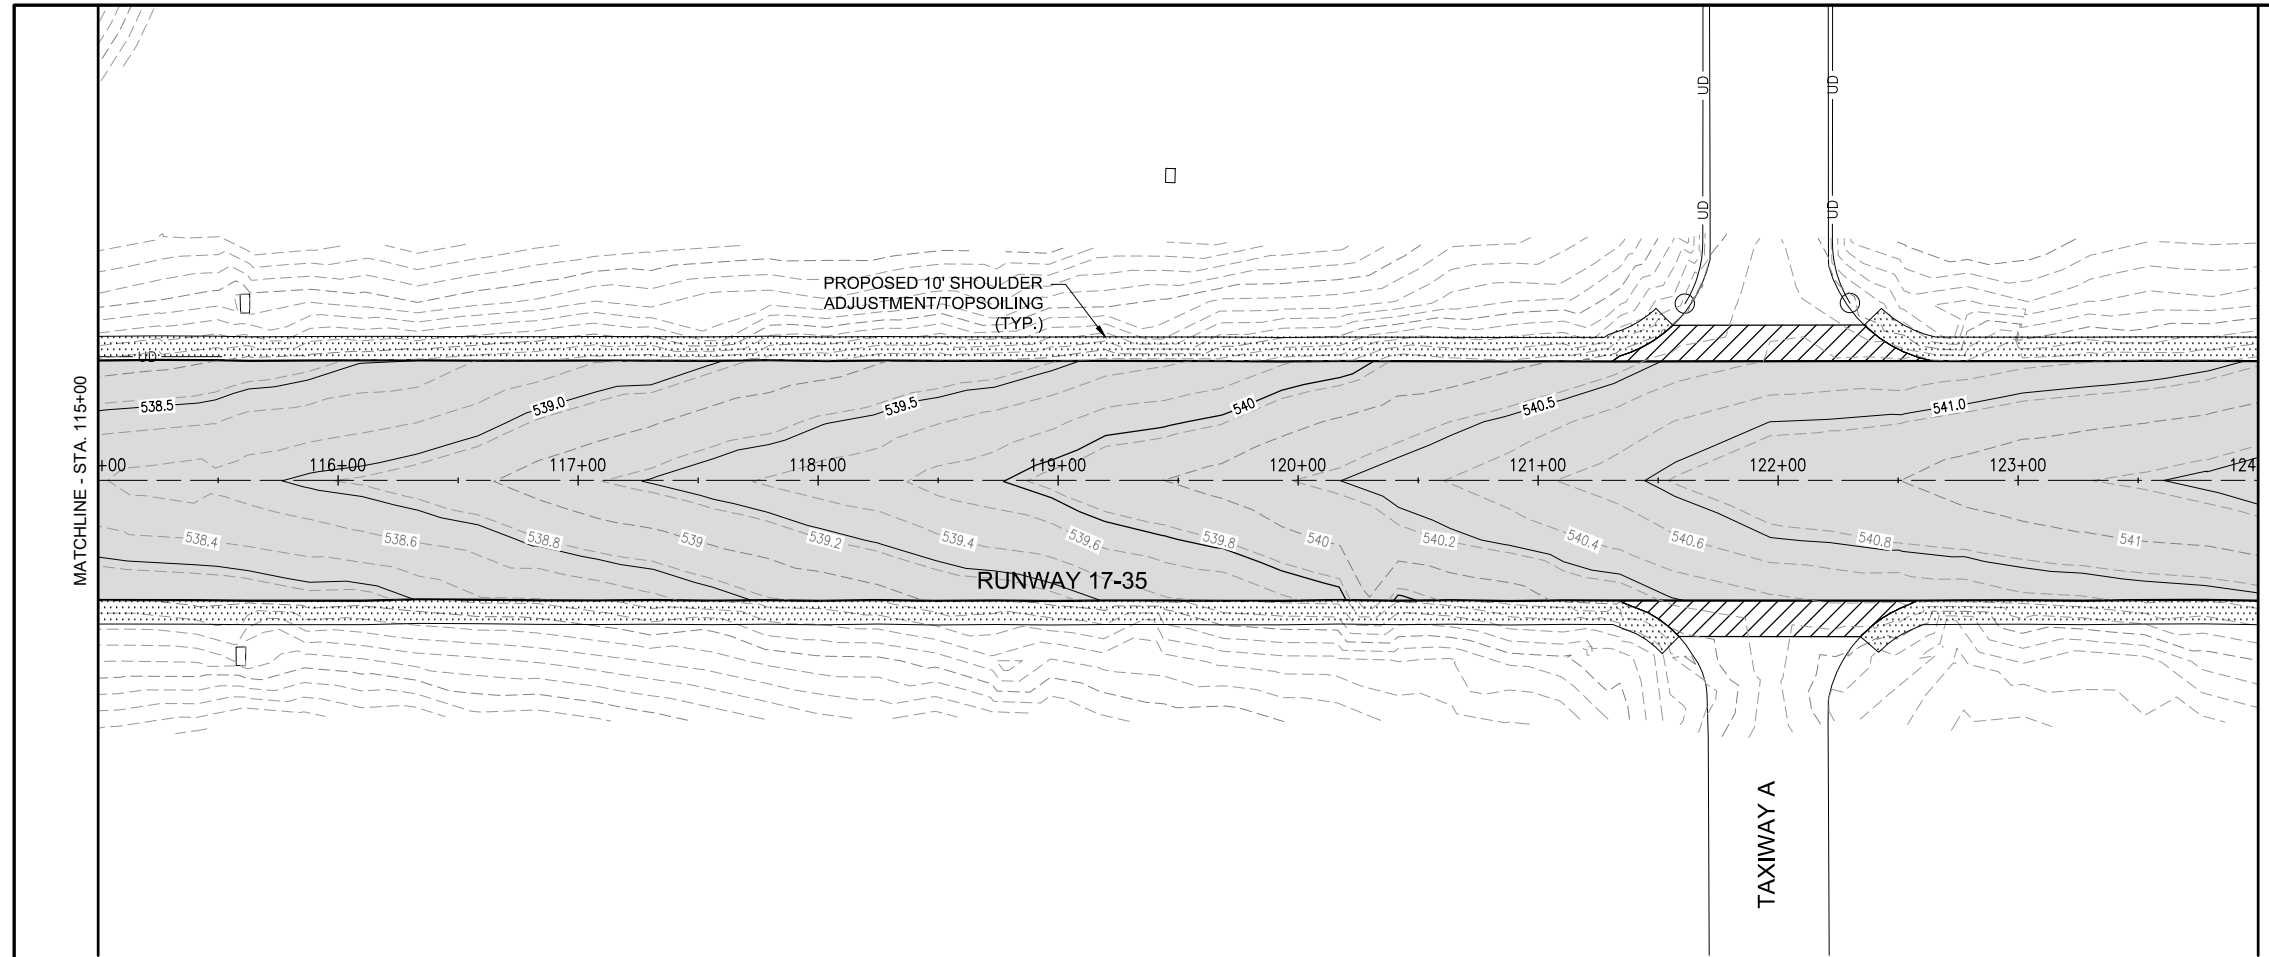

FOR BID







*Jaycen R. Herndon*

DATE: 4/16/2021 LICENSE: 11/30/2021  
SIGNED: EXPIRES:

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-701-PNP.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**PROPOSED PLAN &  
PROFILE - STA.  
133+00 TO STA.  
142+00**


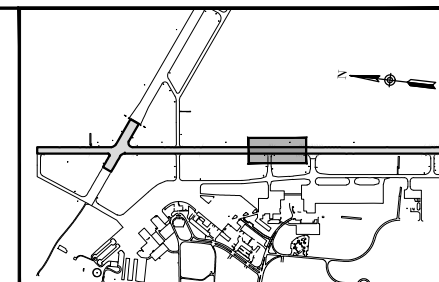


KEYMAP



**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

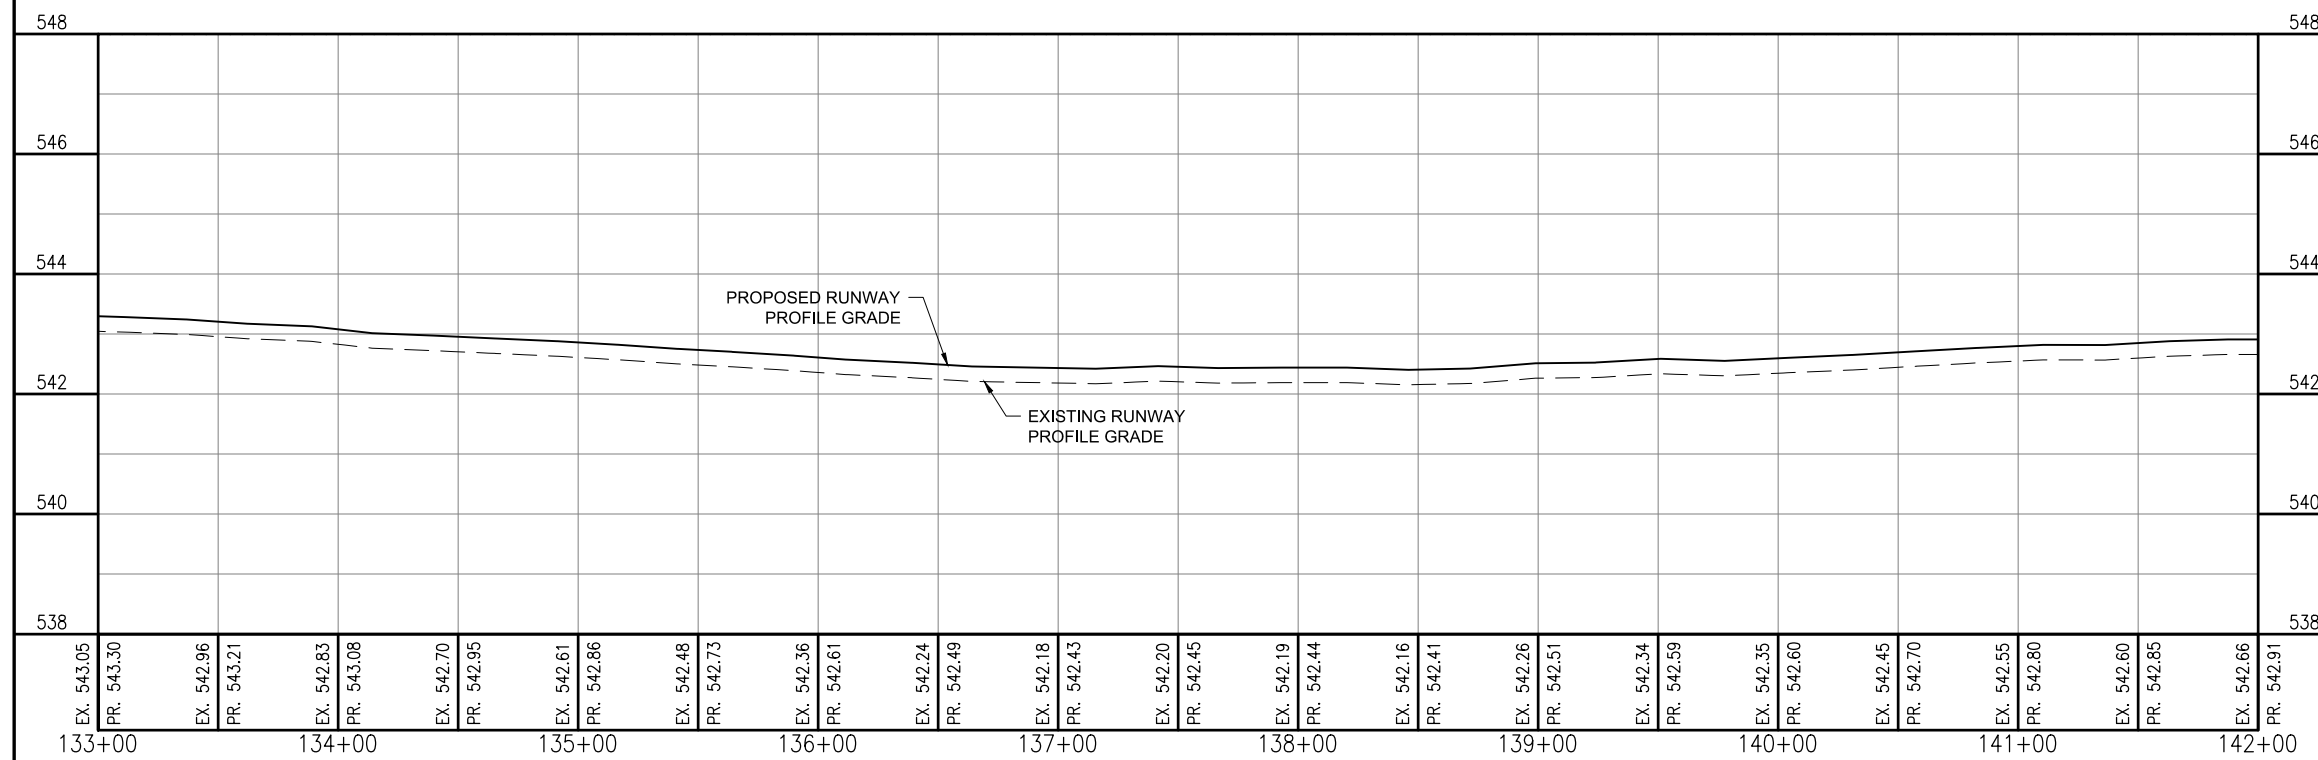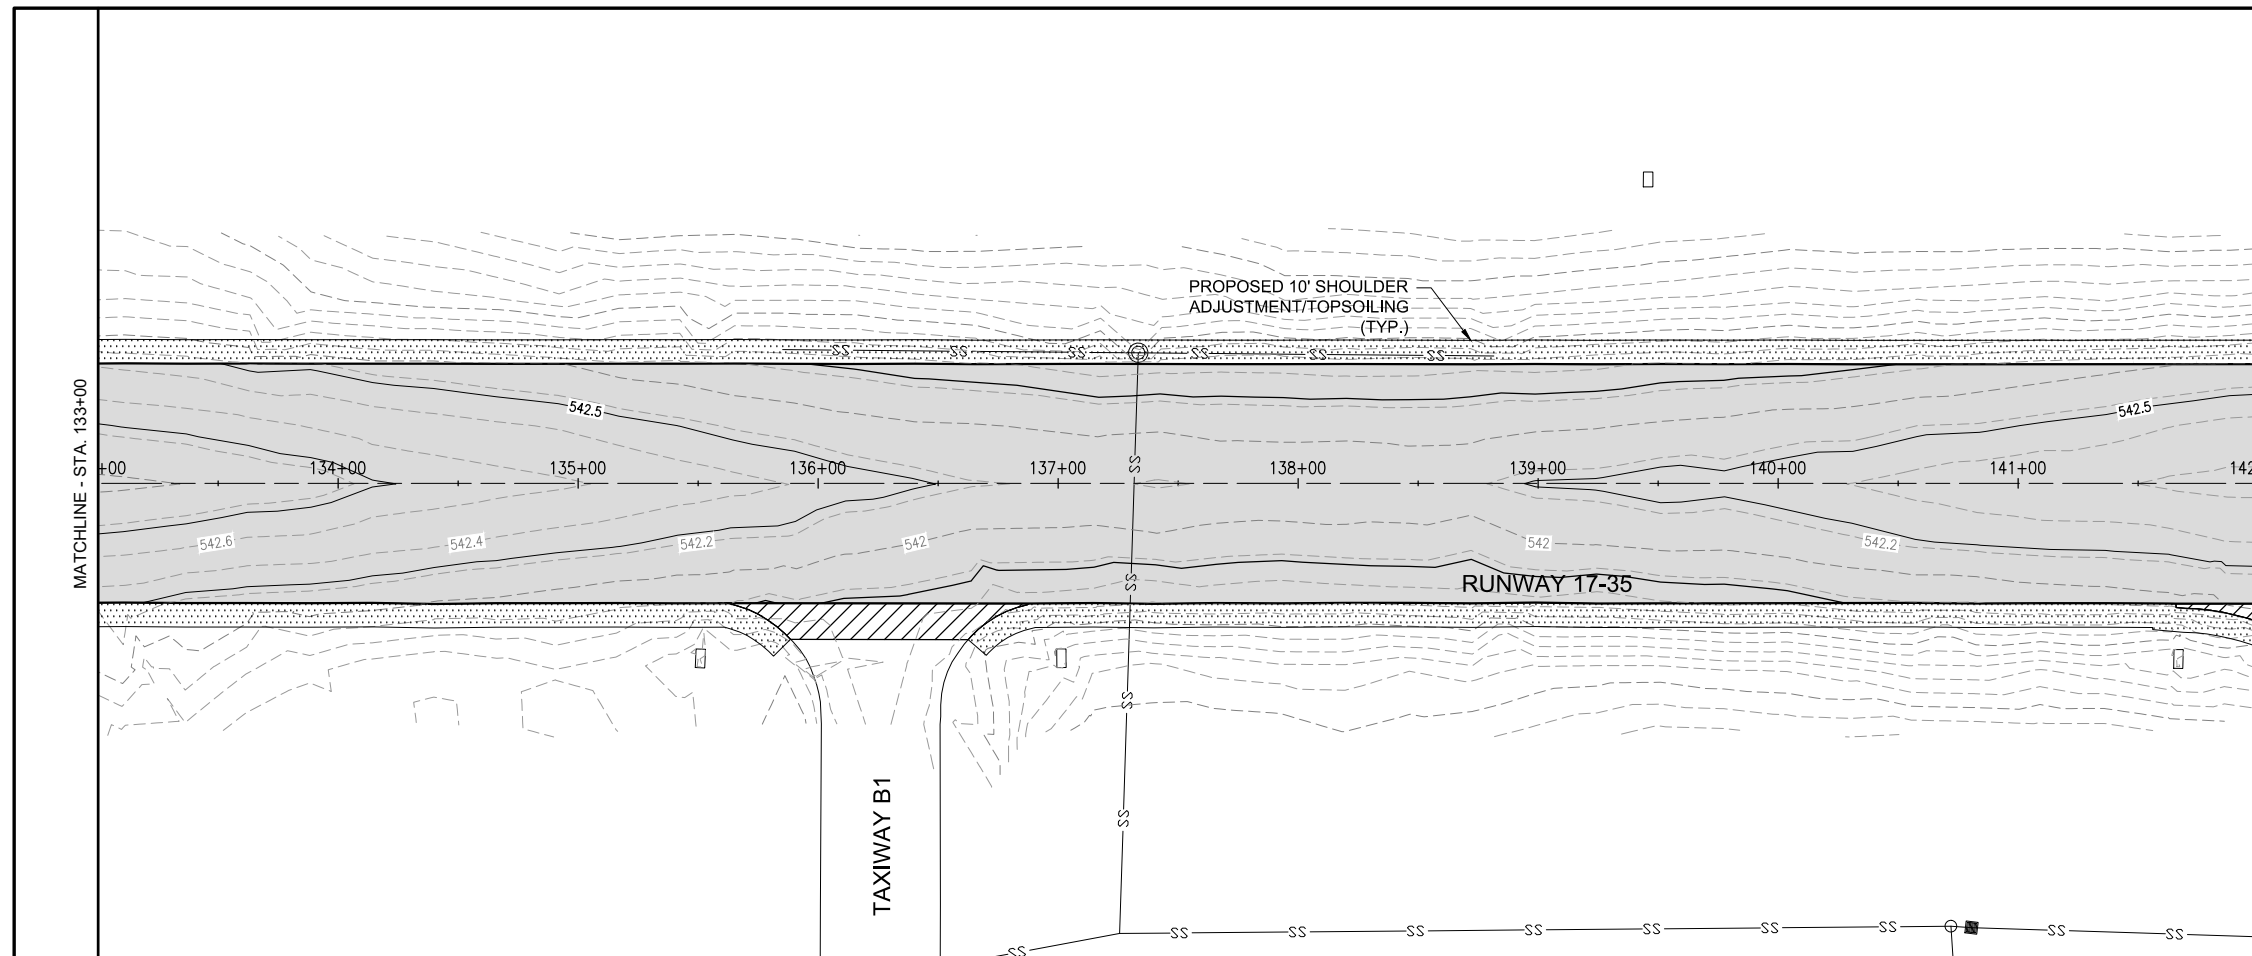

APR 19, 2021 2:39 PM HERNDD01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHETC-701-PNP

**FOR BID**



*Jaycen R. Herndon*

DATE: 4/16/2021 LICENSE: 11/30/2021  
 SIGNED: 4/16/2021 EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812



Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-701-PNP.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**PROPOSED PLAN &  
 PROFILE - STA.  
 142+00 TO STA.  
 151+00**

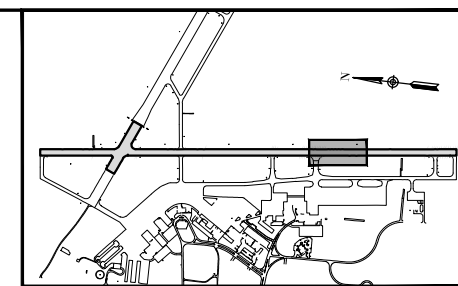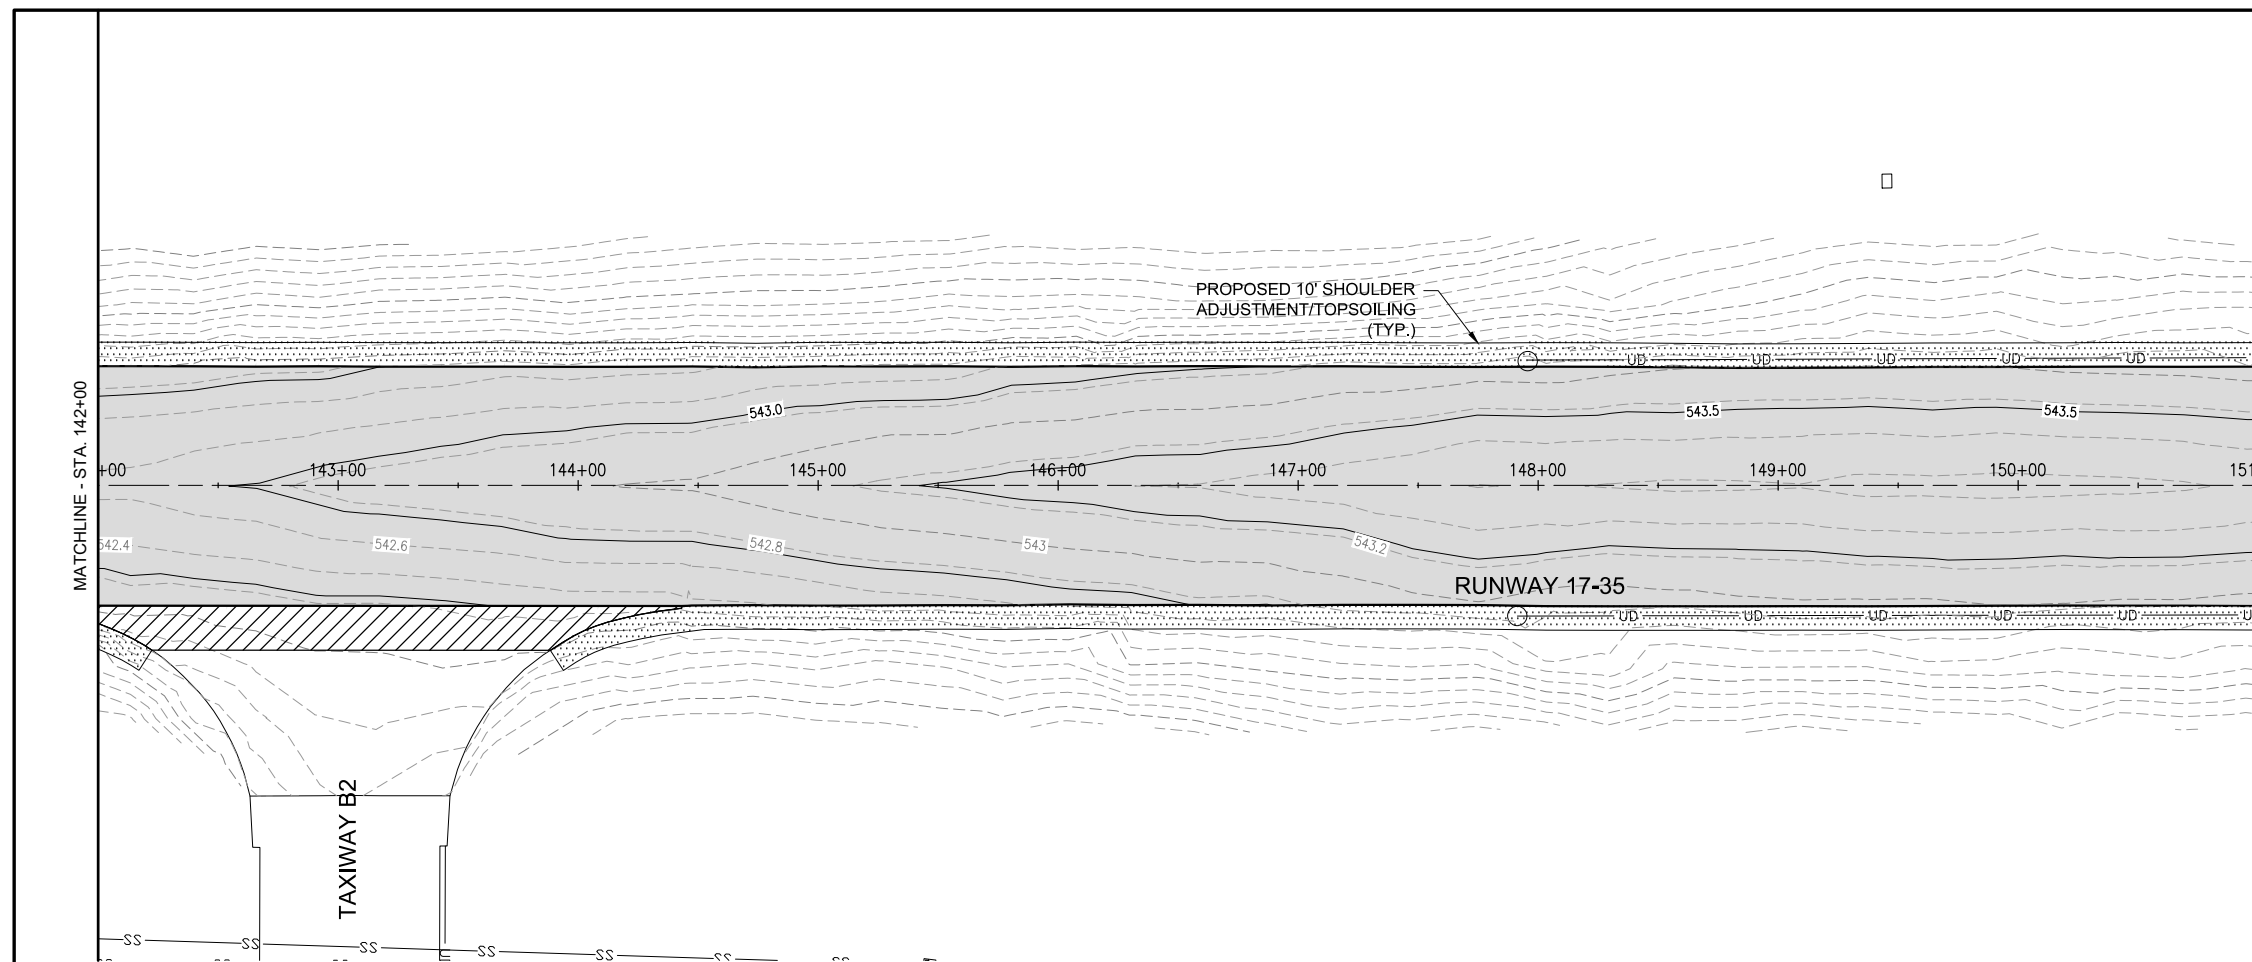


KEYMAP



**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

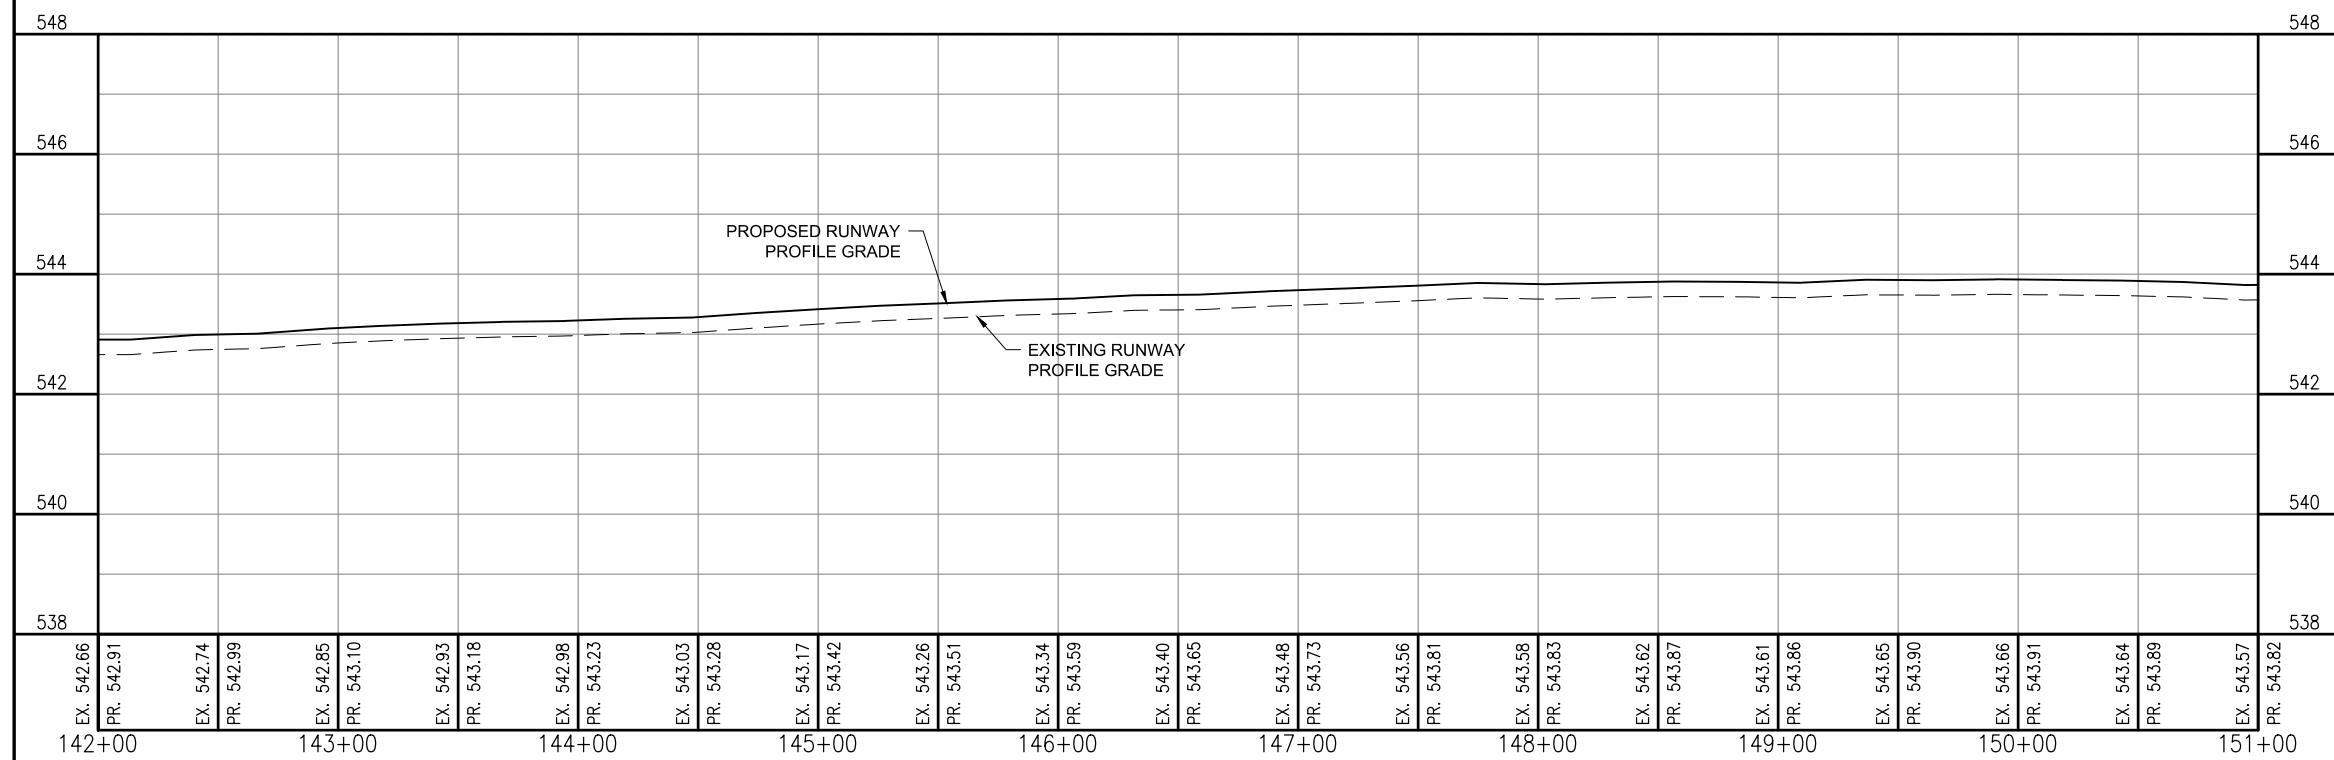

APR 19, 2021 2:39 PM HERNDO1562  
 I:\17.JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-701-PNP

**FOR BID**



*Jaycen Herndon*

DATE: 4/16/2021 LICENSE: 11/30/2021  
SIGNED: 4/16/2021 EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-701-PNP.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED PLAN &  
PROFILE - STA.  
151+00 TO STA.  
160+00


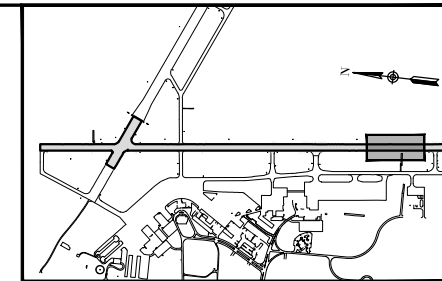


KEYMAP



LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

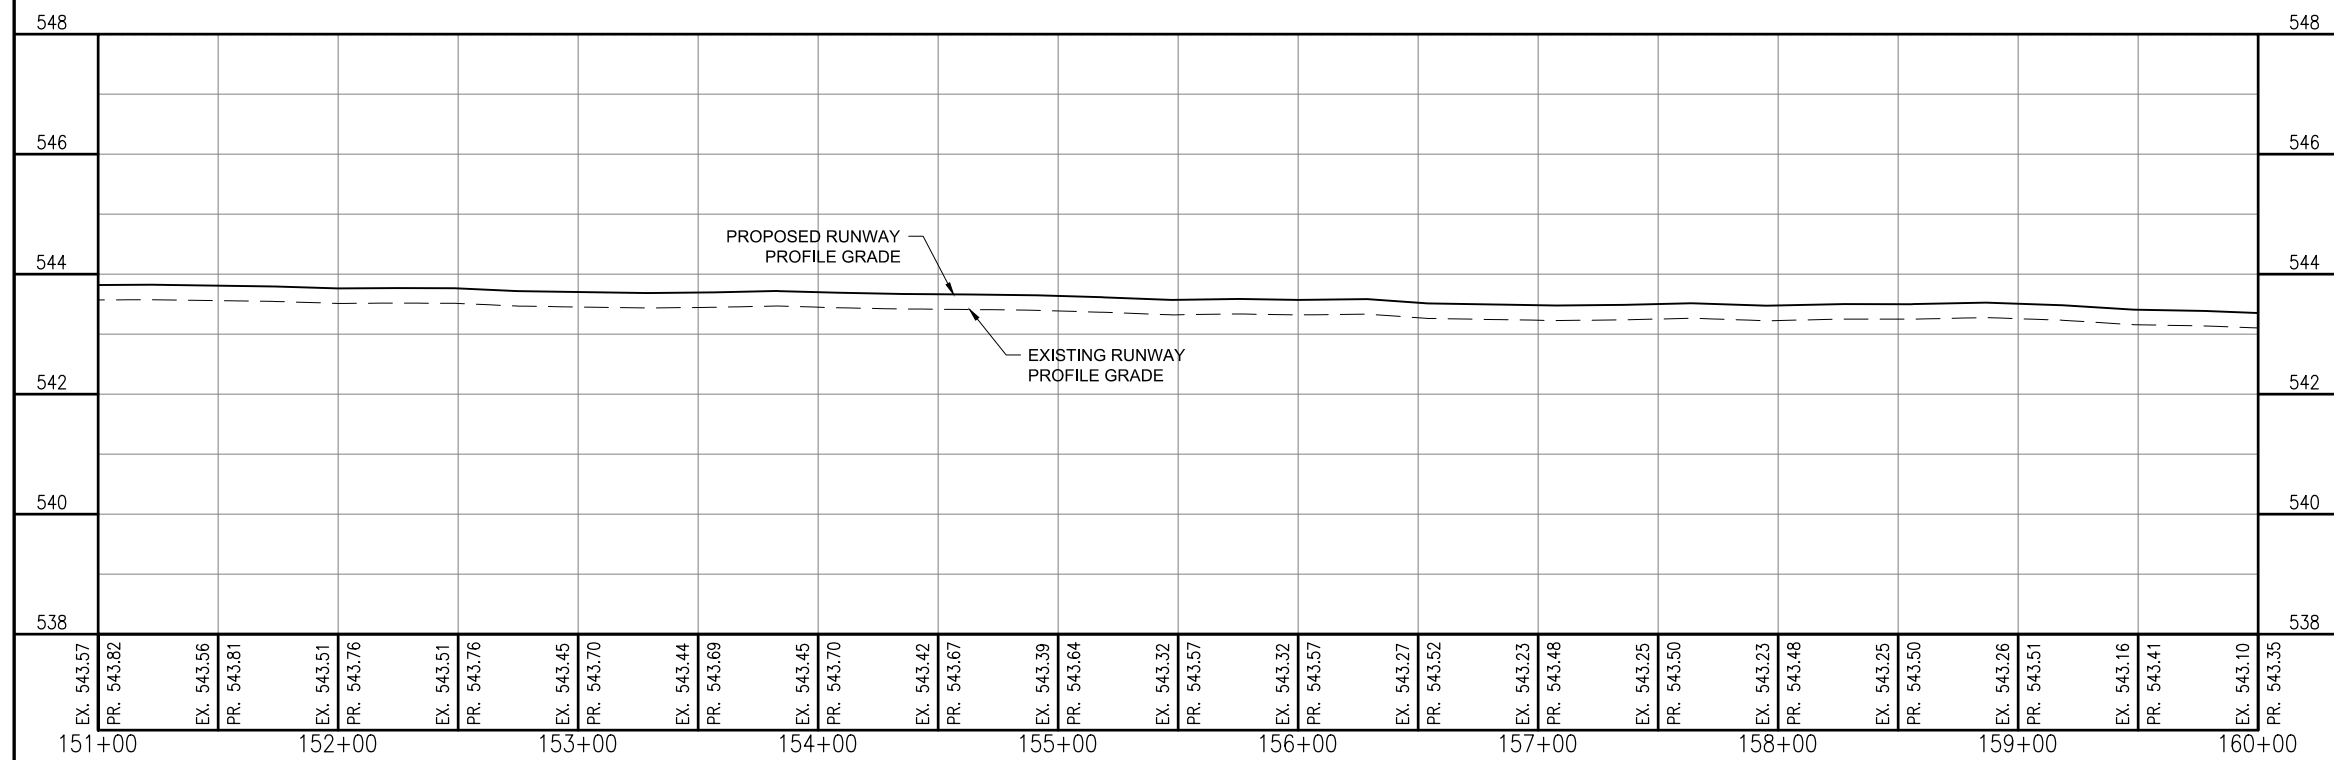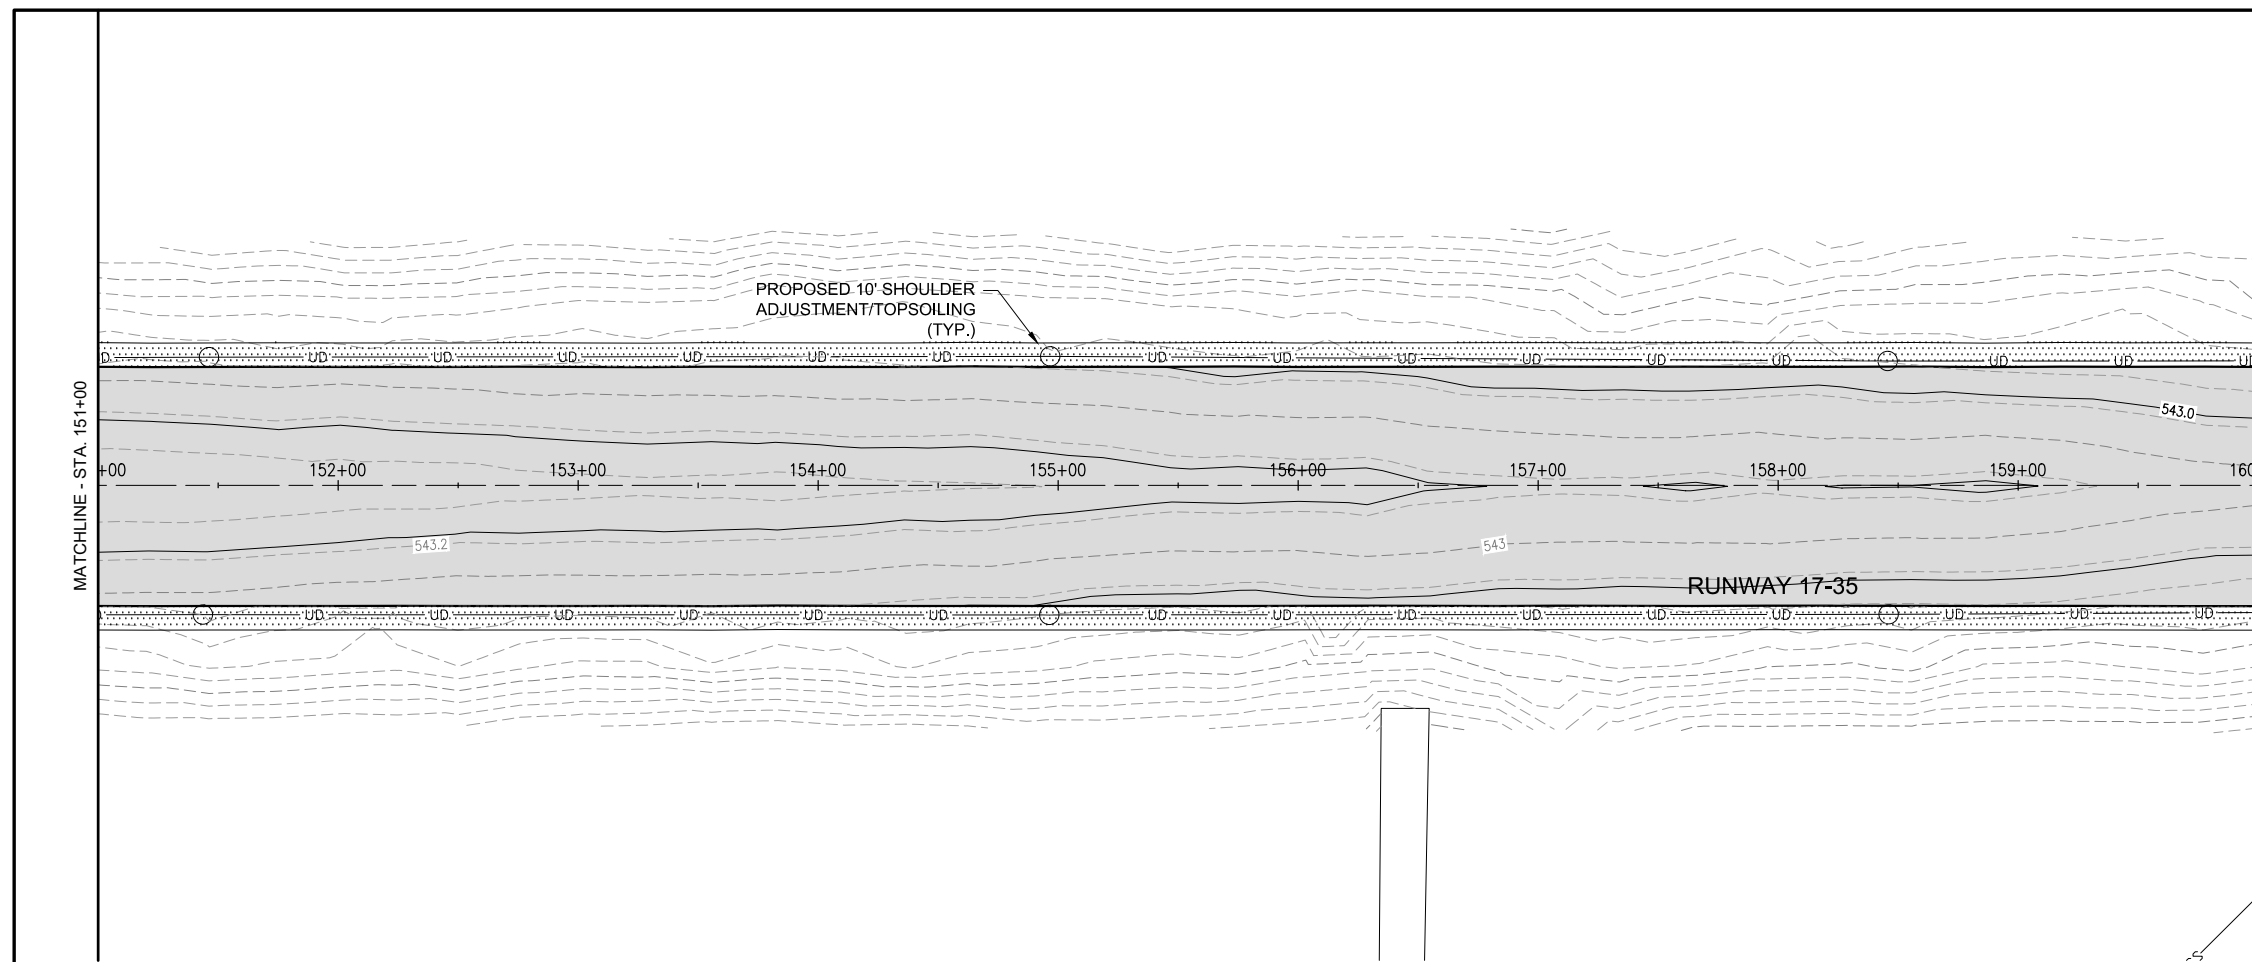

EX. 543.57	PR. 543.82	EX. 543.56	PR. 543.81	EX. 543.51	PR. 543.76	EX. 543.51	PR. 543.76	EX. 543.45	PR. 543.70	EX. 543.44	PR. 543.69	EX. 543.45	PR. 543.70	EX. 543.42	PR. 543.67	EX. 543.39	PR. 543.64	EX. 543.32	PR. 543.57	EX. 543.32	PR. 543.57	EX. 543.27	PR. 543.52	EX. 543.23	PR. 543.48	EX. 543.25	PR. 543.50	EX. 543.23	PR. 543.48	EX. 543.25	PR. 543.50	EX. 543.26	PR. 543.51	EX. 543.16	PR. 543.41	EX. 543.10	PR. 543.35			
151+00		152+00				153+00				154+00				155+00				156+00				157+00				158+00				159+00				160+00						

FOR BID

APR 19, 2021 2:39 PM HERNDON1562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-701-PNP



Engineering | Planning | Allied Services

Hanson Professional Services Inc.  
1525 S. 6th Street  
Springfield, IL 62703  
phone: 217-788-2450  
fax: 217-788-2503

Offices Nationwide  
www.hanson-inc.com

Illinois Licensed  
Professional Service Corporation  
#184-001084



ST. LOUIS REGIONAL AIRPORT

8 Terminal Drive  
East Alton, Illinois 62024



DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-701-PNP.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: JRH 4/16/2021  
REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED PLAN &  
PROFILE - STA.  
160+00 TO STA.  
165+99

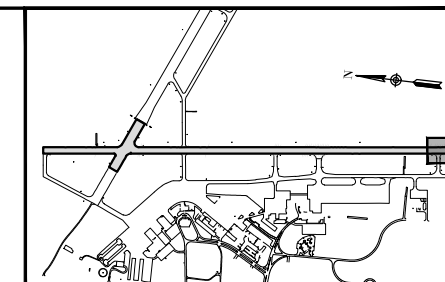



KEYMAP



0' 20' 40' 80'  
HALF SIZE SCALE: 1" = 80'  
FULL SIZE SCALE: 1" = 40'

LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB
- PROPOSED BUTT JOINT
- PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
- EXISTING STORM SEWER
- EXISTING UNDERDRAIN
- EXISTING INLET
- EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

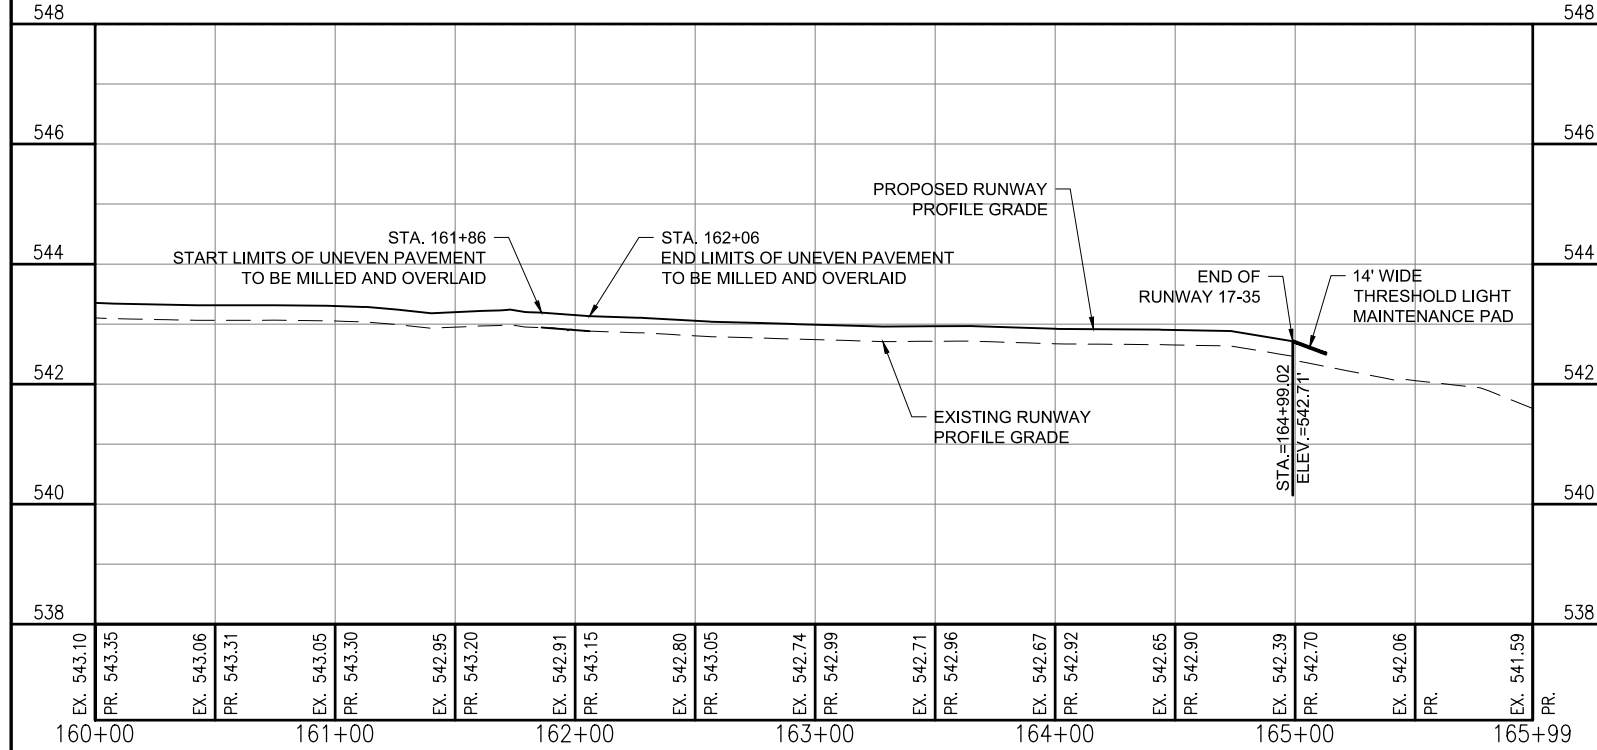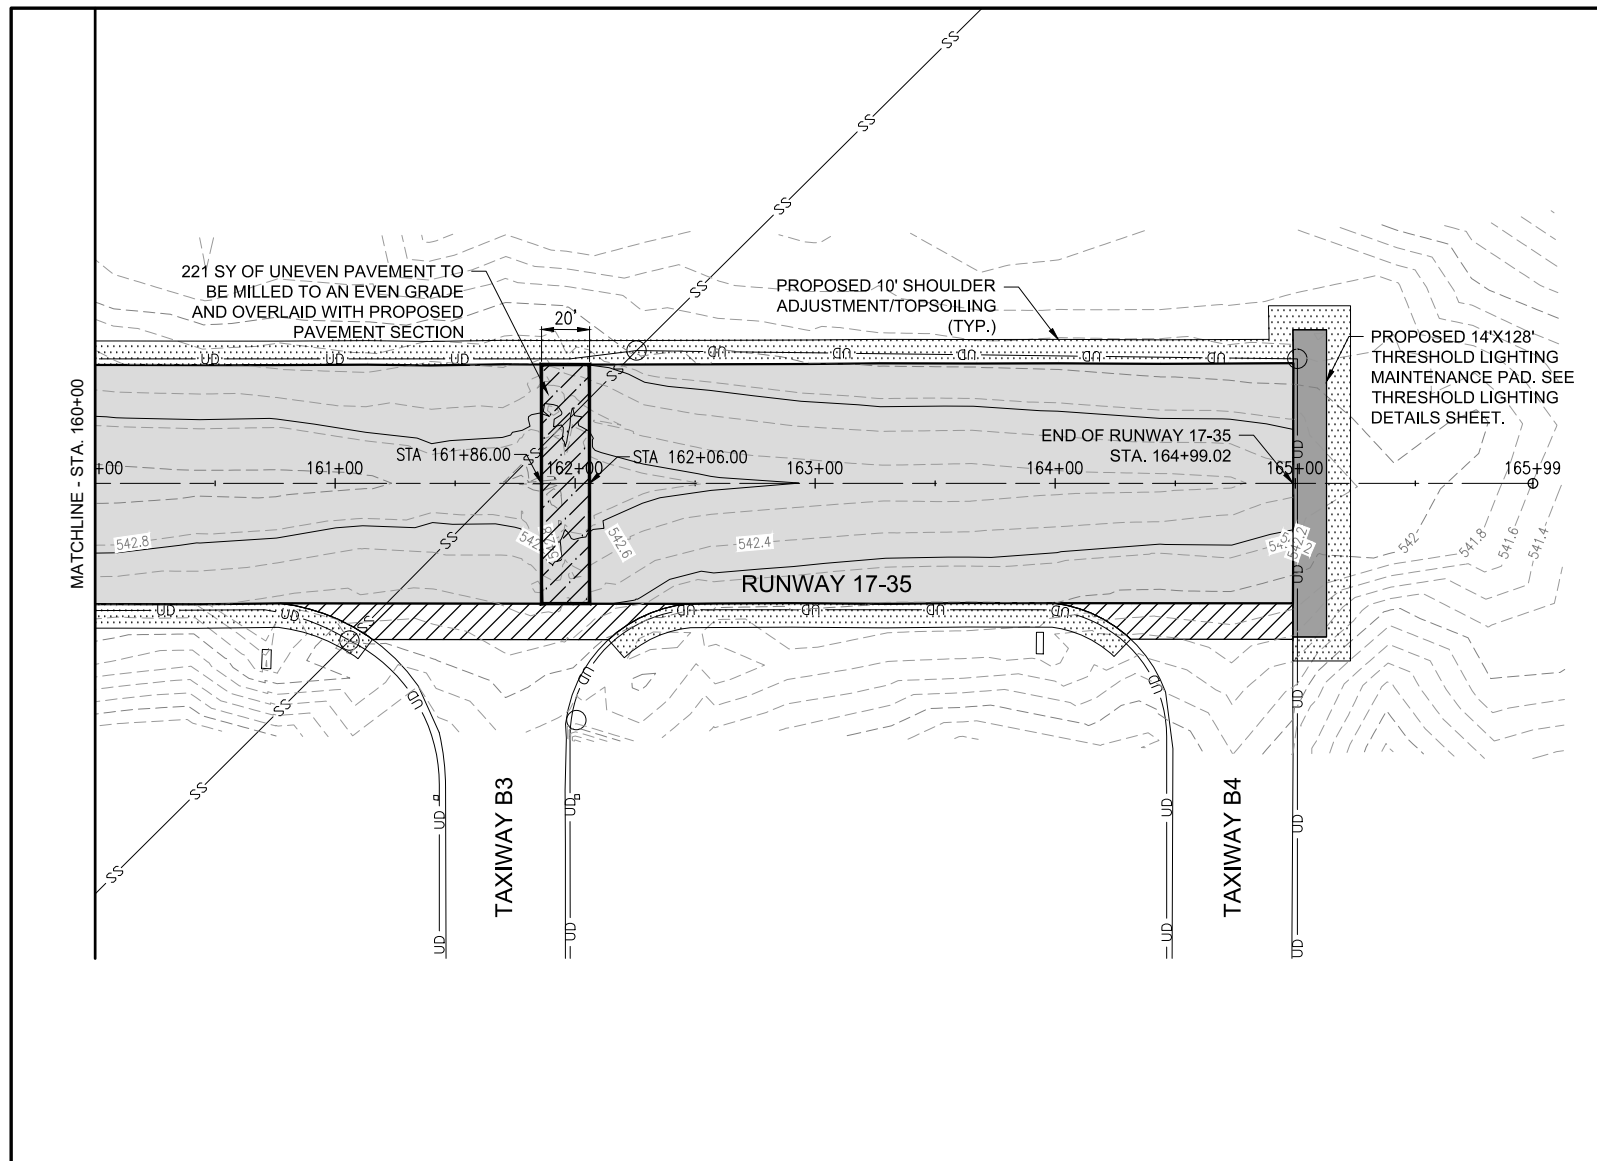

APR 19, 2021 2:39 PM HERNDD01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-701-PNP

FOR BID



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812



Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-701-PNP.DWG  
 DESIGN BY: JRH 3/18/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

PROPOSED PLAN &  
 PROFILE - STA.  
 205+50 TO STA.  
 215+50

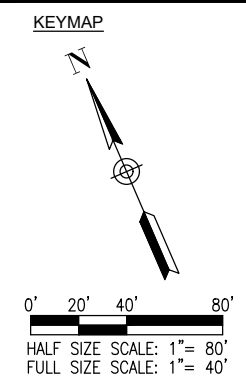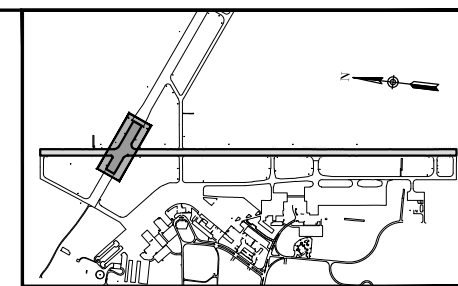

- LEGEND:**
- EXISTING PAVEMENT
  - PROPOSED RUNWAY REHAB
  - PROPOSED BUTT JOINT
  - PROPOSED 10' SHOULDER ADJUSTMENT/TOPSOILING
  - EXISTING STORM SEWER
  - EXISTING UNDERDRAIN
  - EXISTING INLET
  - EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE

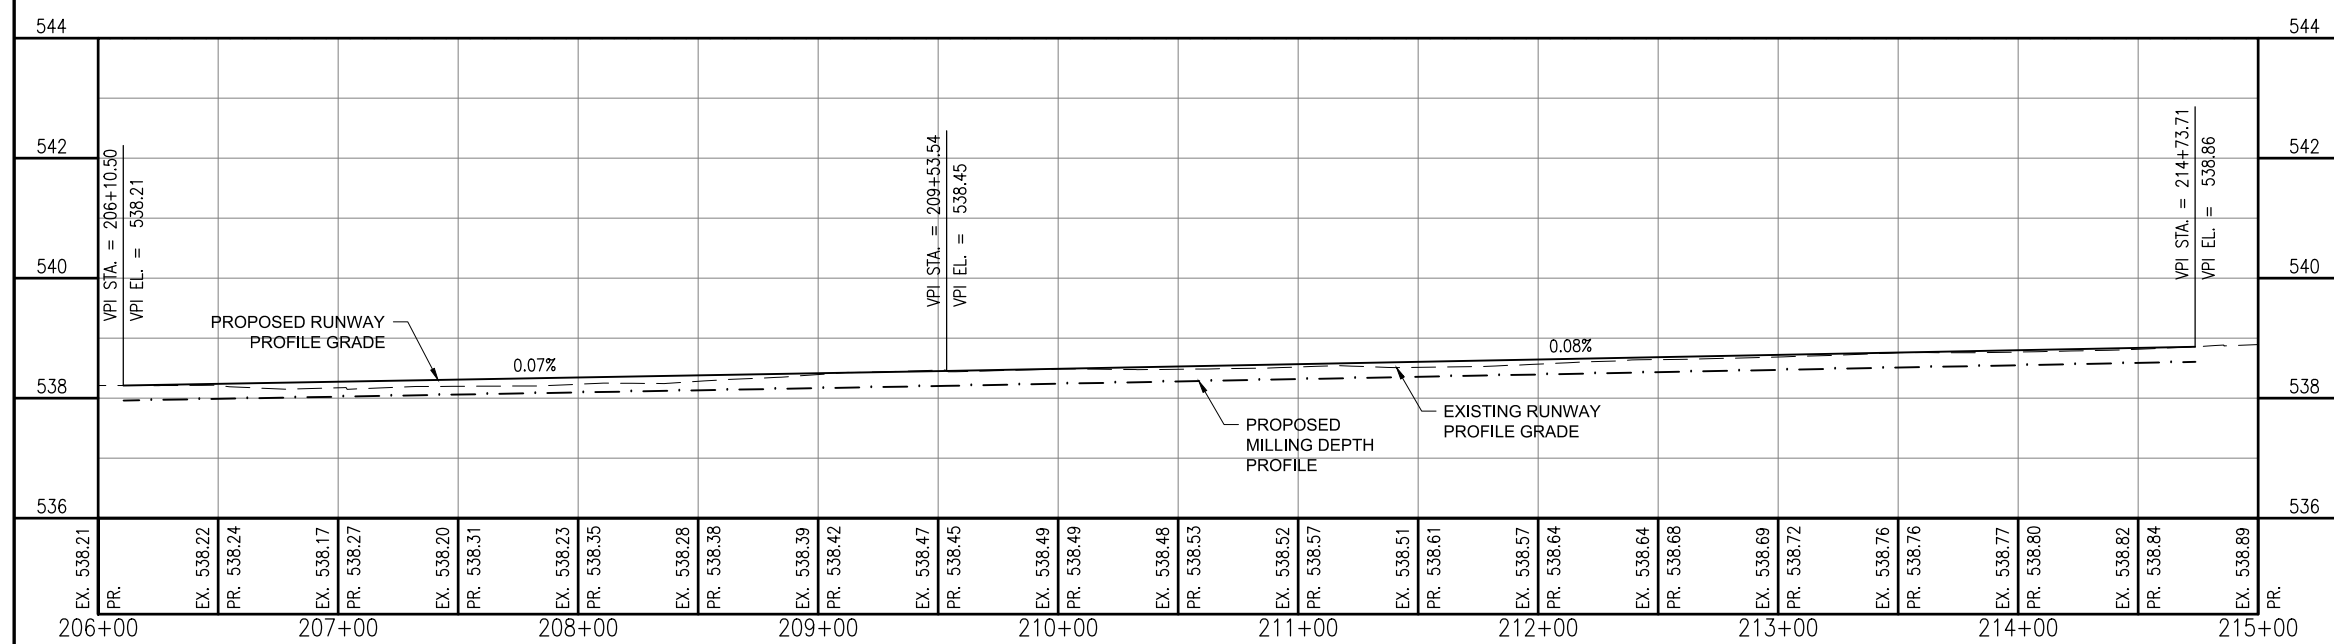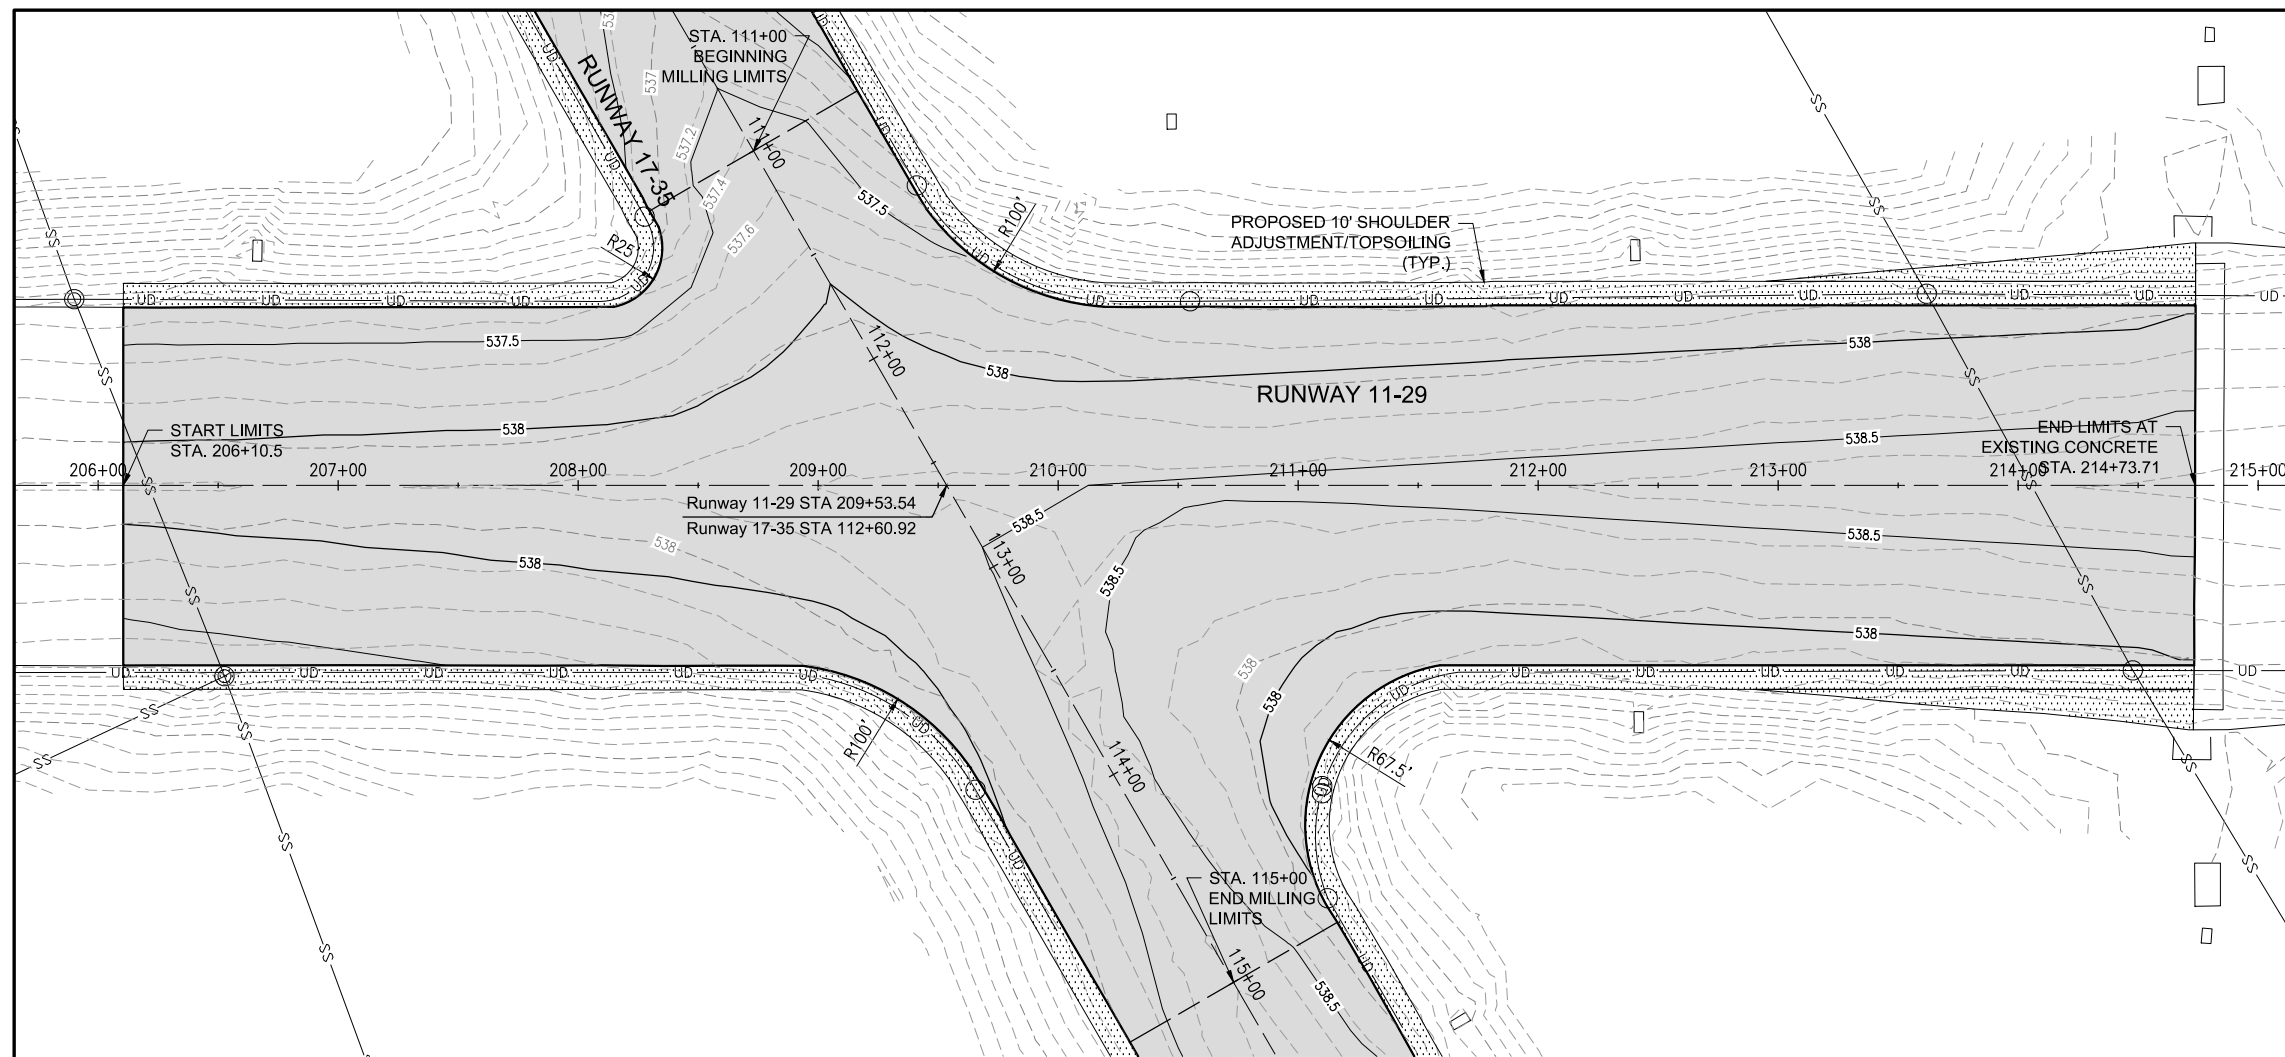

APR 19, 2021 2:39 PM HERN001562  
 I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-701-PNP

**FOR BID**



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV




ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: C-182-STK.DWG  
 DESIGN BY: JRH 4/12/2021  
 DRAWN BY: JRH 4/16/2021  
 REVIEWED BY: BSS 4/16/2021

SHEET TITLE

**PROPOSED STAKING  
 PLAN**

**FOR BID**

APR 19, 2021 2:40 PM HERND01562  
 I:\17 JOBS\17A008504\CAD\AIRPORT\182-STK

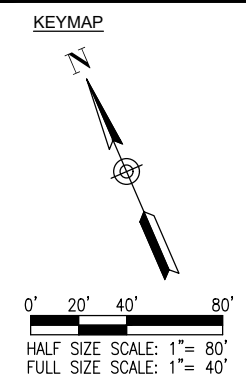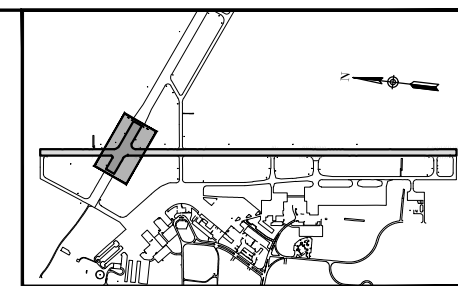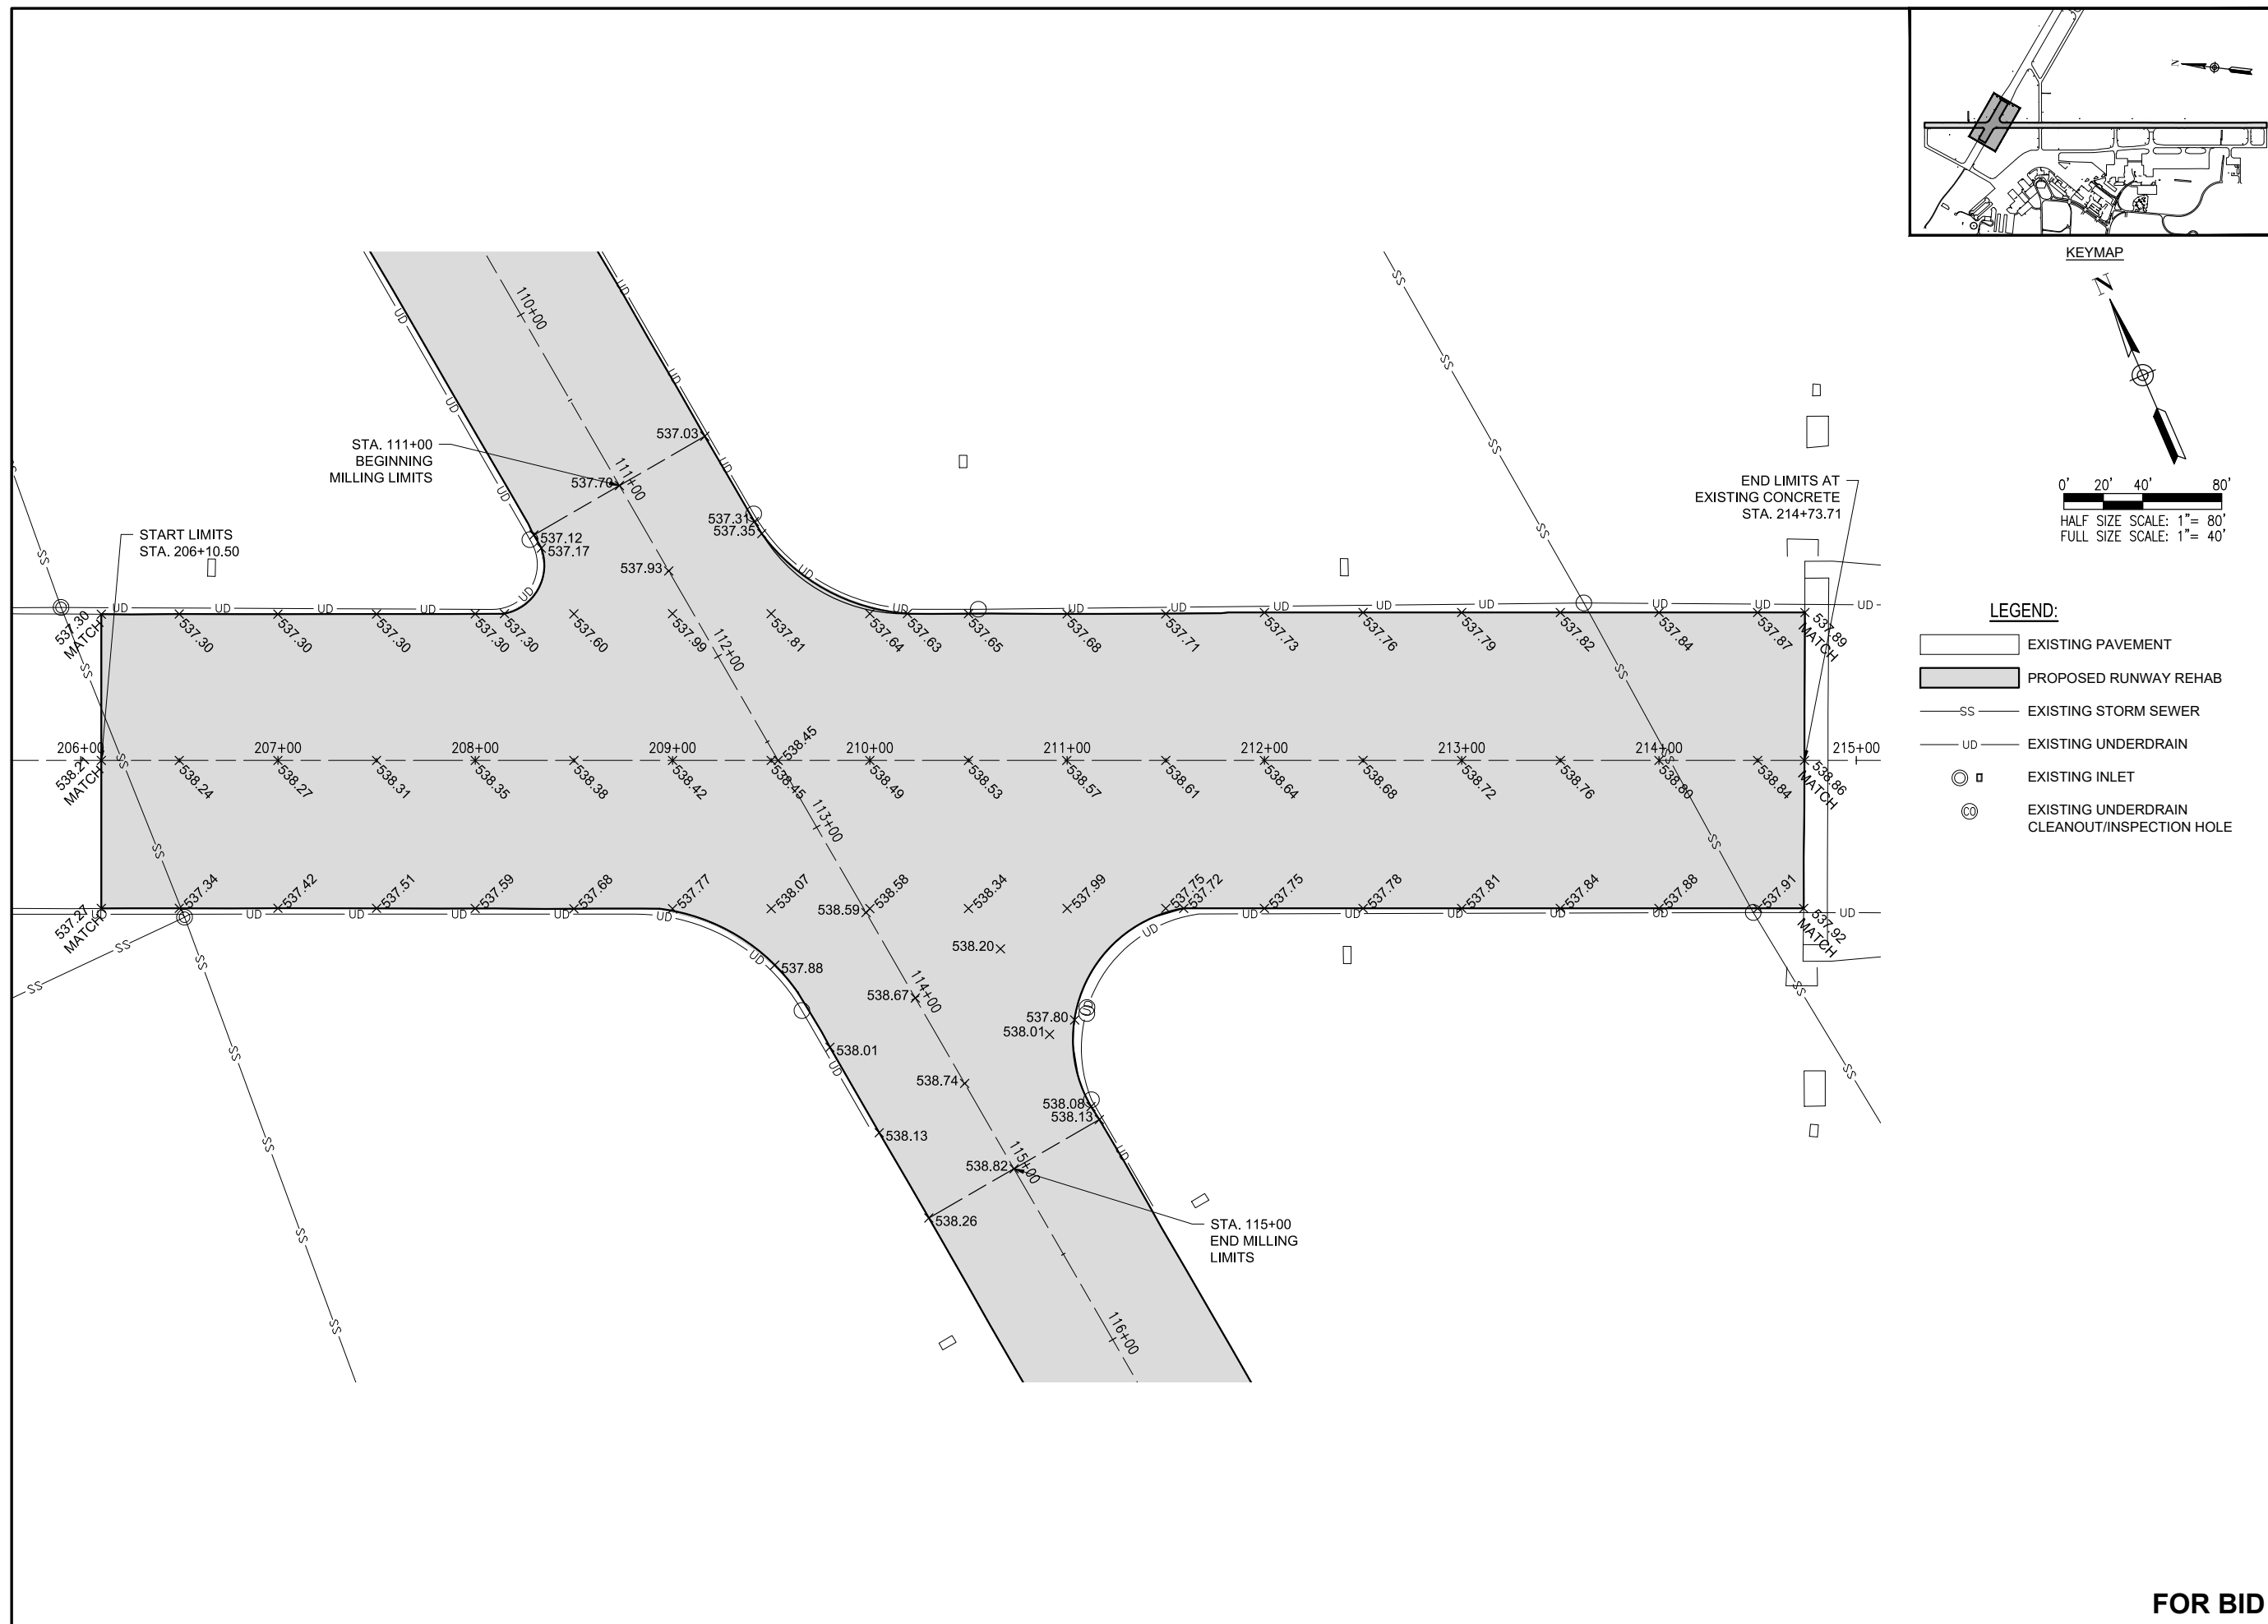

- LEGEND:**
- EXISTING PAVEMENT
  - PROPOSED RUNWAY REHAB
  - EXISTING STORM SEWER
  - EXISTING UNDERDRAIN
  - EXISTING INLET
  - EXISTING UNDERDRAIN CLEANOUT/INSPECTION HOLE







Engineering | Planning | Allied Services

Hanson Professional Services Inc.  
1525 S. 6th Street  
Springfield, IL 62703  
phone: 217-788-2450  
fax: 217-788-2503

Offices Nationwide  
www.hanson-inc.com

Illinois Licensed  
Professional Service Corporation  
#184-001084



ST. LOUIS REGIONAL AIRPORT

8 Terminal Drive  
East Alton, Illinois 62024



DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-151-MRK.DWG  
DESIGN BY: CEM 3/18/2021  
DRAWN BY: CEM 3/18/2021  
REVIEWED BY: JRH 3/22/2021

SHEET TITLE

PROPOSED MARKING  
PLAN - STA. 115+00  
TO STA. 133+00

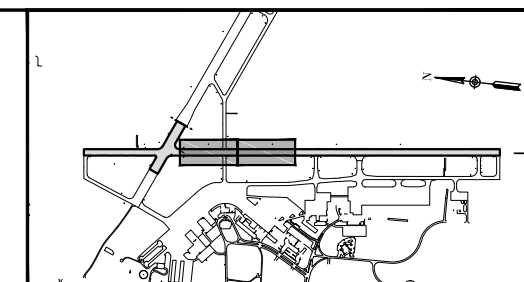


KEYMAP



0' 20' 40' 80'  
HALF SIZE SCALE: 1" = 80'  
FULL SIZE SCALE: 1" = 40'

LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB

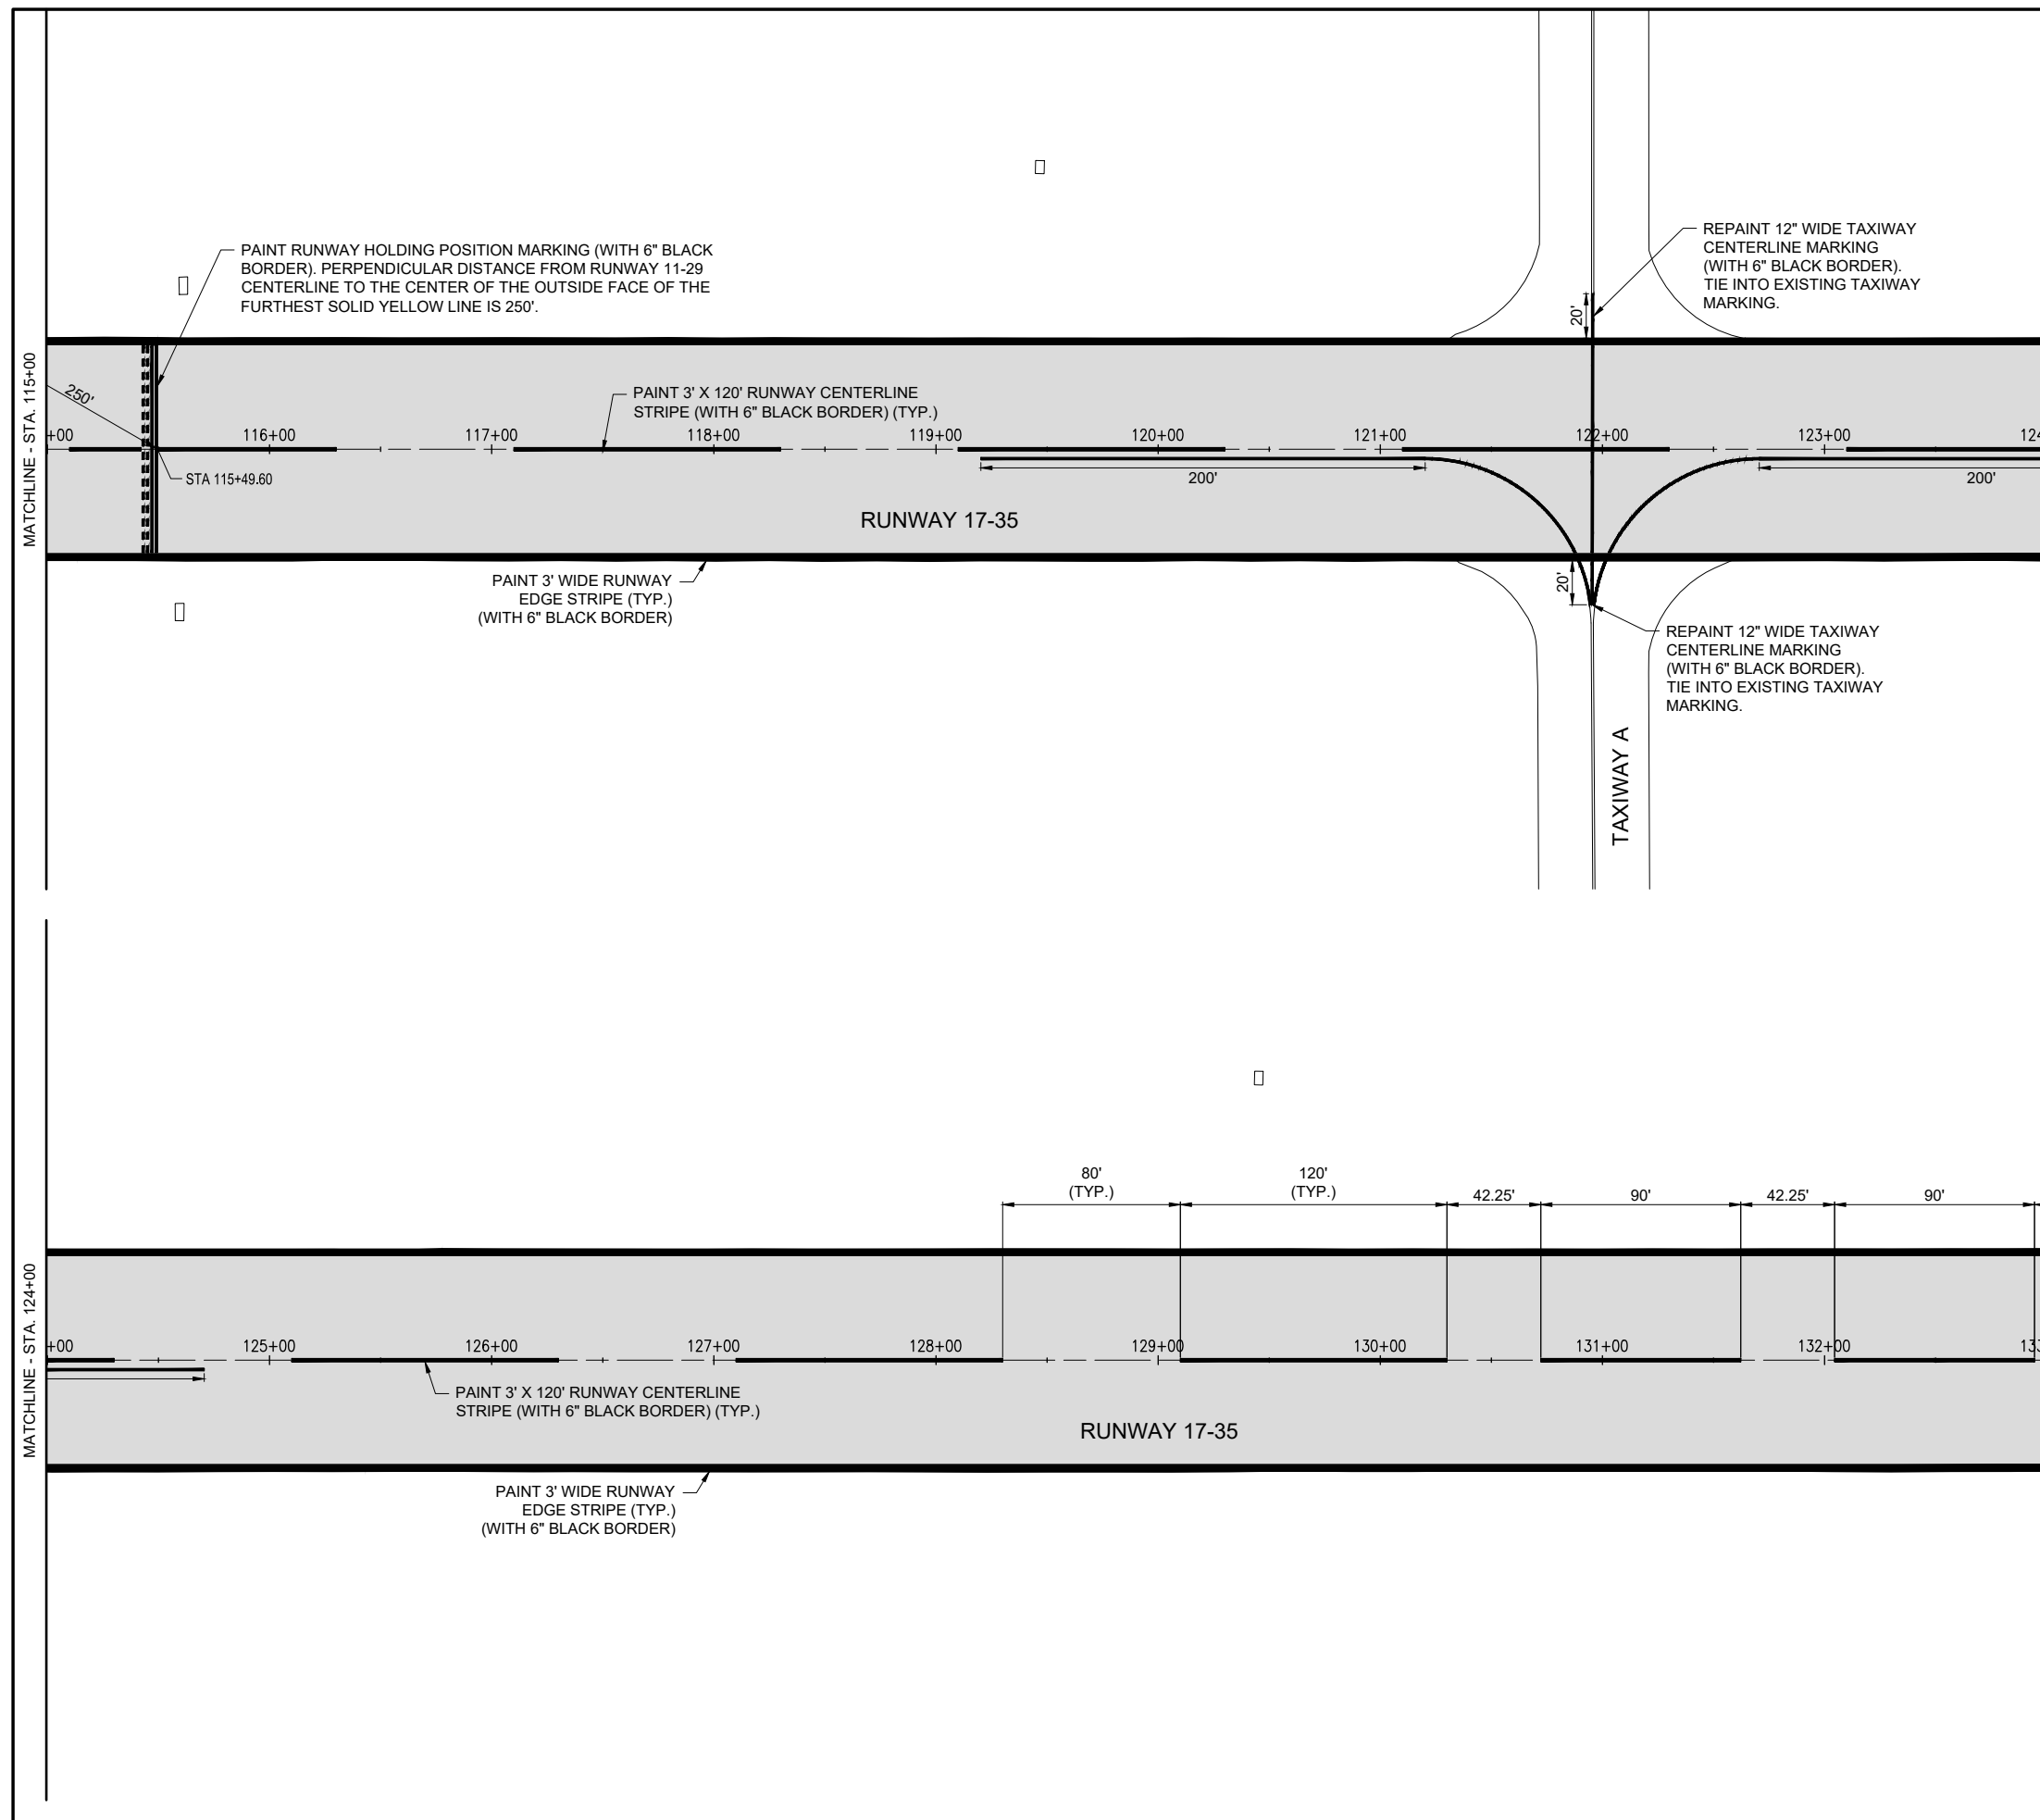

APR 20, 2021 3:03 PM HERNDON01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\TSSHEETC-151-MRK

FOR BID



DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-151-MRK.DWG  
DESIGN BY: CEM 3/18/2021  
DRAWN BY: CEM 3/18/2021  
REVIEWED BY: JRH 3/22/2021

SHEET TITLE

PROPOSED MARKING  
PLAN - STA. 133+00  
TO STA. 151+00

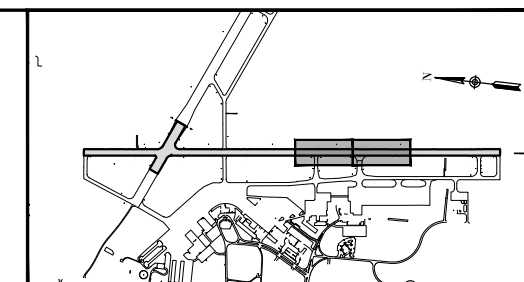


KEYMAP



LEGEND:

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB

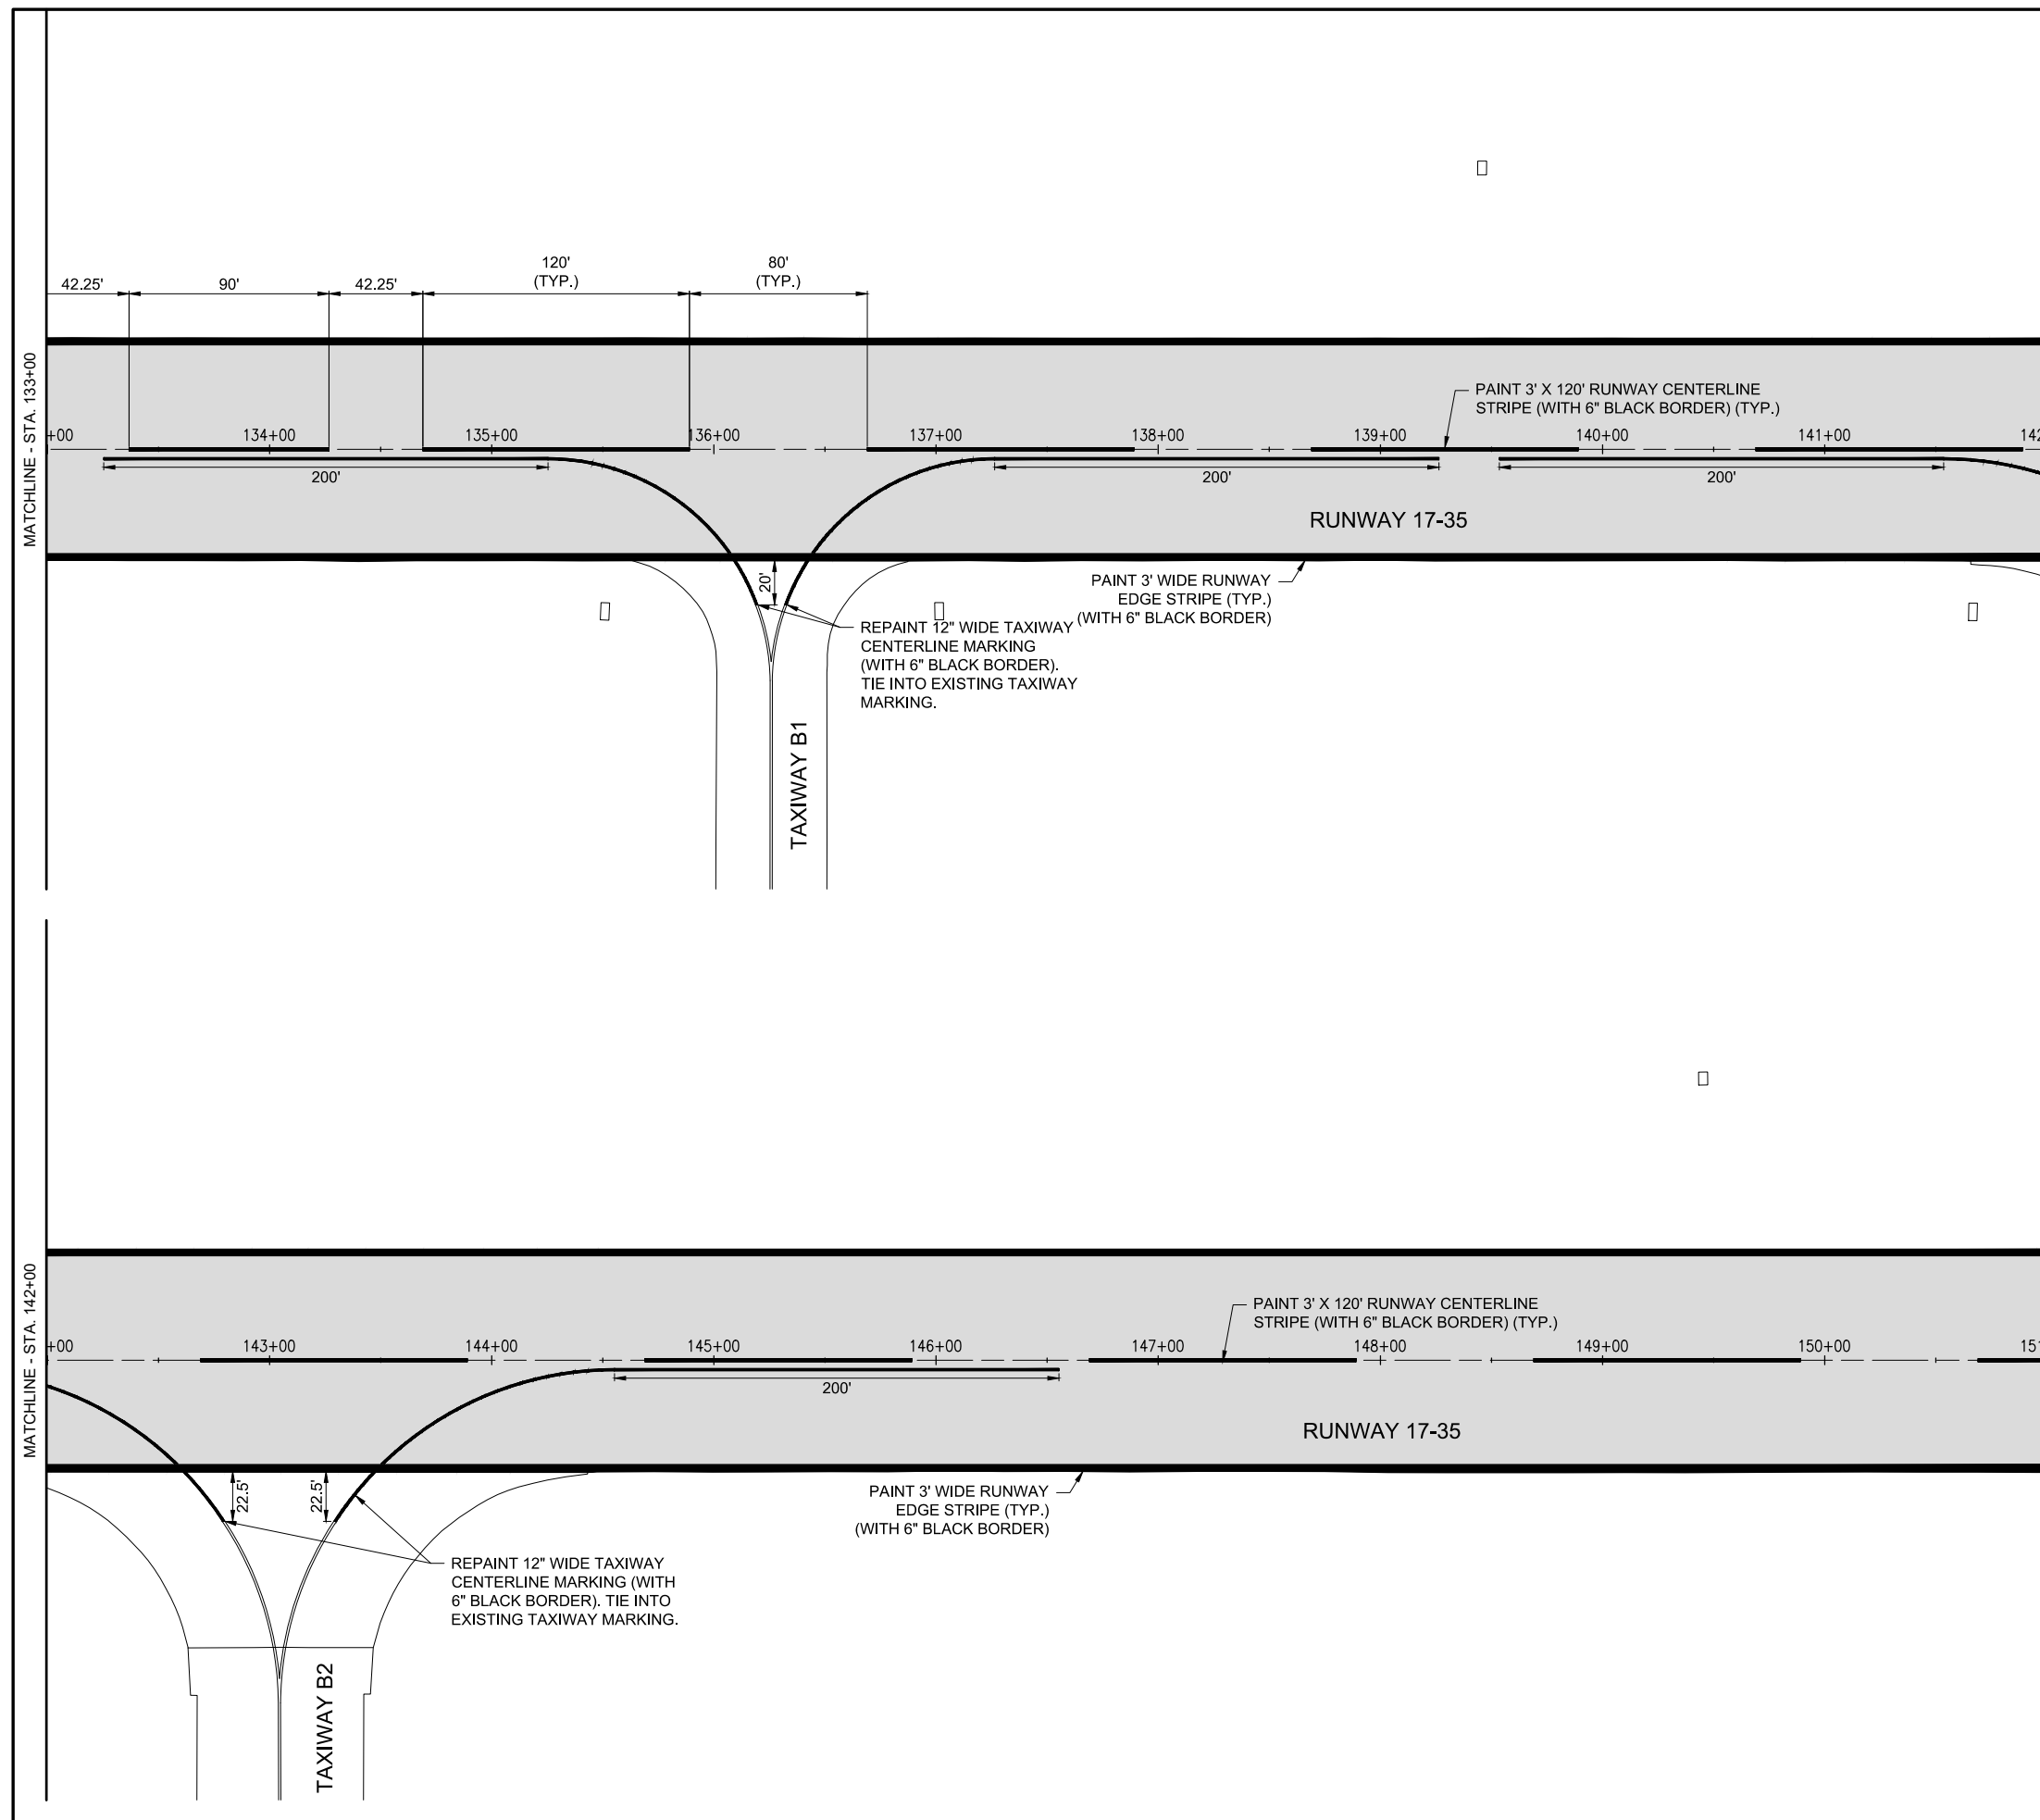

APR 19, 2021 2:41 PM HERNDON01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\TSSHEETC-151-MRK

FOR BID



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-151-MRK.DWG  
DESIGN BY: CEM 3/18/2021  
DRAWN BY: CEM 3/18/2021  
REVIEWED BY: JRH 3/22/2021

SHEET TITLE

**PROPOSED MARKING  
PLAN - STA. 151+00  
TO STA. 165+99**


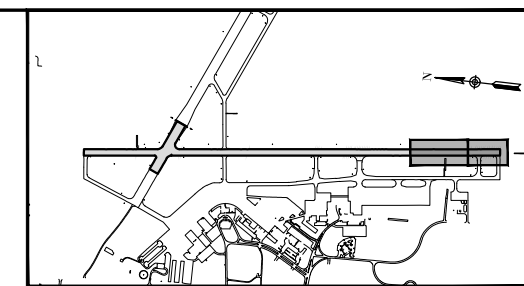


KEYMAP



**LEGEND:**

- EXISTING PAVEMENT
- PROPOSED RUNWAY REHAB

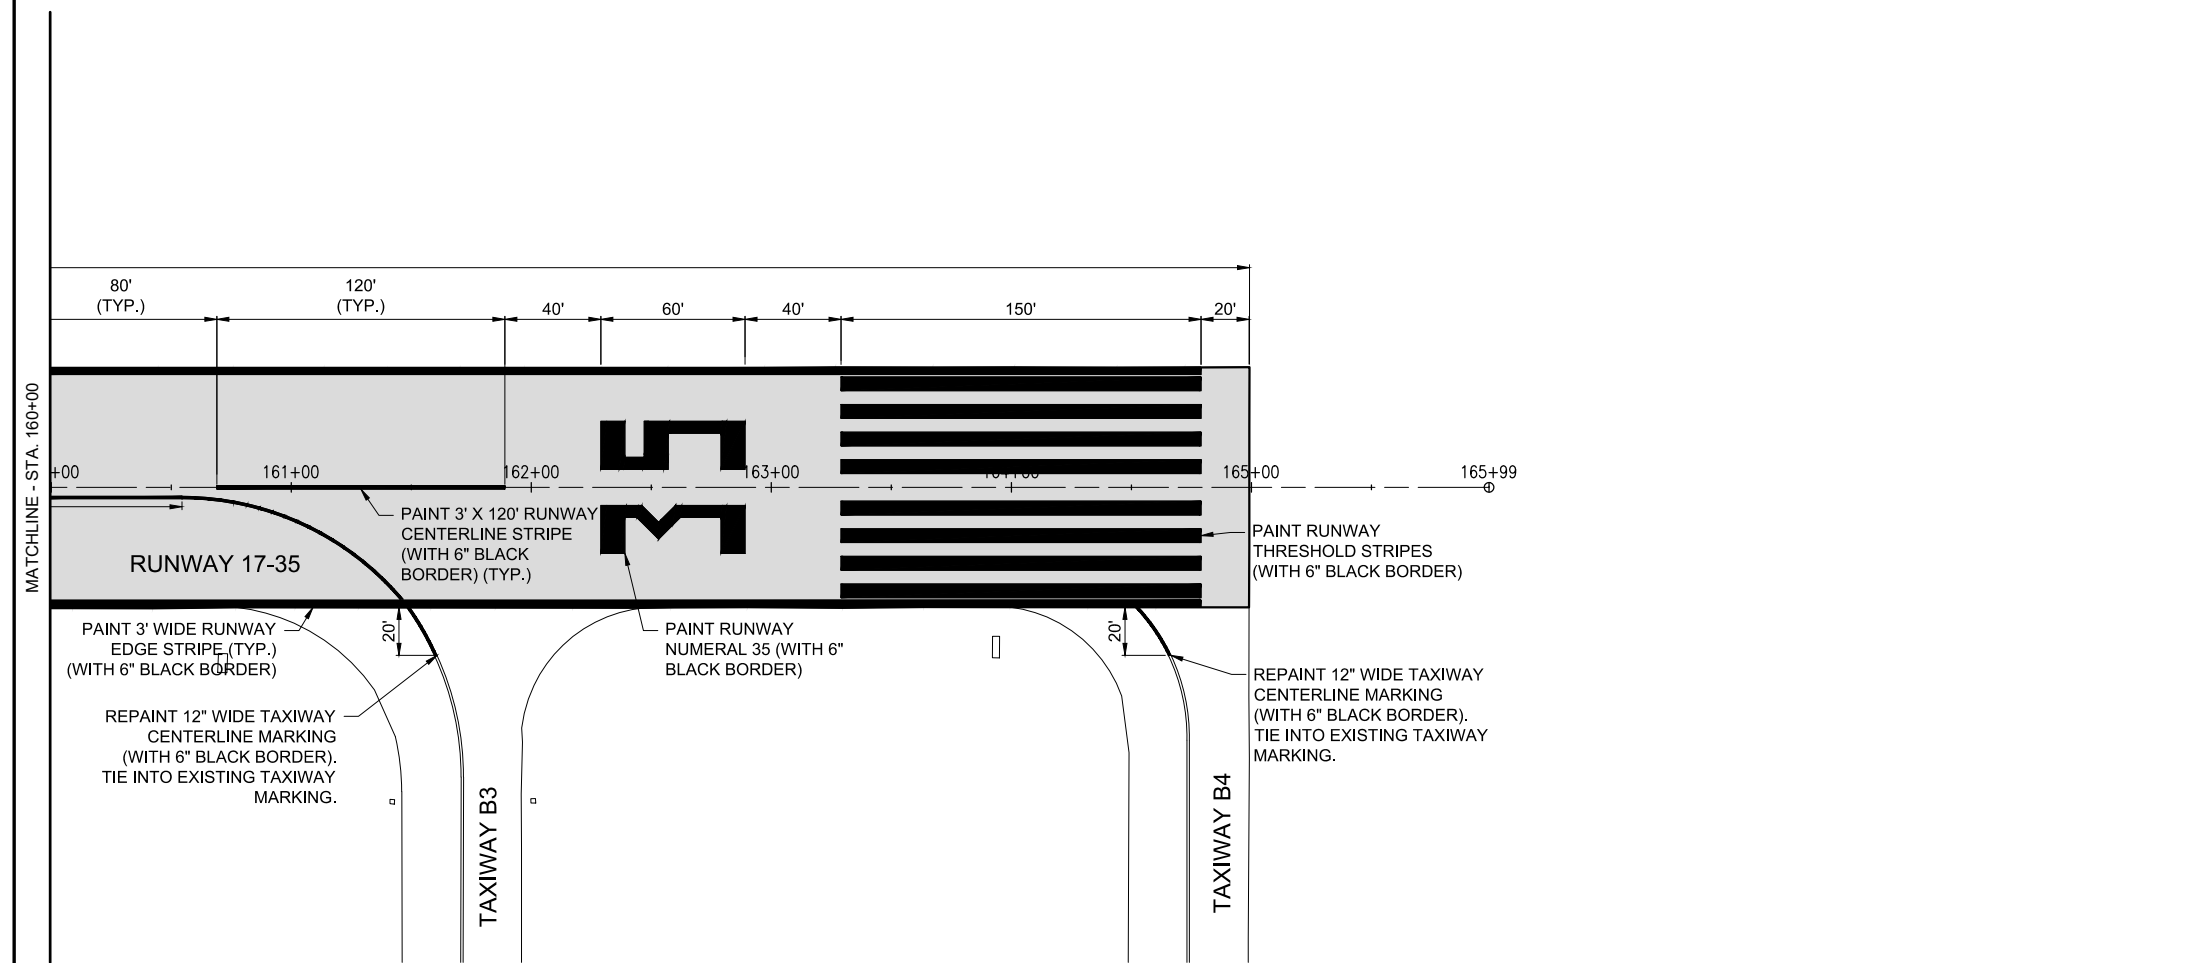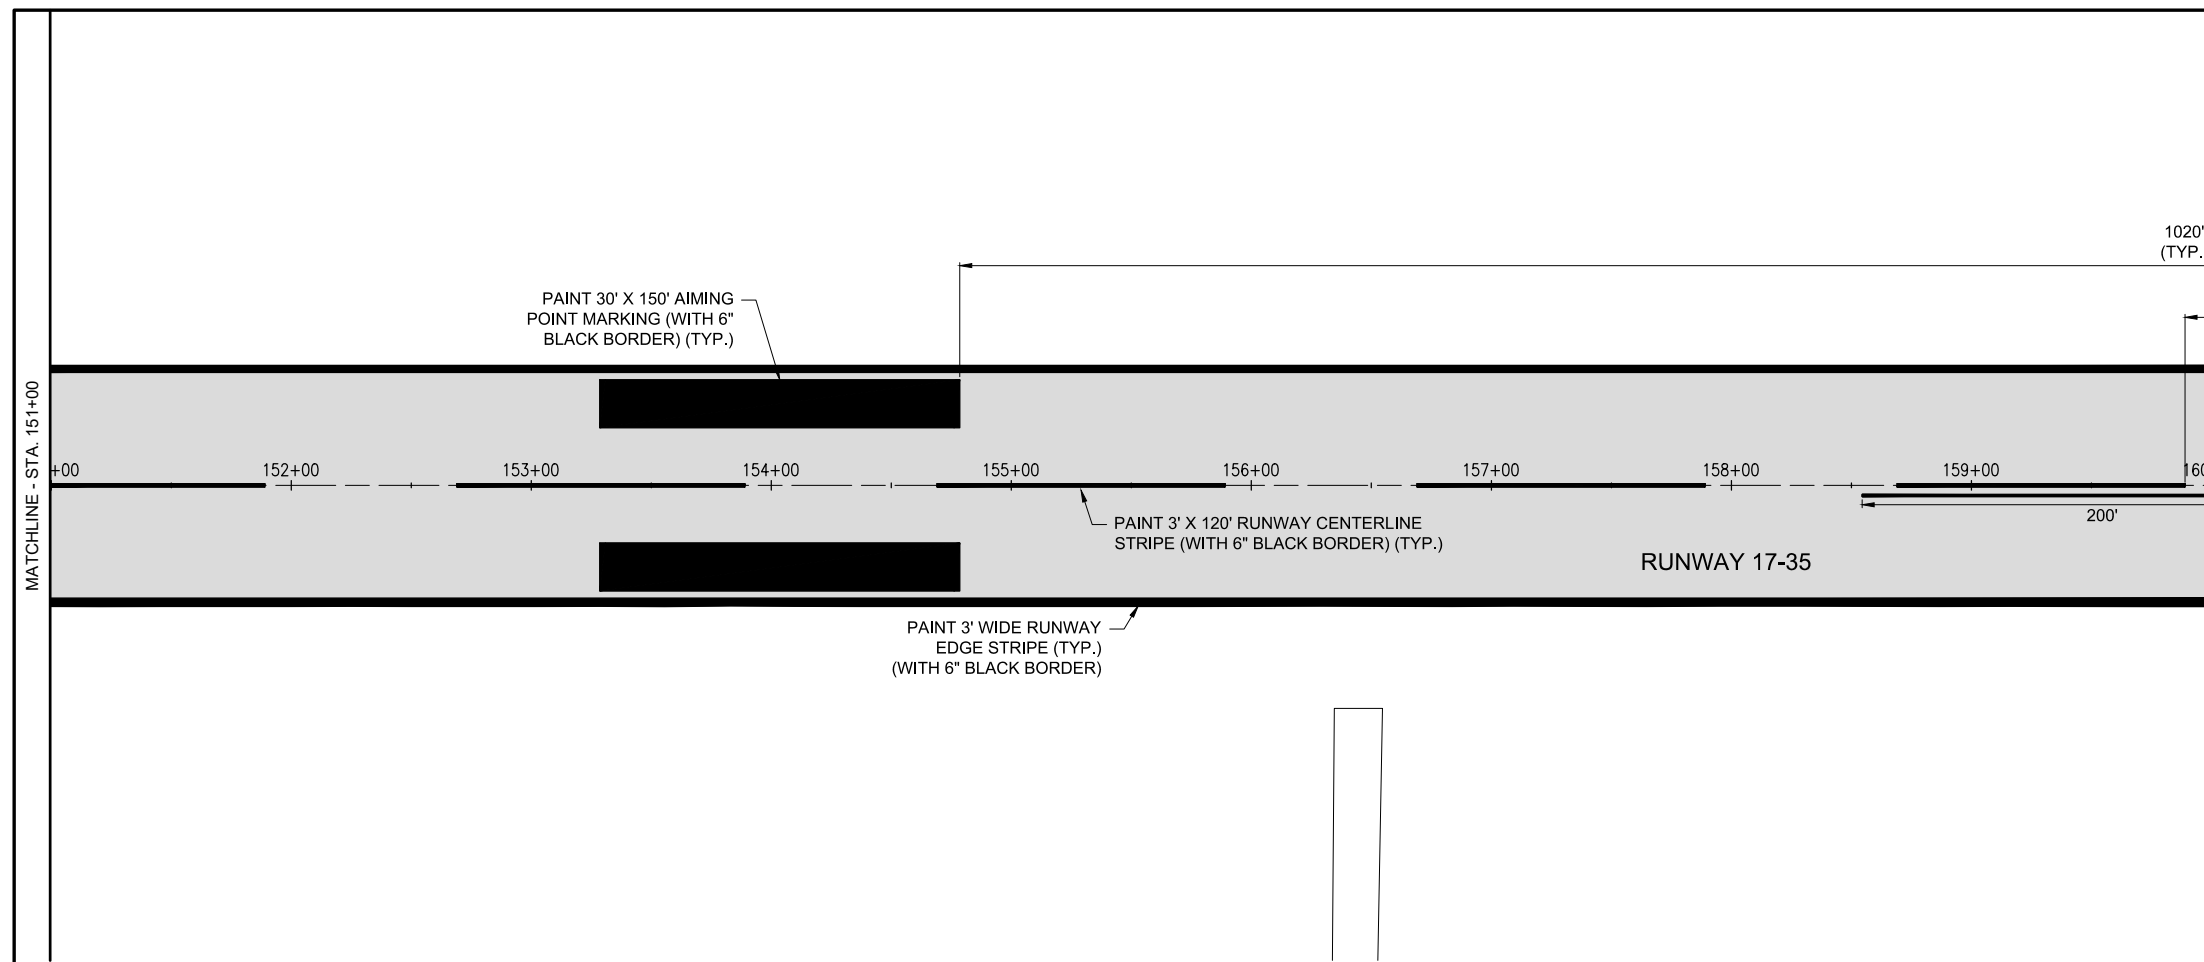





APR 19, 2021 2:41 PM HERNDON01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\TSHEETC-151-MRK

**FOR BID**

MARKING QUANTITIES	
YELLOW MARKING	TOTAL AREA (S.F.)
TAXIWAY CENTERLINES	2,439
RUNWAY HOLDING POSITION	713
TOTAL YELLOW:	3,152
WHITE MARKING	TOTAL AREA (S.F.)
RUNWAY CENTERLINE STRIPES	7,094
THRESHOLD BARS	13,800
AIMING POINTS	20,699
RUNWAY EDGE STRIPES	42,894
RUNWAY NUMERALS	2,174
TOTAL WHITE:	86,661
BLACK MARKING	TOTAL AREA (S.F.)
TAXIWAY CENTERLINES	2,439
RUNWAY HOLDING POSITION	1,183
RUNWAY CENTERLINE STRIPES	4,224
THRESHOLD BARS	2,508
AIMING POINTS	1,020
RUNWAY EDGE STRIPES	7,149
RUNWAY NUMERALS	366
TOTAL BLACK:	18,889
TOTAL YELLOW AND WHITE:	89,813
TOTAL BLACK:	18,889
TOTAL MARKING	108,702

**PAVEMENT MARKING NOTES**

- GLASS BEADS SHALL BE REQUIRED FOR ALL WHITE AND YELLOW PERMANENT PAINT MARKINGS. GLASS BEADS ARE NOT REQUIRED FOR TEMPORARY MARKINGS OR BLACK PAINT. REFER TO SPECIFICATION ITEM P-620 FOR ADDITIONAL INFORMATION.
- IMMEDIATELY PRIOR TO THE APPLICATION OF PAINT, ALL SURFACES SHALL BE DRY AND FREE FROM DIRT, GREASE, OIL, LAITANCE, OR OTHER FOREIGN MATERIAL WHICH WOULD REDUCE THE BOND BETWEEN THE PAINT AND THE PAVEMENT. THIS SHALL INCLUDE PAINTED AREAS ON THE EXISTING PAVEMENTS. REFER TO SPECIFICATION P-620-3.3 FOR ADDITIONAL INFORMATION.
- EXISTING PAVEMENT MARKINGS OUTSIDE THE LIMITS OF THE MARKINGS SHOWN ON THE MARKING PLAN WHICH ARE REMOVED OR WORN DUE TO CONSTRUCTION ACTIVITY SHALL BE REPAINTED. NO ADDITIONAL COMPENSATION SHALL BE MADE FOR THIS WORK.
- NUMERAL MARKING TEMPLATES FOR SURFACE PAINTED HOLD POSITION SIGN MARKINGS SHALL BE PROVIDED BY THE CONTRACTOR FOR USE ON THE PROJECT. TEMPLATES SHALL BE MAINTAINED IN GOOD CONDITION AND TURNED OVER TO THE OWNER AT PROJECT COMPLETION.
- IF THE CONTRACTOR ELECTS TO "BLOCK PAINT" THE BLACK PAINT AND THEN PAINT EITHER YELLOW OR WHITE PAINT OVER THE BLACK PAINT; ONLY THE VISIBLE 6" BLACK OUTLINE WILL BE ELIGIBLE FOR PAYMENT.

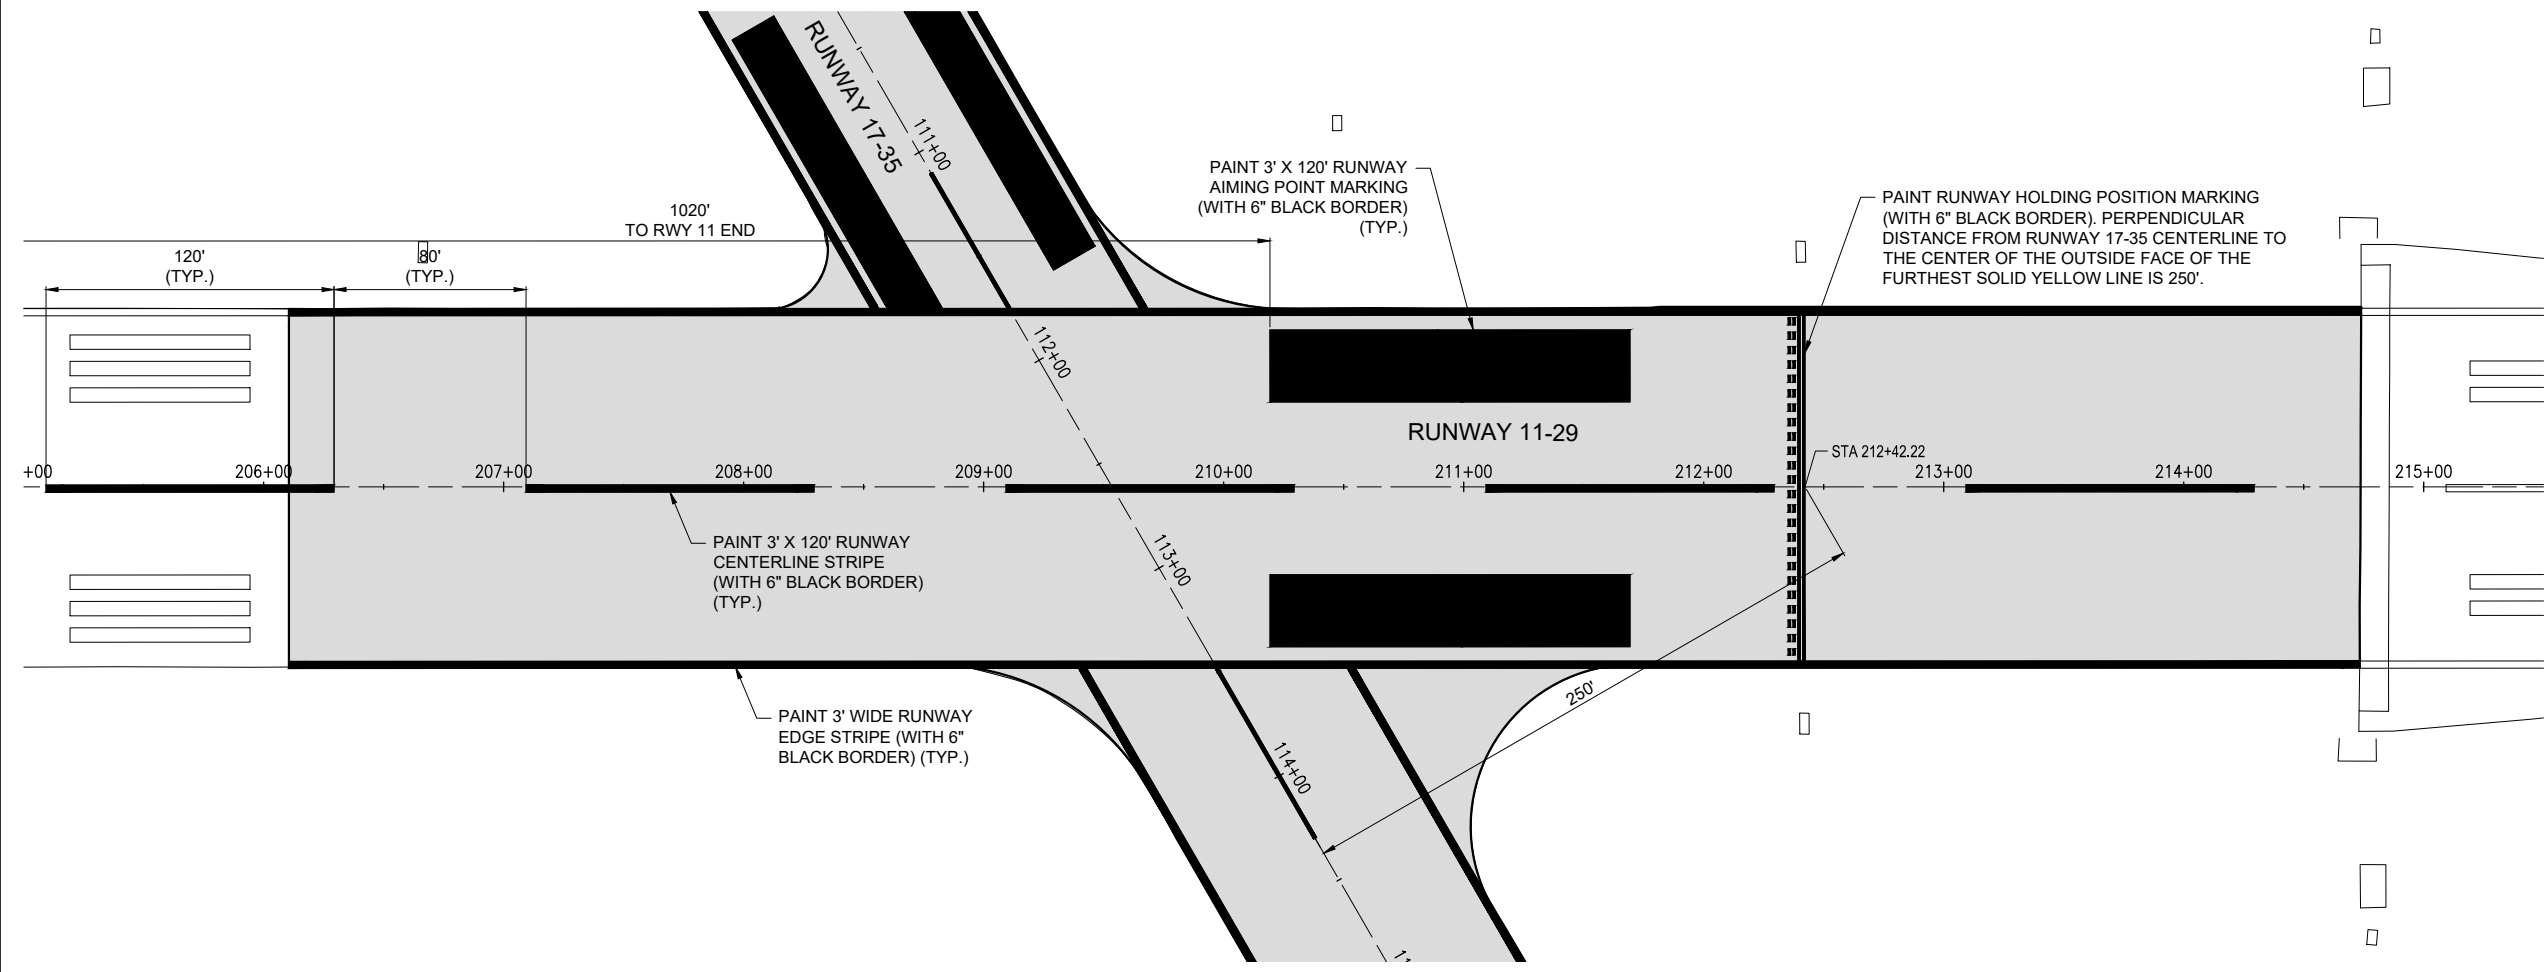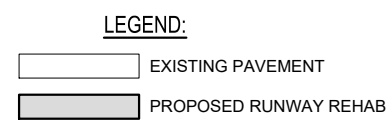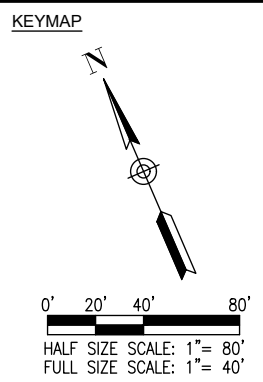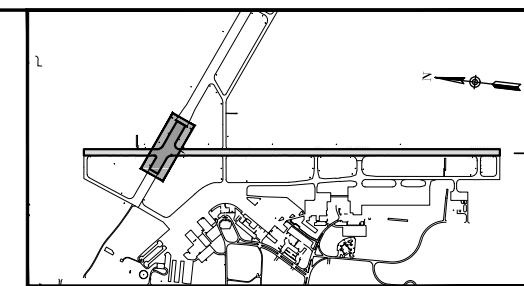

**HANSON**  
Engineering | Planning | Allied Services  
Hanson Professional Services Inc.  
1525 S. 6th Street  
Springfield, IL 62703  
phone: 217-788-2450  
fax: 217-788-2503  
Offices Nationwide  
www.hanson-inc.com



**ST. LOUIS REGIONAL AIRPORT**  
8 Terminal Drive  
East Alton, Illinois 62024



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE RUNWAY 17-35 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-151-MRK.DWG  
DESIGN BY: CEM 3/18/2021  
DRAWN BY: CEM 3/18/2021  
REVIEWED BY: JRH 3/22/2021

SHEET TITLE

**PROPOSED MARKING PLAN - STA. 205+50 TO STA. 215+50**

APR 20, 2021 3:07 PM HERND01562 I:\17 JOBS\17A008504\CAD\AIRPORT\TSHEETC-151-MRK

**FOR BID**



*Jaycen R. Herndon*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812








Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-501-MRK.DWG  
DESIGN BY: HLE 4/12/2021  
DRAWN BY: HLE 4/12/2021  
REVIEWED BY: JRH 4/12/2021

SHEET TITLE

MARKING DETAILS

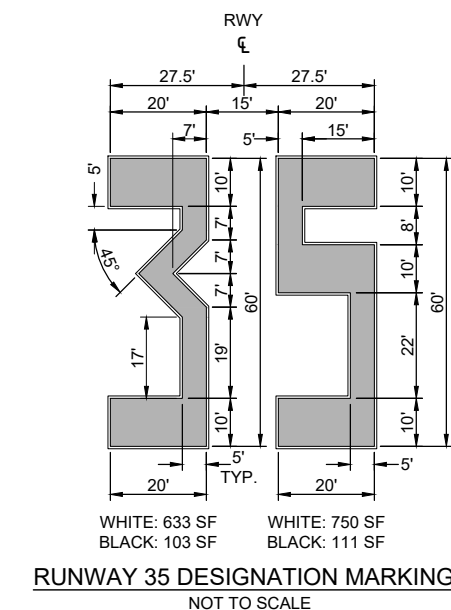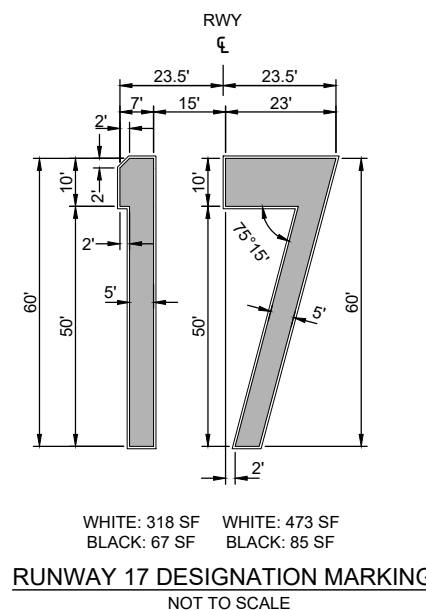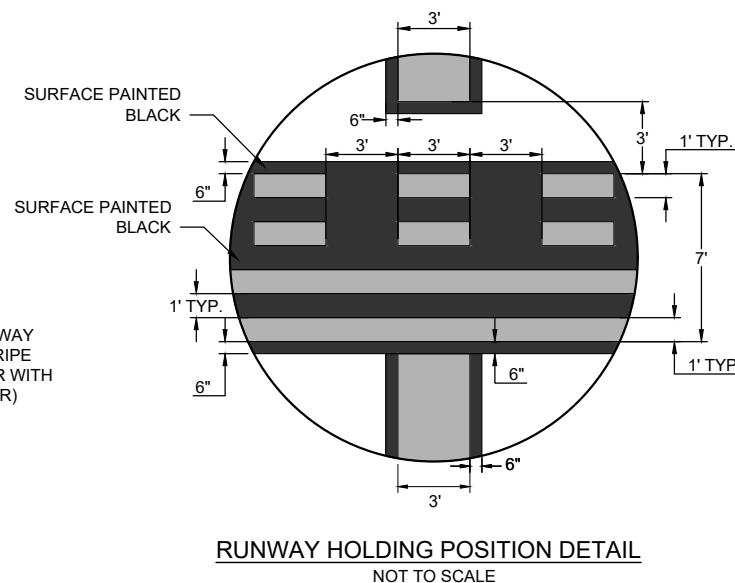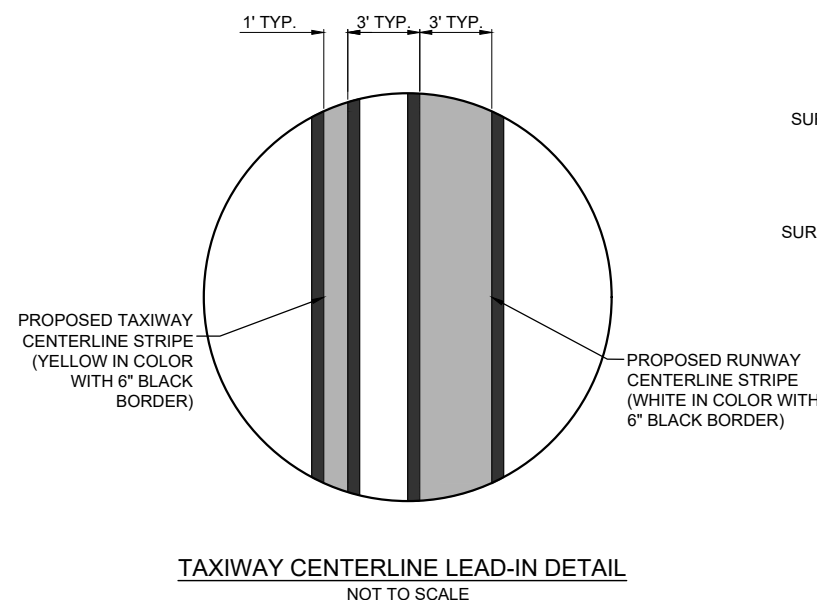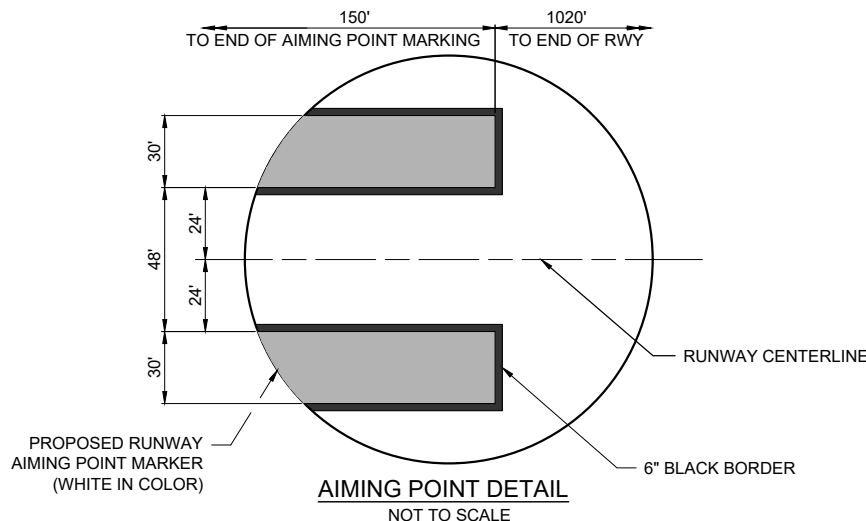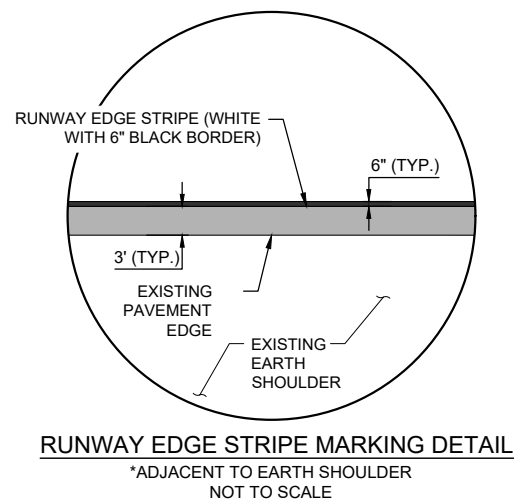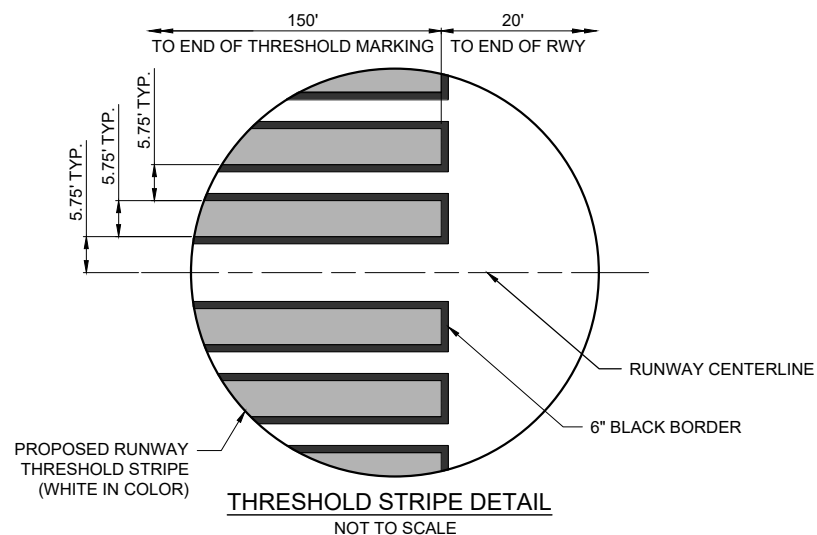

RUNWAY DESIGNATION MARKING NOTES

1. ALL NUMERAL MARKING WILL BE WHITE IN COLOR WITH A 6" BLACK OUTLINE.
2. NUMERALS ARE HORIZONTALLY SPACED 15 FEET APART.
3. DOUBLE DIGIT NUMERAL DESIGNATIONS ARE CENTERED ON THE RUNWAY PAVEMENT CENTERLINE BASED ON THE CENTER OF THE OUTER EDGES OF THE TWO NUMERALS.





*Kevin N. Lightfoot*

DATE SIGNED: 4/18/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-141-ELE.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: CWS 3/18/2021  
REVIEWED BY: KNL 3/18/2021

SHEET TITLE

EXISTING  
ELECTRICAL PLAN -  
STA. 99+00 TO STA.  
115+00

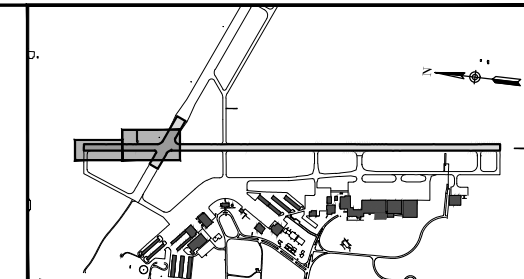


KEYMAP



0' 20' 40' 80'  
HALF SIZE SCALE: 1"= 80'  
FULL SIZE SCALE: 1"= 40'

**LEGEND**

- EXISTING PAVEMENT
- EXISTING BUILDING
- EXISTING MARKING
- EXISTING ELECTRICAL DUCT
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING STORM SEWER/UNDERDRAIN
- EXISTING ELECTRIC UTILITY UG PRIMARY
- EXISTING TELEPHONE
- EXISTING GAS
- EXISTING FENCE
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- EXISTING TAXI/RUNWAY SIGN
- EXISTING STAKE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING BASE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING STAKE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING AIRFIELD SIGN TO BE REMOVED
- EXISTING ELECTRICAL HANDHOLE
- EXISTING SPLICE CAN
- EXISTING ELECTRICAL MANHOLE
- EXISTING BASE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING REIL
- EXISTING WIND CONE

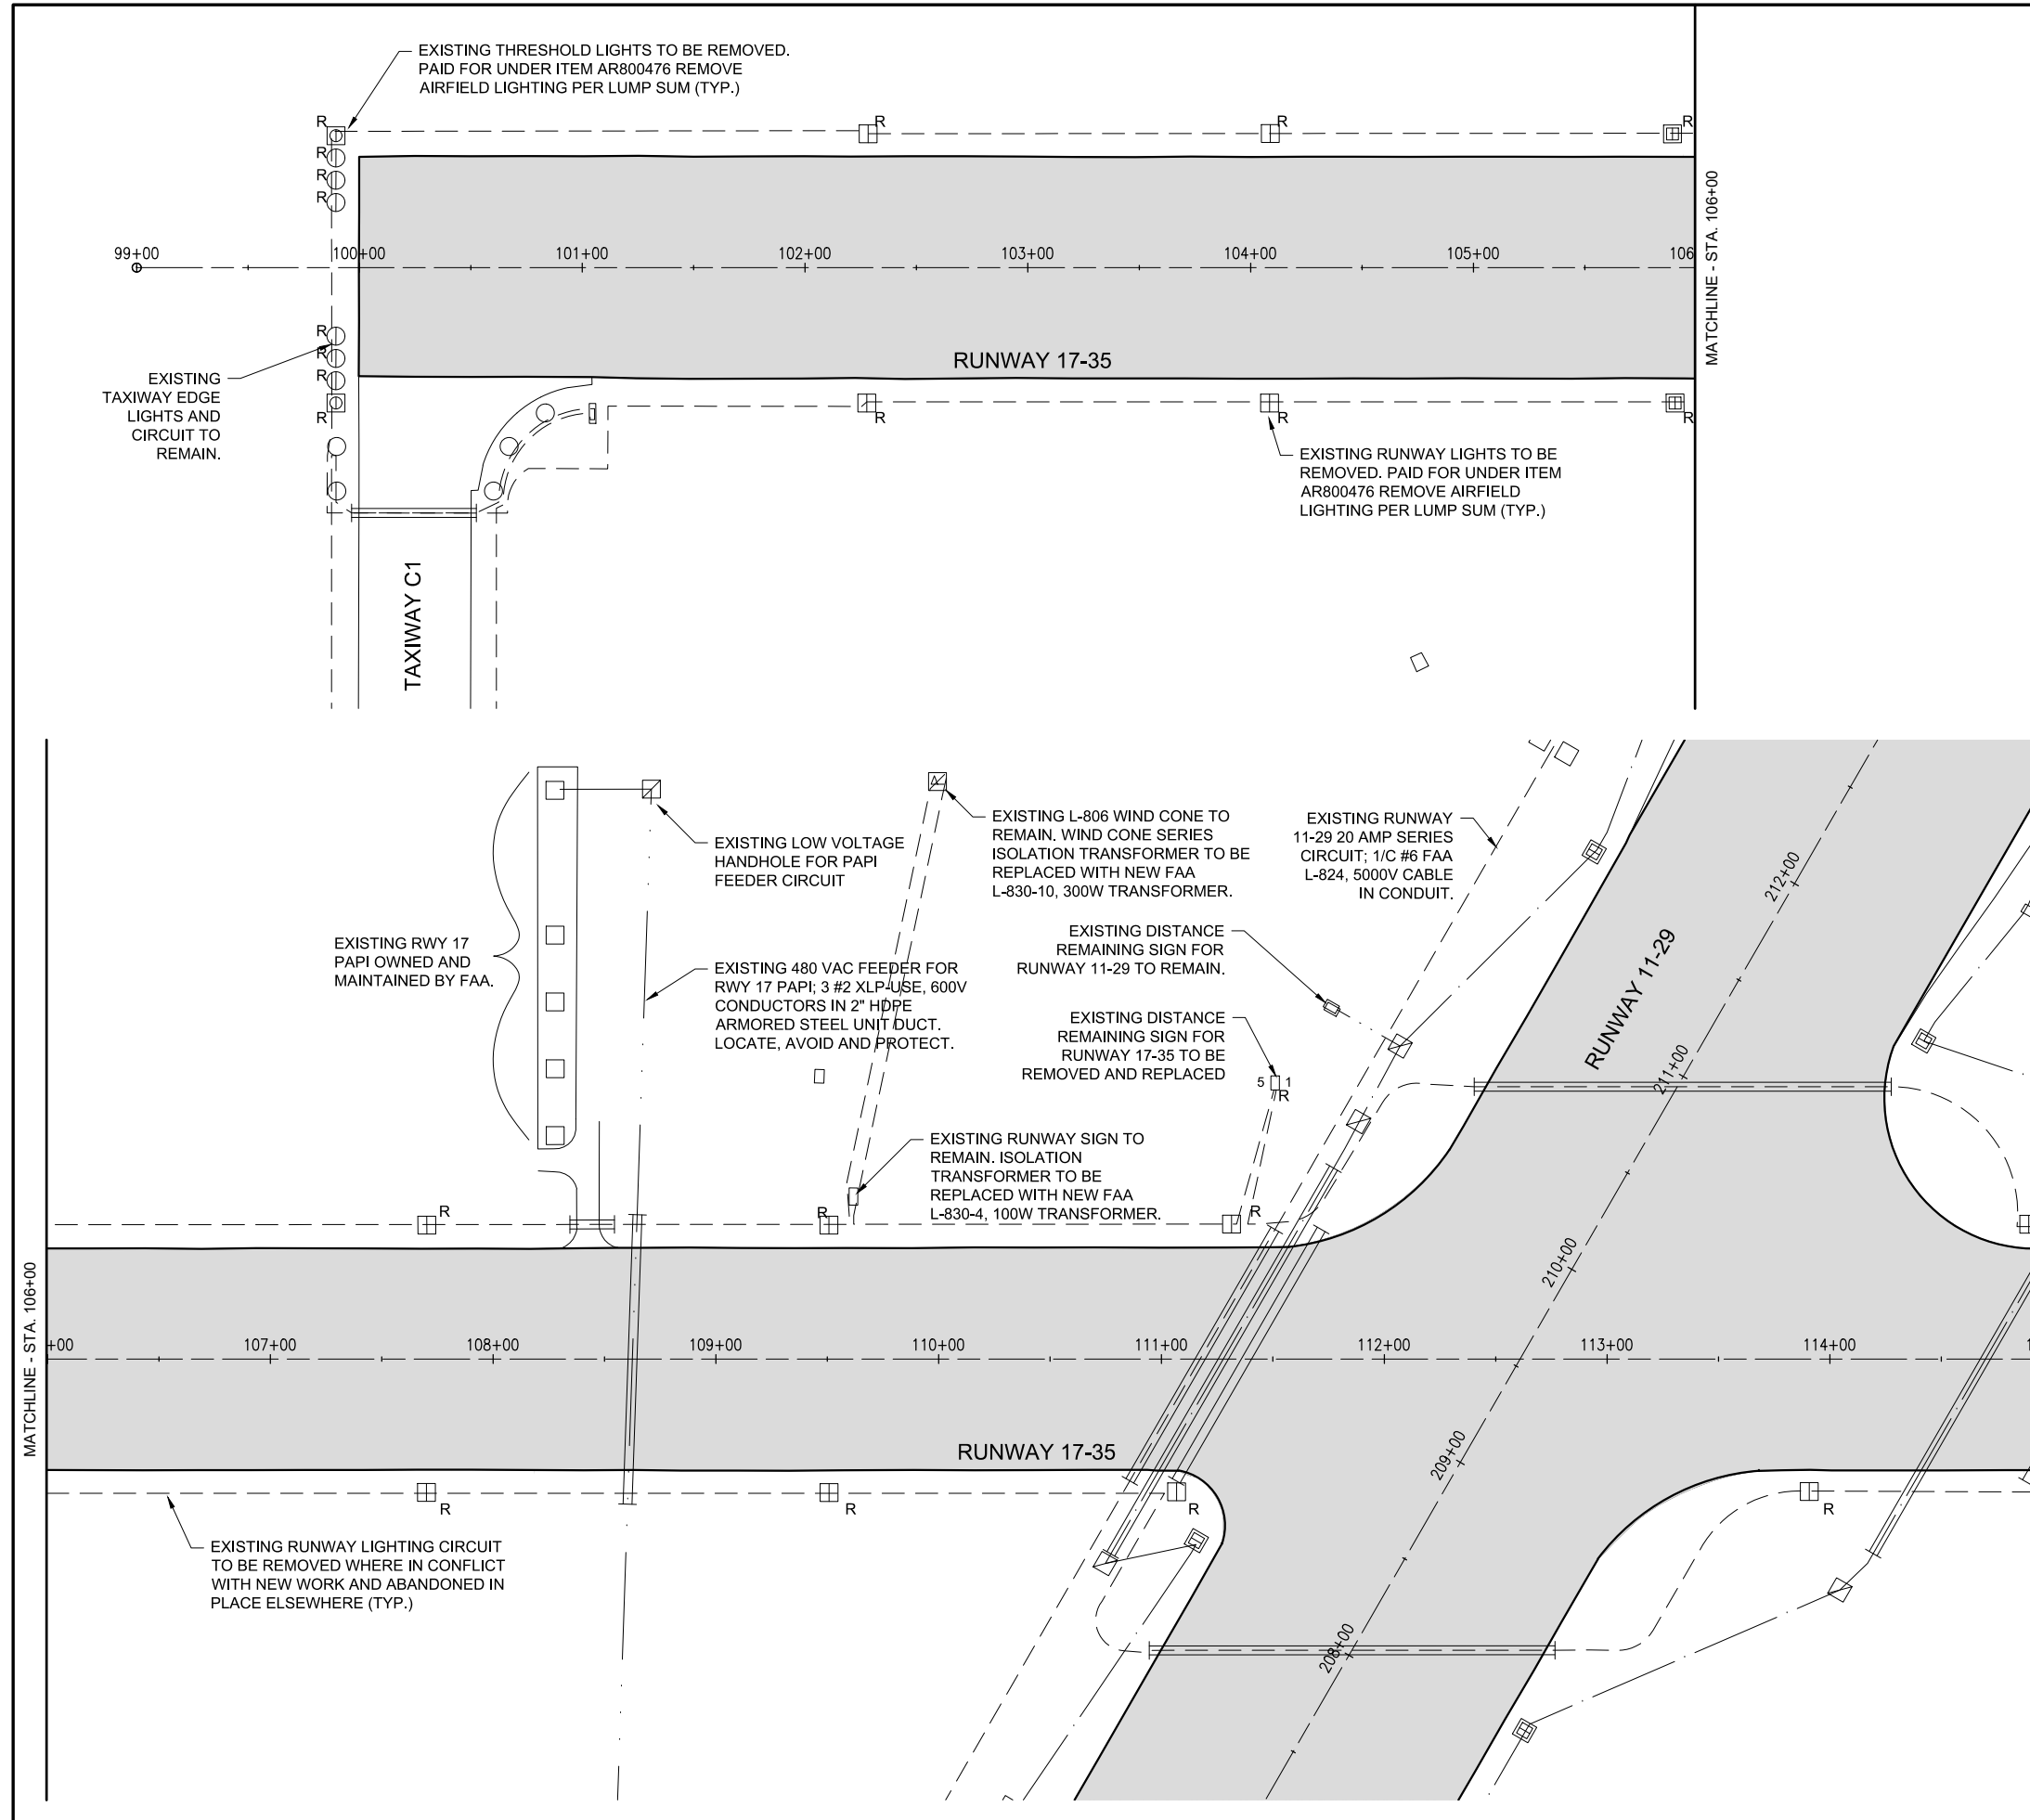

APR 19, 2021 2:42 PM HERND01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEETC-141-ELE

**FOR BID**



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-141-ELE.DWG  
DESIGN BY: JRH 3/18/2021  
DRAWN BY: CWS 3/18/2021  
REVIEWED BY: KNL 3/18/2021

SHEET TITLE

EXISTING  
ELECTRICAL PLAN -  
STA. 115+00 TO STA.  
133+00

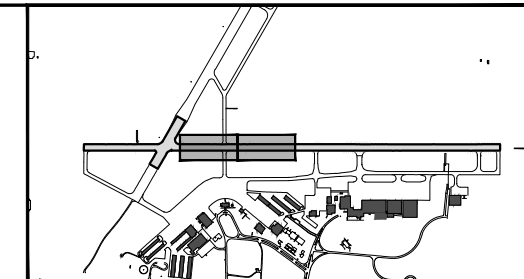


KEYMAP




**LEGEND**

- EXISTING PAVEMENT
- EXISTING BUILDING
- EXISTING MARKING
- EXISTING ELECTRICAL DUCT
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING STORM SEWER/UNDERDRAIN
- EXISTING ELECTRIC UTILITY UG PRIMARY
- EXISTING TELEPHONE
- EXISTING GAS
- EXISTING FENCE
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- EXISTING TAXI/RUNWAY SIGN
- EXISTING STAKE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING BASE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING STAKE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING AIRFIELD SIGN TO BE REMOVED
- EXISTING ELECTRICAL HANDHOLE
- EXISTING SPLICE CAN
- EXISTING ELECTRICAL MANHOLE
- EXISTING BASE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING REIL
- EXISTING WIND CONE

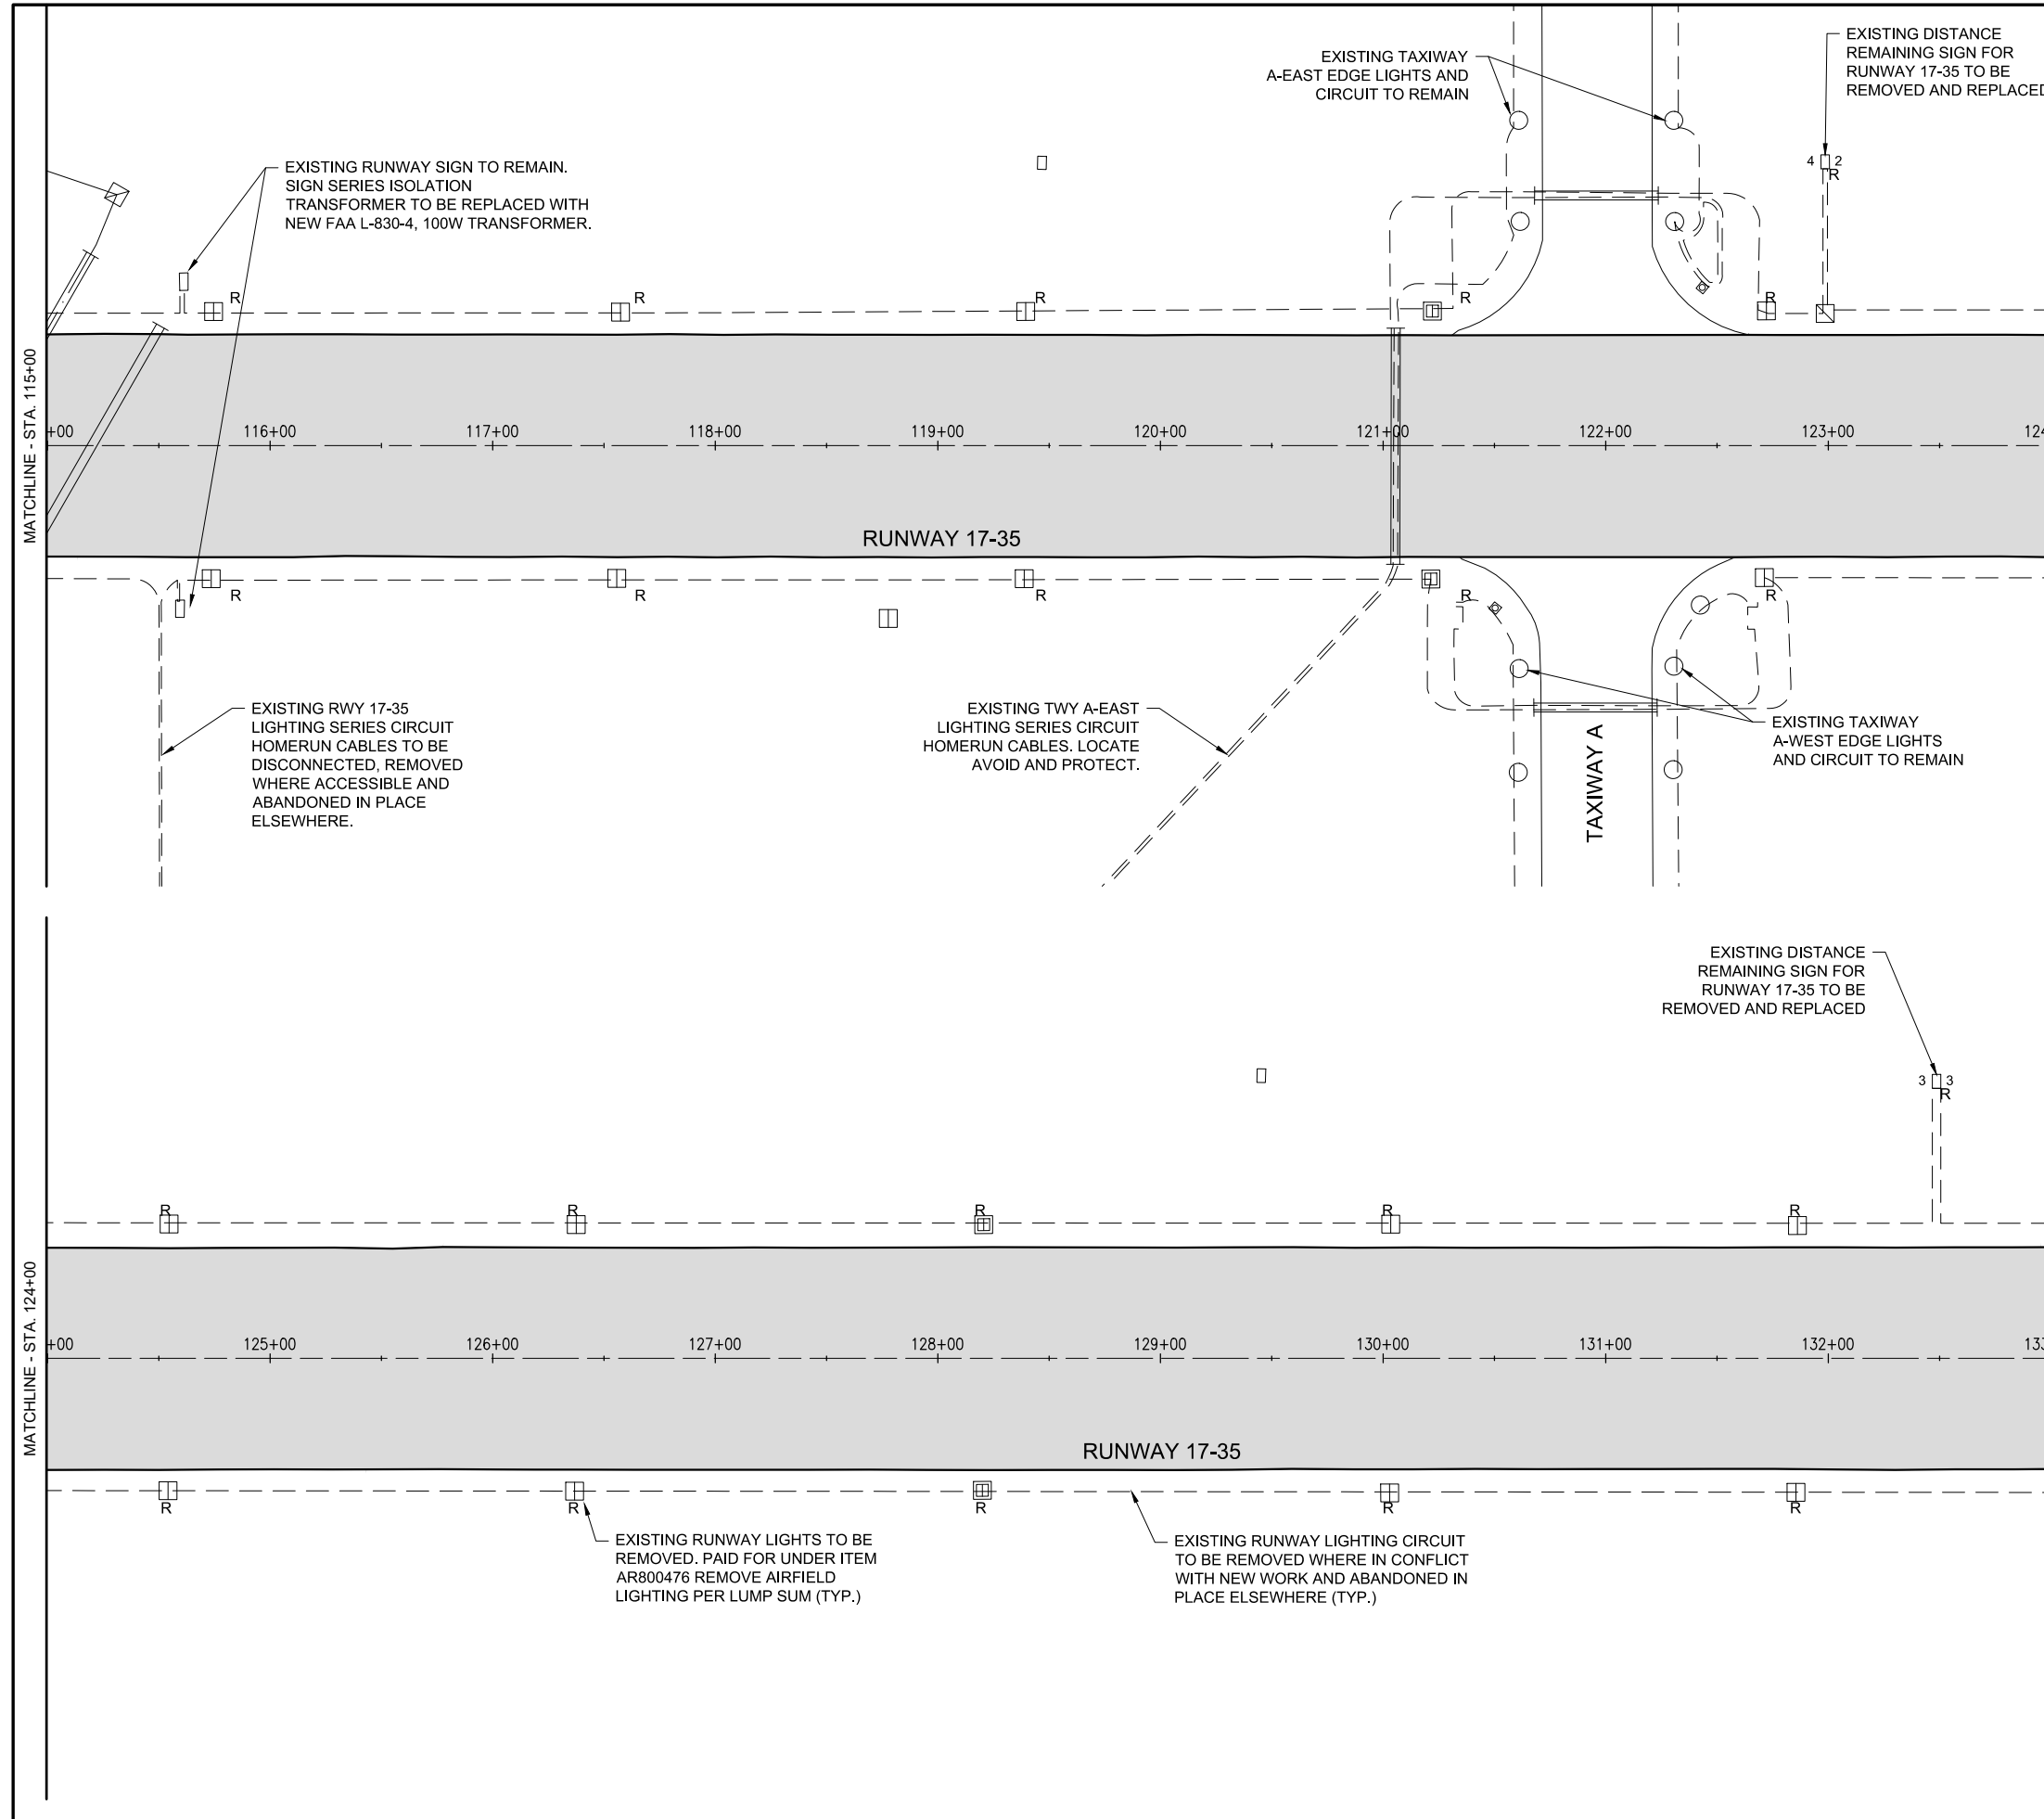

APR 19, 2021 2:42 PM HERND01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-141-ELE

**FOR BID**



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-141-ELE.DWG  
DESIGN BY: JRH 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

EXISTING  
ELECTRICAL PLAN -  
STA. 133+00 TO STA.  
151+00

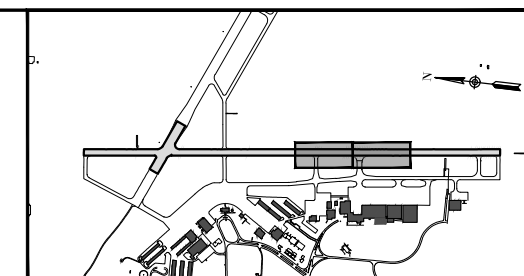


KEYMAP



**LEGEND**

- EXISTING PAVEMENT
- EXISTING BUILDING
- EXISTING MARKING
- EXISTING ELECTRICAL DUCT
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL CABLES
- EXISTING STORM SEWER/UNDERDRAIN
- EXISTING ELECTRIC UTILITY UG PRIMARY
- EXISTING TELEPHONE
- EXISTING GAS
- EXISTING FENCE
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- EXISTING TAXI/RUNWAY SIGN
- EXISTING STAKE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING BASE MOUNTED RUNWAY LIGHT TO BE REMOVED
- EXISTING STAKE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING AIRFIELD SIGN TO BE REMOVED
- EXISTING ELECTRICAL HANDHOLE
- EXISTING SPLICE CAN
- EXISTING ELECTRICAL MANHOLE
- EXISTING BASE MOUNTED RUNWAY THRESHOLD LIGHT TO BE REMOVED
- EXISTING REIL
- EXISTING WIND CONE

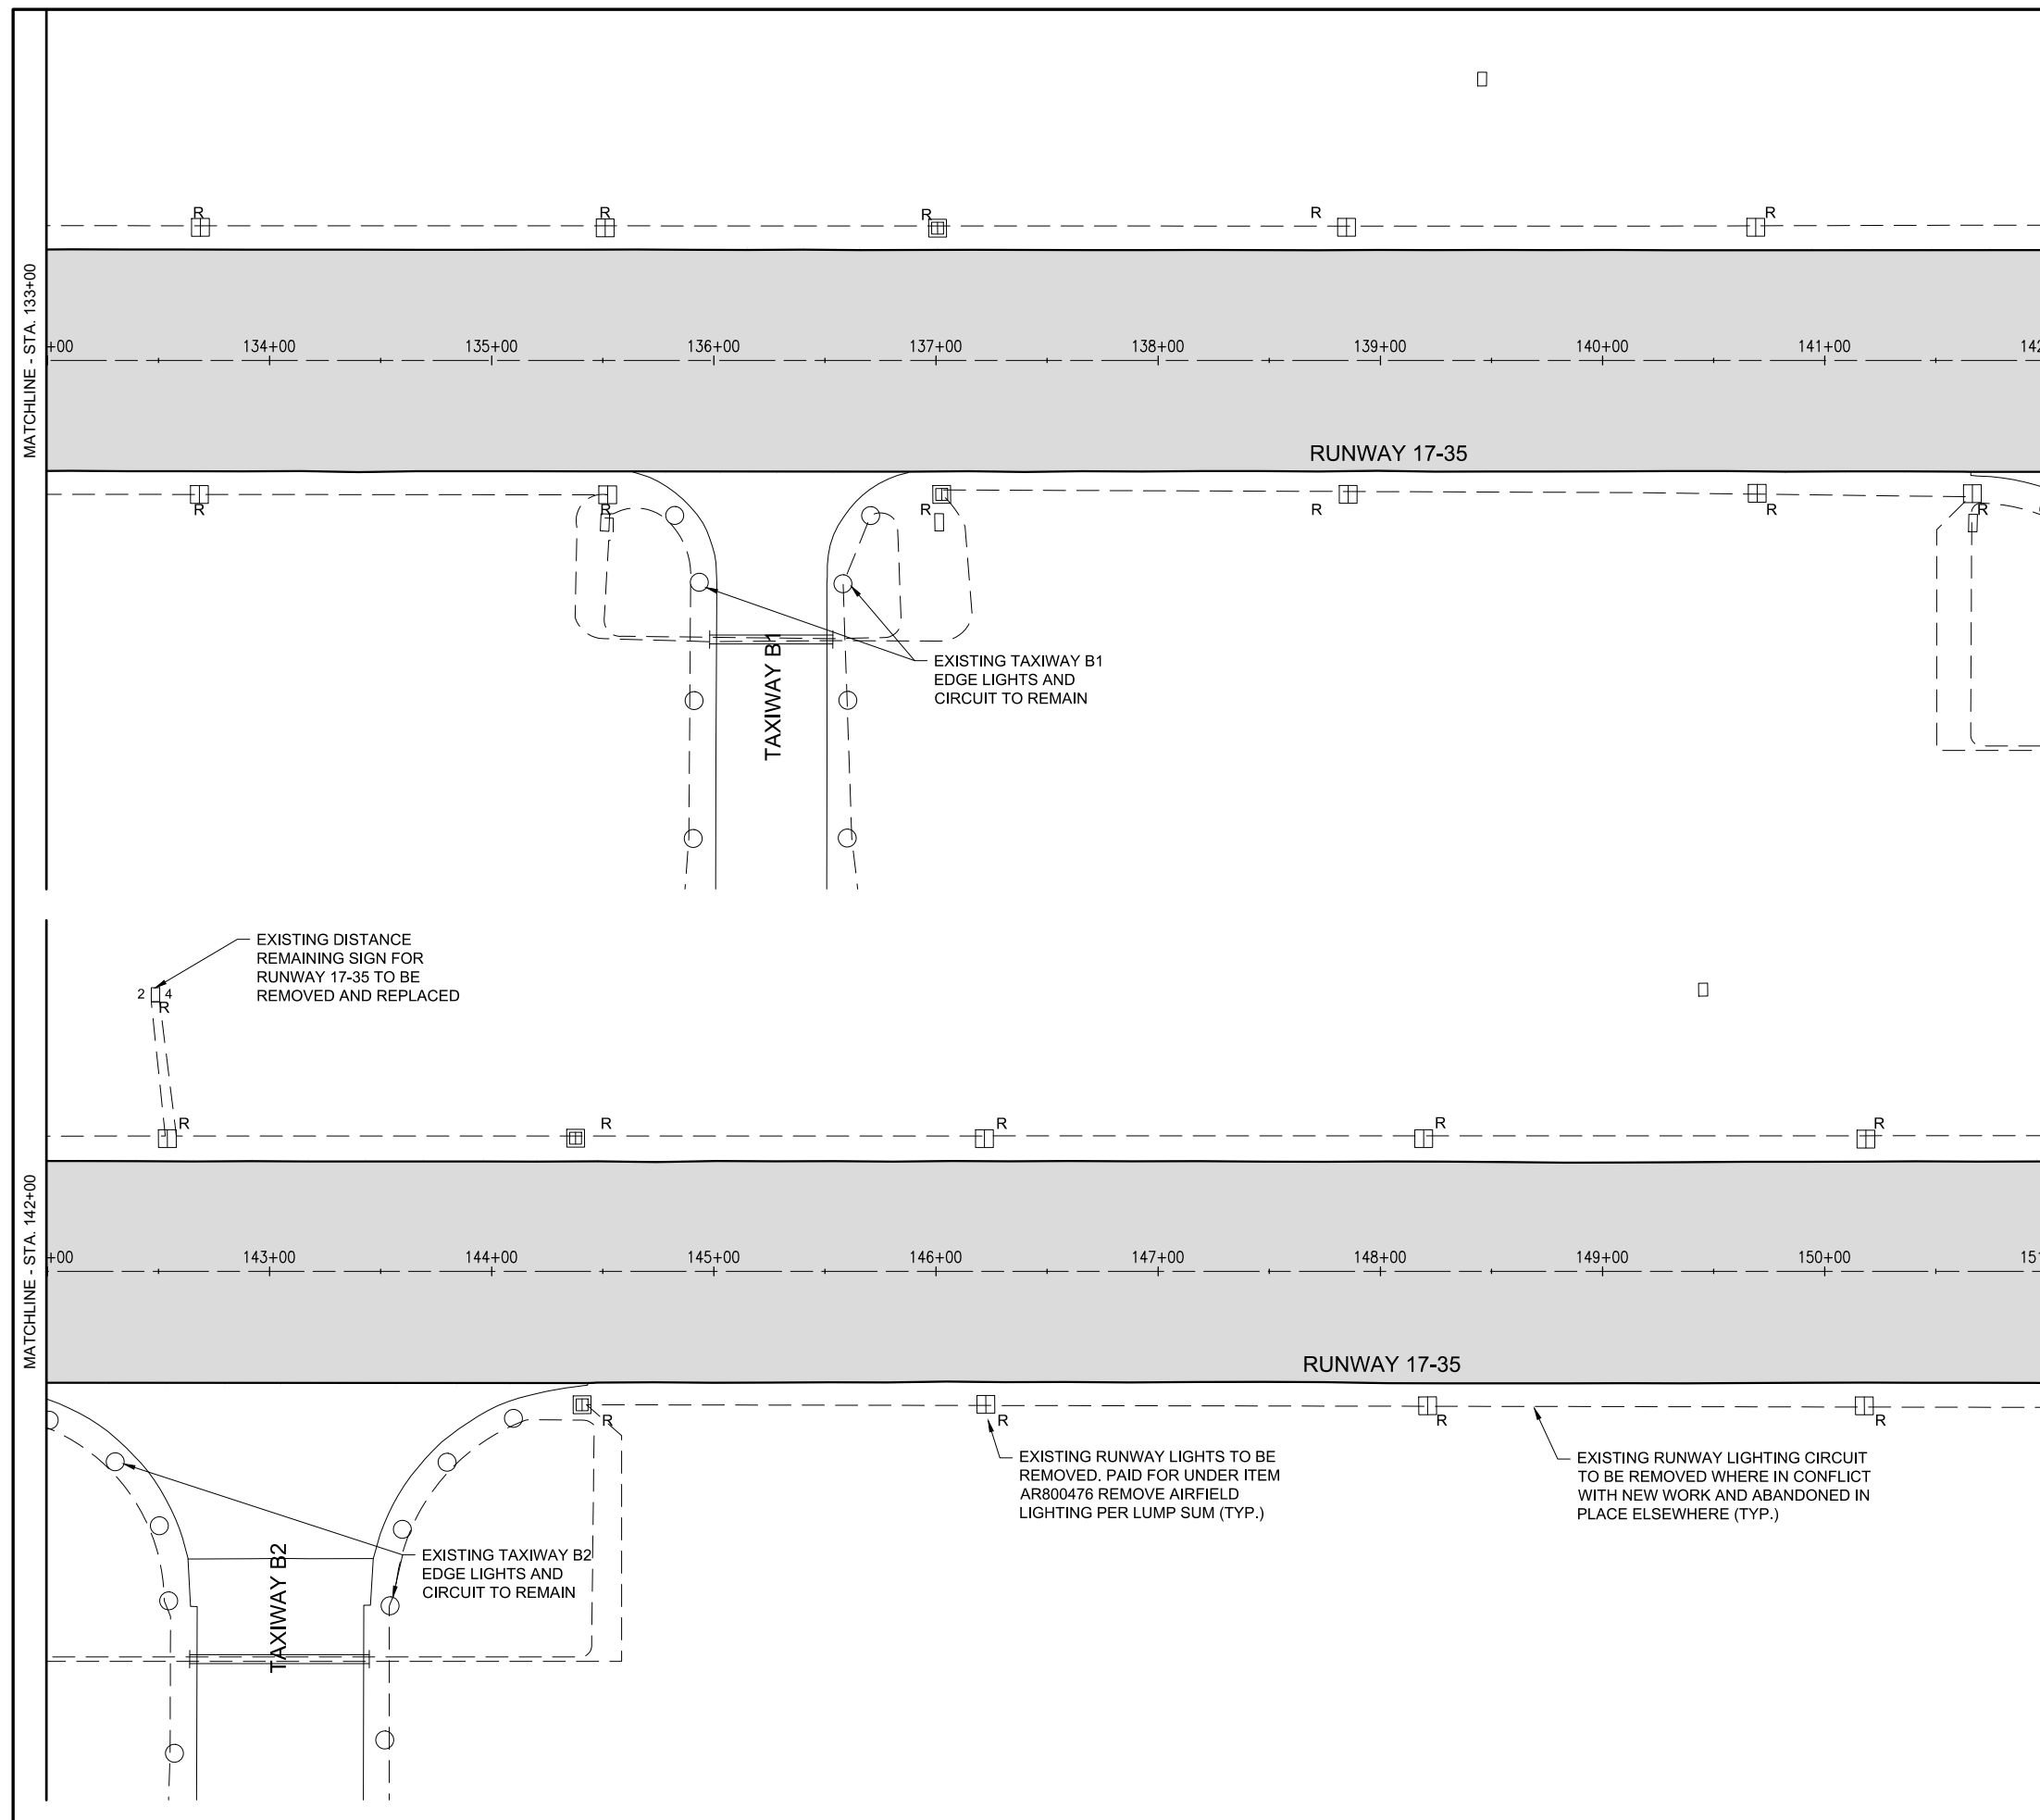

APR 19, 2021 2:42 PM HERNDD01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEETC-141-ELE

**FOR BID**









*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-142-ELE.DWG  
DESIGN BY: JRH 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

**PROPOSED  
ELECTRICAL PLAN -  
STA. 99+00 TO STA.  
115+00**

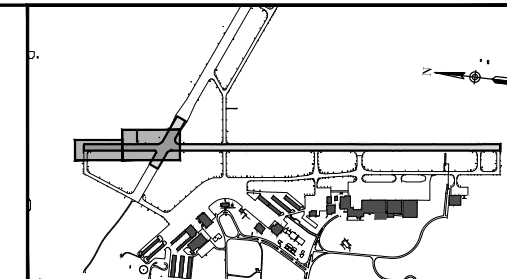



KEYMAP



**LEGEND**

- EXISTING PAVEMENT
- EXISTING BUILDING
- EXISTING MARKING
- EXISTING ELECTRICAL DUCT
- PROPOSED ELECTRICAL DUCT
- EXISTING ELECTRICAL CIRCUIT
- EXISTING ELECTRICAL CIRCUIT
- EXISTING ELECTRICAL CABLES
- EXISTING STORM SEWER/UNDERDRAIN
- EXISTING ELECTRIC UTILITY UG PRIMARY
- EXISTING TELEPHONE
- EXISTING GAS
- EXISTING FENCE
- PROPOSED 1/8 AWG, FAA L-824, 5000 VOLT TYPE C UNDERGROUND CABLE IN 2" SCHED 40 (MIN.) PVC OR HDPE DUCT
- PROPOSED 2-1/8 AWG, FAA L-824, 5000 VOLT TYPE C UNDERGROUND CABLE IN 2" SCHED 40 (MIN.) PVC OR HDPE DUCT
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- PROPOSED BASE MOUNTED RUNWAY LIGHT
- PROPOSED BASE MOUNTED RUNWAY THRESHOLD LIGHT
- EXISTING RUNWAY/TAXI GUIDANCE SIGN
- PROPOSED RUNWAY DISTANCE REMAINING SIGN
- EXISTING ELECTRICAL HANDHOLE
- EXISTING ELECTRICAL MANHOLE
- EXISTING SPLICE CAN
- PROPOSED ELECTRICAL HANDHOLE
- PROPOSED SPLICE CAN
- EXISTING WIND CONE
- EXISTING REIL


**FOR BID**

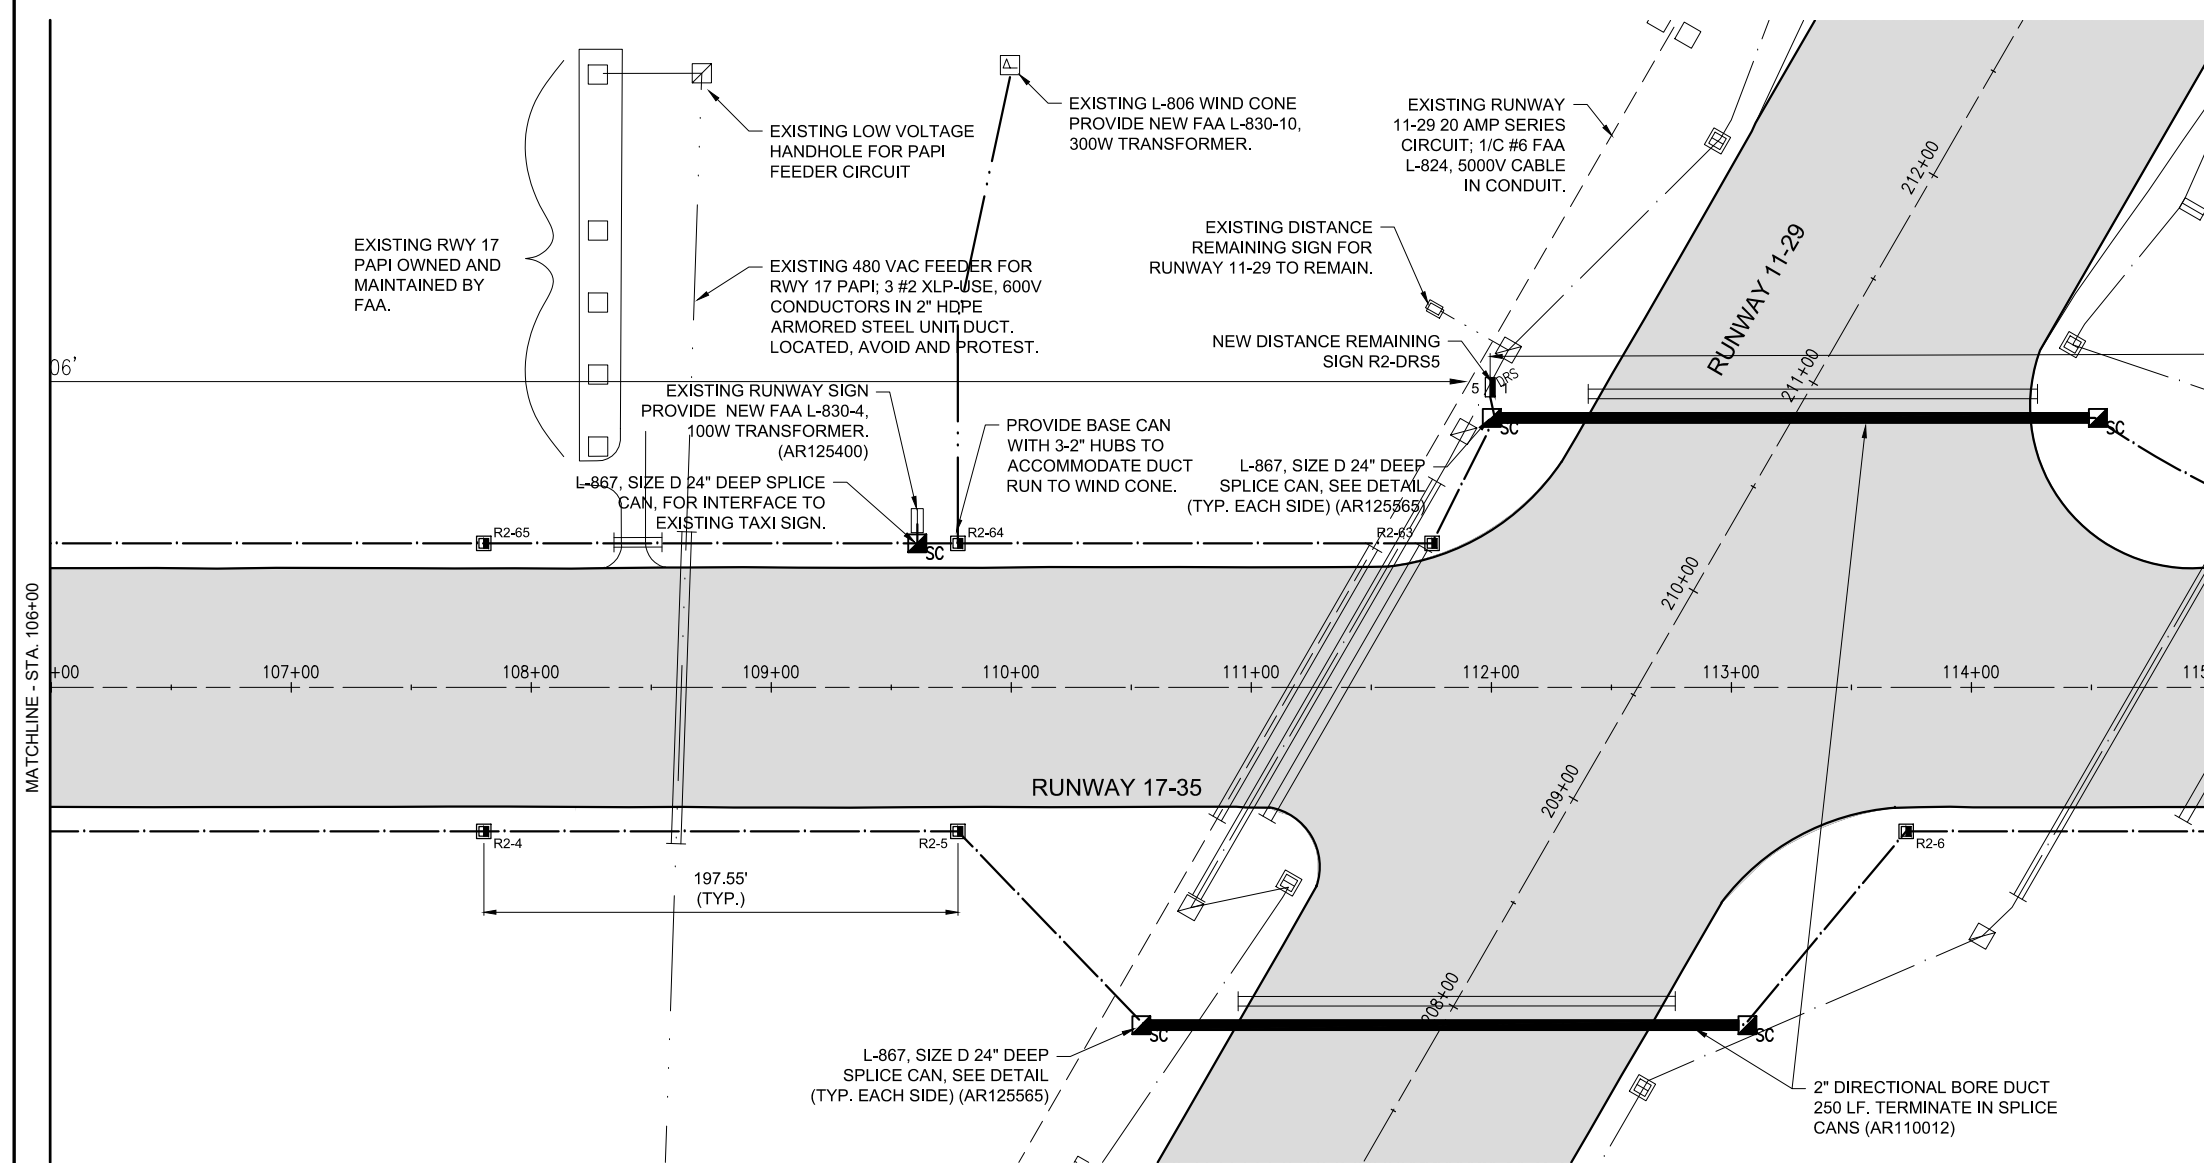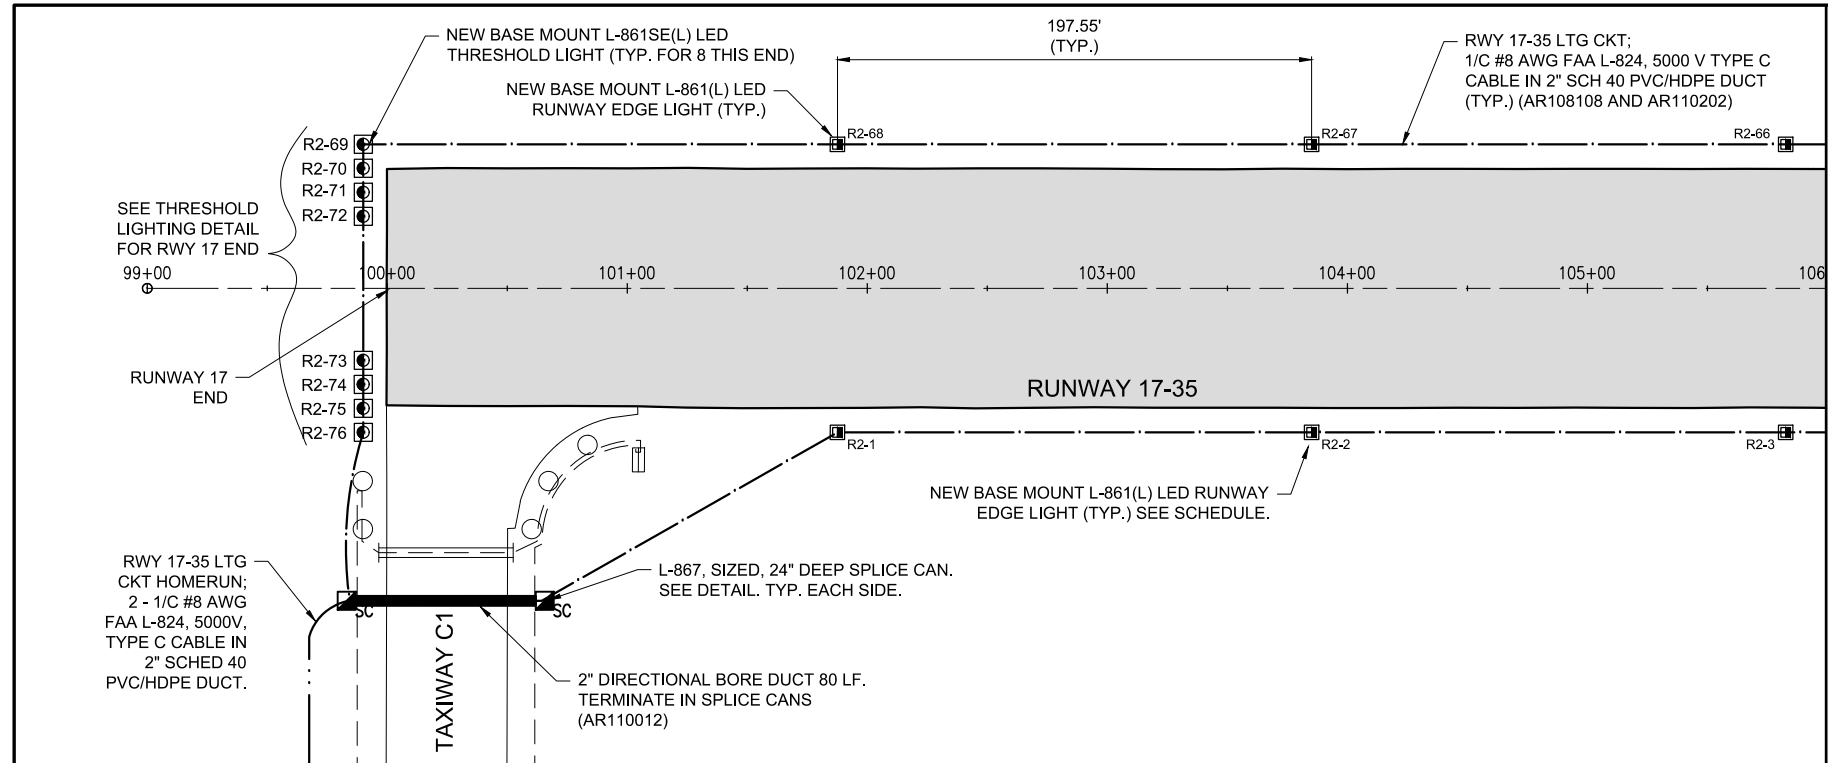

APR 19, 2021 2:43 PM HERND01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\TSHEETC-142-ELE







*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV



ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: C-142-ELE.DWG  
DESIGN BY: JRH 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

PROPOSED  
ELECTRICAL PLAN -  
STA. 133+00 TO STA.  
151+00

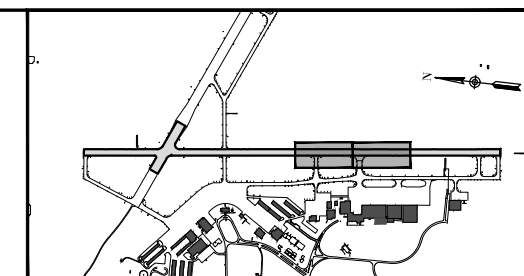


KEYMAP



LEGEND

- EXISTING PAVEMENT
- EXISTING BUILDING
- EXISTING MARKING
- EXISTING ELECTRICAL DUCT
- PROPOSED ELECTRICAL DUCT
- EXISTING ELECTRICAL CIRCUIT
- EXISTING ELECTRICAL CIRCUIT
- EXISTING ELECTRICAL CIRCUIT
- EXISTING ELECTRICAL CABLES
- EXISTING STORM SEWER/UNDERDRAIN
- EXISTING ELECTRIC UTILITY UG PRIMARY
- EXISTING TELEPHONE
- EXISTING GAS
- EXISTING FENCE
- PROPOSED 1/C #8 AWG, FAA L-824, 5000 VOLT TYPE C UNDERGROUND CABLE IN 2" SCHED 40 (MIN.) PVC OR HDPE DUCT
- PROPOSED 2-1/C #8 AWG, FAA L-824, 5000 VOLT TYPE C UNDERGROUND CABLE IN 2" SCHED 40 (MIN.) PVC OR HDPE DUCT
- EXISTING STAKE MOUNTED TAXIWAY LIGHT
- EXISTING BASE MOUNTED TAXIWAY LIGHT
- PROPOSED BASE MOUNTED RUNWAY LIGHT
- PROPOSED BASE MOUNTED RUNWAY THRESHOLD LIGHT
- EXISTING RUNWAY/TAXI GUIDANCE SIGN
- PROPOSED RUNWAY DISTANCE REMAINING SIGN
- EXISTING ELECTRICAL HANDHOLE
- EXISTING ELECTRICAL MANHOLE
- EXISTING SPLICE CAN
- PROPOSED ELECTRICAL HANDHOLE
- PROPOSED SPLICE CAN
- EXISTING WIND CONE
- EXISTING REIL

FOR BID

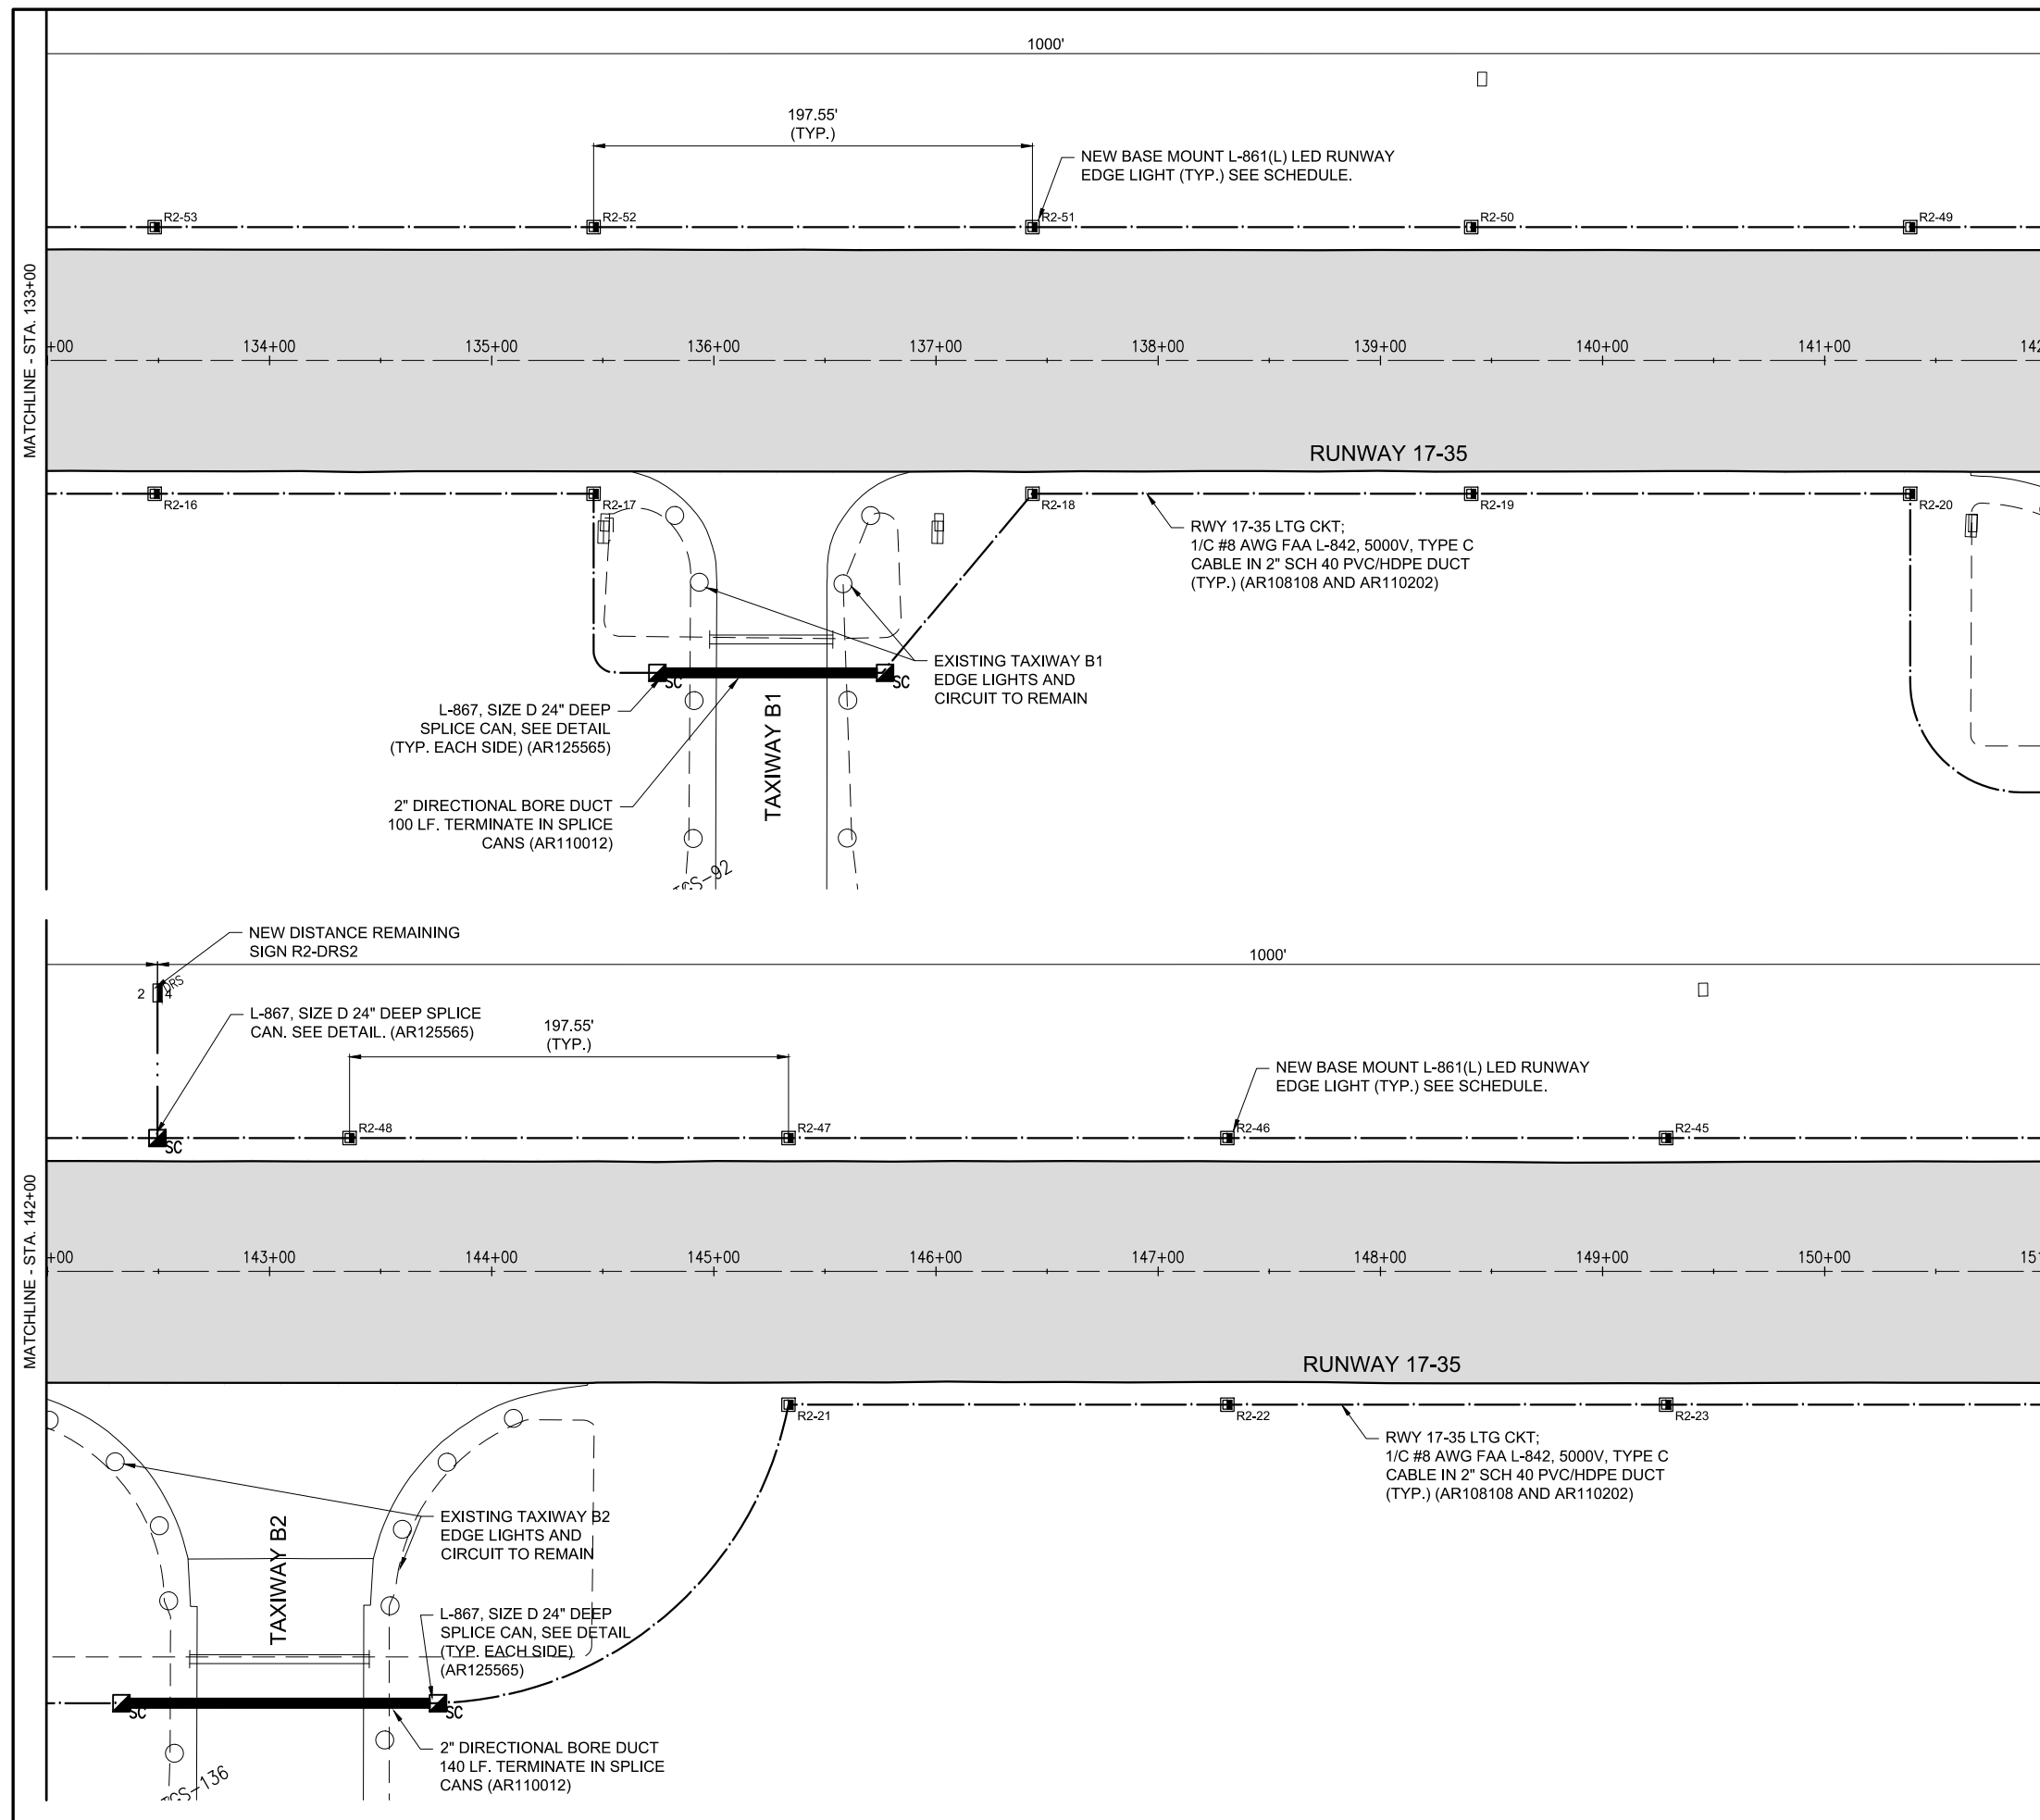

APR 19, 2021 2:43 PM HERND01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\T\SHEET\C-142-ELE









*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-510-THRS.DWG



DESIGN BY: BSS 03/18/2021

DRAWN BY: CWS 03/18/2021

REVIEWED BY: BSS 03/18/2021

SHEET TITLE


THRESHOLD  
LIGHTING DETAILS

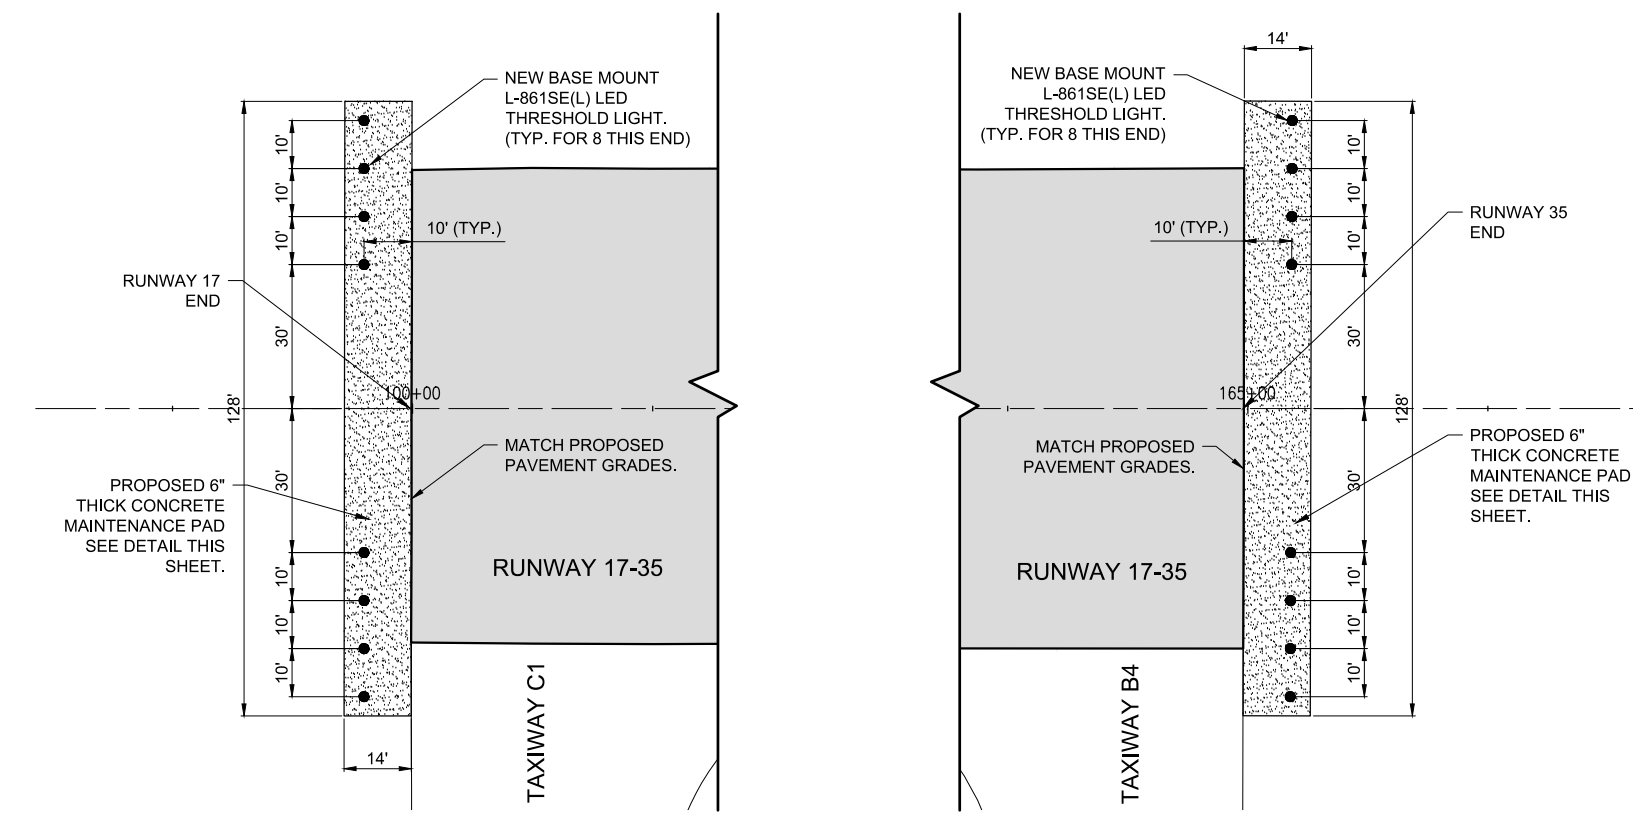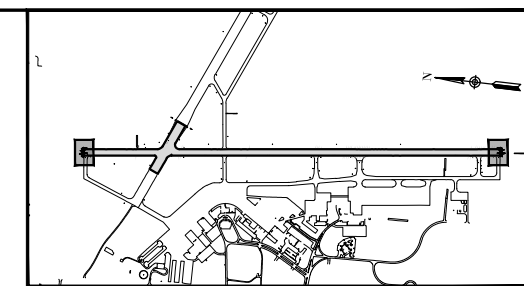


THRESHOLD LIGHT PLAN RUNWAY 17 END  
(NOT TO SCALE)

THRESHOLD LIGHT PLAN RUNWAY 35 END  
(NOT TO SCALE)

NOTE:  
CONTRACTOR SHALL TOOL CONTROL JOINTS IN NEW CONCRETE, 1/4" WIDE, MIN. 1" DEPTH. COORDINATE JOINT SPACING IN FIELD. INCIDENTAL TO MAINTENANCE PAD CONSTRUCTION.

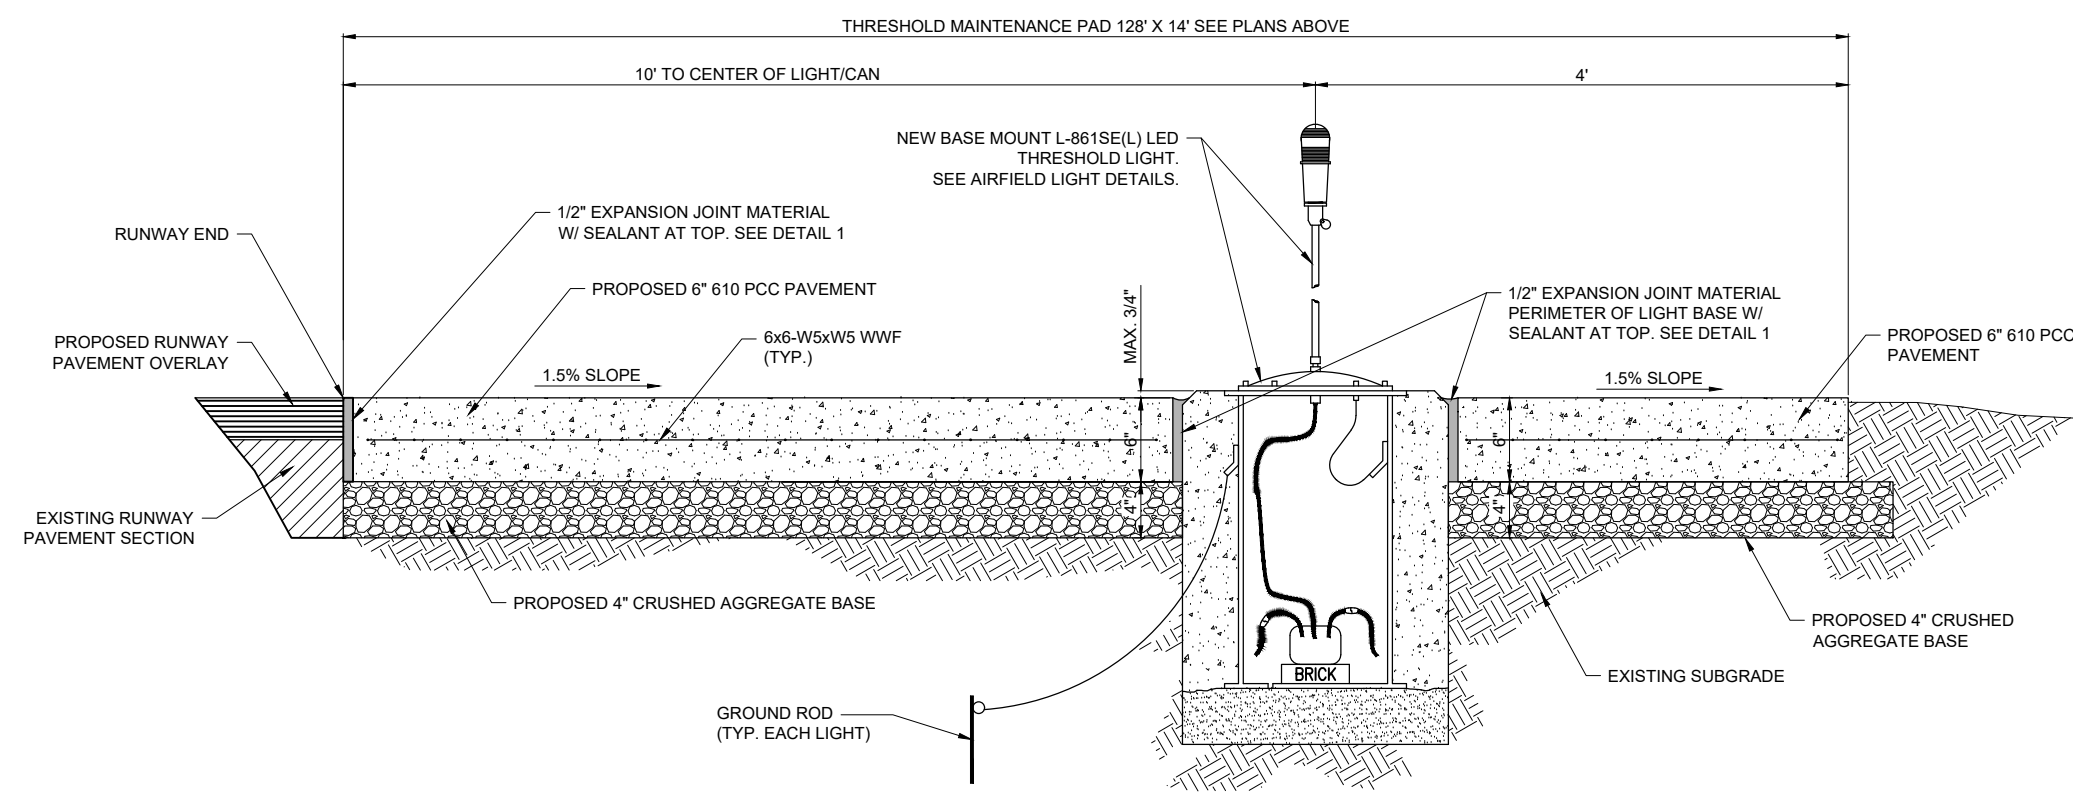

THRESHOLD LIGHTING MAINTENANCE PAD DETAIL  
(NOT TO SCALE)

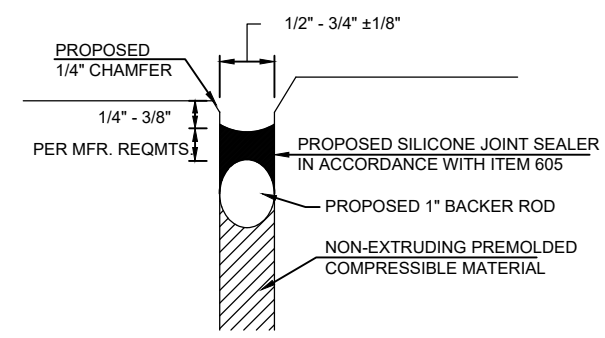

DETAIL 1  
(NOT TO SCALE)

APR 19, 2021 2:44 PM HERND01562 I:\17 JOBS\17A008504\CAD\AIRPORT\THRS\THRS-510-THRS

FOR BID







Engineering | Planning | Allied Services

Hanson Professional Services Inc.
1525 S. 6th Street
Springfield, IL 62703
phone: 217-788-2450
fax: 217-788-2503


Offices Nationwide
www.hanson-inc.com

Illinois Licensed
Professional Service Corporation
#184-001084



ST. LOUIS REGIONAL AIRPORT

8 Terminal Drive
East Alton, Illinois 62024



Kevin N. Lightfoot signature

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE
RUNWAY 17-35
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD
IDA No: ALN-4812

Contract No. SR095

Table with 3 columns: NO., DATE, DESCRIPTION. Includes sub-columns for DES, DWN, REV.

ISSUE: APRIL 16, 2021
PROJECT NO: 17A008504
CAD FILE: E-001-NOTES.DWG
DESIGN BY: KNL 03/18/2021
DRAWN BY: CWS 03/18/2021
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

AIRFIELD LIGHTING
NOTES

AIRFIELD LIGHTING REMOVAL, RELOCATION, AND INSTALLATION NOTES

- 1. KEEP ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS COORDINATED WITH THE AIRPORT DIRECTOR/MANAGER. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
2. EXAMINE THE SITE TO DETERMINE THE EXTENT OF THE WORK. CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS.
3. VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES PRIOR TO REMOVING, DISCONNECTING, RELOCATING, INSTALLING, CONNECTING OR WORKING ON THE RESPECTIVE AIRFIELD LIGHTING, DISTANCE REMAINING SIGN, RUNWAY SIGN, TAXI SIGN, NAVAID, VAULT EQUIPMENT OR OTHER DEVICE.
4. INSTALL AIRFIELD LIGHTING, SIGNS, SPLICE CANS, ELECTRICAL DUCTS, HANDHOLES, MANHOLES, AND CABLE AT THE LOCATIONS SHOWN AND IN COMPLIANCE WITH THE SPECIFICATIONS, SPECIAL PROVISIONS, RESPECTIVE DETAILS, AND MANUFACTURER'S RECOMMENDATIONS.
5. NEW AIRFIELD LIGHTING SYSTEM INSTALLATIONS, ADJUSTMENTS, RELOCATIONS, REINSTALLATIONS, AND/OR UPGRADES SHALL USE BASE (L-867 OR L-868) MOUNTED FIXTURES AND A CLOSED CONDUIT SYSTEM.
6. LIGHTING CABLE FOR AIRFIELD LIGHTING SERIES CIRCUITS SHALL BE 1/C, #8 AWG, FAA L-824, 5000 VOLT, TYPE C UNDERGROUND CABLE IN 2" SCHEDULE 40 PVC OR SCHEDULE 40 HDPE DUCT. CABLE SHALL BE FAA APPROVED.
7. IN AREAS WHERE THERE IS A CONGESTION OF CABLES OR WHERE THE PROPOSED CABLE CROSSES AN EXISTING CABLE, THE CONTRACTOR IS REQUIRED TO HAND DIG THE TRENCH NECESSARY FOR THE PROPOSED CABLE. AT OTHER LOCATIONS, THE PROPOSED CABLE MAY BE TRENCHED OR PLOWED INTO PLACE. HAND DIGGING, TRENCHING AND/OR PLOWING WILL BE CONSIDERED INCIDENTAL TO THE PROPOSED CABLES AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.
8. GROUND ROD MUST BE INSTALLED AT EACH LIGHT FIXTURE AND RUNWAY/TAXI SIGN. THE PURPOSE OF THE LIGHT BASE GROUND IS PROVIDE A DEGREE OF PROTECTION FOR MAINTENANCE PERSONNEL FROM POSSIBLE CONTACT WITH AN ENERGIZED LIGHT BASE OR MOUNTING STAKE THAT MAY RESULT FROM A SHORTED POWER CABLE OR ISOLATION TRANSFORMER. PER NATIONAL ELECTRICAL CODE ARTICLE 250.53 "GROUNDING ELECTRODE SYSTEM INSTALLATION" RESISTANCE FROM THE GROUND ROD/ELECTRODE TO EARTH GROUND MUST BE 25 OHMS OR LESS VIA MEASUREMENT WITH A GROUND TESTER. GROUNDS RODS FOR LIGHT BASE GROUNDS SHALL BE 3/4-INCH BY 10-FOOT MINIMUM LENGTH UL LISTED COPPER-CLAD STEEL SECTIONAL RODS. GROUND RODS SHALL BE PRODUCED FROM 100% DOMESTIC STEEL. EACH GROUND ROD SHALL BE TESTED AND THE RESULTS RECORDED FOR EACH AIRFIELD LIGHT FIXTURE AND RUNWAY/TAXI SIGN INSTALLATION. COPIES OF GROUND SYSTEM TEST RESULTS SHALL BE FURNISHED TO THE PROJECT ENGINEER AND/OR THE RESIDENT ENGINEER/TECHNICIAN.
9. HOMERUN CABLES FOR A RESPECTIVE CIRCUIT THAT ARE INSTALLED IN CONDUIT OR DUCT SHALL BE RUN TOGETHER IN THE SAME RACEWAY OR DUCT.
10. THE CONTRACTOR SHALL TEST THE RESPECTIVE AIRFIELD LIGHTING CIRCUITS IN AREAS OF WORK WHERE RESPECTIVE CIRCUITS MIGHT BE AFFECTED. THE RESPECTIVE RUNWAY AND TAXIWAY LIGHTING CCR'S (FOR THE AREAS OF WORK ON THIS PROJECT) SHALL BE TESTED FOR PROPER OPERATION BEFORE REMOVAL WORK, MODIFICATIONS, AND/OR ADDITIONS AND AFTER THE NEW CABLES AND LIGHTING SYSTEM MODIFICATIONS AND ADDITIONS HAVE BEEN COMPLETED. CONTRACTOR SHALL TEST AND RECORD THE INPUT CURRENT AND OUTPUT CURRENT FOR EACH CONSTANT CURRENT REGULATOR IN THE AUTOMATIC AND MANUAL MODES OF OPERATIONS. CONTRACTOR SHALL REPORT CONCERNS AND/OR DEFICIENCIES TO THE RESIDENT ENGINEER/TECHNICIAN. TEST RESULTS SHALL BE PROVIDED TO THE PROJECT ENGINEER AND RESIDENT ENGINEER/TECHNICIAN.
11. FAA AC 150/5370-106 "STANDARDS FOR SPECIFYING CONSTRUCTION OF AIRPORTS", ITEM L-108 "UNDERGROUND POWER CABLE FOR AIRPORTS", REQUIRES THAT EVERY AIRFIELD LIGHTING CABLE SPLICER SHALL BE QUALIFIED IN MAKING CABLE SPLICES AND TERMINATIONS ON CABLES RATED ABOVE 5,000 VOLTS AC. CABLE SPLICING/TERMINATING PERSONNEL SHALL HAVE A MINIMUM OF THREE (3) YEARS CONTINUOUS EXPERIENCE IN TERMINATING/SPLICING MEDIUM VOLTAGE CABLE.
12. OTHER CONSTRUCTION PROJECTS MIGHT BE IN PROGRESS AT THE AIRPORT AT THE SAME TIME AS THIS PROJECT. THE CONTRACTOR WILL BE REQUIRED TO COOPERATE WITH ALL OTHER CONTRACTORS AND THE AIRPORT MANAGER IN THE COORDINATION OF THE WORK.
13. OBTAIN APPROVAL FROM THE AIRPORT MANAGER PRIOR TO SHUTTING DOWN A RUNWAY OR TAXIWAY. WHEN A RESPECTIVE RUNWAY IS CLOSED THE RESPECTIVE RUNWAY LIGHTING AND NAVAIDS FOR THAT RUNWAY SHALL BE SHUT OFF. WHEN A RESPECTIVE TAXIWAY IS CLOSED THE RESPECTIVE TAXIWAY LIGHTING FOR THAT TAXIWAY SHALL BE SHUT OFF.
14. THE CONTRACTOR IS REQUIRED TO FILL IN ALL HOLES AND DEPRESSIONS RESULTING FROM THE NEW WORK, WITH EARTH MATERIAL. THE AREAS SHALL BE COMPACTED TO PREVENT FUTURE SETTLEMENT AND FERTILIZED, SEEDED, AND MULCHED IN ACCORDANCE WITH ITEMS 901 AND 908 RESPECTIVELY.
15. IN THE EVENT A CONFLICT IS DETERMINED WITH RESPECT TO MANUFACTURER INSTALLATION INSTRUCTIONS, NEC, AND/OR THE CONTRACT DOCUMENTS, CONTACT THE PROJECT ENGINEER FOR FURTHER DIRECTION.
16. SEE SAFETY PLAN AND NOTES FOR SAFETY AND CONSTRUCTION COORDINATION REQUIREMENTS.
17. EXISTING AIRFIELD LIGHTS DESIGNATED FOR REMOVAL SHALL BE CAREFULLY REMOVED IN THERE ENTIRETY. THE CONTRACTOR SHALL DISCONNECT AND REMOVE THE EXISTING LIGHTS, AS NOT TO DAMAGE THEM, INCLUDING MOUNTING STAKES, BASES, FOUNDATIONS AND TRANSFORMERS. THE EXISTING AIRFIELD LIGHTS, TRANSFORMERS, LIGHT BASES, COVERS AND MOUNTING STAKES SHALL BE TURNED OVER TO THE AIRPORT. LIGHT BASES SHALL BE REMOVED AND DISPOSED OF OFF SITE. ANY MATERIAL NOT SALVAGED BY THE AIRPORT SHALL BE DISPOSED OF OFF THE AIRPORT SITE, IN A LEGAL MANNER, AT THE CONTRACTOR'S OWN EXPENSE. EXISTING DUCTS AND CABLES ASSOCIATED WITH AIRFIELD LIGHTING REMOVALS, RELOCATIONS, REPLACEMENTS AND/OR CABLE OR DUCT REPLACEMENTS SHALL BE REMOVED AND DISPOSED OF OFF SITE AT NO ADDITIONAL COST TO THE CONTRACT. PROVIDE TEMPORARY CABLES AND DUCTS TO ACCOMMODATE AIRFIELD LIGHTING CIRCUITS THAT ARE TO REMAIN ACTIVE DURING CONSTRUCTION. CONTRACTOR MAY REMOVE ABANDONED CABLES AT NO ADDITIONAL COST TO THE CONTRACT AND SHALL HAVE THE SALVAGE RIGHTS TO ABANDONED CABLES. REMOVAL OF EXISTING AIRFIELD LIGHTING WILL BE PAID FOR UNDER ITEM AR800476 REMOVE AIRFIELD LIGHTING PER LUMP SUM.
18. OWNER SHALL BE KEPT INFORMED OF WORK AND SCHEDULES.
19. ROUTE NEW CABLES AND DUCTS TO AVOID INTERFERENCES WITH OTHER UTILITIES, LINES, CABLES AND STRUCTURES.
20. ALL ELECTRICAL EQUIPMENT (INCLUDING AIRFIELD LIGHTING AND NAVAIDS) AND MATERIALS SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 - NATIONAL ELECTRIC CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS, AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, INTERNEK TESTING SERVICES VERIFICATION/ETL LISTING (OR OTHER THIRD PARTY LISTING) AND/OR MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
21. CONTRACTOR SHALL COMPLY WITH THE REQUIREMENTS OF FAA AC NO. 150/5370-26 (OR MOST CURRENT ISSUE) "OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION".
22. CONTRACTOR SHALL COMPLY WITH THE APPLICABLE REQUIREMENTS OF NFPA 70E - STANDARD FOR ELECTRICAL SAFETY IN THE WORKPLACE.
23. RUNWAY AND TAXIWAY LIGHTING CIRCUITS SHALL BE ACTIVE AT THE END OF EACH CONSTRUCTION DAY FOR AN OPEN RUNWAY OR AN OPEN TAXIWAY. THE CONTRACTOR SHALL PROVIDE TEMPORARY CABLE & CONNECTIONS WHERE NECESSARY TO MAINTAIN A RUNWAY OR TAXIWAY LIGHTING SYSTEM. TEMPORARY CABLE FOR AIRFIELD LIGHTING SERIES CIRCUITS SHALL BE 1/C #8 FAA L-824 5KV UG CABLE IN DUCT OR UNIT DUCT.
24. ALL ABOVEGROUND JUMPERS SHALL BE IN A DUCT WITH ALL CONNECTIONS SEALED. THE CONTRACTOR SHALL SECURE, IDENTIFY AND PLACE ALL TEMPORARY EXPOSED WIRING IN CONDUIT, DUCT, OR UNIT DUCT TO PREVENT ELECTROCUTION AND FIRE IGNITION SOURCES AS PER THE REQUIREMENTS OF FAA 150/5370-26, OPERATION SAFETY ON AIRPORTS DURING CONSTRUCTION, SECTION 2.18.3 "LIGHTING AND VISUAL NAVAIDS". ALL LABOR, MATERIALS, AND TIME NECESSARY TO COMPLY WITH THIS REQUIREMENT SHALL BE CONSIDERED INCIDENTAL TO THE CONTRACT AND NO ADDITIONAL COMPENSATION WILL BE ALLOWED.
25. CONTRACTOR SHALL INTERFACE EXISTING AIRFIELD LIGHTING AND/OR SIGNS TO THE NEW, REMOVED, REINSTALLED, ADJUSTED, REPLACED, AND/OR RELOCATED AIRFIELD LIGHTING AND ASSOCIATED CIRCUITS.
26. ALL AIRFIELD LIGHT FIXTURES SHALL BE TAGGED BY THE CONTRACTOR IN ACCORDANCE WITH THE RESPECTIVE LIGHT FIXTURE NUMBERS. CONFIRM LIGHT FIXTURE NUMBERING WITH THE AIRPORT MANAGER/MAINTENANCE SUPERVISOR.
27. HIGH VOLTAGE CIRCUITS (AIRFIELD LIGHTING 5000 VOLT SERIES CIRCUITS AND OTHER CIRCUITS RATED ABOVE 600 VOLTS) AND LOW VOLTAGE CIRCUITS (RATED 600 VOLTS AND BELOW) SHALL NOT BE INSTALLED IN THE SAME WIREWAY, CONDUIT, DUCT, RACEWAY, JUNCTION STRUCTURE, OR HANDHOLE.
28. THE CONTRACTOR IS REQUIRED TO RESTORE ALL DISTURBED PAVEMENT ASSOCIATED WITH REMOVAL WORK AND/OR NEW AIRFIELD LIGHTING INSTALLATIONS.
29. NO CONNECTION TO AN ACTIVE LIGHTING CIRCUIT WILL BE BROKEN UNTIL THE CIRCUIT HAS BEEN TURNED OFF IN ACCORDANCE WITH NOTE 1.

THE LOCATION, SIZE, AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS ARE NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATSOEVER IN RESPECT TO THE ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE, EITHER EXPRESSED OR IMPLIED, THAT THE LOCATIONS, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER/TECHNICIAN SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT JULIE (JOINT UTILITY LOCATION INFORMATION FOR EXCAVATORS) FOR UTILITY INFORMATION, PHONE: 1-800-892-0123. CONTACT THE FAA (FEDERAL AVIATION ADMINISTRATION) FOR ASSISTANCE IN LOCATING FAA CABLES AND UTILITIES. LOCATION OF FAA POWER, CONTROL, AND COMMUNICATION CABLES SHALL BE COORDINATED WITH AND/OR LOCATED BY THE FAA. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVEGROUND UTILITIES.

APR 19, 2021 2:45 PM HERNDD01562
I:\17 JOBS\17A008504\CAD\AIRPORT\T\SHEETE-001-NOTES

FOR BID



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-501-DETL.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE


**AIRFIELD LIGHT  
DETAILS**

**FOR BID**

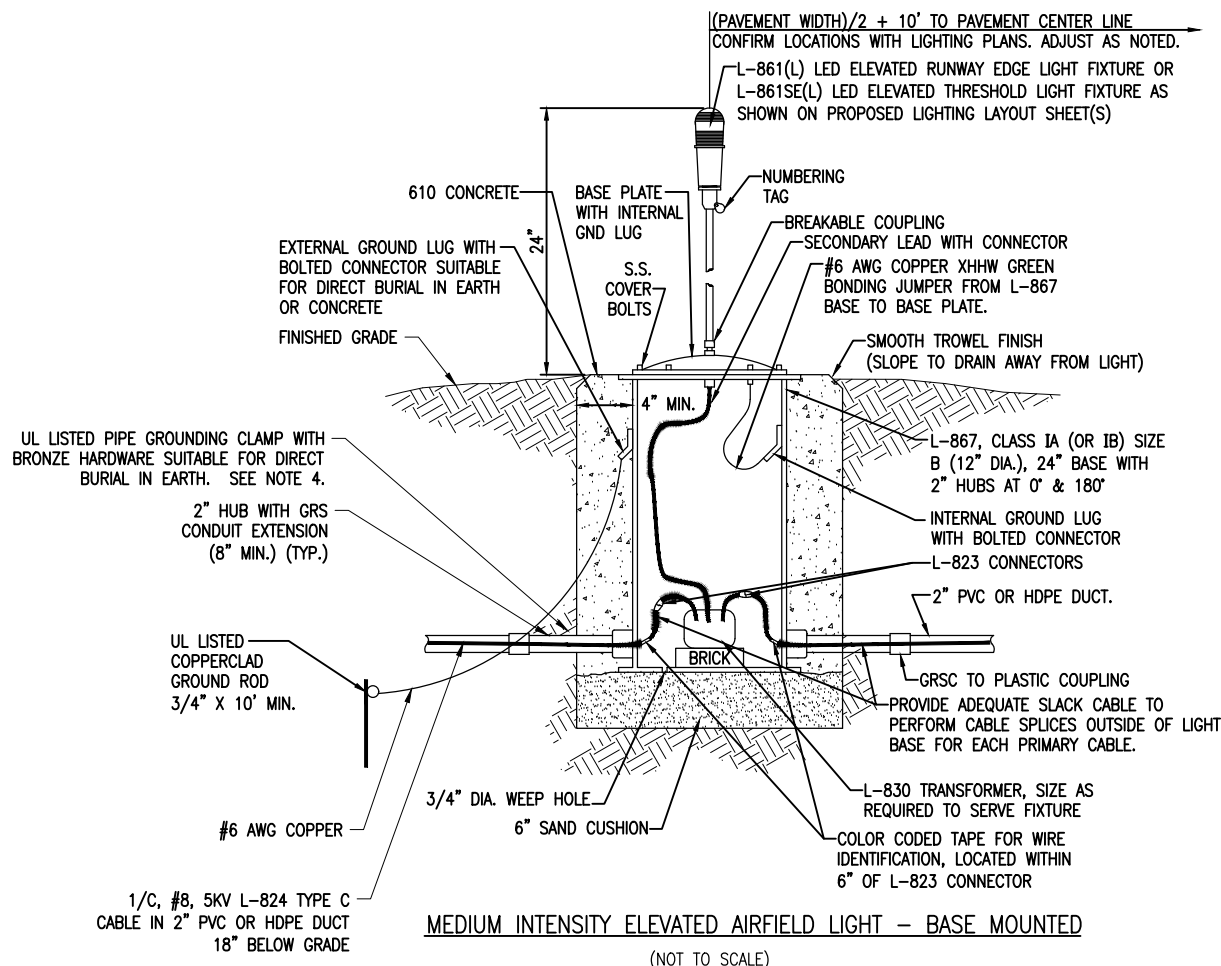


**MEDIUM INTENSITY ELEVATED AIRFIELD LIGHT – BASE MOUNTED**

(NOT TO SCALE)



**NUMBERING TAG DETAIL**

(NOT TO SCALE)

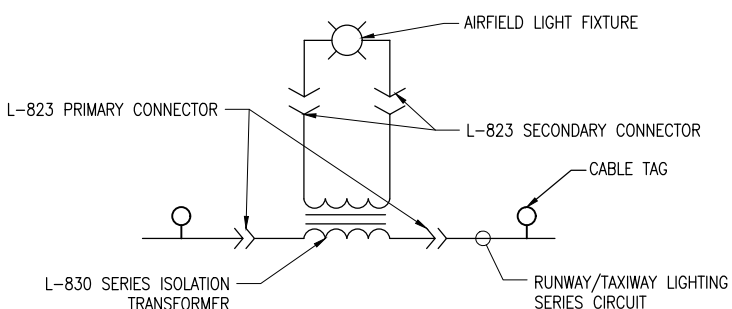

**LIGHTING CONNECTION SCHEMATIC**

NOT TO SCALE

**NOTES:**

- SEE ELECTRICAL NOTES SHEETS.
- SEE "ELECTRICAL NOTES SHEET 2" AND "GROUNDING NOTES" SHEET FOR GROUNDING NOTES FOR AIRFIELD LIGHTING.
- SEE PROPOSED LIGHTING LAYOUT SHEET(S) FOR LIGHT LOCATIONS
- WHERE GROUND LUGS ARE NOT ACCESSIBLE ON BASE CANS, PROVIDE A UL LISTED PIPE GROUND CLAMP RATED FOR DIRECT BURIAL IN EARTH AND BOND TO THE METAL CONDUIT EXTENSION TO PROVIDE GROUND PATH TO LIGHT BASE.
- THE PROPOSED AIRFIELD LIGHT FIXTURES SHALL CONFORM TO ADVISORY CIRCULAR 150/5345-46 (CURRENT ISSUE(S) IN EFFECT) AND BE FAA APPROVED FOR TYPE L-861(L) FOR RUNWAY EDGE LIGHTS AND L-861SE(L) FOR THRESHOLD LIGHTS. AIRFIELD LIGHT FIXTURES SHALL HAVE LED (LIGHT EMITTING DIODE) ILLUMINATION AND SHALL CONFORM TO THE APPLICABLE REQUIREMENTS OF FAA ENGINEERING BRIEF NO. 67D LIGHT SOURCES OTHER THAN INCANDESCENT AND XENON FOR AIRPORT AND OBSTRUCTION LIGHTING FIXTURES.
- LIGHT BASE CANS FOR THE AIRFIELD LIGHT FIXTURES SHALL CONFORM TO THE REQUIREMENTS OF FAA AC 150/5345-42 (CURRENT ISSUE IN EFFECT), FOR TYPE L-867, CLASS IA, SIZE B (12 IN. NOMINAL DIAMETER), AND 24 IN. DEEP AND/OR AS DETAILED ON THE PLANS. EACH LIGHT BASE CAN SHALL INCLUDE INTERNAL AND EXTERNAL GROUND LUGS TO ACCOMMODATE THE RESPECTIVE APPLICATIONS. LIGHT BASE PLATES SHALL BE SIZED AND COMPATIBLE WITH THE RESPECTIVE LIGHT BASES AND LIGHT FIXTURES WITH STAINLESS STEEL BOLTS.
- PRIOR TO INSTALLING THE AIRFIELD LIGHT FIXTURES, APPLY AN OXIDE-INHIBITING, ANTI-SEIZING COMPOUND TO ALL SCREWS, NUTS, BREAKABLE COUPLING, AND ALL PLACES WHERE METAL COMES INTO CONTACT WITH METAL.
- SERIES CIRCUIT ISOLATION TRANSFORMERS FOR THE AIRFIELD LIGHTING SHALL BE MANUFACTURED TO FAA SPECIFICATION AC 150/5345-47, (CURRENT EDITION IN EFFECT), AND SHALL BE FAA-APPROVED (ETL/INTERTEK TESTING SERVICES-CERTIFIED). SERIES CIRCUIT TRANSFORMER SHALL BE PROPERLY SIZED FOR THE RESPECTIVE AIRFIELD LIGHTING DEVICE, AND SHALL BE AS RECOMMENDED BY THE RESPECTIVE EQUIPMENT MANUFACTURER. CONFIRM PROPER TRANSFORMER SELECTION AND SIZING WITH THE RESPECTIVE EQUIPMENT MANUFACTURER.
- THE CONCRETE USED IN THE CONSTRUCTION OF THE BASES FOR THE AIRFIELD LIGHTING AND SPLICE CANS SHALL BE IN ACCORDANCE WITH ITEM 610 CONCRETE FOR MISCELLANEOUS STRUCTURES.
- IDENTIFICATION TAGS SHALL BE ATTACHED TO EACH AIRFIELD LIGHT FIXTURE.
- PER ILLINOIS STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS ITEM 108, ITEM 125, AND FAA AC 150/5370-10H ITEM L-108 AND L-125, RUBBER AND PLASTIC ELECTRICAL TAPES SHALL BE SCOTCH ELECTRICAL TAPE NUMBERS 130C LINERLESS RUBBER SPLICING TAPE (2" WIDE) AND 88 (1.5" WIDE) RESPECTIVELY, AS MANUFACTURED THE MINNESOTA MINING AND MANUFACTURING COMPANY, OR EQUIVALENT.

A LIGHT BASE GROUND SHALL BE INSTALLED AT EACH STAKE MOUNTED LIGHT AND EACH TRANSFORMER BASE/LIGHT CAN ASSOCIATED WITH RUNWAY LIGHTS, TAXIWAY LIGHTS, RUNWAY DISTANCE REMAINING SIGNS, AND LIGHTED RUNWAY/TAXI GUIDANCE SIGNS. THE LIGHT BASE GROUND SHALL BE A #6 AWG BARE COPPER CONDUCTOR CONNECTED TO THE GROUND LUG ON THE RESPECTIVE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE AND A 3/4-INCH DIAMETER BY 10-FOOT LONG (MINIMUM) UL LISTED COPPER CLAD GROUND ROD.





*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: E-509-DETL.DWG  
 DESIGN BY: KNL 03/18/2021  
 DRAWN BY: CWS 03/18/2021  
 REVIEWED BY: KNL 03/18/2021

SHEET TITLE


IN-PAVEMENT  
 RUNWAY LIGHT AND  
 SPLICE CAN DETAILS

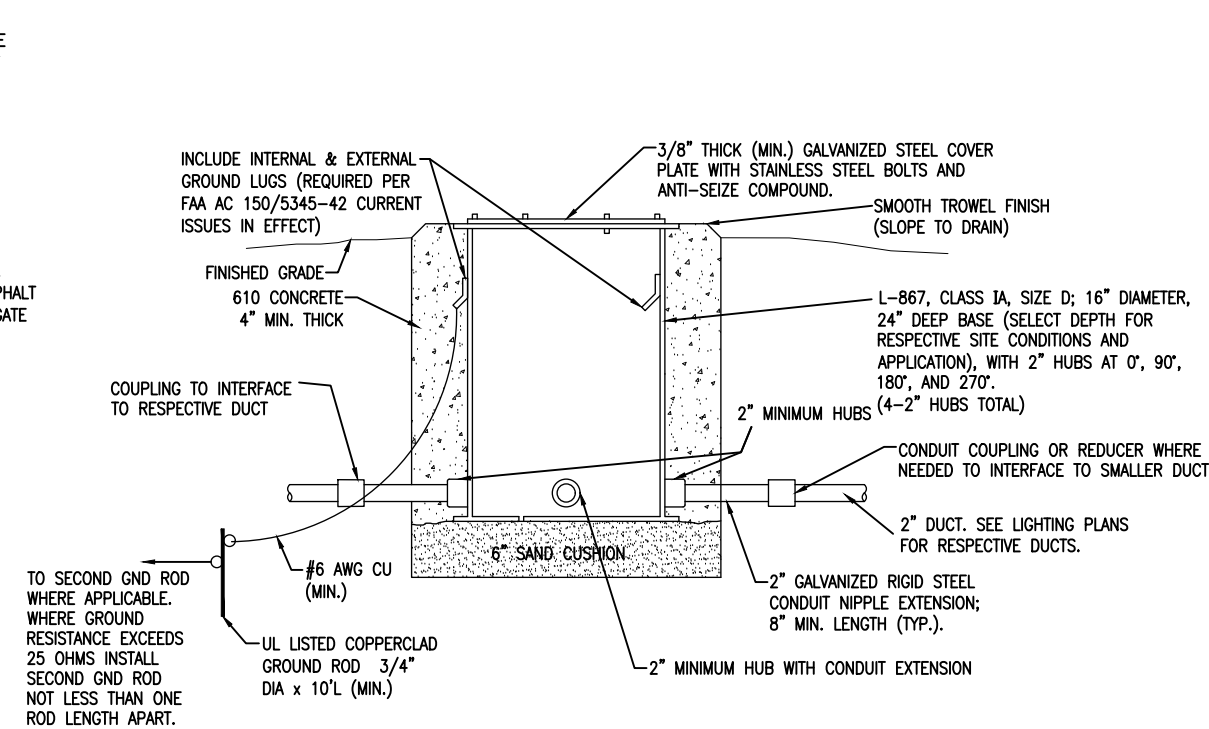

SPLICE CAN/JUNCTION CAN DETAIL  
 "NOT TO SCALE"

NOTES FOR SPLICE CAN/JUNCTION CAN DETAIL:

- SPLICE CANS SHALL CONFORM TO THE REQUIREMENTS OF FAA AC 150/5345-42 (CURRENT ISSUES IN EFFECT), FOR TYPE L-867, CLASS IA, SIZE D, (16 IN. NOMINAL DIAMETER), AND 24 IN. DEEP AND/OR AS DETAILED ON THE PLANS. EACH SPLICE CAN SHALL INCLUDE INTERNAL AND EXTERNAL GROUND LUGS TO ACCOMMODATE THE RESPECTIVE APPLICATIONS. SPLICE CANS AND/OR JUNCTION CANS SHALL HAVE GALVANIZED STEEL COVERS, 3/8-INCH THICK (MINIMUM), WITH STAINLESS STEEL BOLTS.
- FOR THE PURPOSE OF ENHANCING SAFETY, EACH BASE MUST HAVE INSTALLED, BY THE MANUFACTURER, AN INTERNAL AND EXTERNAL GROUND STRAP THAT IS AVAILABLE FOR THE PURPOSE OF ATTACHING A GROUND LUG THAT IS CONNECTED TO AN EARTH GROUND OR A SAFETY GROUND CONDUCTOR INSTALLED WITH THE RESPECTIVE CIRCUIT. FOR AIRPORT PROJECTS RECEIVING FEDERAL FUNDS THIS REQUIREMENT IS MANDATORY PER FAA AC 150/5345-42 (CURRENT ISSUES IN EFFECT).
- APPLY AN OXIDE-INHIBITING, ANTI-SEIZING COMPOUND TO ALL SCREWS, NUTS, AND ALL PLACES WHERE METAL COMES INTO CONTACT WITH METAL.
- THE CONCRETE USED IN THE CONSTRUCTION OF THE BASES FOR THE AIRFIELD LIGHTING CANS SHALL BE IN ACCORDANCE WITH ITEM 610 STRUCTURAL PORTLAND CEMENT CONCRETE.
- LIDS FOR THE SPLICE CANS CONTAINING HIGH VOLTAGE AIRFIELD LIGHTING CABLES SHALL INCLUDE MINIMUM 1/2-INCH HIGH LETTERING LABELED "DANGER HIGH VOLTAGE KEEP OUT" TO COMPLY WITH NEC ARTICLE 300.45 "WARNING SIGNS" AND NEC ARTICLE 314.71(E) "SUITABLE COVERS". THIS WILL NEED TO BE COORDINATED WITH THE SPLICE CAN MANUFACTURER.
- LIDS FOR THE SPLICE CANS CONTAINING LOW VOLTAGE CABLES (RATED 600 VOLTS AND BELOW) WILL BE ACCEPTABLE TO USE BLANK COVERS.

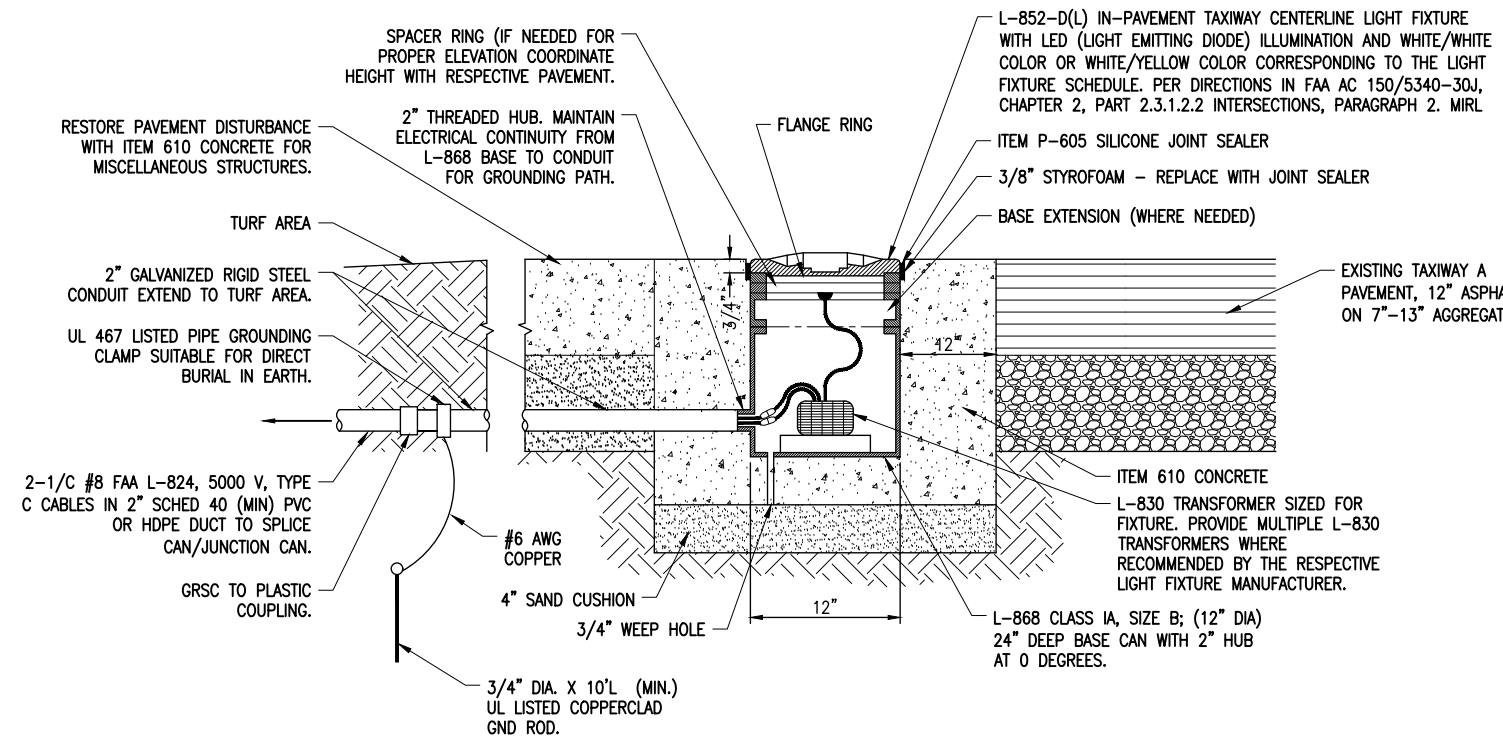


IN-PAVEMENT RUNWAY LIGHT  
 "NOT TO SCALE"

NOTES:

- MEDIUM INTENSITY IN-PAVEMENT RUNWAY LIGHT SHALL BE AN L-852D(L) LED IN-PAVEMENT TAXIWAY CENTERLINE LIGHT WITH WHITE/WHITE COLOR OR WHITE/YELLOW COLOR CORRESPONDING TO THE LIGHT FIXTURE SCHEDULE. FAA AC 150/5340-30J, CHAPTER 2 RUNWAY AND TAXIWAY EDGE LIGHTING SYSTEMS, PART 2.3.1.2.2 INTERSECTIONS, PARAGRAPH 2 MIRL NOTES THE FOLLOWING: IF THE DISTANCE BETWEEN THE RUNWAY EDGE LIGHTS UNITS IS GREATER THAN 400 FT, INSTALL AN L-852D, TAXIWAY CENTERLINE LIGHT FIXTURE (PER AC 150/5345-46, SPECIFICATION FOR RUNWAY AND TAXIWAY LIGHT FIXTURES), MODIFIED TO PRODUCE WHITE LIGHT (BY REMOVING THE FILTERS IF AN INCANDESCENT LAMP IS USED) OR WHITE/YELLOW, AND MAINTAIN THE DESIGNED SPACING PER PER FIGURE A-3.
- SAW CUT AND REMOVE PAVEMENT FROM EDGE CLOSEST TO RESPECTIVE IN-PAVEMENT LIGHT FIXTURE TO ACCOMMODATE INSTALLATION. RESTORE PAVEMENT AND AREA AROUND IN-PAVEMENT LIGHT FIXTURE WITH ITEM 610 CONCRETE FOR MISCELLANEOUS STRUCTURES. SURROUNDING CONCRETE PAVEMENT DEPTH AND AGGREGATE BASE DEPTH SHALL MATCH EXISTING.
- IN-PAVEMENT RUNWAY LIGHT WILL BE PAID FOR UNDER ITEM AR125512 MIRL, INPAVEMENT PER EACH.

FOR BID



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-502-DET.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE



RUNWAY DISTANCE  
REMAINING SIGN  
DETAILS

**FOR BID**

SIGN DESIGNATION	SIDE A	SIDE B
R2-DRS1	1	5
R2-DRS2	2	4
R2-DRS3	3	3
R2-DRS4	4	2
R2-DRS5	5	1



**DISTANCE REMAINING SIGN NOTES**

1. THE PROPOSED RUNWAY DISTANCE REMAINING SIGNS SHALL CONFORM TO ADVISORY CIRCULAR 150/5345-44H (OR LATEST ISSUE IN FORCE) AND BE FAA APPROVED FOR TYPE L-858-B(L) LIGHT EMITTING DIODE RUNWAY DISTANCE REMAINING SIGN. THE SIGN SHALL BE SIZE 4, 48-IN. SIGN FACE WITH A 40-IN. LEGEND; STYLE 2, POWERED FROM A 4.8 TO 6.6 AMP SERIES LIGHTING CIRCUIT; CLASS 2, FOR OPERATION FROM -40°F TO 131°F; MODE 2, TO WITHSTAND WIND LOADS OF 200 M.P.H., BASE-MOUNTED, DOUBLE-SIDED, AS SPECIFIED ON THE PLANS.
2. ALL SIGNS SHALL BE FURNISHED WITH TETHERS. TETHERS SHALL BE 3/16" STAINLESS STEEL AIRCRAFT CABLE WITH A FORMED EYE ON BOTH ENDS. THE TETHER EYE SHALL BE ATTACHED TO THE SIGN AND BASE BY BEING SANDWICHED BETWEEN TWO STAINLESS STEEL FENDER WASHERS, WITH A 1/2" MINIMUM STAINLESS STEEL BOLT. THE TETHER SHALL BE OF SUFFICIENT LENGTH TO HAVE A MINIMUM OF 6" OF SLACK WHEN ATTACHED BETWEEN THE SIGN AND THE SIGN BASE. THE TETHERS AND BONDING CONDUCTORS SHALL BE OF SUFFICIENT LENGTH TO ALLOW THE FRANGIBLE COUPLINGS TO OPERATE WITHOUT RESTRICTIONS AND TO ALLOW THE POWER CABLE TO DISCONNECT IF THE SIGN FALLS OVER. PROVIDE 3" ± 1/2" SLACK IN TETHER AND ALL TETHERS SHALL BE THE SAME LENGTH.
3. DISTANCE REMAINING SIGNS SHALL BE CONNECTED TO THE RESPECTIVE RUNWAY LIGHTING SERIES CIRCUIT SO THE SIGNS WILL BE ILLUMINATED WHEN THE RUNWAY EDGE LIGHTS ARE ILLUMINATED TO COMPLY WITH FAA AC 150/5340-18G, CHAPTER 2, PART 2.4 "SIGN OPERATION".

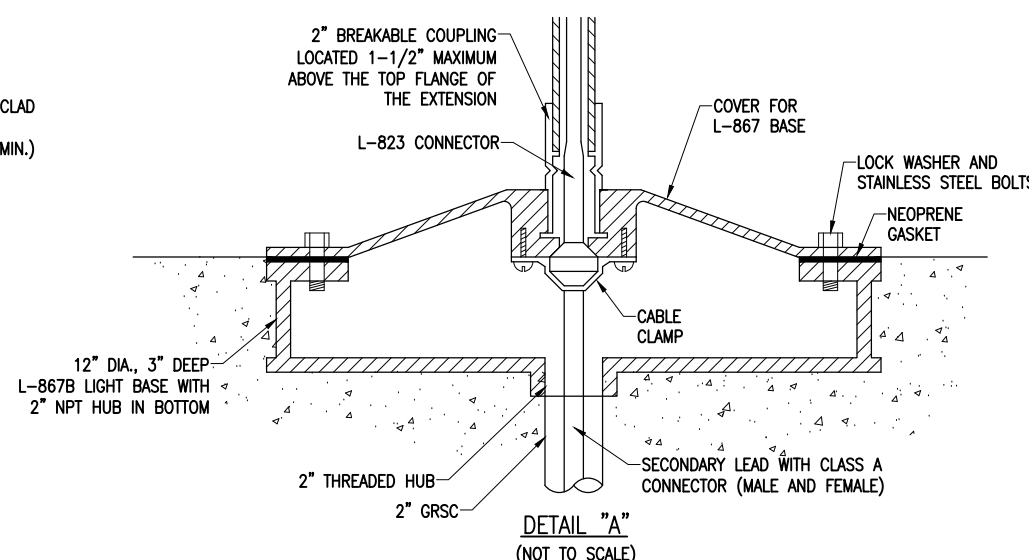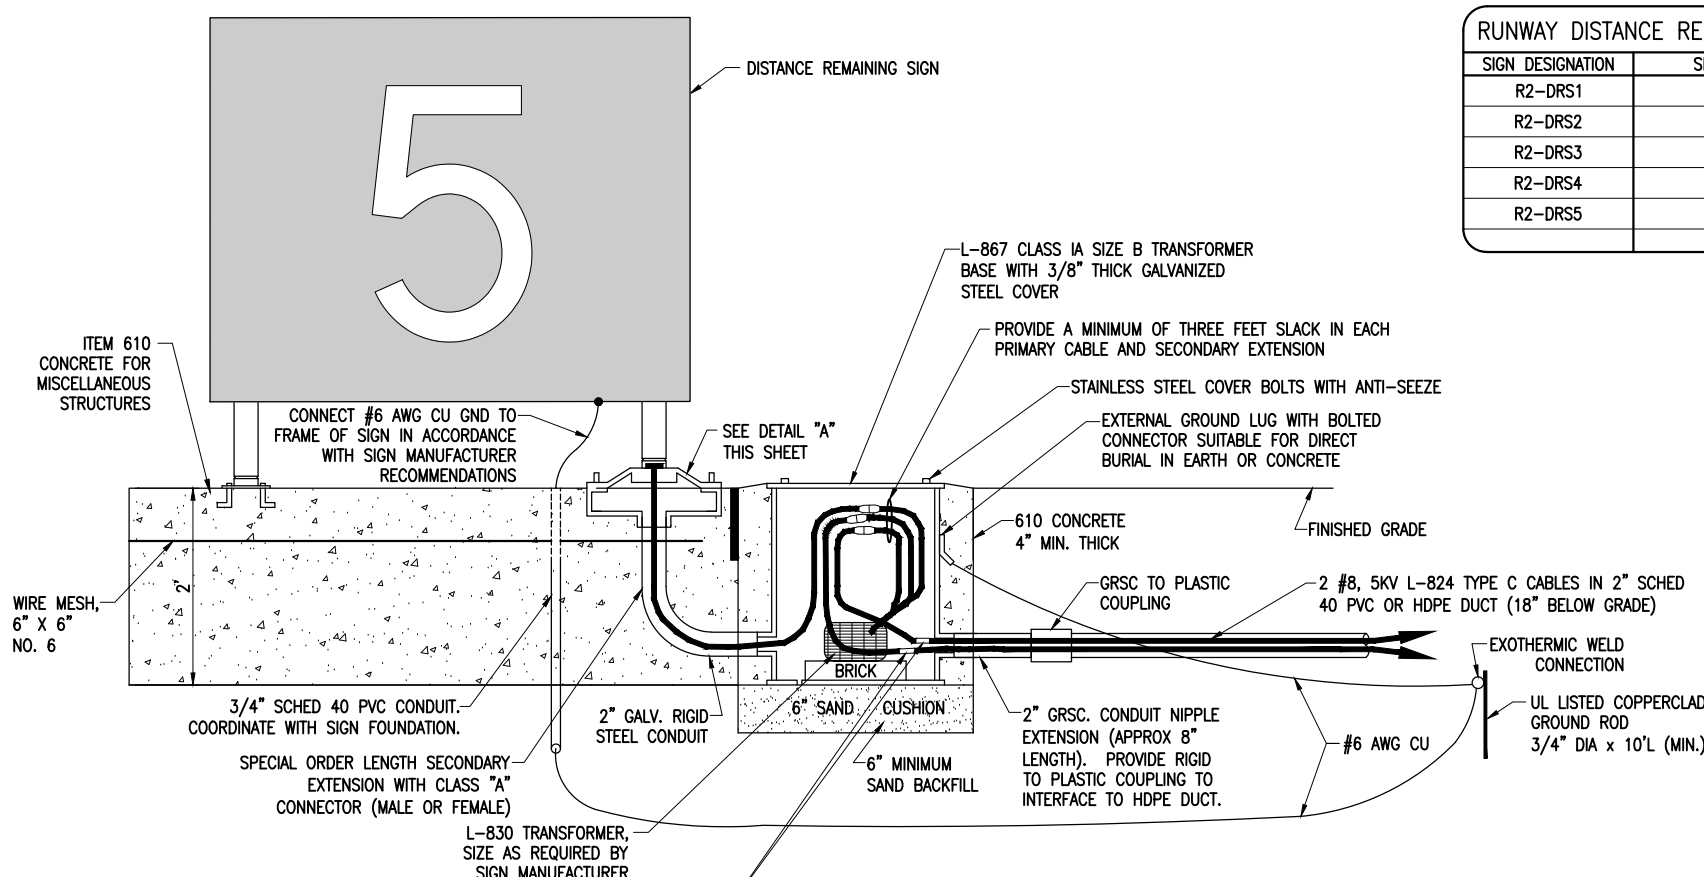

A LIGHT BASE GROUND MUST BE INSTALLED AT EACH LIGHT FIXTURE. A LIGHT BASE GROUND SHALL BE INSTALLED AT EACH STAKE MOUNTED LIGHT AND EACH TRANSFORMER BASE/LIGHT CAN ASSOCIATED WITH RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED AIRFIELD GUIDANCE SIGNS. THE LIGHT BASE GROUND SHALL BE A #6 AWG BARE COPPER CONDUCTOR CONNECTED TO THE GROUND LUG ON THE RESPECTIVE L-867 TRANSFORMER BASE/LIGHT CAN, SIGN FRAME, OR MOUNTING STAKE AND A 3/4-INCH DIAMETER BY 10-FOOT LONG (MINIMUM) UL LISTED COPPER CLAD GROUND ROD.

- NOTES:**
1. DETAILS SHOWN ON THIS SHEET APPLY TO NEW DISTANCE REMAINING SIGNS AND/OR RELOCATED DISTANCE REMAINING SIGNS.
  2. RUNWAY 17-35 SERIES CIRCUIT CABLES SHALL BE #8 AWG.
  3. INCLUDE TETHERS FOR EACH SIGN.

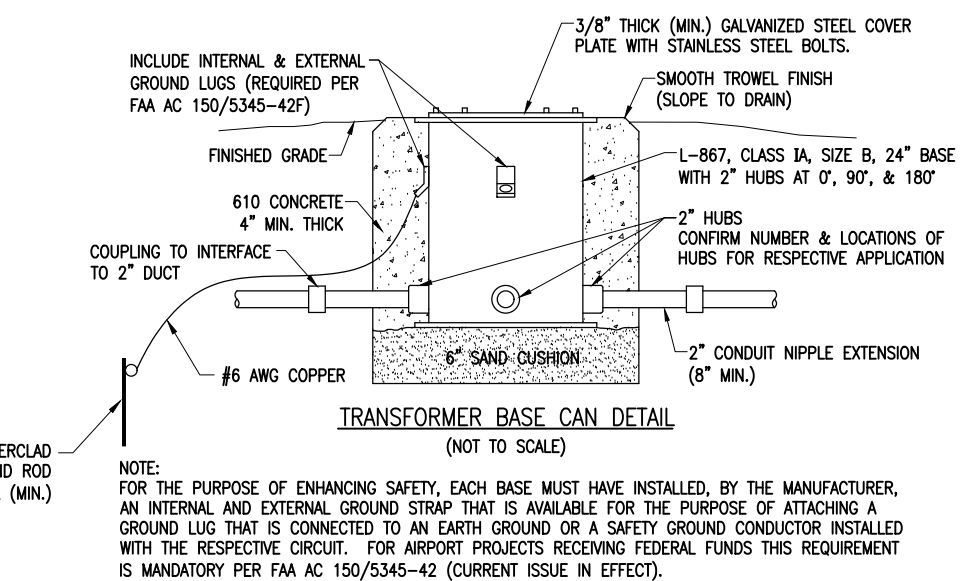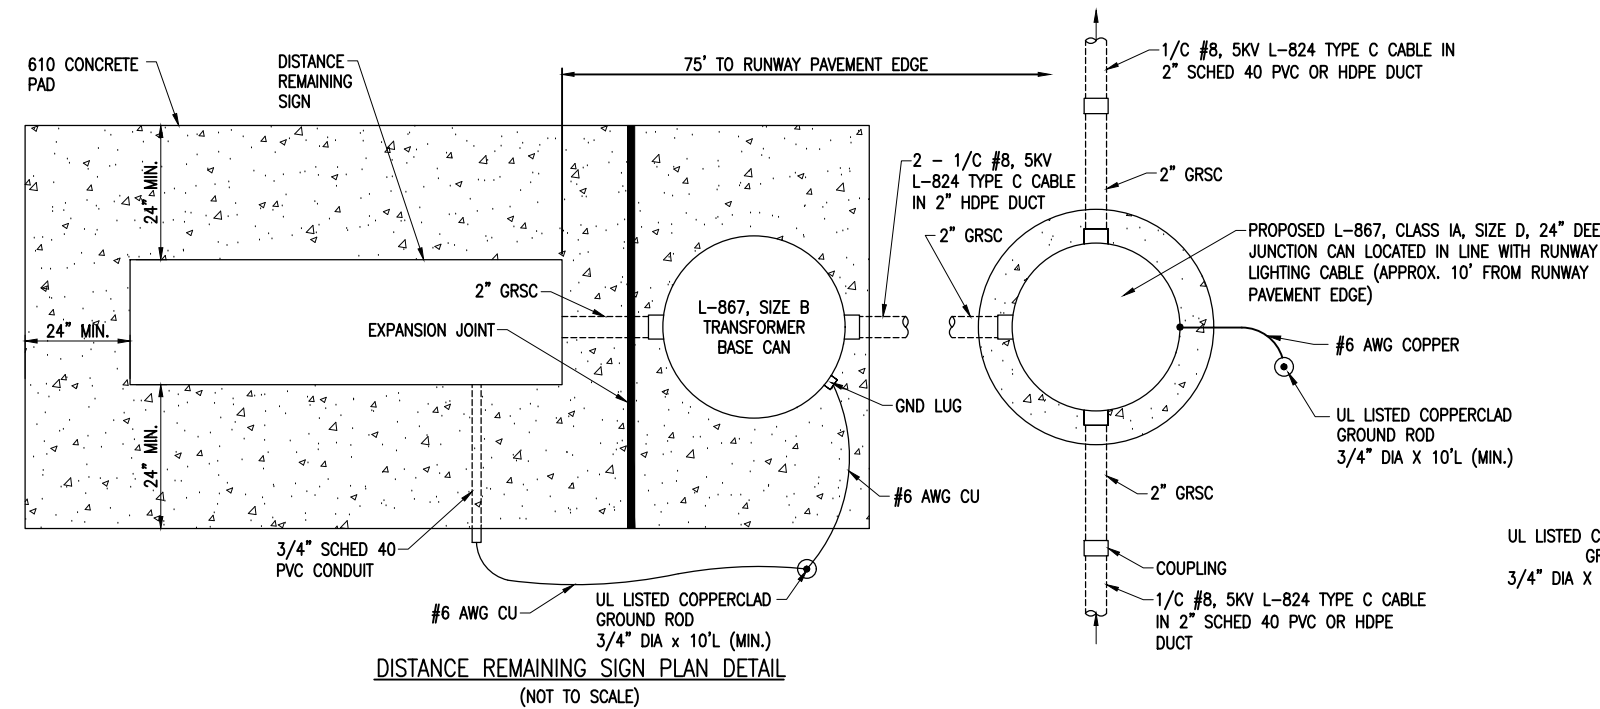



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-504-DETL.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE


**AIRFIELD LIGHTING  
CABLE SPLICE  
DETAILS**

**NOTES:**


1. SPLICE DETAILS ARE PROVIDED FOR NEW WORK AND TO ASSIST IN REPAIRS OF ACCIDENTAL OR UNEXPECTED INTERRUPTIONS AND/OR CUTS TO AIRFIELD LIGHTING CABLES.
2. KEEP ON HAND A MINIMUM OF 10 SETS OF SPLICE KITS FOR L-823 CONNECTORS AND A MINIMUM OF 10 SETS OF TYPE A LOW VOLTAGE SPLICE KITS TO ACCOMMODATE REPAIRS.
3. EVERY AIRFIELD LIGHTING CABLE SPICER SHALL BE QUALIFIED IN MAKING CABLE SPLICES AND TERMINATIONS ON CABLES RATED AT AND/OR ABOVE 5,000 VOLTS AC TO COMPLY WITH THE REQUIREMENTS OF FAA AC 150/5370-10G ITEM L-108.
4. INSIDE DIAMETER OF RESPECTIVE CABLE CONNECTOR SHALL PROPERLY MATCH OUTSIDE DIAMETER OF CABLE.
5. WHEN PREPARING CABLE FOR SPLICES, THE CONTRACTOR SHALL USE A CABLE STRIPPER/PENCILLER WHENEVER CABLE CONNECTIONS ARE MADE.
6. WRAP ALL PRIMARY AND SECONDARY POWER CONNECTIONS WITH SUFFICIENT LAYERS OF HIGH VOLTAGE ELECTRICAL INSULATING TAPE (RUBBER SPLICING TAPE SUITABLE FOR PRIMARY ELECTRICAL INSULATION FOR SPLICING CABLE FROM 600 VOLTS TO 69,000 VOLTS) AND COVER WITH VINYL ELECTRICAL TAPE (ALL-WEATHER VINYL INSULATING TAPE SUITABLE FOR PROTECTIVE JACKETING FOR HIGH-VOLTAGE CABLE SPLICES AND REPAIRS) FOR FULL VALUE OF CABLE INSULATION VOLTAGE. PER ILLINOIS STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AIRPORTS ITEM 108, ITEM 125, AND FAA AC 150/5370-10H ITEM L-108 AND L-125, HIGH VOLTAGE ELECTRICAL INSULATING TAPE SHALL BE 3M SCOTCH 130C LINERLESS RUBBER SPLICING TAPE (2 INCHES WIDE) OR APPROVED EQUIVALENT, AND VINYL ELECTRICAL TAPE SHALL BE 3M SCOTCH 88 (1.5 INCHES WIDE) OR APPROVED EQUIVALENT. TAPES MUST BE RATED SUITABLE FOR THE APPLICATION.
7. PROVIDE CABLE TAGS TO IDENTIFY THE RESPECTIVE CIRCUITS ALL POINTS OF ACCESS INCLUDING L-867 BASES, L-868 BASES, HANDHOLES, MANHOLES, JUNCTION BOXES, AND WIREWAYS.
8. CONNECTION OF CONDUCTORS MUST BE MADE BY USING CRIMP CONNECTORS AND A CRIMPING TOOL APPROVED BY THE CONNECTOR/LUG MANUFACTURER. THE TOOL MUST PRODUCE A COMPLETE CRIMP BEFORE IT CAN BE REMOVED. FOR THE L-823 CONNECTORS, THE CRIMPING TOOL USED MUST BE LISTED BY THE L-823 KIT MANUFACTURER. MAKE THE NUMBER AND TYPE OF CRIMPS PER THE KIT MANUFACTURER'S INSTRUCTIONS.

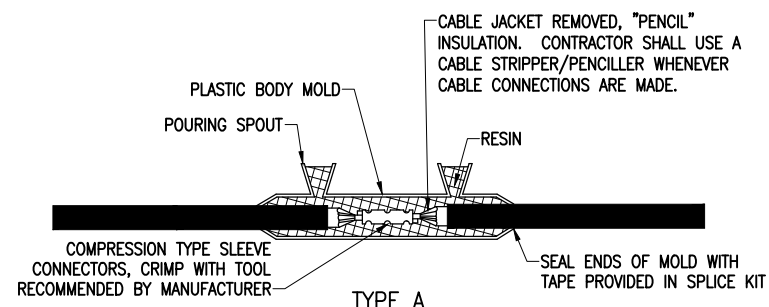


**TYPE A**  
FOR SPLICES IN LOW VOLTAGE CABLE (600V) HOMERUNS FOR EXTENSIONS TO EXISTING LOW VOLTAGE CABLES ONLY. TYPE A SPLICES SHALL BE MADE IN SPLICE CANS, HANDHOLES, MANHOLES, OR JUNCTION BOXES

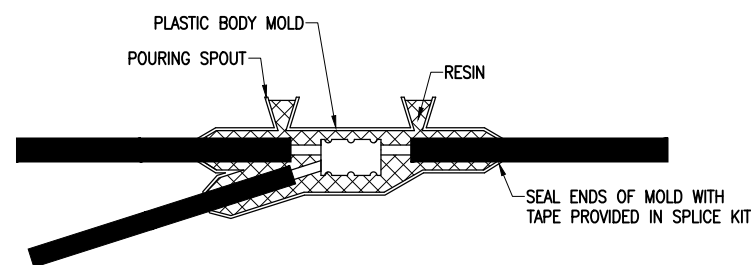

**LOW VOLTAGE UNDERGROUND TAP SPLICE**  
FOR TAP SPLICES IN LOW VOLTAGE (600V) CABLE. SPLICES SHALL BE RATED AND LISTED SUITABLE FOR DIRECT BURIAL LOCATIONS. FOR SPLICES UP TO #2 AWG CONDUCTOR, SPLICES SHALL BE WYE RESIN TYPE POWER CABLE TAP SPLICE KIT SUITABLE FOR THE RESPECTIVE CABLES AND RESPECTIVE APPLICATION.

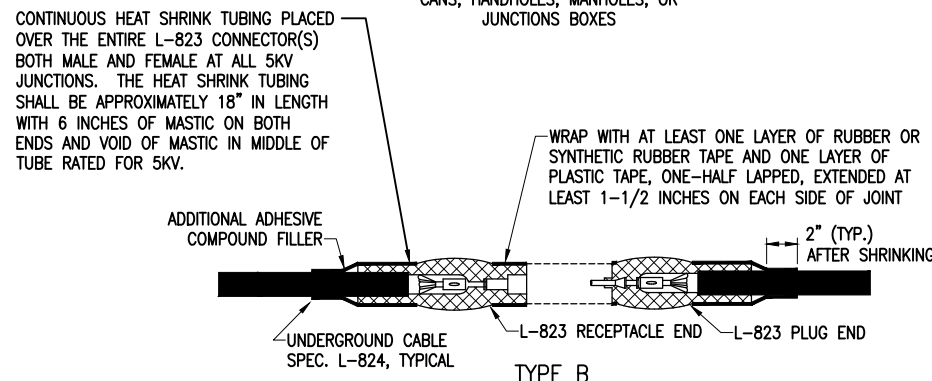


**TYPE B**  
FOR SPLICES AT JUNCTION OF HOMERUN WITH LOOP CIRCUIT AND FOR SPLICES IN HOMERUNS TO EXISTING CABLES

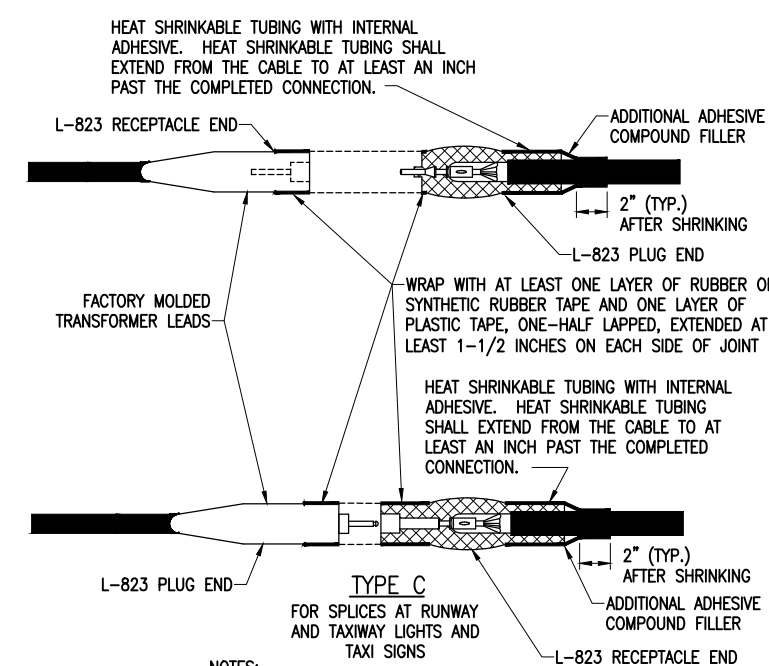

**TYPE C**  
FOR SPLICES AT RUNWAY AND TAXIWAY LIGHTS AND TAXI SIGNS

**NOTES:**  
INSIDE DIAMETER OF CONNECTOR SHALL PROPERLY MATCH THE OUTSIDE DIAMETER OF CABLE.

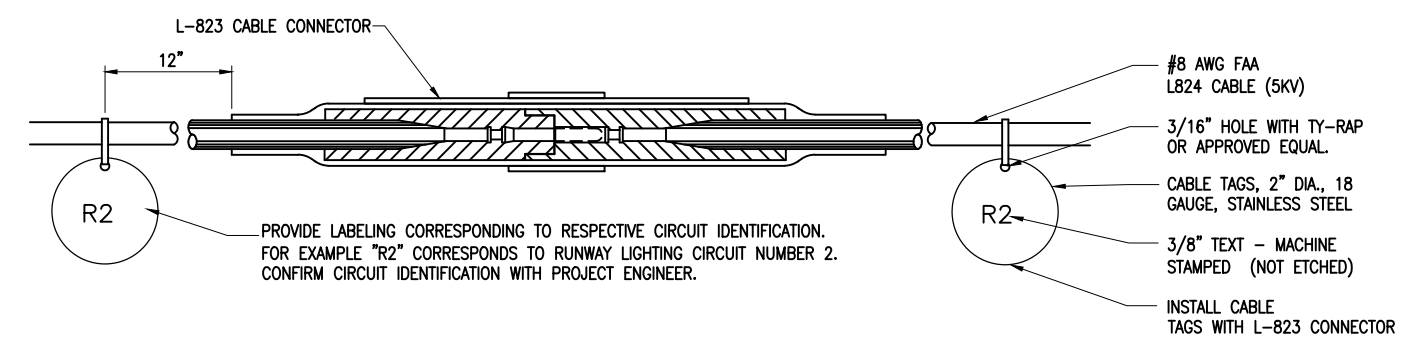

1. CONTRACTOR SHALL PROVIDE CABLE CIRCUIT IDENTIFICATION MARKERS ATTACHED TO BOTH SIDES OF EACH CABLE CONNECTION.
2. CABLE IDENTIFICATION TAGS SHALL BE STAINLESS STEEL OR BRASS.
3. THE CABLE SHALL THOROUGHLY BE CLEANED PRIOR TO THE INSTALLATION OF THE L-823 CONNECTOR KIT.
4. ATTACH EACH CABLE TIE ENOUGH TO HOLD IN PLACE WITHOUT COMPRESSING EDGE OF CABLE TAG INTO CONDUCTOR. TRIM OFF EXCESS CABLE TIE.
5. CABLE TAGS SHALL BE PROVIDED AT ALL POINTS OF ACCESS INCLUDING L-867 BASES, L-868 BASES, HANDHOLES, MANHOLES, JUNCTION BOXES, AND WIREWAYS.
6. CABLE TAGS SHALL BE LABELED AS FOLLOWS FOR RESPECTIVE AIRFIELD LIGHTING CIRCUITS,  
RUNWAY 11-29 LIGHTING: R1  
RUNWAY 17-35 LIGHTING: R2

**CABLE SPLICES**  
"NOT TO SCALE"

**CABLE TAG DETAIL**  
"NOT TO SCALE"

**FOR BID**

APR 19, 2021 2:46 PM HERNDD01562 I:\17 JOBS\17A008504\CAD\AIRPORT\T\SHEETE-504-DETL





*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-505-DETL.DWG

DESIGN BY: KNL 03/18/2021


DRAWN BY: CWS 03/18/2021

REVIEWED BY: KNL 03/18/2021



SHEET TITLE

CONDUIT TRENCH  
DETAILS


FOR BID

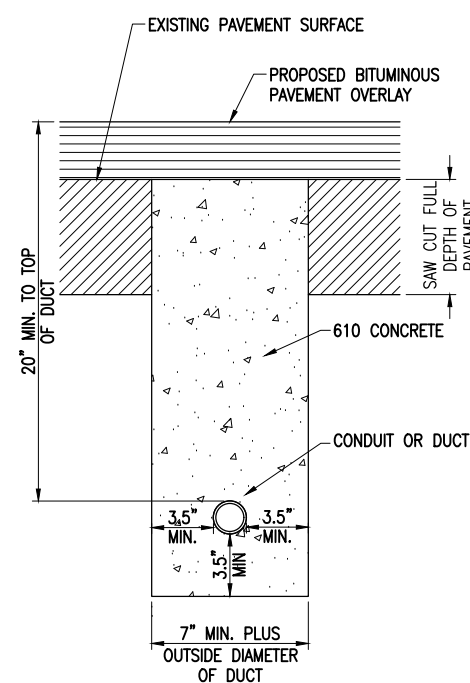

CONDUIT IN TRENCH – PAVED AREAS  
"NOT TO SCALE"

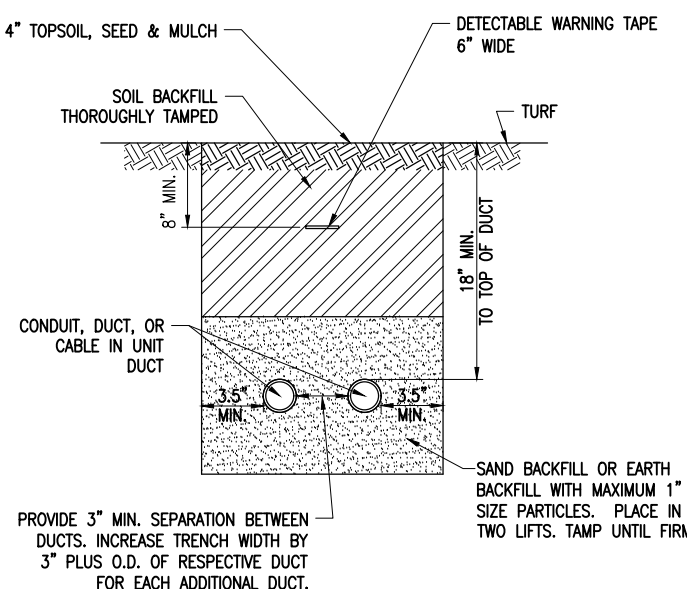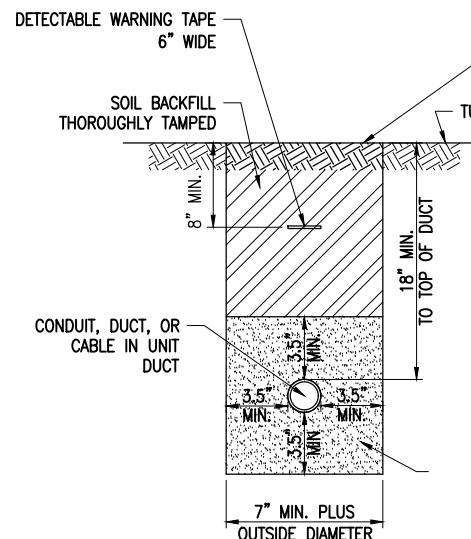

CONDUIT IN TRENCH – NON-PAVEMENT AREAS  
"NOT TO SCALE"

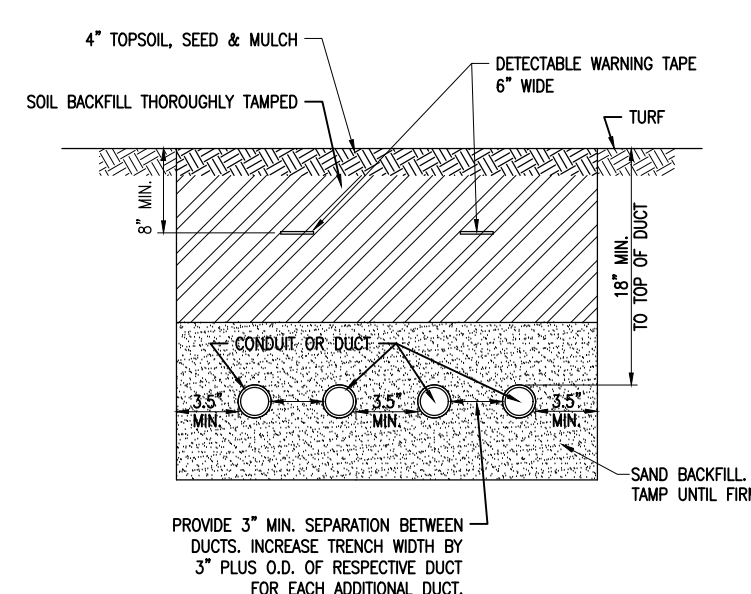


NOTES:

- DIMENSIONS FOR COVERAGE AND SEPARATION BETWEEN DUCTS ARE MINIMUM.
- TRENCHES WITH MORE THAN TWO DUCTS OR CABLE IN UNIT DUCTS SHALL BE INCREASED 3" IN WIDTH PLUS DIAMETER OF RESPECTIVE DUCT FOR EACH ADDITIONAL CONDUIT, DUCT, OR CABLE IN UNIT DUCT; IF SPECIFIED ON PLANS TWO PARALLEL TRENCHES MAY BE CONSTRUCTED.
- DEPTH OF TRENCHES SHALL BE AS SHOWN ABOVE UNLESS OTHERWISE SPECIFIED ON THE PLANS. MINIMUM COVER REQUIREMENTS FOR CABLES AND DUCTS AT AIRPORT RUNWAYS AND ADJACENT AREAS WHERE TRESPASSING IS PROHIBITED IS 18 INCHES PER NEC 300.5 AND 300.50. MINIMUM COVER REQUIREMENTS FOR DUCTS CONTAINING NAVAID FEEDER CIRCUITS SHALL BE 24". MINIMUM COVER REQUIREMENTS FOR DUCTS LOCATED BELOW PAVEMENT OR ROADWAYS IS 30". MINIMUM COVER REQUIREMENTS FOR DUCTS LOCATED IN AREAS SUBJECT TO FARMING IS 42". MINIMUM COVER FOR DUCTS CONTAINING SECONDARY ELECTRIC SERVICE CONDUCTORS SHALL BE 36" OR AS REQUIRED BY THE SERVING ELECTRIC UTILITY COMPANY. ADJUST/INCREASE BURIAL DEPTHS TO ACCOMMODATE SITE CONDITIONS, DRAINAGE AND/OR OBSTRUCTIONS. COVER IS DEFINED AS THE SHORTEST DISTANCE IN INCHES MEASURED BETWEEN A POINT ON THE TOP SURFACE OF ANY DIRECT-BURIED CONDUCTOR, CABLE, CONDUIT, OR OTHER RACEWAY AND THE TOP SURFACE OF FINISHED GRADE, CONCRETE OR SIMILAR COVER.
- HIGH-VOLTAGE CIRCUIT WIRING (AIRFIELD LIGHTING 5000 VOLT SERIES CIRCUITS AND/OR OTHER CIRCUITS RATED ABOVE 600 VOLTS) AND LOW-VOLTAGE CIRCUIT WIRING (RATED 600 VOLTS AND BELOW) SHALL MAINTAIN SEPARATION FROM EACH OTHER. HIGH-VOLTAGE WIRING AND LOW-VOLTAGE WIRING SHALL NOT BE INSTALLED IN THE SAME WIREWAY, CONDUIT, DUCT, RACEWAY, HANDHOLE, OR JUNCTION BOX. CORRECTIVE WORK WILL BE REQUIRED TO SEPARATE HIGH VOLTAGE SERIES CIRCUIT CONDUCTORS FROM LOW VOLTAGE CONDUCTORS WHERE THEY ARE INSTALLED IN THE SAME RACEWAY.
- SERVICE CONDUCTORS SHALL NOT BE INSTALLED IN THE SAME RACEWAY, CONDUIT, DUCT, OR HANDHOLE WITH FEEDER CIRCUITS, BRANCH CIRCUITS OR CONTROL CIRCUITS.
- COMMUNICATION CIRCUITS SHALL NOT BE INSTALLED IN THE SAME RACEWAY, CONDUIT, DUCT, OR HANDHOLE WITH POWER CIRCUITS.
- HOME RUN CABLES FOR A RESPECTIVE CIRCUIT SHALL BE INSTALLED IN THE SAME RACEWAY OR DUCT.
- COORDINATE DUCT INTERFACE TO MANHOLES AND HANDHOLES. FIELD CUT OPENINGS FOR CONDUITS AND DUCTS TO INTERFACE TO MANHOLES AND/OR HANDHOLES. CUT WALL OF RESPECTIVE HANDHOLE OR MANHOLE WITH A TOOL DESIGNED FOR MATERIAL TO BE CUT. SIZE HOLES FOR RESPECTIVE DUCTS, CONDUITS, AND TERMINATION FITTINGS AND SEAL AROUND PENETRATIONS. ALL CORING, INTERFACE, CUTTING, AND SEALING WILL BE CONSIDERED INCIDENTAL TO THE RESPECTIVE DUCT INSTALLATION AND/OR RESPECTIVE HANDHOLE/MANHOLE INSTALLATION. PROVIDE BUSHINGS OR BELLS AT CONDUIT TERMINATIONS IN ELECTRICAL HANDHOLES OR MANHOLES.
- ALL DISTURBED SURFACES SHALL BE RESTORED TO THEIR ORIGINAL CONDITION. COST IS INCIDENTAL TO TRENCH.

- ALL ELECTRICAL EQUIPMENT AND MATERIALS SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 – NATIONAL ELECTRICAL CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, INTERTEK TESTING SERVICES VERIFICATION/ETL LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
- CONTRACTOR SHALL COORDINATE WORK AND ANY POWER OUTAGES AND/OR SHUT DOWN OF SYSTEMS WITH THE RESPECTIVE FACILITY OWNER PERSONNEL AND THE AIRPORT MANAGER/DIRECTOR. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATSOEVER IN RESPECT TO ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE EITHER EXPRESSED OR IMPLIED, THAT THE LOCATIONS, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT. ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT JULIE (JOINT UTILITY LOCATION INFORMATION FOR EXCAVATORS) FOR UTILITY INFORMATION PHONE; 1-800-892-0123. CONTACT THE FAA (FEDERAL AVIATION ADMINISTRATION) FOR ASSISTANCE IN LOCATING FAA CABLES AND UTILITIES. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVEGROUND UTILITIES.
- ADJUSTMENTS TO DUCT BANK ROUTES MIGHT BE REQUIRED TO ACCOMMODATE EXISTING SITE CONDITIONS AND UNDERGROUND LINES AND UTILITIES. CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS. CONTRACTOR SHALL COORDINATE DUCT ROUTE ADJUSTMENTS WITH THE RESIDENT PROJECT REPRESENTATIVE AND THE AIRPORT MANAGER.

- CONTRACTOR SHALL LOCATE AND MARK ALL EXISTING CABLES, LINES, OR UTILITIES WITHIN 10 FT OF PROPOSED EXCAVATING/TRENCHING AREA. ANY CABLES, LINES, AND UTILITIES FOUND INTERFERING WITH PROPOSED EXCAVATION OR CABLE/TRENCHING SHALL BE HAND DUG AND EXPOSED. ANY DAMAGED CABLES OR OTHER UTILITIES SHALL BE IMMEDIATELY REPAIRED TO THE SATISFACTION OF THE RESPECTIVE OWNER'S REPRESENTATIVE AT THE CONTRACTOR'S EXPENSE. THE RESIDENT ENGINEER/RESIDENT TECHNICIAN AND OWNER SHALL BE NOTIFIED IMMEDIATELY IF ANY CABLES OR OTHER UTILITIES ARE DAMAGED.
- PAYMENT FOR LOCATING AND MARKING UNDERGROUND UTILITIES AND CABLES WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE CONSIDERED INCIDENTAL TO THE RESPECTIVE DUCT INSTALLATION.
- THE CONTRACTOR WILL DETERMINE IF THERE IS A CONFLICT BETWEEN THE INSTALLATION OF THE PROPOSED ELECTRICAL DUCTS AND ANY EXISTING UTILITIES. THE CONTRACTOR WILL MAKE ALL NECESSARY ADJUSTMENTS IN DEPTH OF INSTALLATION TO AVOID ANY AND ALL PROPOSED UNDERGROUND IMPROVEMENTS
- CONDUITS FOR DIRECT BURIAL OR CONCRETE ENCASED DUCT BANK SHALL BE SCHEDULE 40 (MINIMUM) PVC CONDUIT, UL-LISTED, RATED FOR 90°C CABLE—CONFORMING TO NEMA STANDARD TC-2 AND UL 651, LISTED SUITABLE FOR UNDERGROUND USE EITHER DIRECT-BURIED OR ENCASED IN CONCRETE, OR SCHEDULE 40 (MINIMUM) HDPE CONDUIT, UL LISTED, CONFORMING TO NEMA STANDARD TC-7 AND UL 651B AND LISTED SUITABLE FOR UNDERGROUND USE; EITHER DIRECT BURY OR ENCASED IN CONCRETE. HEAVIER WALL CONDUITS SHALL BE FURNISHED FOR RESPECTIVE APPLICATIONS WHERE DETAILED HEREIN.
- CONDUITS FOR DIRECTIONAL BORING SHALL BE SCHEDULE 40 PVC CONDUIT OR SCHEDULE 80 PVC CONDUIT, UL-LISTED, RATED FOR 90°C CABLE—CONFORMING TO NEMA STANDARD TC-2 AND UL 651 AND SUITABLE FOR DIRECTIONAL BORING INSTALLATION, SCHEDULE 80 HDPE CONDUIT, UL-LISTED, CONFORMING TO NEMA STANDARD TC-7 AND UL 651B AND SUITABLE FOR DIRECTIONAL BORING INSTALLATION, OR WALL TYPE MINIMUM SDR 11 HDPE CONDUIT MANUFACTURED IN ACCORDANCE WITH ASTM D-3350 (SPECIFICATION OF POLYETHYLENE PLASTICS PIPE AND FITTINGS MATERIALS) AND ASTM F2160 (STANDARD SPECIFICATION FOR SOLID WALL, HIGH-DENSITY POLYETHYLENE CONDUIT BASED ON CONTROLLED OUTSIDE DIAMETER), AND SUITABLE FOR DIRECTIONAL BORING INSTALLATION. PER NEC 300.5 (K), RACEWAYS INSTALLED USING DIRECTIONAL BORING EQUIPMENT SHALL BE APPROVED FOR THE PURPOSE.
- UNDERGROUND DUCTS INSTALLED BY DIRECTIONAL-BORING METHOD SHALL BE INSTALLED IN A MANNER THAT WILL NOT DAMAGE ANY EXISTING UNDERGROUND UTILITIES, AND SHALL NOT DISTURB OR DAMAGE THE RESPECTIVE PAVEMENT OR ROADWAY SURFACE. DUCTS SHALL BE DIRECTIONAL-BORED AT THE LOCATIONS SHOWN ON THE CONSTRUCTION PLANS. THE DUCTS WILL BE BORED AT A MINIMUM DEPTH OF 42 IN. BELOW THE RESPECTIVE PAVEMENT IT IS BEING BORED UNDER.
- A PULL WIRE SHALL BE INSTALLED IN EACH CONDUIT OR DUCT TO BE LEFT VACANT.
- CONTRACTOR SHALL COORDINATE DUCT MARKING WITH AIRPORT.
- ALL POWER AND CONTROL CABLES IN HANDHOLES, MANHOLES, AND JUNCTION BOXES SHALL BE TAGGED TO IDENTIFY THE RESPECTIVE CABLE. A MINIMUM OF TWO TAGS SHALL BE PROVIDED ON EACH CABLE IN A MANHOLE; ONE AT THE CABLE ENTRANCE AND ONE AT THE CABLE EXIT. CABLE TAGS SHALL BE STAMPED BRASS TAGS OR OTHER WEATHERPROOF/WATERPROOF CORROSION RESISTANT MATERIAL.



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-506-DETL.DWG

DESIGN BY: KNL 03/18/2021


DRAWN BY: CWS 03/18/2021

REVIEWED BY: KNL 03/18/2021


SHEET TITLE

CABLE AND DUCT  
MARKER DETAILS


FOR BID

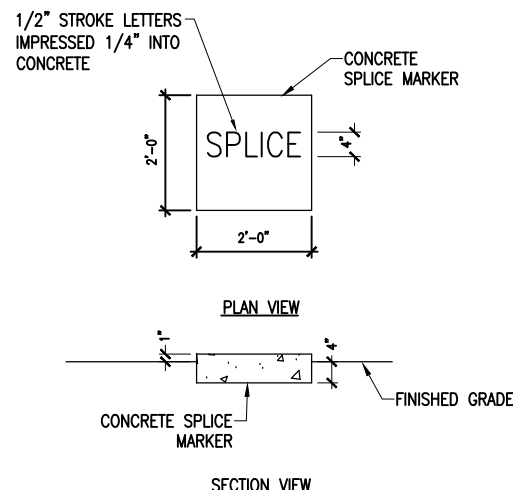


TURF CABLE MARKERS  
"NOT TO SCALE"

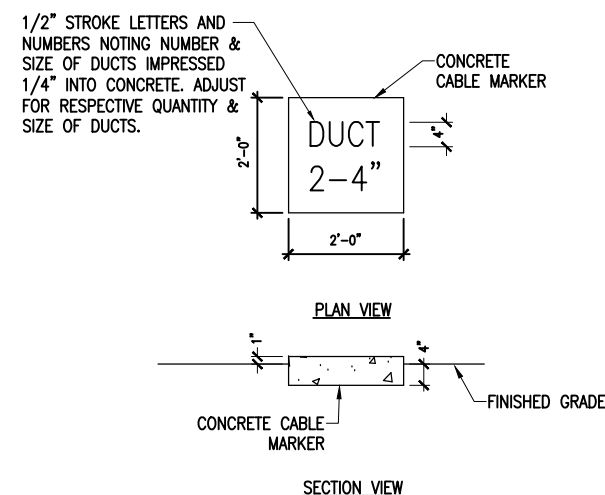

TURF CABLE MARKERS  
"NOT TO SCALE"

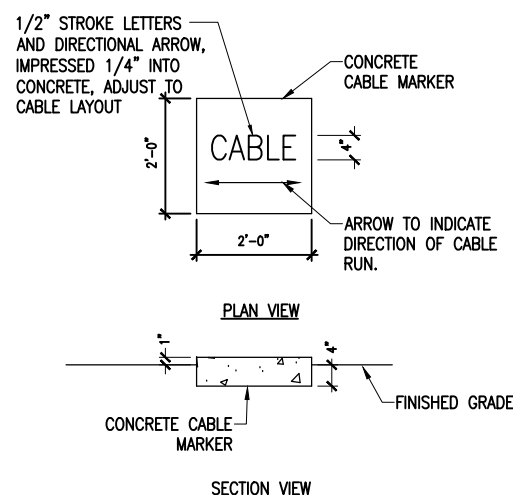



TURF CABLE MARKERS  
"NOT TO SCALE"

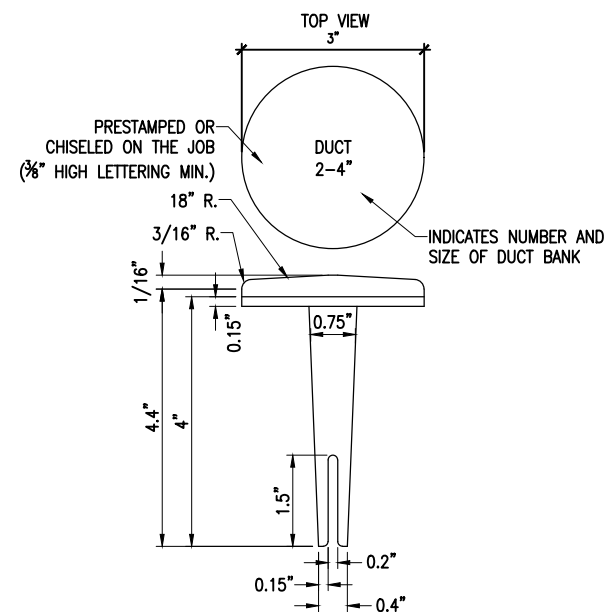

BITUMINOUS PAVEMENT DUCT MARKERS  
"NOT TO SCALE"

NOTE:

1. TOP OF MARKER SHALL BE FLUSH WITH FINISHED PAVEMENT SURFACE. MARKER MAY BE INSTALLED IN A DRILLED HOLE AND SECURED WITH EPOXY GLUE
2. BRASS DUCT MARKERS ARE AVAILABLE FROM BERNTSEN INTERNATIONAL INC., P.O. BOX 8670, MADISON, WI. 53708-8670, PHONE: 1-877-959-8556, SURV-KAP, 3225 E. 47TH ST., TUCSON, AZ 85713, PHONE: (502)-622-6011, OR OTHER EQUIVALENT MANUFACTURERS.

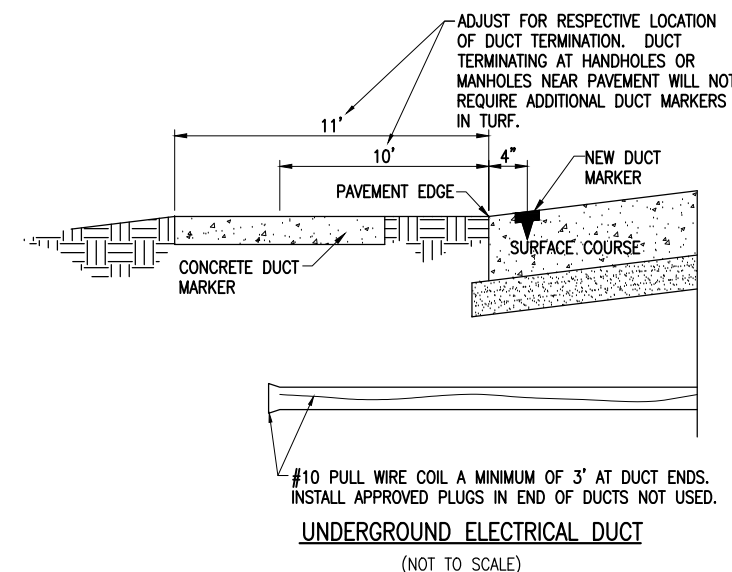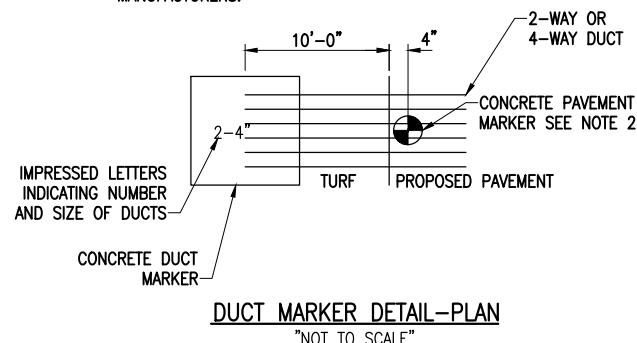

CABLE & DUCT MARKER NOTES:

1. THE COST OF ALL TURF AND PAVEMENT DUCT MARKERS SHALL BE INCIDENTAL TO THE DUCT. THE COST OF ALL CABLE MARKERS SHALL BE INCIDENTAL TO THE CABLE.
2. BITUMINOUS PAVEMENT DUCT MARKER AND CONCRETE DUCT MARKER TO BE PROVIDED AT EACH END OF EACH DUCT AS SHOWN ON THE LOCATION PLAN. FOR CONCRETE PAVEMENT, THE LETTER "D" SHALL BE IMPRESSED IN THE PAVEMENT INSTEAD OF THE MARKER. THE LETTER SHALL BE INFORMED AS DESCRIBED IN NOTE 4.
3. UNDERGROUND CABLE RUNS MUST BE IDENTIFIED BY CABLE MARKERS AT 200 FEET (61 M) MAXIMUM SPACING WITH AN ADDITIONAL MARKER AT EACH CHANGE OF DIRECTION OF THE CABLE RUN. CABLE MARKERS MUST BE INSTALLED ABOVE THE CABLE. CABLE MARKERS ARE NOT REQUIRED FOR CABLE RUNS BETWEEN RUNWAY/TAXIWAY EDGE LIGHTS.
4. CONCRETE CABLE MARKERS AND DUCT MARKERS SHALL HAVE LETTERS 4" HIGH, 3" WIDE WITH WIDTH OF STROKE 1/2" AND 1/4" DEEP. ALL LETTERS, NUMBERS AND ARROWS TO BE IMPRESSED.
5. EMPLOY THE FOLLOWING METHODS WHERE ADDITIONAL SPACE TO FIT THE LEGEND IS REQUIRED:  
A. REDUCE LETTER SIZE TO 3" HIGH, 2" WIDE.  
B. INCREASE THE MARKER SIZE TO 30" X 30".  
C. PROVIDE ADDITIONAL MARKERS PLACED SIDE BY SIDE
6. TURF DUCT MARKERS ARE NOT REQUIRED AT PAVEMENT CROSSINGS WHERE DUCTS TERMINATE IN HANDHOLES, OR JUNCTION STRUCTURES.
7. LOCATION OF ALL DIRECT EARTH BURIAL UNDERGROUND CABLE SPLICE/CONNECTIONS, EXCEPT THOSE AT ISOLATION TRANSFORMERS, MUST BE IDENTIFIED BY SPLICE MARKERS. SPLICE MARKERS MUST BE PLACED ABOVE THE SPLICE/CONNECTIONS. DIRECT EARTH BURIAL UNDERGROUND CABLE SPLICES SHALL BE AVOIDED WHERE POSSIBLE. CABLE SPLICES SHALL BE LOCATED IN SPLICE CANS, LIGHT BASES, HANDHOLES, MANHOLES, OR OTHER JUNCTION STRUCTURES UNLESS OTHERWISE APPROVED BY THE PROJECT ENGINEER.
8. THE CABLE AND SPLICE MARKERS MUST IDENTIFY THE CIRCUITS TO WHICH THE CABLES BELONG. FOR EXAMPLE: RWY 4-22, PAPI-4, PAPI-22.
9. LOCATIONS OF ENDS OF ALL UNDERGROUND DUCTS MUST BE IDENTIFIED BY DUCT MARKERS.







**AIRFIELD LIGHTING NOTES**

1. UNLESS OTHERWISE NOTED, ALL UNDERGROUND AIRFIELD LIGHTING SERIES CIRCUIT CONDUCTORS WHETHER DEB OR IN DUCT/CONDUIT SHALL BE FAA APPROVED 5000 VOLT L-824 TYPE. ALL UNDERGROUND FIELD POWER LOW VOLTAGE (600 VOLT & BELOW) CIRCUIT CONDUCTORS WHETHER DEB OR IN DUCT/CONDUIT SHALL BE UL LISTED 600 VOLT, TYPE XLP-USE-2 COPPER CONDUCTORS. CONDUCTOR SIZES SHALL BE AS SPECIFIED, HEREIN.
2. NO COMPONENTS OF PRIMARY CIRCUIT SUCH AS CABLE, CONNECTORS AND TRANSFORMERS SHALL BE BROUGHT ABOVE GROUND AT EDGE LIGHTS, SIGNS, REIL, PAPI, ETC.
3. THERE SHALL BE NO EXPOSED POWER/CONTROL CABLES BETWEEN THE POINT WHERE THEY LEAVE THE UNDERGROUND (DEB OR L-867 BASES) AND WHERE THEY ENTER THE EQUIPMENT (SUCH AS TAXIWAY SIGNS, PAPI, REIL, ETC.) ENCLOSURES. THESE CABLES SHALL BE ENCLOSED IN RIGID CONDUIT OR IN FLEXIBLE, WATERTIGHT CONDUIT WITH BREAKABLE COUPLING(S) AT THE GRADE OR THE HOUSING COVER, AS SHOWN IN APPLICABLE DETAILS.
4. THE JOINTS OF THE L-823 PRIMARY CONNECTORS SHALL BE WRAPPED WITH AT LEAST ONE LAYER OF RUBBER OR SYNTHETIC RUBBER TAPE AND ONE LAYER OF PLASTIC TAPE, ONE-HALF LAPPED, EXTENDING AT LEAST 1-1/2 INCHES ON EACH SIDE OF THE JOINT, AS SHOWN ON AIRFIELD LIGHTING CABLE SPLICE DETAILS.
5. THE CABLE ENTRANCE INTO THE FIELD-ATTACHED L-823 CONNECTORS SHALL BE ENCLOSED BY A HEAT-SHRINKABLE TUBING WITH CONTINUOUS INTERNAL ADHESIVE, AS SHOWN ON AIRFIELD LIGHTING CABLE SPLICE DETAILS.
6. L-823 TYPE II, TWO-CONDUCTOR SECONDARY CONNECTORS SHALL BE CLASS 'A' (FACTORY MOLDED).
7. THERE SHALL BE NO SPLICES IN THE SECONDARY CABLE(S) WITHIN THE STEMS OF A RUNWAY/TAXIWAY EDGE/THRESHOLD LIGHTING FIXTURE AND THE WIREWAYS LEADING TO TAXIWAY SIGNS AND PAPI/REIL EQUIPMENT.
8. ELECTRICAL INSULATING GREASE SHALL BE APPLIED WITHIN THE L-823, SECONDARY, TWO CONDUCTOR CONNECTORS TO PREVENT WATER ENTRANCE. THESE CONNECTORS SHALL NOT BE TAPED.
9. DEB ISOLATION TRANSFORMERS SHALL BE BURIED AT A DEPTH OF TEN (10") INCHES ON A LINE CROSSING THE LIGHT AND PERPENDICULAR TO THE RUNWAY/TAXIWAY CENTERLINE AT A LOCATION TWELVE (12") INCHES FROM THE LIGHT OPPOSITE FROM THE RUNWAY/TAXIWAY.
10. A SLACK OF THREE (3") FEET, MINIMUM, PLUS DEPTH OF BASE CAN (IF APPLICABLE), SHALL BE PROVIDED IN THE PRIMARY CABLE AT EACH TRANSFORMER/CONNECTOR TERMINATION. AT STAKE-MOUNTED LIGHTS, THE SLACK SHALL BE LOOSELY COILED IMMEDIATELY BELOW THE ISOLATION TRANSFORMER. THERE SHALL BE NO ADDITIONAL PAYMENT FOR CABLE SLACK AND THEREFORE THE QUANTITY OF PROPOSED CABLE SLACK HAS NOT BEEN INCLUDED IN THE RESPECTIVE CABLE PAY ITEMS.
11. DIRECTION OF PRIMARY CABLES SHALL BE IDENTIFIED BY COLOR CODING AS FOLLOWS: WHEN FACING LIGHT WITH BACK TO PAVEMENT, CABLE TO THE LEFT IS CODED RED AND CABLE TO RIGHT IS CODED BLUE. THIS APPLIES TO STAKE MOUNTED LIGHTS AND BASE MOUNTED LIGHTS WHERE THE BASE HAS ONLY ONE ENTRANCE.
12. L-867 BASES SHALL BE SIZE B, 24" DEEP, CLASS I, UNLESS OTHERWISE NOTED.
13. BASE MOUNTED BREAKABLE COUPLINGS SHALL NOT HAVE WEEP HOLES TO THE OUTSIDE. PLUGGED UP HOLES SHALL NOT BE ACCEPTABLE. IT SHALL BE A 1/4" DIAMETER, MINIMUM, OR EQUIVALENT OPENING FOR DRAINAGE FROM THE SPACE AROUND THE SECONDARY CONNECTOR INTO THE L-867 BASE.
14. THE ELEVATION OF THE BREAKABLE COUPLING GROOVE SHALL NOT EXCEED 1-1/2" ABOVE THE EDGE OF THE COVER IN CASE OF BASE MOUNTED COUPLINGS, OR THE TOP OF THE STAKE IN CASE OF STAKE MOUNTED COUPLINGS.
15. WHERE THE BREAKABLE COUPLING IS NOT AN INTEGRAL PART OF THE LIGHT FIXTURE STEM OR MOUNTING LEG, A BEAD OF SILICON SEAL SHALL BE APPLIED COMPLETELY AROUND LIGHT STEM OR WIREWAY AT BREAKABLE COUPLING TO PROVIDE A WATERTIGHT SEAL.
16. TOPS OF THE STAKES SUPPORTING LIGHT FIXTURES SHALL BE FLUSH WITH THE SURROUNDING GRADE.
17. PLASTIC LIGHTING FIXTURE COMPONENTS, SUCH AS LAMP HEADS, STEMS, BREAKABLE COUPLINGS, BASE COVERS, BRACKETS, STAKES, SHALL NOT BE ACCEPTABLE.
18. THE TOLERANCE FOR THE HEIGHT OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE: ONE (1) INCH. IN CASE OF STAKE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE STAKE AND THE TOP OF THE LENS. IN CASE OF BASE MOUNTED LIGHTS, THE SPECIFIED LIGHTING FIXTURE HEIGHT SHALL BE MEASURED BETWEEN THE TOP OF THE BASE FLANGE AND THE TOP OF THE LENS, THUS INCLUDING THE BASE COVER, THE FRANGIBLE COUPLING, THE STEM, THE LAMP HOUSING AND THE LENS.
19. THE TOLERANCE FOR THE LATERAL SPACING (LIGHT LANE TO RUNWAY/TAXIWAY CENTERLINE) OF RUNWAY/TAXIWAY EDGE LIGHTS SHALL BE ONE (1) INCH. THIS ALSO APPLIES AT INTERSECTIONS TO LATERAL SPACING BETWEEN LIGHTS OF A RUNWAY/TAXIWAY AND THE INTERSECTING RUNWAY/TAXIWAY.

20. ENTRANCES INTO L-867 BASES SHALL HAVE CONDUIT COUPLINGS OR REDUCERS TO INTERFACE UNIT DUCT/CONDUIT TO L-867 BASE HUBS, OR SHALL BE SEALED WITH HEAT SHRINK.
21. GALVANIZED/PAINTED EQUIPMENT/COMPONENT SURFACES SHALL NOT BE DAMAGED BY DRILLING, FILING, ETC. DRAIN HOLES IN METAL TRANSFORMER HOUSINGS SHALL BE MADE BEFORE GALVANIZING.
22. EDGE LIGHT NUMBERING TAGS SHALL BE FACING THE PAVEMENT.
23. CABLE/SPLICE/DUCT MARKERS SHALL BE PRECAST CONCRETE OF THE SIZE SHOWN. LETTERS/NUMBERS/ARROWS FOR THE LEGEND TO BE IMPRESSED INTO THE TOPS OF THE MARKERS SHALL BE PRE-ASSEMBLED AND SECURED IN THE MOLD BEFORE THE CONCRETE IS POURED. LEGEND INSCRIBED BY HAND IN WET CONCRETE SHALL NOT BE ACCEPTABLE.
24. ALL UNDERGROUND CABLE RUNS SHALL BE IDENTIFIED BY CABLE MARKERS AT 200 FEET MAXIMUM SPACING, WITH AN ADDITIONAL MARKER AT EACH CHANGE OF DIRECTION OF THE CABLE RUN. CABLE MARKERS SHALL BE INSTALLED IMMEDIATELY ABOVE THE CABLES.
25. THERE SHALL BE NO SPLICES BETWEEN THE ISOLATION TRANSFORMERS. L-823 CONNECTORS ARE ALLOWED AT TRANSFORMER CONNECTIONS ONLY, UNLESS OTHERWISE SHOWN.
26. APPLY AN OXIDE INHIBITING, ANTI-SEIZING COMPOUND TO ALL SCREWS, NUTS AND BREAKAGE COUPLING THREADS.
27. LOCATIONS OF ENDS OF ALL UNDERGROUND DUCTS SHALL BE IDENTIFIED BY DUCT MARKERS.
28. WHERE A PARALLEL, CONSTANT VOLTAGE PAPI SYSTEM IS PROVIDED, THE "T" SPLICES SHALL BE OF THE CAST TYPE.
29. CONCRETE USED FOR SLABS, FOOTINGS, BACKFILL AROUND TRANSFORMER HOUSINGS, MARKINGS, ETC. SHALL BE 3500 PSI (MINIMUM) AT 14 DAYS, IN ACCORDANCE WITH ITEM 610 STRUCTURAL PORTLAND CEMENT CONCRETE.
30. ALL POWER AND CONTROL CABLES IN MAN/HAND HOLES SHALL BE TAGGED. USE EMBOSSED COPPER STRIPS TO BE ATTACHED AT BOTH ENDS TO THE CABLE BY THE USE OF PLASTIC STRAPS. MINIMUM OF TWO TAGS SHALL BE PROVIDED ON EACH CABLE IN A MAN/HAND HOLE-ONE AT THE CABLE ENTRANCE AND ONE AT THE CABLE EXIT.
31. THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND AND/OR ABOVEGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. NEITHER THE OWNER NOR THE ENGINEER ASSUMES ANY RESPONSIBILITY WHATSOEVER IN RESPECT TO ACCURACY, COMPLETENESS, OR SUFFICIENCY OF THE INFORMATION. THERE IS NO GUARANTEE EITHER EXPRESSED OR IMPLIED, THAT THE LOCATIONS, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ARE REPRESENTATIVE OF THOSE TO BE ENCOUNTERED IN THE CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE OWNER'S REPRESENTATIVE AND/OR THE RESIDENT ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY DAMAGE TO SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT. ALL UTILITY CABLES AND LINES SHALL BE LOCATED BY THE RESPECTIVE UTILITY. CONTACT JULIE (JOINT UTILITY LOCATION INFORMATION FOR EXCAVATORS) FOR UTILITY INFORMATION, PHONE: 1-800-892-0123. CONTACT THE FAA (FEDERAL AVIATION ADMINISTRATION) FOR ASSISTANCE IN LOCATING FAA CABLES AND UTILITIES. LOCATION OF FAA POWER, CONTROL AND COMMUNICATION CABLES SHALL BE COORDINATED WITH AND/OR LOCATED BY THE FAA. ALSO CONTACT AIRPORT DIRECTOR/MANAGER AND AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING UNDERGROUND AIRPORT CABLES AND/OR UTILITIES. ALSO COORDINATE WORK WITH ALL ABOVE GROUND UTILITIES.
32. WHEN PREPARING CABLE FOR SPLICES, THE CONTRACTOR SHALL USE A CABLE STRIPPER/PENCILLER WHENEVER CABLE CONNECTIONS ARE MADE.

**GROUNDING NOTES FOR AIRFIELD LIGHTING**

1. GROUNDING FOR RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS SHALL BE AS DETAILED ON THE PLANS AND AS SPECIFIED HEREIN. A GROUND ROD MUST BE INSTALLED AT EACH LIGHT FIXTURE, TAXI GUIDANCE SIGN AND L-867/L-868 BASE. THE PURPOSE OF THE LIGHT BASE GROUND IS TO PROVIDE A DEGREE OF PROTECTION FOR MAINTENANCE PERSONNEL FROM POSSIBLE CONTACT WITH AN ENERGIZED LIGHT BASE OR MOUNTING STAKE THAT MAY RESULT FROM A SHORTED POWER CABLE OR ISOLATION TRANSFORMER. A LIGHT BASE GROUND SHALL BE INSTALLED AT EACH TRANSFORMER BASE/LIGHT CAN ASSOCIATED WITH RUNWAY LIGHTS, TAXIWAY LIGHTS, AND LIGHTED TAXI GUIDANCE SIGNS. A LIGHT BASE GROUND SHALL ALSO BE INSTALLED AT EACH STAKE MOUNTED LIGHT FIXTURE. A LIGHT BASE GROUND SHALL BE INSTALLED AND CONNECTED TO THE METAL FRAME OF EACH TAXI GUIDANCE SIGN AS DETAILED ON THE PLANS AND IN ACCORDANCE WITH THE RESPECTIVE TAXI GUIDANCE SIGN MANUFACTURER RECOMMENDATIONS. THE LIGHT BASE GROUND SHALL BE A #6 AWG BARE COPPER CONDUCTOR BONDED TO THE GROUND LUG ON THE RESPECTIVE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE AND A 3/4-INCH DIAMETER BY 10-FOOT LONG (MINIMUM) UL LISTED COPPER CLAD GROUND ROD. CONNECTIONS TO GROUND LUGS ON THE L-867 TRANSFORMER BASE/LIGHT CAN OR MOUNTING STAKE SHALL BE WITH A UL LISTED GROUNDING CONNECTOR. CONNECTIONS TO LIGHT BASES MAY ALSO BE MADE WITH A UL 467 LISTED PIPE CLAMP CONNECTED TO THE GRSC NIPPLE EXTENDING FROM A THREADED LIGHT BASE HUB. CONNECTIONS TO GROUND RODS SHALL BE MADE WITH EXOTHERMIC WELD TYPE CONNECTORS, CADWELD BY PENTAIR ERICO PRODUCTS, INC., THERMOWELD BY CONTINENTAL INDUSTRIES, INC., ULTRAWELD BY HARGER, OR APPROVED EQUAL. EXOTHERMIC WELD CONNECTIONS SHALL BE INSTALLED IN CONFORMANCE WITH THE RESPECTIVE MANUFACTURER'S DIRECTIONS USING MOLDS AS REQUIRED FOR EACH RESPECTIVE APPLICATION. BOLTED CONNECTIONS WILL NOT BE PERMITTED AT GROUND RODS. TOP OF GROUND RODS SHALL BE BURIED 12 INCHES MINIMUM BELOW GRADE, UNLESS SPECIFIED OTHERWISE HEREIN, FOR RESPECTIVE APPLICATIONS.
2. PER THE REQUIREMENTS OF FAA AC 150/5340-30J DESIGN AND INSTALLATION DETAILS FOR AIRPORT VISUAL AIDS, CHAPTER 12, PART 12.6 "LIGHT FIXTURE BONDING" IT NOTES THE FOLLOWING: BOND THE LIGHT FIXTURE TO THE LIGHT BASE INTERNAL GROUND LUG VIA A NO. 6 AWG STRANDED COPPER WIRE RATED 600 VOLTS WITH GREEN XHHW, THWN-2, OR OTHER SUITABLE INSULATION, BARE STRANDED CONDUCTOR OR A BRAIDED GROUND STRAP OF EQUIVALENT CURRENT RATING. THE BONDING CONDUCTOR LENGTH MUST BE SUFFICIENT TO ALLOW THE REMOVAL OF THE LIGHT FIXTURE FROM THE LIGHT BASE FOR ROUTINE MAINTENANCE. SEE THE LIGHT FIXTURE MANUFACTURER'S INSTRUCTIONS FOR PROPER METHODS OF ATTACHING A BONDING WIRE TO THE FIXTURE.
3. STEEL USED TO MANUFACTURE GROUND RODS SHALL BE 100 PERCENT DOMESTIC STEEL.
4. CLEAN ALL METAL SURFACES BEFORE MAKING GROUND CONNECTIONS. METALLIC SURFACES TO BE JOINED SHALL BE PREPARED BY THE REMOVAL OF ALL NON-CONDUCTIVE MATERIAL PER 2017 NATIONAL ELECTRICAL CODE ARTICLE 250-12.
5. THE RESISTANCE TO GROUND OF THE RESPECTIVE MOUNTING STAKE OR LIGHT BASE (WITH GROUND ROD CONNECTED) MUST BE 25 OHMS OR LESS.
6. FOR EACH AIRFIELD LIGHT FIXTURE, TAXI GUIDANCE SIGN, DISTANCE REMAINING SIGN, JUNCTION STRUCTURE/L-867 BASE/L-868 BASE, OR OTHER AIRFIELD LIGHT FIXTURE, THE CONTRACTOR SHALL TEST THE MADE ELECTRODE GROUND SYSTEM WITH AN INSTRUMENT SPECIFICALLY DESIGNED FOR TESTING GROUNDING SYSTEMS. TEST RESULTS SHALL BE RECORDED FOR EACH AIRFIELD LIGHT FIXTURE AND EACH TAXI GUIDANCE SIGN INSTALLATION. IF GROUND RESISTANCE EXCEEDS 25 OHMS, LONGER GROUND RODS OR ADDITIONAL GROUND RODS MIGHT BE REQUIRED. IF GROUND RESISTANCE EXCEEDS 25 OHMS CONTACT THE PROJECT ENGINEER FOR FURTHER DIRECTION. ALSO REFER TO EOR-47643 FOR ADDITIONAL INFORMATION ON GROUNDING REQUIREMENTS WHERE APPLICABLE. COPIES OF THE GROUND SYSTEM TEST RESULTS SHALL BE FURNISHED TO THE RESIDENT ENGINEER/RESIDENT TECHNICIAN AND THE PROJECT ENGINEER.

APR 19, 2021 2:47 PM HERND01562 I:\17\JOBS\17A008504\CAD\AIRPORT\TSHEETE-003-NOTES



Engineering | Planning | Allied Services  
 Hanson Professional Services Inc.  
 1525 S. 6th Street  
 Springfield, IL 62703  
 phone: 217-788-2450  
 fax: 217-788-2503  
 Offices Nationwide  
 www.hanson-inc.com

Illinois Licensed  
 Professional Service Corporation  
 #184-001084



ST. LOUIS REGIONAL AIRPORT  
 8 Terminal Drive  
 East Alton, Illinois 62024



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: E-003-NOTES.DWG  
 DESIGN BY: KNL 03/18/2021  
 DRAWN BY: CWS 03/18/2021  
 REVIEWED BY: KNL 03/18/2021

SHEET TITLE

**ELECTRICAL NOTES  
 SHEET 2**



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812


Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-507-DETL.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE


GROUNDING DETAILS

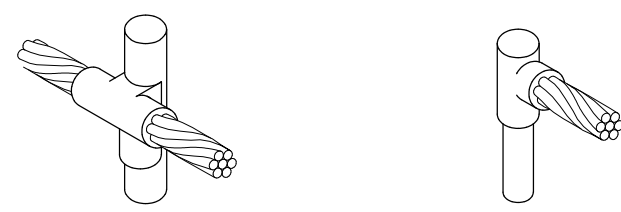


CABLE TO GROUND ROD




CABLE TO GROUND ROD




CABLE TO GROUND ROD

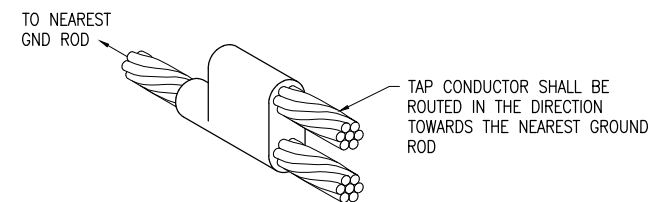

CABLE TO CABLE  
HORIZONTAL PARALLEL TAP

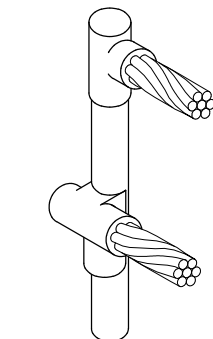

CABLES TO GROUND ROD




CABLE TO REBAR

DETAIL NOTES

- ALL BELOW GRADE CONNECTIONS TO GROUND RODS & GROUND RING CONDUCTORS SHALL BE EXOTHERMIC WELD TYPE CONNECTIONS. EXOTHERMIC WELDS SHALL BE CADWELD AS MANUFACTURED BY PENTAIR ERICO PRODUCTS, ULTRAWELD AS MANUFACTURED BY HARGER LIGHTNING PROTECTION & GROUNDING EQUIPMENT, OR THERMOWELD AS MANUFACTURED BY CONTINENTAL INDUSTRIES OR APPROVED EQUAL. VERIFY PROPER SIZES, MOLDS, TYPES, AND REQUIREMENTS FOR THE RESPECTIVE APPLICATION WITH THE MANUFACTURER, AND INSTALL PER THEIR DIRECTIONS.
- FOR APPLICATIONS TO GALVANIZED STEEL OR PAINTED STEEL, REMOVE GALVANIZING AND/OR PAINT & CLEAN THE SURFACE TO EXPOSE BARE STEEL BEFORE MAKING EXOTHERMIC WELD CONNECTION.
- INDIVIDUAL GROUNDING ELECTRODE CONDUCTORS SHALL NOT BE INSTALLED IN METAL CONDUIT. INSTALL GROUNDING ELECTRODE CONDUCTORS IN SCHED 40 PVC CONDUIT AS REQUIRED IN FOUNDATIONS, FOR PROTECTION, WHERE ENTERING ENCLOSURES, ETC. WHERE PLASTIC CONDUIT IS USED FOR INDIVIDUAL GROUND WIRES, DO NOT COMPLETELY ENCIRCLE THE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. WHERE METAL CLAMPS ARE INSTALLED USE NYLON BOLTS, NUTS, WASHERS, & SPACERS TO INTERRUPT A COMPLETE METALLIC PATH FROM ENCIRCLING THE CONDUIT.

EXOTHERMIC WELD DETAILS

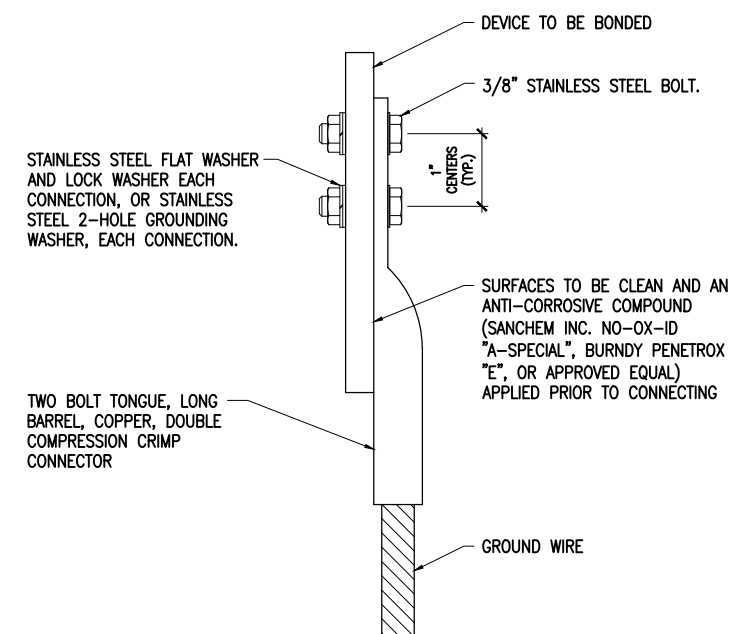

STAINLESS STEEL FLAT WASHER AND LOCK WASHER EACH CONNECTION, OR STAINLESS STEEL 2-HOLE GROUNDING WASHER, EACH CONNECTION.

TWO BOLT TONGUE, LONG BARREL, COPPER, DOUBLE COMPRESSION CRIMP CONNECTOR


SURFACES TO BE CLEAN AND AN ANTI-CORROSIVE COMPOUND (SANCHEM INC. NO-OX-ID "A-SPECIAL", BURNDY PENETROX "E", OR APPROVED EQUAL) APPLIED PRIOR TO CONNECTING

2 HOLE LONG BARREL COMPRESSION LUG TABLE (OR APPROVED EQUAL)			
WIRE SIZE	BURNDY CAT. NO.	THOMAS & BETTS CAT. NO.	PENN-UNION CAT. NO.
#8 AWG STRANDED	YA8C-2TC38	256-30695-1157	BBLU-8D-2TC38
#6 AWG SOLID	YA8C-2TC38 OR YGA6C-2TC38E2G1		
#6 AWG STRANDED	YA6C-2TC38	256-30695-1158	BBLU-6D-2TC38
#4 AWG STRANDED	YA4C-2TC38	256-30695-1159	BBLU-4D-2TC38
#2 AWG STRANDED	YA2C-2TC38	256-30695-1160	BBLU-2D-2TC38
#2 AWG SOLID	YA3C-2TC38	256-30695-1160	BBLU-3D-2TC38
#1/0 AWG STRANDED	YA25-2TC38	256-30695-1162	BBLU-1/0D-2TC38
#2/0 AWG STRANDED	YA26-2TC38	256-30695-1116	BBLU-2/0D-2TC38
#3/0 AWG STRANDED	YA27-2TC38	54816BE	BBLU-3/0D-2TC38
#4/0 AWG STRANDED	YA28-2TC38	256-30695-1117	BBLU-4/0D-2TC38

NOTES

- ALL CONNECTIONS TO GROUND BUS BAR SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE BUS BAR.
- GROUND WIRE CONNECTIONS TO EQUIPMENT SHALL BE WITH 2 HOLE TONGUE LONG BARREL COMPRESSION LUGS BOLTED TO THE DEVICE OR WITH THE RESPECTIVE EQUIPT MANUFACTURER'S LUG OR TERMINAL WHERE APPLICABLE.
- GROUNDING ELECTRODE CONDUCTORS, BONDING JUMPERS, & INDIVIDUAL GROUND WIRES SHALL NOT BE INSTALLED IN METAL CONDUIT. WHERE PLASTIC CONDUIT IS USED FOR INDIVIDUAL GROUND WIRES, DO NOT COMPLETELY ENCIRCLE THE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. WHERE METAL CLAMPS ARE INSTALLED USE NYLON BOLTS, NUTS, WASHERS, & SPACERS TO INTERRUPT A COMPLETE METALLIC APTH FROM ENCIRCLING THE CONDUIT.
- ALL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND (SANCHEM INC. NO-OX-ID "A-SPECIAL", BURNDY PENETROX E, OR APPROVED EQUAL) BEFORE JOINING. ALL COPPER BUS BARS SHALL BE CLEANED PRIOR TO MAKING CONNECTIONS TO REMOVE SURFACE OXIDATION. CLEAN SURFACES, OF RESPECTIVE DEVICES TO BE BONDED, TO BARE METAL, PER NEC 250-12.

GROUNDING LUG CONNECTION DETAIL

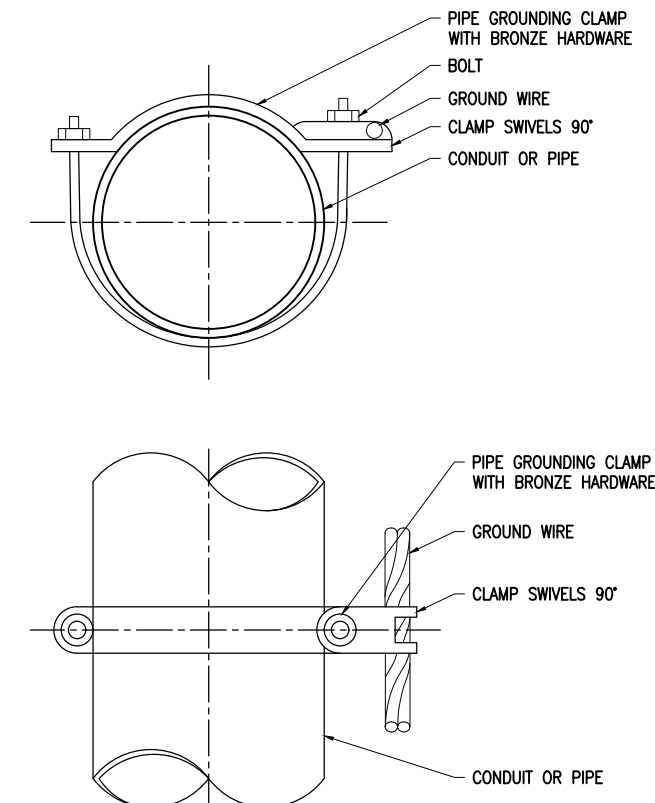

PIPE GROUNDING CLAMP TABLE (OR APPROVED EQUAL)		
BURNDY CAT. NO.	THOMAS & BETTS CAT. NO.	PIPE SIZE
GAR3902-BU	3902BU	1/2" - 1"
GAR3903-BU	3903BU	1 1/4" - 2"
GAR3904-BU	3904BU	2 1/2" - 3 1/2"
GAR3905-BU	3905BU	4" - 5"
GAR3906-BU	3906BU	6"

NOTES

- PIPE GROUNDING CLAMPS SHALL HAVE BRONZE HARDWARE, BE CORROSION RESISTANT, SUITABLE FOR DIRECT BURIAL IN EARTH OR CONCRETE, & UL 467 LISTED.

PIPE/CONDUIT GROUNDING CLAMP DETAIL






**GROUNDING NOTES**

THE CONTRACTOR SHALL FURNISH AND INSTALL ALL GROUNDING AS MAY BE NECESSARY OR REQUIRED TO MAKE A COMPLETE GROUNDING SYSTEM AS REQUIRED BY THE LATEST NATIONAL ELECTRICAL CODE (NFPA 70) IN FORCE AND FAA-STD-019e (LIGHTNING AND SURGE PROTECTION, GROUNDING, BONDING, AND SHIELDING REQUIREMENTS FOR FACILITIES AND ELECTRONIC EQUIPMENT). THE RELIABILITY OF THE GROUNDING SYSTEM IS DEPENDENT ON CAREFUL, PROPER INSTALLATION AND CHOICE OF MATERIALS. IMPROPER PREPARATION OF SURFACES TO BE JOINED TO MAKE AN ELECTRICAL PATH, LOOSE JOINTS OR CORROSION CAN INTRODUCE IMPEDANCE THAT WILL SERIOUSLY IMPAIR THE ABILITY OF THE GROUND PATH TO PROTECT PERSONNEL AND EQUIPMENT AND TO ABSORB TRANSIENTS THAT CAN CAUSE NOISE IN COMMUNICATIONS CIRCUITS. THE FOLLOWING FUNCTIONS ARE PARTICULARLY IMPORTANT TO ENSURE A RELIABLE GROUND SYSTEM:

- FURNISH AND INSTALL GROUND RODS AS DETAILED HEREIN. GROUND RODS SHALL BE MINIMUM 3/4-IN. DIAMETER BY 10-FT LONG, UL-LISTED, COPPER CLAD WITH 10-MIL MINIMUM COPPER COATING (UNLESS DETAILED OTHERWISE HEREIN). GROUND RODS SHALL BE SPACED OR AS DETAILED ON THE RESPECTIVE PLANS, AND IN NO CASE SPACED LESS THAN ONE ROD LENGTH APART. ALL CONNECTIONS TO GROUND RODS AND THE GROUND RING SHALL BE MADE WITH EXOTHERMIC WELD TYPE CONNECTORS, CADWELD BY PENTAIR ERICO PRODUCTS, INC., THERMOWELD BY CONTINENTAL INDUSTRIES, INC., ULTRAWELD BY HARGER, OR APPROVED EQUAL. EXOTHERMIC WELD CONNECTIONS SHALL BE INSTALLED IN CONFORMANCE WITH THE RESPECTIVE MANUFACTURER'S DIRECTIONS USING MOLDS AS REQUIRED FOR EACH RESPECTIVE APPLICATION. BOLTED CONNECTIONS WILL NOT BE PERMITTED AT GROUND RODS OR AT BURIED GROUNDING ELECTRODE CONDUCTORS.
- CONTRACTOR SHALL TEST EACH MADE ELECTRODE GROUND ROD/GROUND FIELD/GROUND RING WITH AN INSTRUMENT SPECIFICALLY DESIGNED FOR TESTING GROUND FIELD SYSTEMS. IF GROUND RESISTANCE EXCEEDS 25 OHMS, CONTACT THE PROJECT ENGINEER FOR FURTHER DIRECTION. ALSO REFER TO EOR-47643 FOR ADDITIONAL INFORMATION ON GROUNDING REQUIREMENTS WHERE APPLICABLE. COPIES OF GROUND ROD TEST RESULTS SHALL BE FURNISHED TO THE RESIDENT ENGINEER/RESIDENT TECHNICIAN AND THE PROJECT ENGINEER.
- ALL PRODUCTS ASSOCIATED WITH THE GROUNDING SYSTEM SHALL BE UL-LISTED AND LABELED.
- ALL BOLTED OR MECHANICAL CONNECTIONS SHALL BE COATED WITH A CORROSION PREVENTATIVE COMPOUND BEFORE JOINING, SANCHEM INC. "NO-OX-ID "A-SPECIAL" COMPOUND, BURNDY PENETROX E, OR APPROVED EQUAL.
- METALLIC SURFACES TO BE JOINED SHALL BE PREPARED BY THE REMOVAL OF ALL NON-CONDUCTIVE MATERIAL, PER 2017 NATIONAL ELECTRICAL CODE ARTICLE 250-12. ALL COPPER BUS BARS MUST BE CLEANED PRIOR TO MAKING CONNECTIONS TO REMOVE SURFACE OXIDATION.
- METALLIC RACEWAY FITTINGS SHALL BE MADE UP TIGHT TO PROVIDE A PERMANENT LOW IMPEDANCE PATH FOR ALL CIRCUITS. METAL CONDUIT TERMINATIONS IN ENCLOSURES SHALL BE BONDED TO THE ENCLOSURE WITH UL-LISTED FITTINGS SUITABLE FOR GROUNDING. PROVIDE GROUNDING BUSHINGS WITH BONDING JUMPERS FOR ALL METAL CONDUITS ENTERING SERVICE EQUIPMENT (METER BASE, CT CABINET, MAIN SERVICE BREAKER ENCLOSURE, ETC.). PROVIDE GROUNDING BUSHINGS WITH BONDING JUMPERS FOR ALL METAL CONDUITS ENTERING AN ENCLOSURE THROUGH CONCENTRIC OR ECCENTRIC KNOCKOUTS THAT ARE PUNCHED OR OTHERWISE FORMED SO AS TO IMPAIR THE ELECTRICAL CONNECTION TO GROUND. STANDARD LOCKNUTS OR BUSHINGS SHALL NOT BE THE SOLE MEANS FOR BONDING WHERE A CONDUIT ENTERS AN ENCLOSURE THROUGH A CONCENTRIC OR ECCENTRIC KNOCKOUT
- ALL CONNECTIONS, LOCATED ABOVE GRADE, BETWEEN THE DIFFERENT TYPES OF GROUNDING CONDUCTORS SHALL BE MADE USING UL-LISTED DOUBLE COMPRESSION CRIMP TYPE CONNECTORS OR UL-LISTED BOLTED GROUND CONNECTORS. FOR GROUND CONNECTIONS TO ENCLOSURES, CASES AND FRAMES OF ELECTRICAL EQUIPMENT NOT SUPPLIED WITH GROUND LUGS THE CONTRACTOR SHALL DRILL REQUIRED HOLES FOR MOUNTING A BOLTED GROUND CONNECTOR. ALL BOLTED GROUND CONNECTORS SHALL BE BURNDY, DOSSERT CORPORATION, ILSCO CORPORATION, PENN-UNION CORPORATION, THOMAS & BETTS, OR APPROVED EQUAL. TIGHTEN CONNECTIONS TO COMPLY WITH TIGHTENING TORQUES IN UL STANDARD 486A TO ASSURE PERMANENT AND EFFECTIVE GROUNDING.
- ALL METAL EQUIPMENT ENCLOSURES, CONDUITS, CABINETS, BOXES, RECEPTACLES, MOTORS, ETC. SHALL BE BONDED TO THE RESPECTIVE GROUNDING SYSTEM.
- PROVIDE ALL BOXES FOR PROPOSED OUTLETS, SWITCHES, CIRCUIT BREAKERS, ETC. WITH GROUNDING SCREWS. PROVIDE ALL PANELBOARD, SWITCHGEAR, ETC., ENCLOSURES WITH GROUNDING BARS WITH INDIVIDUAL SCREWS, LUGS, CLAMPS, ETC., FOR EACH OF THE GROUNDING CONDUCTORS THAT ENTER THEIR RESPECTIVE ENCLOSURES.
- EACH NEW FEEDER CIRCUIT AND/OR BRANCH CIRCUIT SHALL INCLUDE AN EQUIPMENT GROUND WIRE. METAL RACEWAY OR CONDUIT SHALL NOT MEET THIS REQUIREMENT. THE EQUIPMENT GROUND WIRE FROM EQUIPMENT SHALL NOT BE SMALLER THAN ALLOWED BY 2017 NEC TABLE 250-122 "MINIMUM SIZE CONDUCTORS OR GROUNDING RACEWAY AND EQUIPMENT." WHEN CONDUCTORS ARE ADJUSTED IN SIZE TO COMPENSATE FOR VOLTAGE DROP, EQUIPMENT-GROUNDING CONDUCTORS SHALL BE ADJUSTED PROPORTIONATELY ACCORDING TO CIRCULAR MIL AREA. ALL EQUIPMENT GROUND WIRES SHALL BE COPPER, EITHER BARE OR INSULATED GREEN IN COLOR. WHERE THE EQUIPMENT GROUNDING CONDUCTORS ARE INSULATED, THEY SHALL BE IDENTIFIED BY THE COLOR GREEN, AND SHALL BE THE SAME INSULATION TYPE AS THE PHASE CONDUCTORS.

- ALL EXTERIOR METAL CONDUIT, WHERE NOT ELECTRICALLY CONTINUOUS BECAUSE OF MANHOLES, HANDHOLES, NON-METALLIC JUNCTION BOXES, ETC., SHALL BE BONDED TO ALL OTHER METAL CONDUIT IN THE RESPECTIVE DUCT RUN, AND AT EACH END, WITH A COPPER-BONDING JUMPER SIZED IN CONFORMANCE WITH 2017 NEC 250-102. WHERE METAL CONDUITS TERMINATE IN AN ENCLOSURE (SUCH AS A MOTOR CONTROL CENTER, SWITCHBOARD, ETC) WHERE THERE IS NOT ELECTRICAL CONTINUITY WITH THE CONDUIT AND THE RESPECTIVE ENCLOSURE, PROVIDE A BONDING JUMPER FROM THE RESPECTIVE ENCLOSURE GROUND BUS TO THE CONDUIT SIZED PER 2017 NEC 250-102.
- IT IS THE INTENT OF THIS SPECIFICATION THAT ALL MOTOR FRAMES, PUMP BASES ELECTRICAL EQUIPMENT ENCLOSURES, PANEL HOUSINGS, CONDUITS, BOXES, ETC. HAVE A CONTINUOUS COPPER WIRE GROUND CONNECTION AND SHALL BE POSITIVELY BONDED TO THE RESPECTIVE GROUNDING SYSTEM. CONDUIT CONNECTORS WILL NOT BE CONSIDERED AS ADEQUATE GROUNDING.
- PROVIDE A POSITIVE GROUND BOND FOR ALL OUTLET BOXES, ELECTRICAL EQUIPMENT ENCLOSURES, GROUNDING RECEPTACLES, TOGGLE SWITCHES, ETC. INSTALL A GROUNDING CONDUCTOR IN ALL WIRE AND CABLE RACEWAYS. GROUND CONDUCTOR TO HAVE 600-VOLT INSULATION AND BE IDENTIFIED BY A CONTINUOUS GREEN COLOR COATING. THEY SHALL BE USED SOLELY FOR GROUNDING PURPOSES AND BE ENTIRELY SEPARATE FROM WHITE GROUNDED NEUTRAL CONDUCTOR, EXCEPT AT SUPPLY SIDE OF SERVICE DISCONNECTING MEANS, WHERE GROUNDING AND NEUTRAL SYSTEMS ARE TO BE CONNECTED TO SERVICE GROUND.
- EACH AND ALL GROUNDED CASED AND METAL PARTS ASSOCIATED WITH ELECTRICAL EQUIPMENT SHALL BE TESTED FOR CONTINUITY OF CONNECTION WITH GROUND BUS SYSTEM BY CONTRACTOR IN PRESENCE OF OWNER'S REPRESENTATIVE.
- ALL CONNECTIONS BETWEEN THE DIFFERENT TYPES OF GROUNDING CONDUCTORS ABOVE GRADE SHALL BE MADE USING BOLTED GROUND CONNECTORS. GROUND LUGS SHALL BE PROVIDED IN ALL ENCLOSURES AND WIRING TERMINATION JUNCTION BOXES. EQUIPMENT GROUNDS AND GROUNDING CONDUCTOR SHALL BE CONNECTED TO THESE GROUND LUGS. FOR GROUND CONNECTIONS TO ENCLOSURES, CASES AND FRAMES OF ELECTRICAL EQUIPMENT NOT SUPPLIED WITH GROUND LUGS THE CONTRACTOR SHALL DRILL REQUIRED HOLES FOR MOUNTING A BOLTED GROUND CONNECTOR. ALL BOLTED GROUND CONNECTORS SHALL BE BURNDY, DOSSERT CORPORATION, ILSCO CORPORATION, PENN-UNION CORPORATION, THOMAS & BETTS, OR APPROVED EQUAL.
- BOND ALL NONCURRENT-CARRYING PARTS OF METAL EQUIPMENT TO GROUND SYSTEM.
- BUILDING STRUCTURAL STEEL SYSTEM SHALL BE BONDED TO ELECTRICAL GROUND SYSTEM.
- INSTALL GROUNDING ELECTRODE CONDUCTORS, LIGHTNING PROTECTION DOWN CONDUCTORS AND SEPARATE GROUND CONDUCTORS IN SCHEDULE 40 OR SCHEDULE 80 PVC CONDUIT OR EXPOSED WHERE ACCEPTABLE TO LOCAL CODES. WHERE GROUNDING ELECTRODE CONDUCTORS, LIGHTNING PROTECTION DOWN CONDUCTORS OR INDIVIDUAL GROUND CONDUCTORS ARE RUN IN PVC CONDUIT, DO NOT COMPLETELY ENCIRCLE CONDUIT WITH FERROUS AND/OR MAGNETIC MATERIALS. USE NON-METALLIC REINFORCED FIBERGLASS STRUT SUPPORT. WHERE METAL CONDUIT CLAMPS ARE INSTALLED, USE NYLON BOLTS, NUTS, WASHERS AND SPACERS TO INTERRUPT A COMPLETE METALLIC PATH FROM ENCIRCLING THE CONDUIT. THIS IS REQUIRED TO AVOID GIRDLING OF GROUND CONDUCTORS. GIRDLING OF A GROUND CONDUCTOR IS THE RESULT OF PLACING THE CONDUCTOR IN A RING OF MAGNETIC MATERIAL. THIS RING COULD BE A METALLIC CONDUIT, U-BOLT OR STRUT SUPPORT PIPE CLAMP, OR OTHER SUPPORT HARDWARE. THE RESULT OF GIRDLING GROUND CONDUCTORS SIGNIFICANTLY INCREASES THE INDUCTIVE IMPEDANCE OF THE GROUND CONDUCTOR. INDUCTIVE AND CAPACITIVE IMPEDANCE IS A TYPE OF RESISTANCE THAT OPPOSES THE FLOW OF ALTERNATING CURRENT. ANY INCREASE IN THE IMPEDANCE OF A GROUND CONDUCTOR REDUCES ITS ABILITY TO EFFECTIVELY MITIGATE RADIO FREQUENCY NOISE IN THE GROUND SYSTEM. THE CONDITION WHERE A GROUND CONDUCTOR IS GIRDLING DURING A LIGHTNING STRIKE RESULTS IN PHENOMENA KNOWN AS SURGE IMPEDANCE LOADING. SURGE IMPEDANCE LOADING IS A RESULT OF VOLTAGE AND CURRENT REACHING 500,000 VOLTS AND 10,000 AMPS FOR A SHORT DURATION. GIRDLING FURTHER INCREASES THE IMPEDANCE AT LIGHTNING FREQUENCIES OF 100 KILOHERTZ TO 100 MEGAHERTZ. AT THESE POWER AND FREQUENCY LEVELS ANY INCREASE IN THE IMPEDANCE OF THE GROUND CONDUCTOR MUST BE CONTROLLED. DURING LIGHTNING DISCHARGE CONDITIONS A LOW INDUCTIVE IMPEDANCE PATH IS MORE IMPORTANT THAN A LOW DC RESISTANCE PATH.
- IF LOCAL CODES DICTATE THAT INDIVIDUAL GROUNDING CONDUCTORS MUST BE RUN IN METAL CONDUIT OR RACEWAY, THEN THE CONDUIT OR RACEWAY MUST BE BONDED AT EACH END OF THE RUN WITH A BONDING JUMPER SIZED EQUAL TO THE INDIVIDUAL GROUNDING CONDUCTOR OR AS REQUIRED BY 2017 NEC 250-102. NOTE THIS DOES NOT APPLY TO AC EQUIPMENT GROUNDING CONDUCTORS RUN WITH AC CIRCUITS.
- NEVER REMOVE, ALTER, OR ATTEMPT TO REPAIR CONDUCTORS OR CONDUIT SYSTEMS PROVIDING GROUNDING OR ELECTRICAL BONDING FOR ANY ELECTRICAL EQUIPMENT UNTIL ALL POWER IS REMOVED FROM EQUIPMENT. WARN ALL PERSONNEL OF THE UNGROUNDED CONDITION OF THE EQUIPMENT. DISPLAY APPROPRIATE WARNING SIGNS, SUCH AS DANGER TAGS, TO WARN PERSONNEL OF THE POSSIBLE HAZARDS.
- GROUNDING WORK AND MODIFICATIONS SHALL NOT BE PERFORMED DURING A THUNDERSTORM OR WHEN A THUNDERSTORM IS PREDICTED IN THE AREA
- WHERE A CONFLICT IS DETERMINED WITH RESPECT TO GROUNDING REQUIREMENTS PER MANUFACTURER INSTALLATION INSTRUCTIONS, NEC, AND/OR THE CONTRACT DOCUMENTS, CONTACT THE PROJECT ENGINEER FOR FURTHER DIRECTIONS.
- GROUND RODS SHALL BE MANUFACTURED IN THE UNITED STATES OF AMERICA FROM 100 PERCENT DOMESTIC STEEL TO COMPLY WITH THE AIRPORT IMPROVEMENT PROGRAM BUY AMERICAN REQUIREMENTS AND THE STEEL PRODUCTS PROCUREMENT ACT.

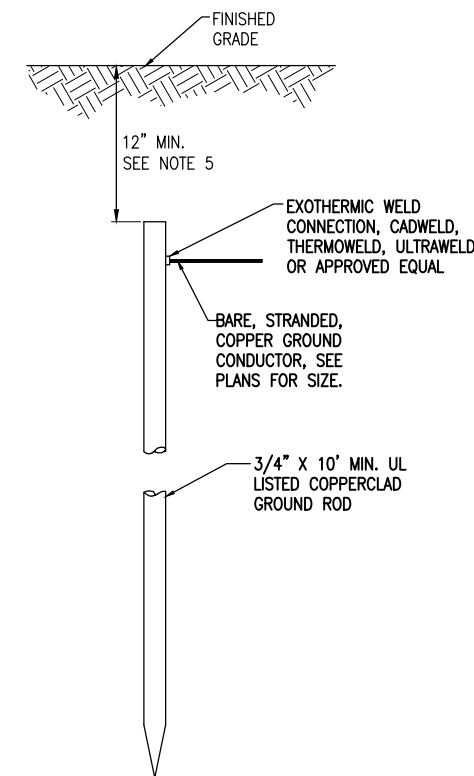

**10 FT. GROUND ROD**

**GROUND RODS**

NOT TO SCALE

**NOTES**

- TYPE AND MINIMUM NUMBER OF GROUND RODS SHALL BE AS SPECIFIED ON THE PLAN.
- THE RESISTANCE TO GROUND OF THE GROUNDING SYSTEM SHALL NOT EXCEED 25 OHMS.
- COST OF GROUND RODS IS INCIDENTAL TO THE ASSOCIATED ITEMS REQUIRING GROUNDING UNLESS OTHERWISE SPECIFIED.
- GROUND RODS SHALL BE SPACED AS DETAILED ON THE PLANS AND SHALL NOT BE SPACED LESS THAN ONE ROD LENGTH APART.
- TOP OF GROUND RODS FOR AIRFIELD LIGHT FIXTURES AND TAXI GUIDANCE SIGNS, SHALL BE 12" MINIMUM BELOW GRADE UNLESS DETAILED OTHERWISE HEREIN.
- GROUND RODS FOR INDIVIDUAL SPLICE CANS SHALL BE 3/4-IN DIAMETER BY 10 FOOT LONG. WHERE GROUND RESISTANCE EXCEEDS 25 OHMS FURNISH AND INSTALL A SECOND GROUND ROD SPACED MINIMUM OF 10 FEET APART (ONE ROD LENGTH APART), AND CONNECT TO FIRST GND ROD.

APR 19, 2021 2:48 PM HERNDD01562  
I:\17 JOBS\17A008504\CAD\AIRPORT\TSHEETE-004-NOTES



Engineering | Planning | Allied Services  
Hanson Professional Services Inc.  
1525 S. 6th Street  
Springfield, IL 62703  
phone: 217-788-2450  
fax: 217-788-2503  
Offices Nationwide  
www.hanson-inc.com

Illinois Licensed  
Professional Service Corporation  
#184-001084



**ST. LOUIS REGIONAL AIRPORT**  
8 Terminal Drive  
East Alton, Illinois 62024



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE RUNWAY 17-35 PAVEMENT & LIGHTING**

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-004-NOTES.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

**GROUNDING NOTES**

**FOR BID**


**ST. LOUIS REGIONAL AIRPORT**

 8 Terminal Drive  
 East Alton, Illinois 62024

*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

**REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING**

 SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

 ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: E-005-LGND.DWG  
 DESIGN BY: KNL 03/18/2021  
 DRAWN BY: CWS 03/18/2021  
 REVIEWED BY: KNL 03/18/2021

SHEET TITLE

**ELECTRICAL LEGEND  
 AND ABBREVIATIONS**
**FOR BID**
**NOTES:**

- ALL ELECTRICAL EQUIPMENT AND MATERIALS SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 - NATIONAL ELECTRICAL CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES, AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, INTERTEK TESTING SERVICES VERIFICATION/ETL LISTING (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
- KEEP A COPY OF THE LATEST NEC IN FORCE ON SITE AT ALL TIMES DURING/CONSTRUCTION FOR USE AS A REFERENCE.
- VAULT WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT MANAGER AND MAINTENANCE SUPERVISOR. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- IN THE EVENT A CONFLICT IS DETERMINED WITH RESPECT TO MANUFACTURER INSTALLATION INSTRUCTIONS, NEC, AND/OR THE CONTRACT DOCUMENTS, CONTACT THE PROJECT ENGINEER FOR FURTHER DIRECTIONS.
- COLOR CODE PHASE AND NEUTRAL CONDUCTOR INSULATION FOR NO. 6 AWG OR SMALLER. PROVIDE COLORED INSULATION OR COLORED MARKING TAPE FOR PHASE AND NEUTRAL CONDUCTORS FOR NO. 4 AWG AND LARGER. INSULATED GROUND CONDUCTORS SHALL HAVE GREEN COLORED INSULATION FOR ALL CONDUCTOR AWG AND/OR KCMIL TO COMPLY WITH NEC 250.119. NEUTRAL CONDUCTORS SHALL HAVE WHITE COLORED INSULATION FOR NO. 6 AWG AND SMALLER TO MEET THE REQUIREMENTS OF NEC 200.6. STANDARD COLORS FOR POWER WIRING AND BRANCH CIRCUITS SHALL BE AS FOLLOWS:
 

208/120 VAC, 3 PHASE, 4 WIRE	
PHASE A	BLACK
PHASE B	RED
PHASE C	BLUE
NEUTRAL	WHITE
GROUND	GREEN
- SEE RESPECTIVE SITE PLANS FOR SITE LEGEND INFORMATION.
- LTFMC DENOTES LIQUID TIGHT FLEXIBLE METAL CONDUIT UL LISTED, SUNLIGHT RESISTANT, & SUITABLE FOR GROUNDING. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO CCR'S & TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. EXTERNAL BONDING JUMPERS USED WITH CCR INSTALLATIONS SHALL BE #6 AWG COPPER (MINIMUM). DO NOT INSTALL LTFMC THAT IS NOT UL LISTED. CONFIRM LTFMC BEARS THE UL LABEL PRIOR TO INSTALLATION.
- ALL ENCLOSURES RATED NEMA 4, 4X SHALL HAVE WATERTIGHT HUBS AT CONDUIT ENTRANCES UL LISTED NEMA 4, 4X FOR THE RESPECTIVE ENCLOSURE, TO MAINTAIN THE NEMA 4, 4X RATING.
- CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS. CONTRACTOR SHALL FIELD VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES PRIOR TO REMOVING, DISCONNECTING, ADJUSTING, CONNECTING, OR WORKING ON THE RESPECTIVE AIRFIELD LIGHTING, TAXI SIGN, NAVIAD, VAULT EQUIPMENT, OR OTHER DEVICE.
- HIGH VOLTAGE CIRCUITS (AIRFIELD LIGHTING 5000 VOLT SERIES CIRCUITS AND OTHER CIRCUITS RATED ABOVE 600 VOLTS) AND LOW VOLTAGE CIRCUITS (RATED 600 VOLTS AND BELOW) SHALL NOT BE INSTALLED IN THE SAME WIREWAY, CONDUIT, DUCT, RACEWAY, JUNCTION STRUCTURE OR HANDHOLE.

ELECTRICAL ABBREVIATIONS (CONTINUED)	
PB	PULL BOX
PC	PHOTO CELL
PDB	POWER DISTRIBUTION BLOCK
PNL	PANEL
RCPT	RECEPTACLE
R	RELAY
S	STARTER
SPD	SURGE PROTECTION DEVICE
SPST	SINGLE POLE SINGLE THROW
TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
TYP	TYPICAL
UG	UNDERGROUND
UGE	UNDERGROUND ELECTRIC
UL	UNDERWRITER'S LABORATORIES
V	VOLTS
W/	WITH
W/O	WITHOUT
WP	WEATHER PROOF
XFER	TRANSFER
XFMR	TRANSFORMER

AIRPORT EQUIPMENT/FACILITY ABBREVIATIONS	
ASOS	AUTOMATED SURFACE OBSERVING SYSTEM
ATCT	AIR TRAFFIC CONTROL TOWER
AWOS	AUTOMATED WEATHER OBSERVING SYSTEM
CCR	CONSTANT CURRENT REGULATOR
DME	DISTANCE MEASURING EQUIPMENT
FAR	FEDERAL AVIATION REGULATION
GS	GLIDE SLOPE FACILITY
HIRL	HIGH INTENSITY RUNWAY LIGHT
ILS	INSTRUMENT LANDING SYSTEM
IM	INNER MARKER
LIR	LOW IMPACT-RESISTANT
LOC	LOCALIZER FACILITY
MALS	MEDIUM INTENSITY APPROACH LIGHTING SYSTEM
MALSR	MEDIUM INTENSITY APPROACH LIGHTING SYSTEM WITH RUNWAY ALIGNMENT INDICATING LIGHTS
MIRL	MEDIUM INTENSITY RUNWAY LIGHT
MITL	MEDIUM INTENSITY TAXIWAY LIGHT
NDB	NON-DIRECTIONAL BEACON
PAPI	PRECISION APPROACH PATH INDICATOR
PLASI	PULSE LIGHT APPROACH SLOPE INDICATOR
RAIL	RUNWAY ALIGNMENT INDICATING LIGHTS
REIL	RUNWAY END IDENTIFIER LIGHT
RVR	RUNWAY VISUAL RANGE
VADI	VISUAL APPROACH DESCENT INDICATOR
VASI	VISUAL APPROACH SLOPE INDICATOR
VOR	VERY HIGH FREQUENCY OMNIDIRECTIONAL RANGE FACILITY
WC	WIND CONE

ELECTRICAL ABBREVIATIONS	
A.F.F.	ABOVE FINISHED FLOOR
A, AMP	AMPERES
ATS	AUTOMATIC TRANSFER SWITCH
AWG	AMERICAN WIRE GAUGE
BKR	BREAKER
C	CONDUIT
CB	CIRCUIT BREAKER
CKT	CIRCUIT
CR	CONTROL RELAY
CU	COPPER
DPDT	DOUBLE POLE DOUBLE THROW
DPST	DOUBLE POLE SINGLE THROW
EM	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EOR	ENGINEER OF RECORD
EP	EXPLOSION PROOF
ES	EMERGENCY STOP
ETL	INTERTEK - ELECTRICAL TESTING LABS
ETM	ELAPSE TIME METER
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFI	GROUND FAULT INTERRUPTER
GND	GROUND
GRSC	GALVANIZED RIGID STEEL CONDUIT
HID	HIGH INTENSITY DISCHARGE
HOA	HAND OFF AUTOMATIC
HP	HORSEPOWER
HPS	HIGH PRESSURE SODIUM
J	JUNCTION BOX
KVA	KILOVOLT AMPERE(S)
KNL	KEVIN NEIL LIGHTFOOT
KW	KILOWATTS
LC	LIGHTING CONTACTOR
LTFMC	LIQUID TIGHT FLEXIBLE METAL CONDUIT (UL LISTED)
LTG	LIGHTING
LP	LIGHTING PANEL
MAX	MAXIMUM
MCB	MAIN CIRCUIT BREAKER
MCM	THOUSAND CIRCULAR MIL
MDP	MAIN DISTRIBUTION PANEL
MFR	MANUFACTURER
MH	METAL HALIDE
MIN	MINIMUM
MLO	MAIN LUGS ONLY
NEC	NATIONAL ELECTRICAL CODE (NFPA 70)
NC	NORMALLY CLOSED
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OHE	OVERHEAD ELECTRIC
OL	OVERLOAD

ELECTRICAL LEGEND - SCHEMATIC	
	NORMALLY OPEN (N.O.) CONTACT
	NORMALLY CLOSED (N.C.) CONTACT
	STARTER COIL, * = STARTER NUMBER
	OVERLOAD RELAY CONTACT
	CONTROL RELAY, * = CONTROL RELAY NUMBER
	RELAY, * = RELAY NUMBER
	TOGGLE SWITCH / 2 POSITION SWITCH
	2-POSITION SELECTOR SWITCH
	3-POSITION SELECTOR SWITCH (H-O-A SHOWN)
	2 POLE DISCONNECT SWITCH
	3 POLE DISCONNECT SWITCH
	PHOTOCELL
	TERMINAL BLOCK, * = TERMINAL NUMBER
	DEVICE TERMINAL, * = DEVICE TERMINAL NUMBER
	INTERNAL PANEL WIRING
	FIELD WIRING
	FUSE
	GROUND BUS OR TERMINAL
	NEUTRAL BUS
	GROUND, GROUND ROD, GROUND BUS
	INDUSTRIAL CONTROL RELAY OR LIGHTING CONTACTOR
	S1 CUTOUT HANDLE REMOVED
	S1 CUTOUT HANDLE INSERTED
	N.O. THERMAL SWITCH
	N.C. THERMAL SWITCH
	L-830 SERIES ISOLATION TRANSFORMER

ELECTRICAL LEGEND - ONE-LINE DIAGRAM	
	CABLE TERMINATOR/LUG
	TRANSFORMER
	DISCONNECT SWITCH
	FUSIBLE DISCONNECT SWITCH
	CIRCUIT BREAKER
	THERMAL MAGNETIC CIRCUIT BREAKER
	FUSE
	TRANSIENT VOLTAGE SURGE SUPPRESSOR OR SURGE PROTECTOR DEVICE
	GROUND - GROUND ROD, GROUNDING ELECTRODE, OR AT EARTH POTENTIAL
	INDICATING LIGHT
	MOTOR
	LOAD, MOTOR, # = HORSEPOWER
	ELECTRIC UTILITY METER BASE
	JUNCTION BOX WITH SPLICE
	EQUIPMENT, XXX = DEVICE DESCRIPTION
	GROUND BUS OR TERMINAL
	NEUTRAL BUS
	PANELBOARD WITH MAIN LUGS
	PANELBOARD WITH MAIN BREAKER
	FUSE PANEL WITH MAIN FUSE PULLOUT
	DUPLEX RECEPTACLE 120V SINGLE PHASE GROUNDING TYPE
	CONTROL STATION
	TRANSFER SWITCH
	ENGINE GENERATOR SET





ST. LOUIS REGIONAL AIRPORT

8 Terminal Drive  
East Alton, Illinois 62024



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-601-LINE.DWG

DESIGN BY: KNL 03/18/2021

DRAWN BY: CWS 03/18/2021

REVIEWED BY: KNL 03/18/2021


SHEET TITLE

EXISTING  
ELECTRICAL  
ONE-LINE DIAGRAM  
FOR VAULT

**FOR BID**

**NOTES:**

- EXISTING ONE-LINE DIAGRAM WIRING IS BASED ON FIELD DATA AND INFORMATION PROVIDED BY OTHERS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND WIRING AND REPORT ANY VARIATIONS TO THE RESIDENT ENGINEER/RESIDENT TECHNICIAN.
- ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT MANAGER. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- CONTRACTOR SHALL EXAMINE THE SITE TO DETERMINE THE EXTENT OF THE WORK. CONTRACTOR SHALL FIELD VERIFY EXISTING SITE CONDITIONS. CONTRACTOR SHALL FIELD VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES PRIOR TO REMOVING, DISCONNECTING, WORKING ON, RELOCATING, CONNECTING OR RECONNECTING THE RESPECTIVE AIRFIELD LIGHTING, TAXI SIGN, NAVAID, VAULT EQUIPMENT OR OTHER DEVICE.
- CONTRACTOR SHALL COMPLY WITH THE REQUIREMENTS OF FAA AC NO. 150/5370-2G (OR MOST CURRENT ISSUE) "OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION".
- CONTRACTOR SHALL COMPLY WITH THE APPLICABLE REQUIREMENTS OF NFPA 70E - STANDARD FOR ELECTRICAL SAFETY IN THE WORKPLACE.
- WHEN A RUNWAY IS SHUT DOWN THE RUNWAY LIGHTING AND ASSOCIATED AIRFIELD NAVAIDS FOR THAT RUNWAY SHALL BE SHUT OFF. WHEN A TAXIWAY IS SHUT DOWN THE TAXIWAY LIGHTS FOR THAT TAXIWAY WILL BE SHUT OFF.
- THIS PROJECT WILL AFFECT RUNWAY 17-35 LIGHTING CIRCUIT AND OTHER AIRFIELD LIGHTING CIRCUITS AND THE ASSOCIATED CCR'S.
- EACH CONSTANT CURRENT REGULATOR SHALL BE TESTED FOR PROPER OPERATION BEFORE REMOVAL WORK, MODIFICATIONS, ADDITIONS, AND/OR ANY AIRFIELD WORK THAT MIGHT POSSIBLY AFFECT AIRFIELD LIGHTING CIRCUITS, AND AGAIN AFTER AIRFIELD LIGHTING MODIFICATIONS, ADDITIONS AND/OR UPGRADES.

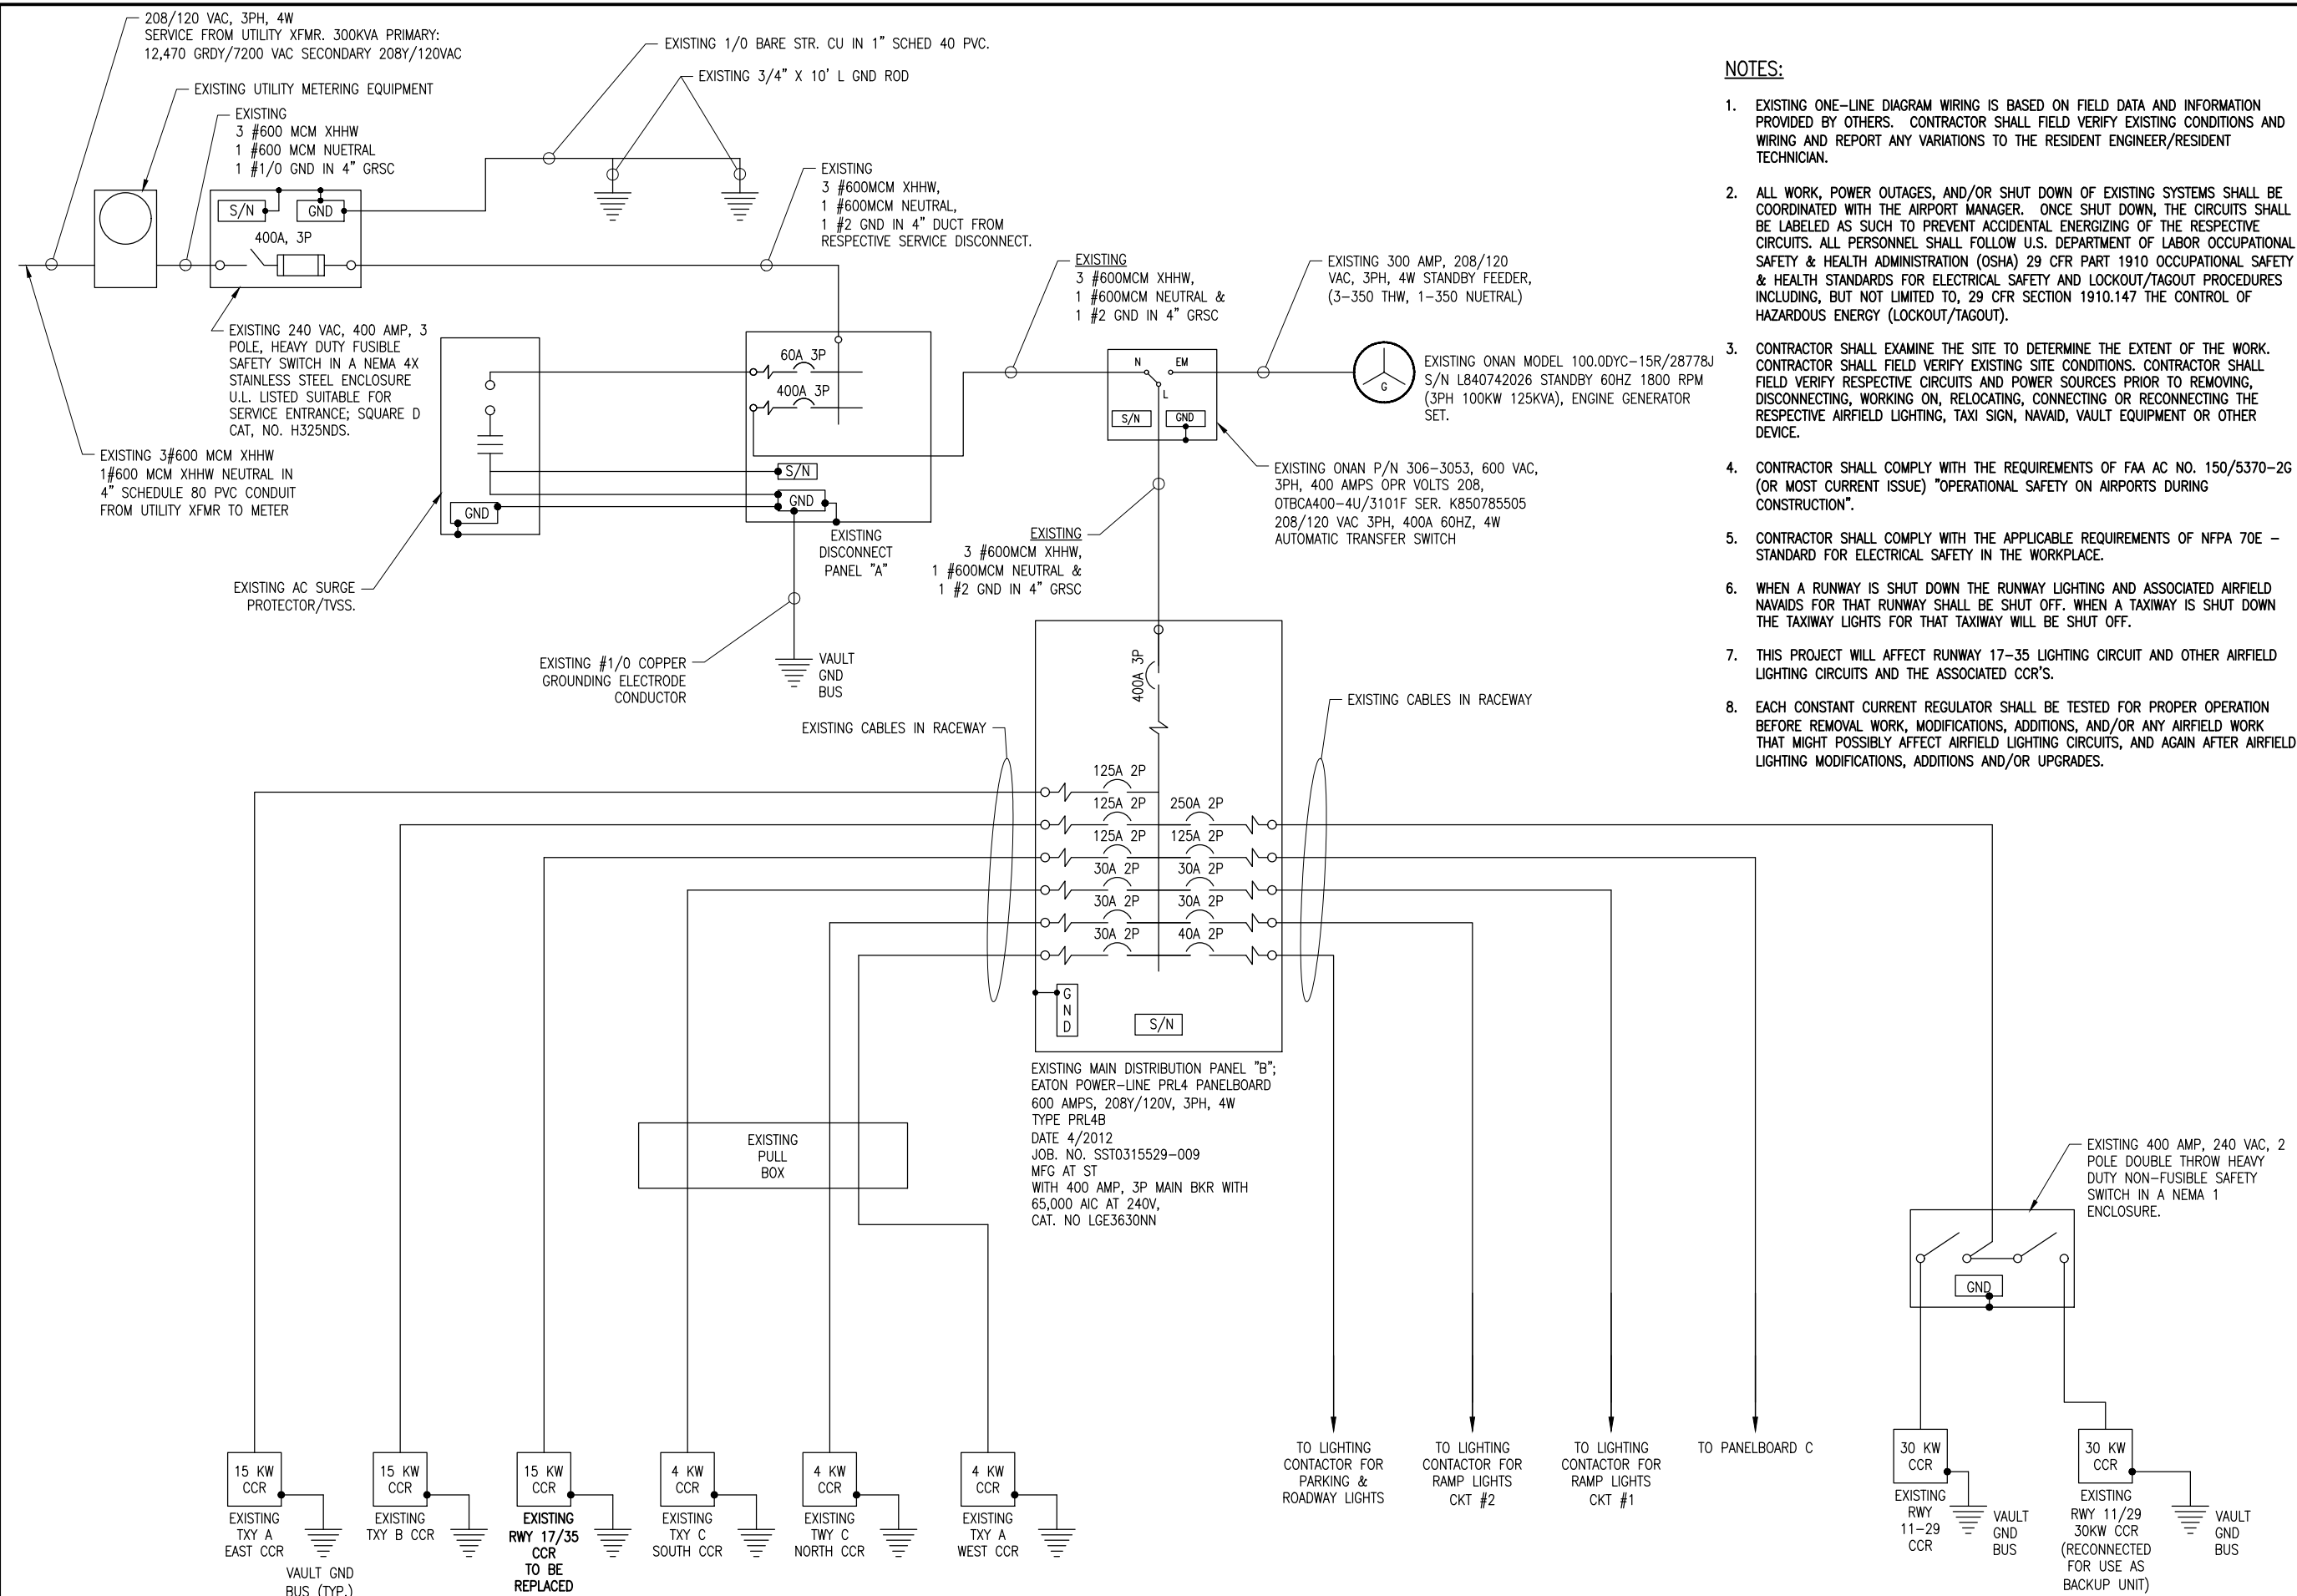

EXISTING ELECTRICAL ONE-LINE DIAGRAM FOR VAULT



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-601-LINE.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

EXISTING  
ELECTRICAL  
ONE-LINE DIAGRAM  
FOR VAULT AND  
AIRFIELD

FOR BID

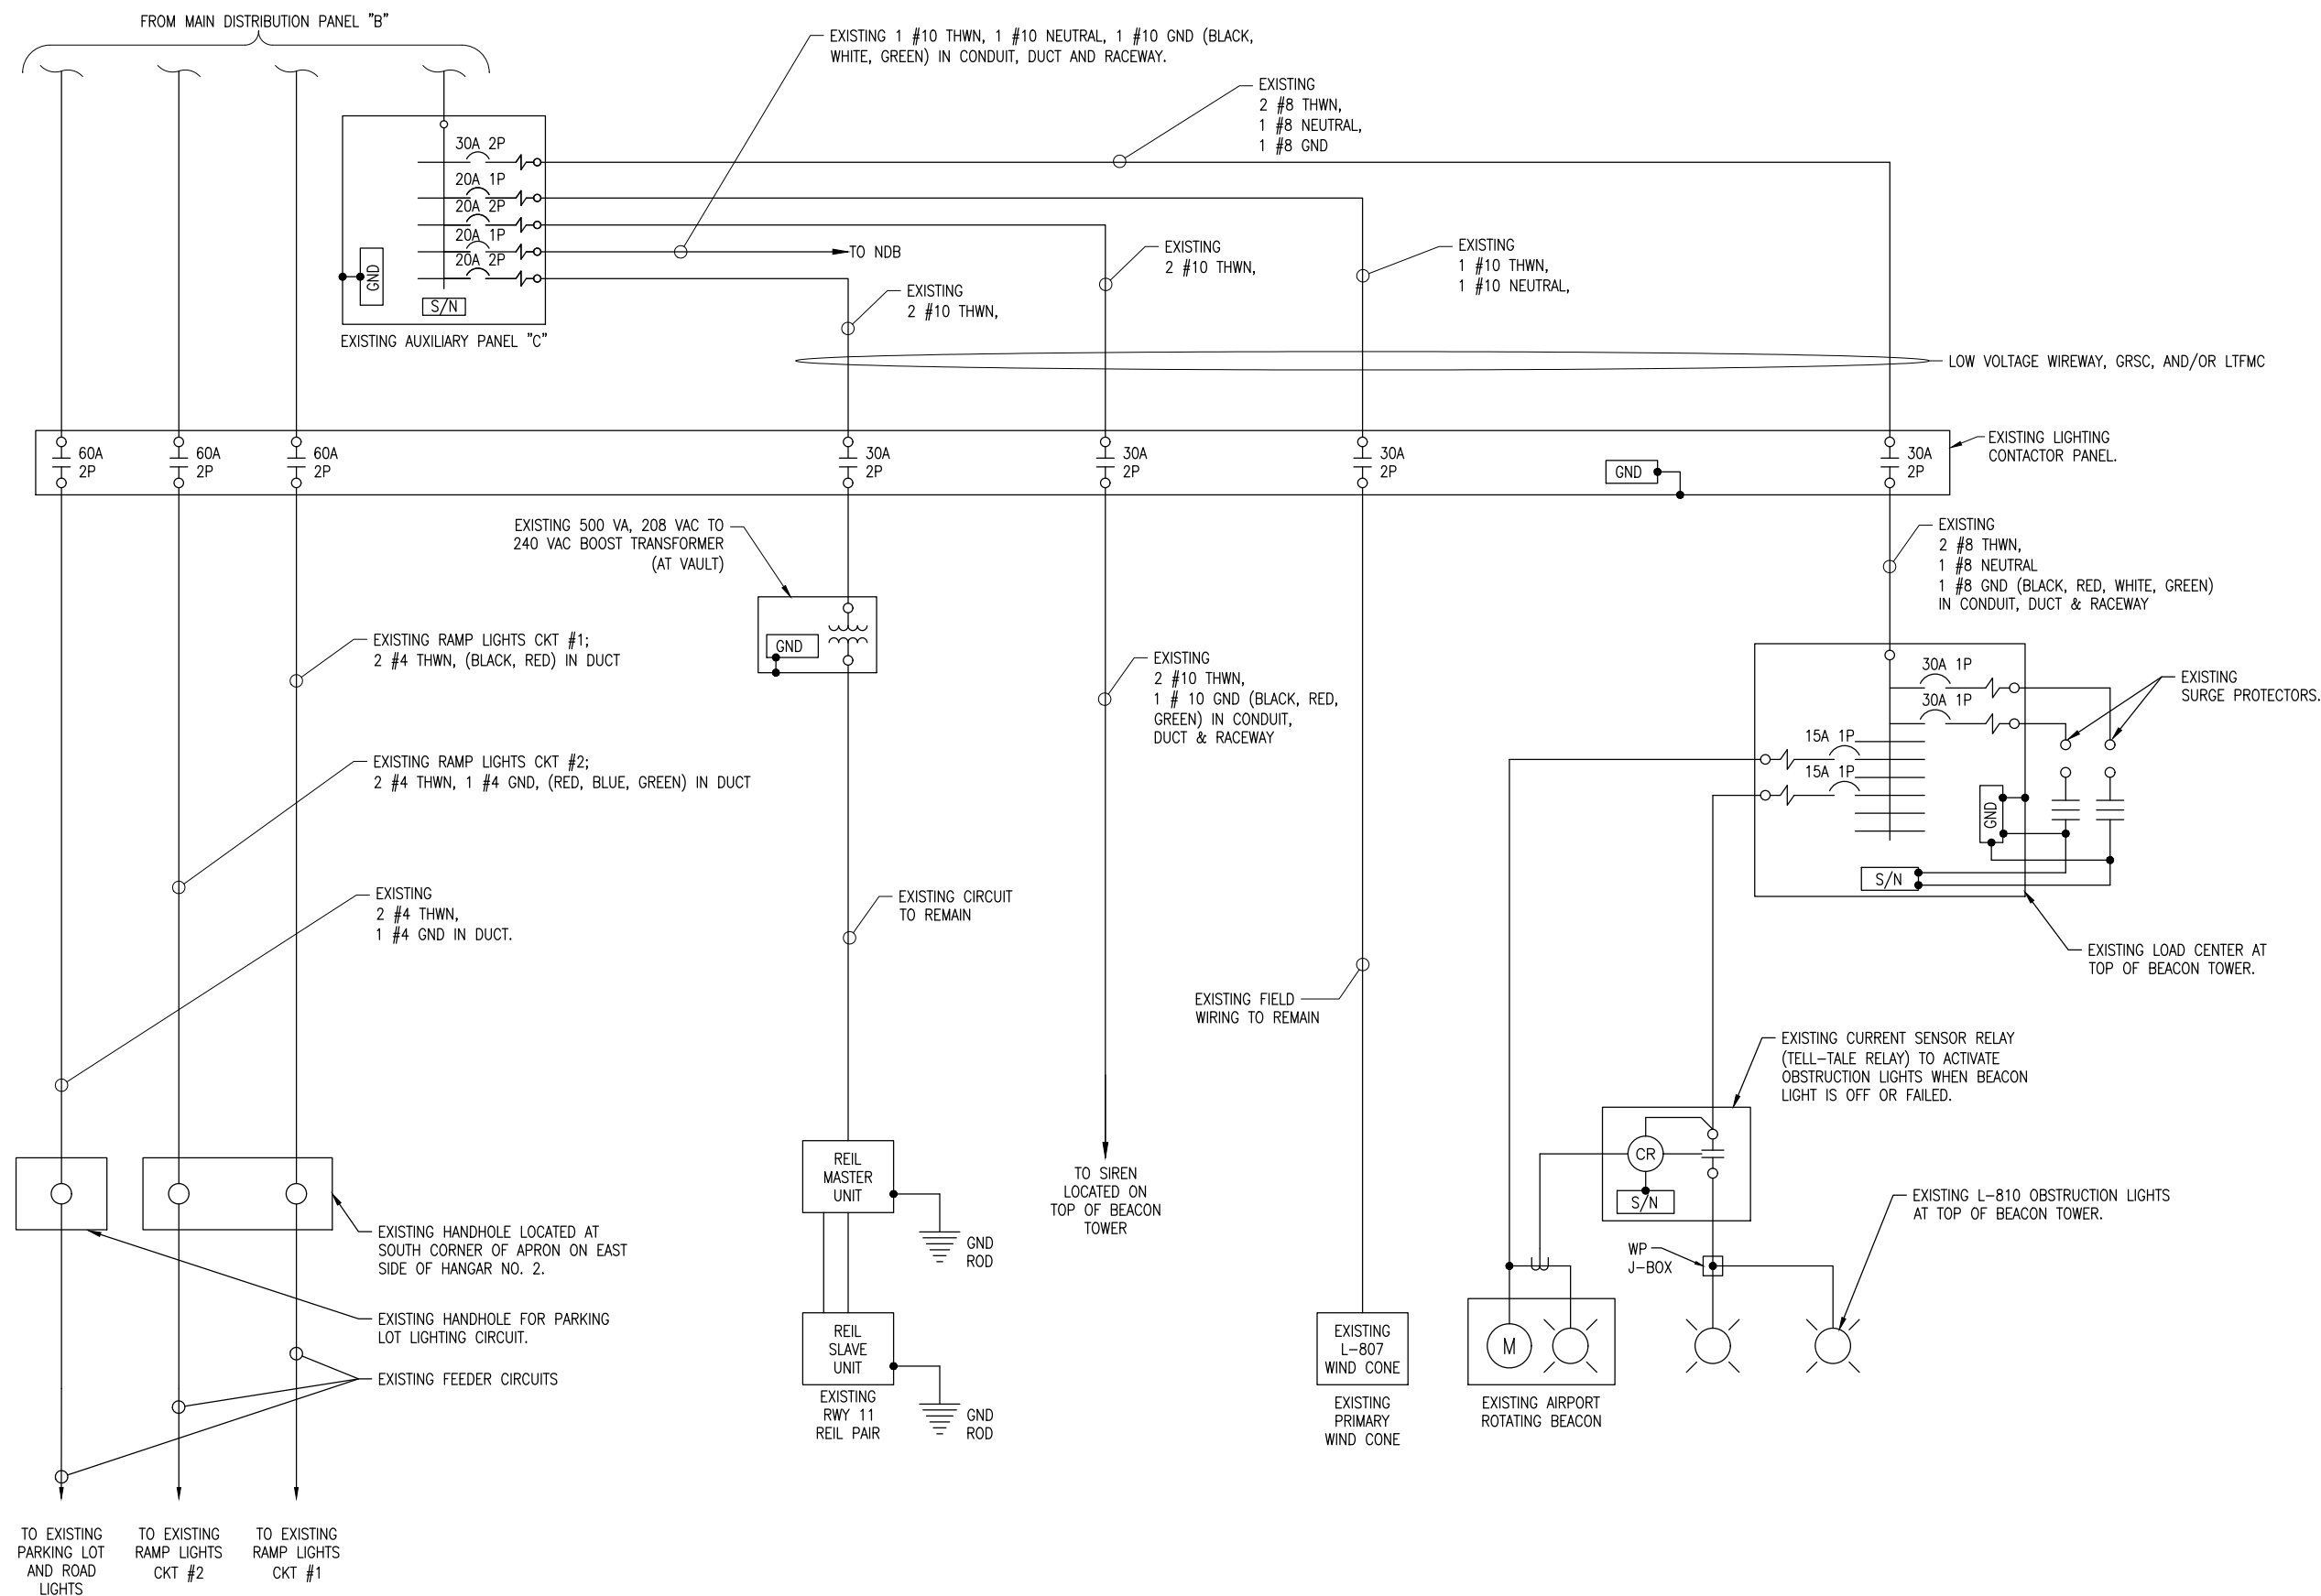


EXISTING ELECTRICAL ONE-LINE DIAGRAM FOR VAULT AND AIRFIELD



ST. LOUIS REGIONAL AIRPORT

8 Terminal Drive  
East Alton, Illinois 62024



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV


ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-605.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

PROPOSED  
ELECTRICAL ONE  
LINE FOR RWY 17-35  
CCR

**NOTES**

- ALL VAULT WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT MANAGEMENT. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- ALL ELECTRICAL EQUIPMENT AND MATERIALS SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70 - NATIONAL ELECTRICAL CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, INTERTEK TESTING SERVICES VERIFICATION/ETL LISTING, (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
- ALL CONDUCTORS/WIRING SHALL BE COPPER.
- PROVIDE LOCKOUT STATION WITH 10 LOCKOUT PADLOCKS, EACH WITH A DIFFERENT KEY, 5 LOCKOUT HASPS TO ACCOMMODATE MULTIPLE PADLOCKS, AND 100 LOCKOUT TAGS IN COMPLIANCE WITH OSHA STANDARD 1910.147.
- HIGH VOLTAGE CIRCUITS (AIRFIELD LIGHTING 5000 VOLT SERIES CIRCUITS OR OTHER CIRCUITS RATED ABOVE 600 VOLTS) AND LOW VOLTAGE CIRCUITS (RATED 600 VOLTS AND BELOW) SHALL NOT BE INSTALLED IN THE SAME WIREWAY, CONDUIT, HANDHOLE, JUNCTION BOX, OR RACEWAY.
- LTFMC DENOTES LIQUID TIGHT FLEXIBLE METAL CONDUIT UL LISTED, SUNLIGHT RESISTANT, & SUITABLE FOR GROUNDING. LIQUID TIGHT FLEXIBLE METAL CONDUIT AND ASSOCIATED FITTINGS SHALL BE U.L. LISTED TO MEET THE REQUIREMENTS OF NEC 350.6. LIQUID TIGHT FLEXIBLE METAL CONDUIT THAT IS USED FOR FLEXIBILITY (INCLUDING CONNECTIONS TO CCR'S & TRANSFORMERS) SHALL REQUIRE AN EXTERNAL BONDING JUMPER OR INTERNAL EQUIPMENT GROUNDING CONDUCTOR PER NEC 350.60. DO NOT INSTALL LTFMC THAT IS NOT UL LISTED. CONFIRM LTFMC BEARS THE UL LABEL PRIOR TO INSTALLATION.
- COLOR CODE PHASE AND NEUTRAL CONDUCTOR INSULATION FOR NO. 6 AWG OR SMALLER. PROVIDE COLORED INSULATION OR COLORED MARKING TAPE FOR PHASE AND NEUTRAL CONDUCTORS FOR NO. 4 AWG AND LARGER. INSULATED GROUND CONDUCTORS SHALL HAVE GREEN COLORED INSULATION FOR ALL CONDUCTOR AWG AND/OR KCMIL TO COMPLY WITH NEC 250.119. NEUTRAL CONDUCTORS SHALL HAVE WHITE COLOR INSULATION FOR NO. 6 AWG OR SMALLER TO MEET THE REQUIREMENTS OF NEC 200.6. STANDARD COLORS FOR POWER WIRING AND BRANCH CIRCUITS SHALL BE AS FOLLOWS:  
  
208/120 V, 3 PHASE, 3 WIRE  
PHASE A - BLACK  
PHASE B - RED  
PHASE C - BLUE  
NEUTRAL - WHITE  
GROUND - GREEN
- EQUIPMENT AND MATERIALS NOT LABELED AS "EXISTING" ARE NEW.

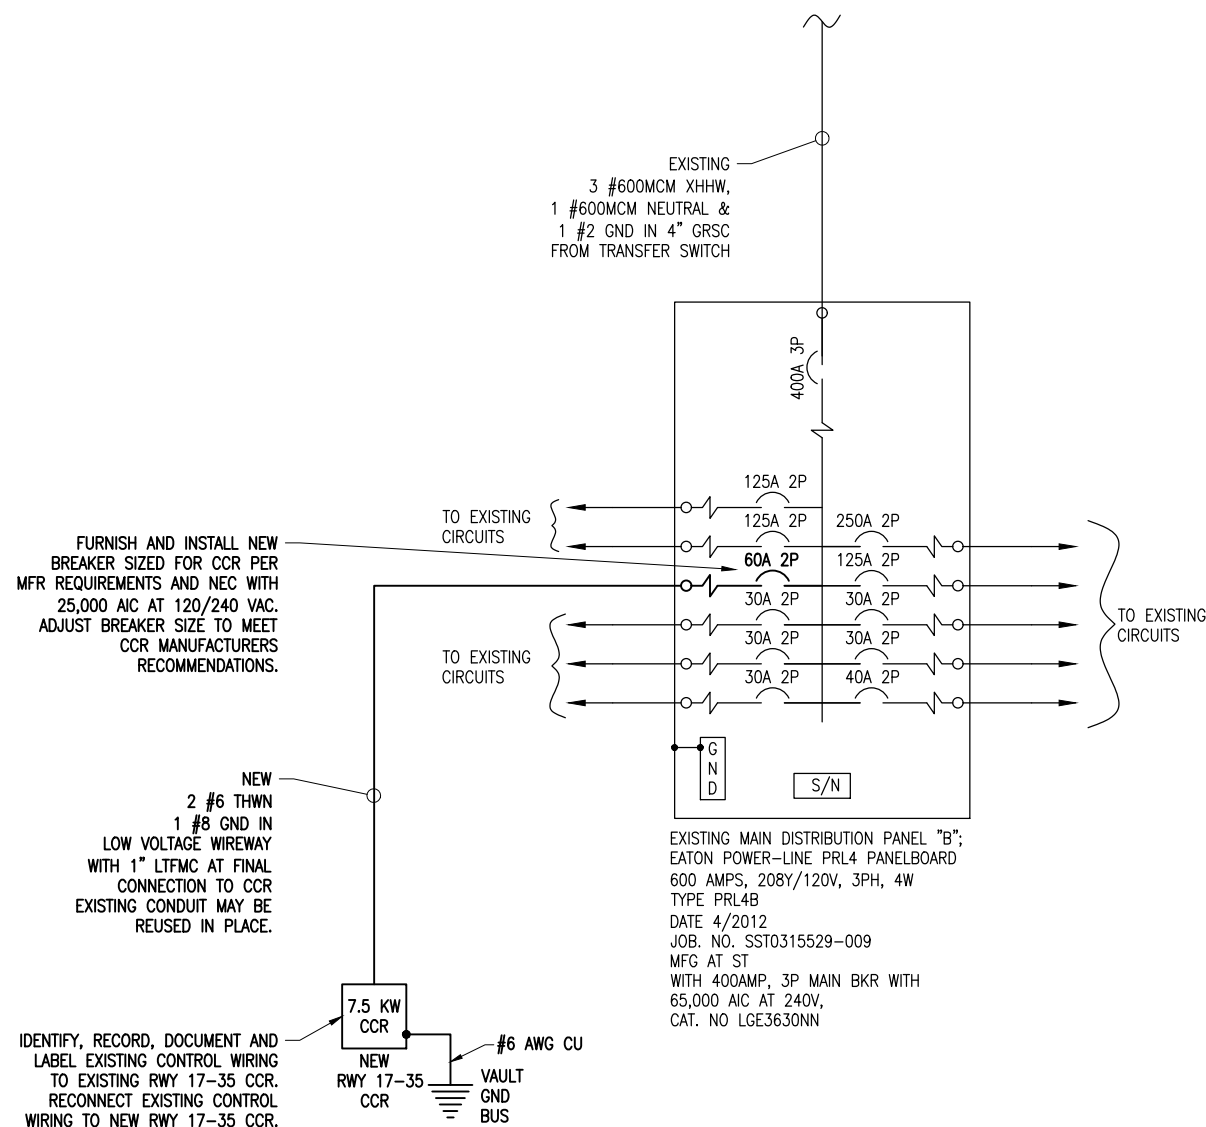

**PROPOSED ELECTRICAL ONE-LINE DIAGRAM FOR RUNWAY 17-35 CCR**

**FOR BID**





*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-602.DWG

DESIGN BY: KNL 03/18/2021

DRAWN BY: CWS 03/18/2021


REVIEWED BY: KNL 03/18/2021

SHEET TITLE

EXISTING HIGH  
VOLTAGE WIRING  
SCHEMATIC FOR  
RUNWAY 11-29

NOTES:

- KEEP ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS COORDINATED WITH THE AIRPORT MANAGER/DIRECTOR AND RESIDENT ENGINEER/TECHNICIAN. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- EXAMINE THE SITE TO CONFIRM AND FIELD VERIFY EXISTING SITE CONDITIONS.
- VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES FOR RESPECTIVE SYSTEMS PRIOR TO REMOVING, DISCONNECTING, WORKING ON, RELOCATING, RECONNECTING, AND/OR INSTALLING THE RESPECTIVE AIRFIELD LIGHTING, TAXI SIGN, NAVAID, VAULT EQUIPMENT, OR OTHER DEVICES. THE CONTRACTOR WILL NEED TO EXERCISE CAUTION WHEN WORKING IN THE VAULT AND ON THE AIRFIELD. CONTRACTOR SHALL REPORT ANY VARIATIONS, DEFICIENCIES, AND/OR APPARENT SAFETY CONCERNS TO THE PROJECT ENGINEER AND THE RESIDENT PROJECT REPRESENTATIVE. CONTRACTOR SHALL FOLLOW LOCKOUT/TAGOUT PROCEDURES FOR SAFETY PERSONNEL.
- IDENTIFY EACH RESPECTIVE CIRCUIT PRIOR TO PERFORMING WORK ON THAT CIRCUIT.
- NOTE THE EXISTING AIRPORT ELECTRICAL VAULT HAS APPARENT NATIONAL ELECTRICAL CODE WORKING CLEARANCE VIOLATIONS WHICH MIGHT CAUSE UNSAFE WORKING CONDITIONS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND CIRCUITS. CONTRACTOR WILL NEED TO EXERCISE CAUTION WHEN WORKING IN THE VAULT AND ON THE AIRFIELD.
- NEVER REMOVE OR INSERT A CUTOUT WITH THE CIRCUIT ENERGIZED. SHUTOFF CIRCUITS PRIOR TO PULLING OR INSERTING A SERIES PLUG CUTOUT.
- THE RESPECTIVE PERSONNEL PERFORMING AIRFIELD LIGHTING WORK, VAULT WORK, AND/OR TESTS SHALL BE FAMILIAR WITH, AND QUALIFIED TO WORK ON, 5000 VOLT AIRFIELD LIGHTING SERIES CIRCUITS, CONSTANT CURRENT REGULATORS, AND ASSOCIATED AIRPORT ELECTRICAL VAULT EQUIPMENT.
- EXERCISE CAUTION, PRACTICE SAFETY, AND DISCONNECT THE SERIES CIRCUITS FROM THE RESPECTIVE CONSTANT CURRENT REGULATORS, AS APPLICABLE WHEN PERFORMING WORK ON THE AIRFIELD LIGHTING OR WORK THAT MIGHT AFFECT THE AIRFIELD LIGHTING. CONTRACTOR SHALL MAKE NECESSARY ARRANGEMENTS TO DISCONNECT POWER AND LOCKOUT CIRCUITS FOR PROTECTION OF PERSONNEL. EXISTING CCR'S DO NOT APPEAR TO HAVE CUTOUTS.
- OVERSEE AND CONDUCT TESTS FOR AREAS OF WORK WHERE THE RESPECTIVE CIRCUITS MIGHT BE AFFECTED. MEGGER TEST AND RECORD EXISTING SERIES CIRCUITS (WITH A CABLE INSULATION TESTER) PRIOR TO CABLE WORK OR ANY OTHER WORK THAT MIGHT POSSIBLY AFFECT AIRFIELD LIGHTING SYSTEMS, AND AGAIN AFTER AIRFIELD LIGHTING MODIFICATIONS, ADDITIONS, UPGRADES AND/OR OTHER WORK HAS BEEN COMPLETED. PROVIDE 5KV INSULATION TESTER FOR 5,000 VOLT SERIES CIRCUIT CABLES. ALSO TEST AND RECORD SERIES CIRCUIT LOOP RESISTANCE WITH AN OHMMETER. PROVIDE COPY OF TEST RESULTS TO THE ENGINEER OF RECORD (EOR) WITHIN 5 DAYS OF CONDUCTING TESTS.
- RESPECTIVE CCR'S SHALL BE TESTED FOR PROPER OPERATION BEFORE REMOVAL WORK, MODIFICATIONS, ADDITIONS AND/OR ANY AIRFIELD WORK THAT MIGHT AFFECT LIGHTING CIRCUITS AND AGAIN AFTER THE AIRFIELD WORK AND ADDITIONS HAVE BEEN COMPLETED. CONTRACTOR SHALL TEST AND RECORD THE INPUT CURRENT AND OUTPUT CURRENT FOR EACH CONSTANT CURRENT REGULATOR IN THE AUTOMATIC AND MANUAL MODES OF OPERATION. PROVIDE A TRUE RMS AMMETER FOR CURRENT MEASUREMENTS. CONTRACTOR SHALL REPORT CONCERNS AND/OR DEFICIENCIES TO THE RESIDENT PROJECT REPRESENTATIVE AND THE ENGINEER OF RECORD (EOR). WRITTEN TEST RESULTS SHALL BE PROVIDED TO THE RESIDENT PROJECT REPRESENTATIVE AND THE ENGINEER OF RECORD (EOR).
- FURNISH AND INSTALL UL LISTED FIRE STOP MATERIAL AT EACH SERIES PLUG CUTOUT ENCLOSURE CONDUIT ENTRY AND EXIT.

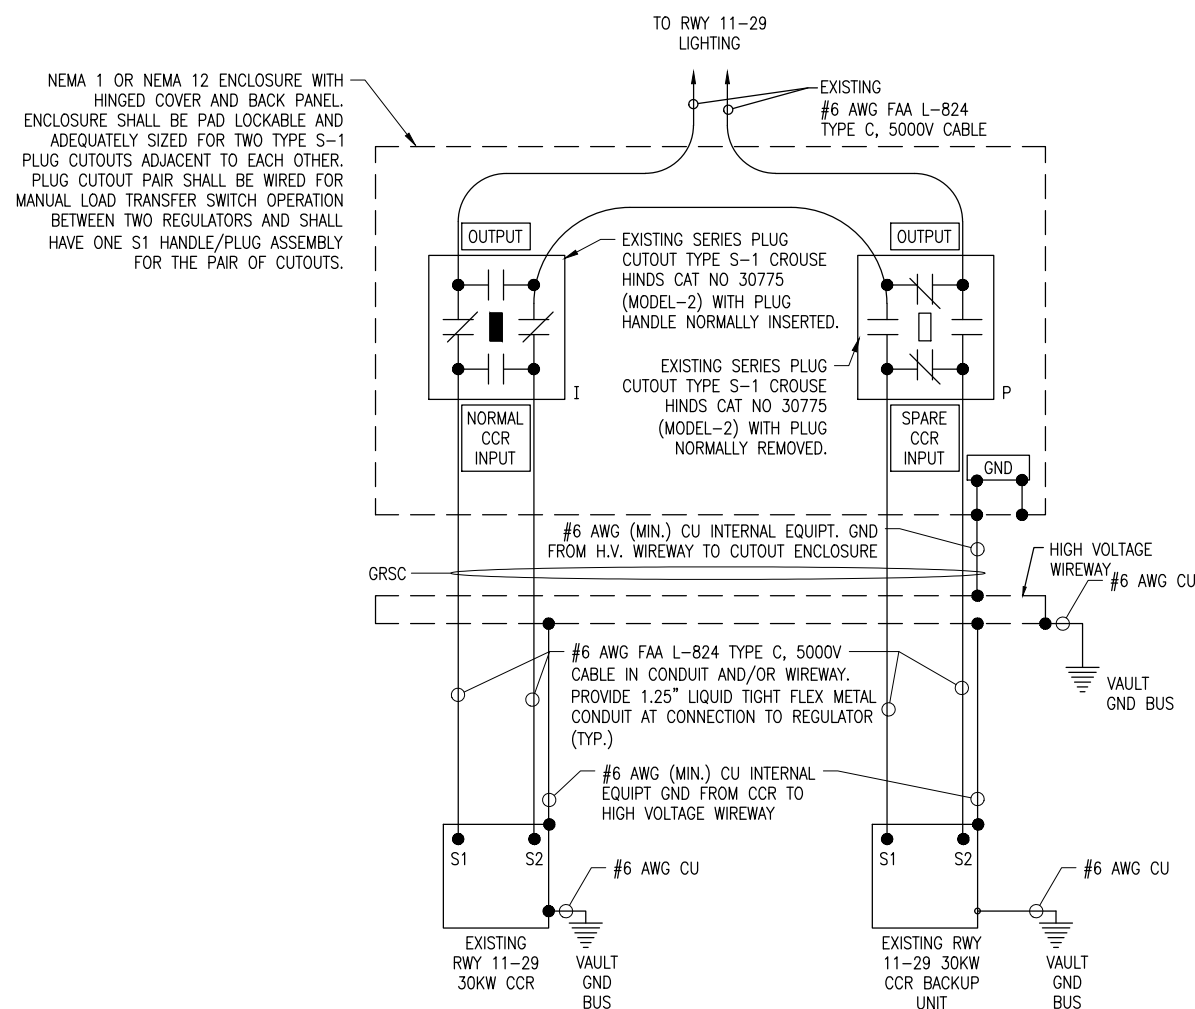

EXISTING VOLTAGE WIRING SCHEMATIC FOR RUNWAY 11-29

LEGEND

- "I" DENOTES PLUG CUTOUT WITH PLUG INSERTED
- "P" DENOTES PLUG CUTOUT WITH PLUG PULLED
- "CCR" DENOTES CONSTANT CURRENT REGULATOR



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
PROJECT NO: 17A008504  
CAD FILE: E-603.DWG  
DESIGN BY: KNL 03/18/2021  
DRAWN BY: CWS 03/18/2021  
REVIEWED BY: KNL 03/18/2021

SHEET TITLE

EXISTING HIGH  
VOLTAGE WIRING  
SCHEMATIC FOR  
RWY 17-35 & TWYS

FOR BID

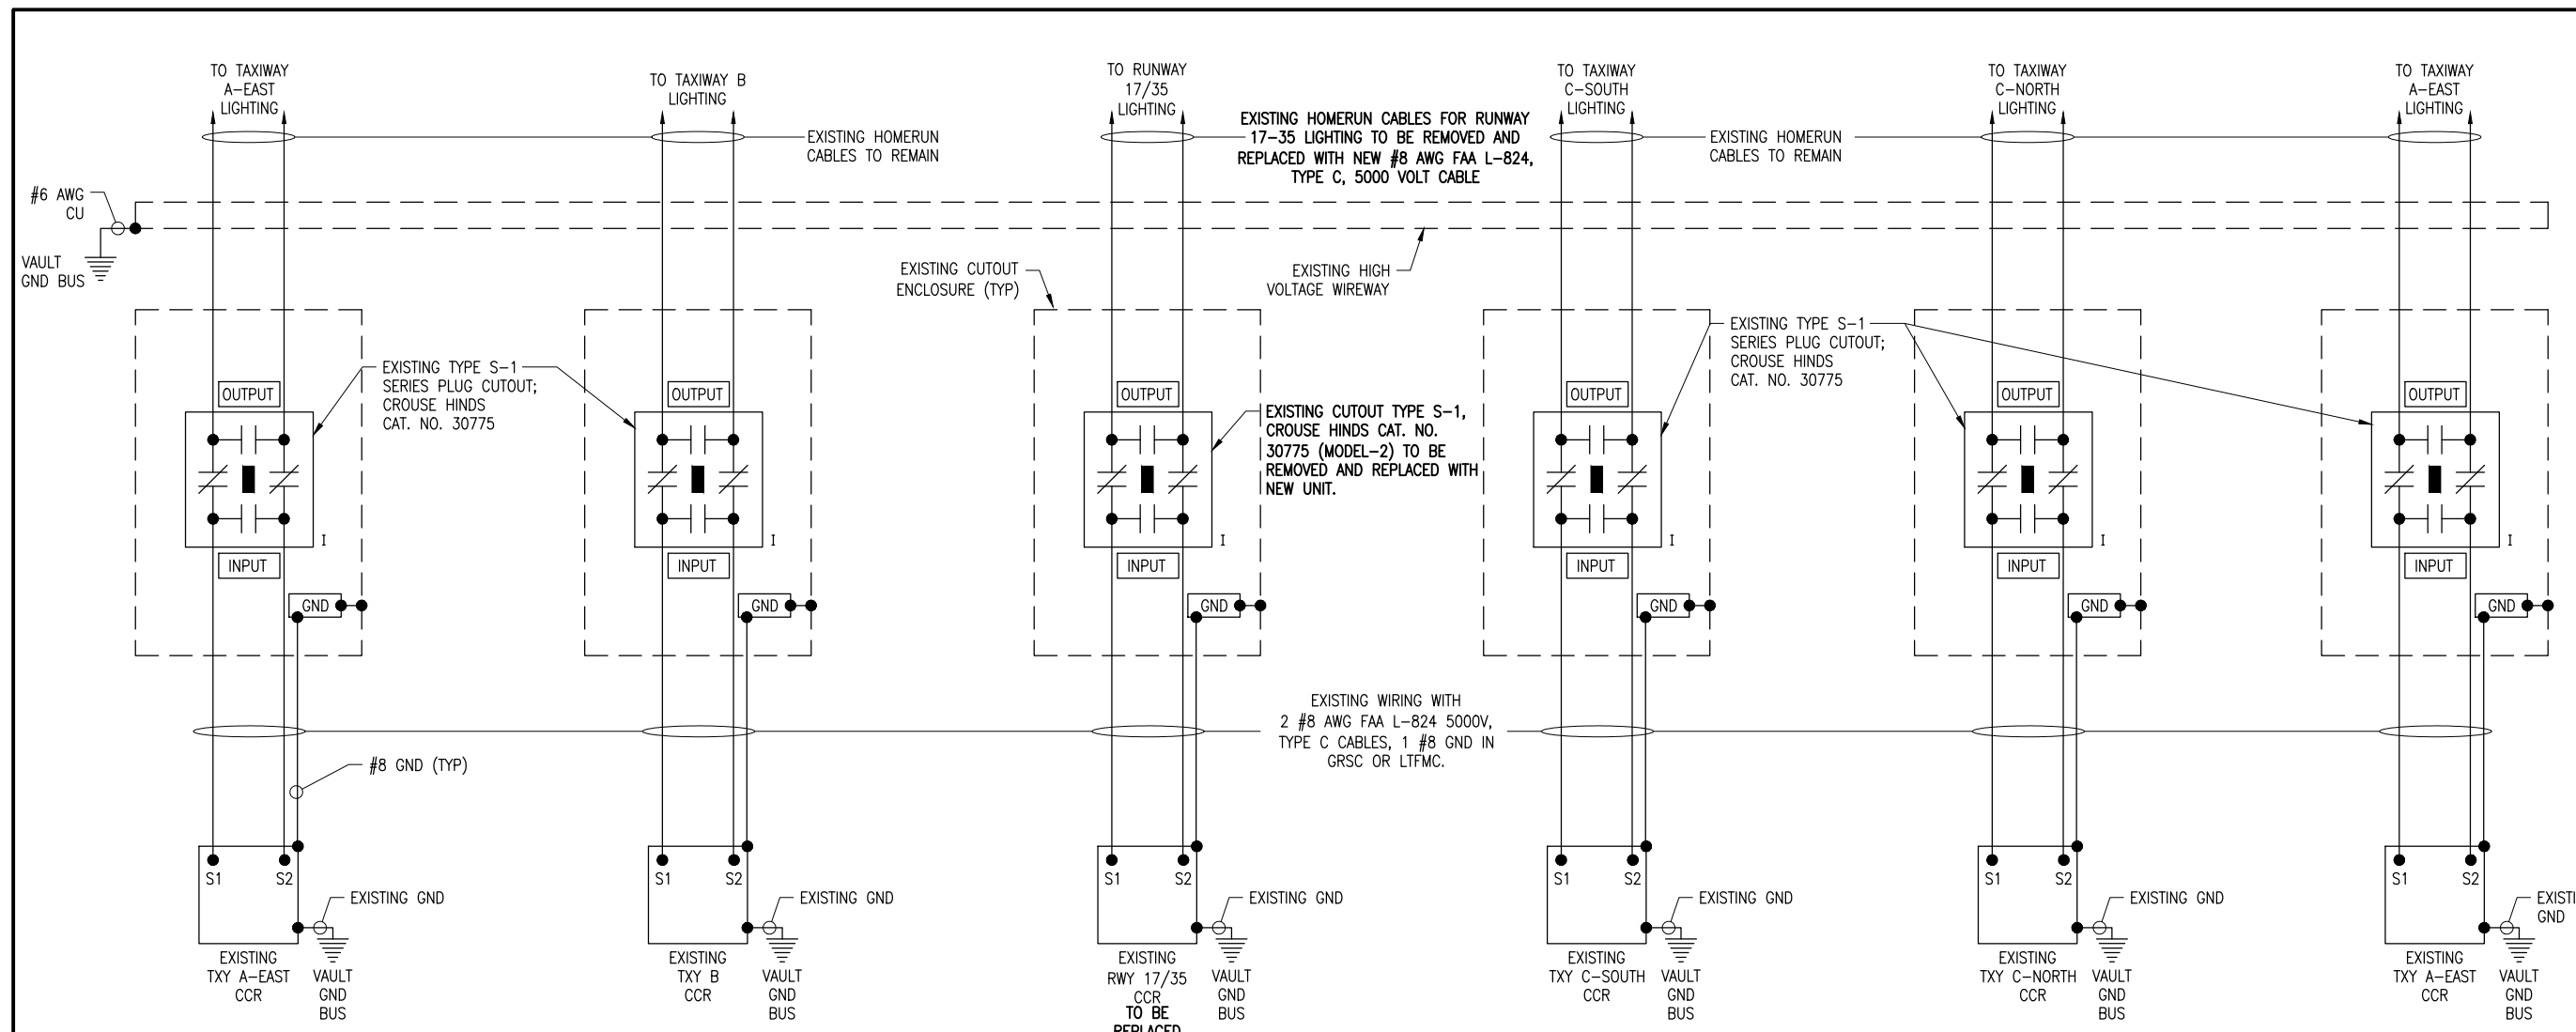

EXISTING HIGH VOLTAGE WIRING SCHEMATIC FOR RUNWAY 17-35 & TAXIWAYS

- LEGEND**
- "I" DENOTES PLUG CUTOUT WITH PLUG INSERTED
  - "P" DENOTES PLUG CUTOUT WITH PLUG PULLED
  - "CCR" DENOTES CONSTANT CURRENT REGULATOR

**NOTES:**

1. KEEP ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS COORDINATED WITH THE AIRPORT MANAGER/DIRECTOR AND RESIDENT ENGINEER/TECHNICIAN. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
2. EXAMINE THE SITE TO CONFIRM AND FIELD VERIFY EXISTING SITE CONDITIONS.
3. VERIFY RESPECTIVE CIRCUITS AND POWER SOURCES FOR RESPECTIVE SYSTEMS PRIOR TO REMOVING, DISCONNECTING, WORKING ON, RELOCATING, RECONNECTING, AND/OR INSTALLING THE RESPECTIVE AIRFIELD LIGHTING, TAXI SIGN, NAVAID, VAULT EQUIPMENT, OR OTHER DEVICES. THE CONTRACTOR WILL NEED TO EXERCISE CAUTION WHEN WORKING IN THE VAULT AND ON THE AIRFIELD. CONTRACTOR SHALL REPORT ANY VARIATIONS, DEFICIENCIES, AND/OR APPARENT SAFETY CONCERNS TO THE PROJECT ENGINEER AND THE RESIDENT PROJECT REPRESENTATIVE. CONTRACTOR SHALL FOLLOW LOCKOUT/TAGOUT PROCEDURES FOR SAFETY PERSONNEL.
4. IDENTIFY EACH RESPECTIVE CIRCUIT PRIOR TO PERFORMING WORK ON THAT CIRCUIT.
5. NOTE THE EXISTING AIRPORT ELECTRICAL VAULT HAS APPARENT NATIONAL ELECTRICAL CODE WORKING CLEARANCE VIOLATIONS WHICH MIGHT CAUSE UNSAFE WORKING CONDITIONS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND CIRCUITS. CONTRACTOR WILL NEED TO EXERCISE CAUTION WHEN WORKING IN THE VAULT AND ON THE AIRFIELD.
6. NEVER REMOVE OR INSERT A CUTOUT WITH THE CIRCUIT ENERGIZED. SHUTOFF CIRCUITS PRIOR TO PULLING OR INSERTING A SERIES PLUG CUTOUT.
7. THE RESPECTIVE PERSONNEL PERFORMING AIRFIELD LIGHTING WORK, VAULT WORK, AND/OR TESTS SHALL BE FAMILIAR WITH, AND QUALIFIED TO WORK ON, 5000 VOLT AIRFIELD LIGHTING SERIES CIRCUITS, CONSTANT CURRENT REGULATORS, AND ASSOCIATED AIRPORT ELECTRICAL VAULT EQUIPMENT.
8. EXERCISE CAUTION, PRACTICE SAFETY, AND DISCONNECT THE SERIES CIRCUITS FROM THE RESPECTIVE CONSTANT CURRENT REGULATORS, AS APPLICABLE WHEN PERFORMING WORK ON THE AIRFIELD LIGHTING OR WORK THAT MIGHT AFFECT THE AIRFIELD LIGHTING. CONTRACTOR SHALL MAKE NECESSARY ARRANGEMENTS TO DISCONNECT POWER AND LOCKOUT CIRCUITS FOR PROTECTION OF PERSONNEL. EXISTING CCR'S DO NOT APPEAR TO HAVE CUTOUTS.
9. OVERSEE AND CONDUCT TESTS FOR AREAS OF WORK WHERE THE RESPECTIVE CIRCUITS MIGHT BE AFFECTED. MEGGER TEST AND RECORD EXISTING SERIES CIRCUITS (WITH A CABLE INSULATION TESTER) PRIOR TO CABLE WORK OR ANY OTHER WORK THAT MIGHT POSSIBLY AFFECT AIRFIELD LIGHTING SYSTEMS, AND AGAIN AFTER AIRFIELD LIGHTING MODIFICATIONS, ADDITIONS, UPGRADES AND/OR OTHER WORK HAS BEEN COMPLETED. PROVIDE 5KV INSULATION TESTER FOR 5,000 VOLT SERIES CIRCUIT CABLES. ALSO TEST AND RECORD SERIES CIRCUIT LOOP RESISTANCE WITH AN OHMMETER. PROVIDE COPY OF TEST RESULTS TO THE ENGINEER OF RECORD (EOR) WITHIN 5 DAYS OF CONDUCTING TESTS.
10. RESPECTIVE CCR'S SHALL BE TESTED FOR PROPER OPERATION BEFORE REMOVAL WORK, MODIFICATIONS, ADDITIONS AND/OR ANY AIRFIELD WORK THAT MIGHT AFFECT LIGHTING CIRCUITS AND AGAIN AFTER THE AIRFIELD WORK AND ADDITIONS HAVE BEEN COMPLETED. CONTRACTOR SHALL TEST AND RECORD THE INPUT CURRENT AND OUTPUT CURRENT FOR EACH CONSTANT CURRENT REGULATOR IN THE AUTOMATIC AND MANUAL MODES OF OPERATION. PROVIDE A TRUE RMS AMMETER FOR CURRENT MEASUREMENTS. CONTRACTOR SHALL REPORT CONCERNS AND/OR DEFICIENCIES TO THE RESIDENT PROJECT REPRESENTATIVE AND THE ENGINEER OF RECORD (EOR). WRITTEN TEST RESULTS SHALL BE PROVIDED TO THE RESIDENT PROJECT REPRESENTATIVE AND THE ENGINEER OF RECORD (EOR).
11. FURNISH AND INSTALL UL LISTED FIRE STOP MATERIAL AT EACH SERIES PLUG CUTOUT ENCLOSURE CONDUIT ENTRY AND EXIT.

APR 19, 2021 2:49 PM HERND01562  
I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHEETE-603



*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
RUNWAY 17-35  
PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
IDA No: ALN-4812

Contract No. SR095

NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021

PROJECT NO: 17A008504

CAD FILE: E-606-SCM.DWG

DESIGN BY: KNL 03/18/2021

DRAWN BY: CWS 03/18/2021

REVIEWED BY: KNL 03/18/2021

SHEET TITLE

PROPOSED HIGH  
VOLTAGE  
SCHEMATIC FOR  
RWY 17-35 CCR

LEGEND PLATE SCHEDULE	
DEVICE	LABEL
RUNWAY 17-35 CCR	RUNWAY 17-35
RUNWAY 17-35 CCR	CAUTION OPERATE CUTOUT WITH CCR SHUT OFF
CUTOUT ENCLOSURE FOR RUNWAY 17-35	RUNWAY 17-35


**LEGEND NOTES:**

- LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH BLACK LETTERS ON A WHITE BACKGROUND UNLESS NOTED OTHERWISE. SECURE WITH WEATHERPROOF ADHESIVE AND MACHINE SCREWS. FURNISH ADDITIONAL LEGEND PLATES WHERE REQUIRED BY CODE, FOR ADDITIONAL EQUIPMENT, AS DETAILED HEREIN ON THE PLANS, AND AS NOTED IN THE SPECIAL PROVISION SPECIFICATIONS.
- FURNISH & INSTALL A WEATHERPROOF WARNING LABEL FOR EACH SAFETY SWITCH, PANELBOARD, LOAD CENTER, CUTOUT, & CONTROL PANEL TO WARN PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110.16 "ARC-FLASH HAZARD WARNING".



**"DANGER - HIGH VOLTAGE" SIGN**

FURNISH AND INSTALL "DANGER - HIGH VOLTAGE" LABELS/SIGNS FOR EACH CUTOUT ENCLOSURE, EACH CONSTANT CURRENT REGULATOR, AND THE HIGH VOLTAGE WIREWAY, TO COMPLY WITH FAA AC 150/5340-26C "MAINTENANCE OF AIRPORT VISUAL AID FACILITIES". LABELS SHALL BE APPROXIMATELY 4" X 6" OR 5" X 7".

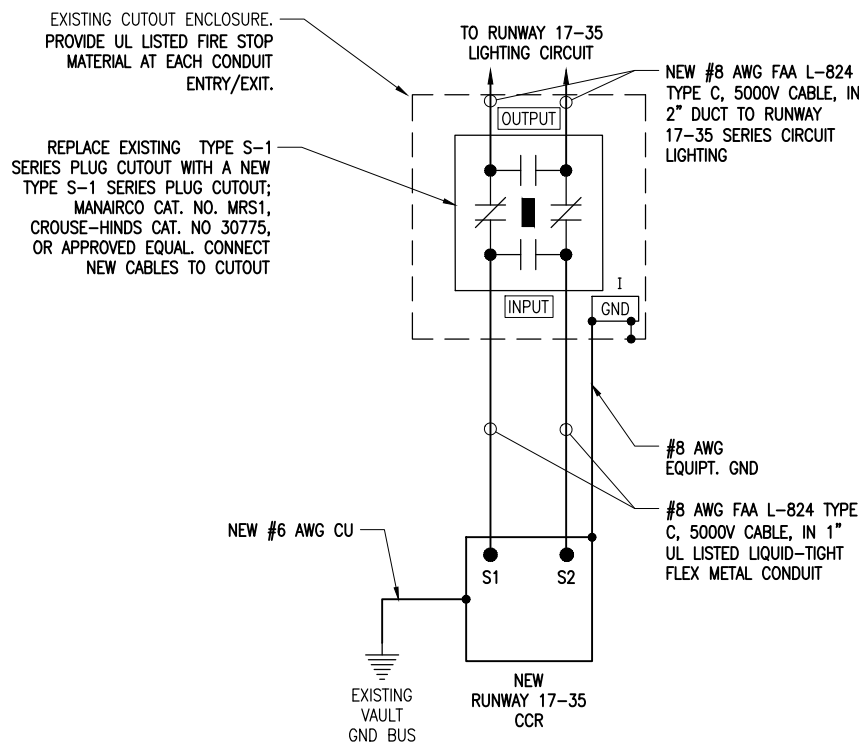

**PROPOSED HIGH VOLTAGE WIRING SCHEMATIC FOR RWY 17-35 CCR**

NOT TO SCALE

**NOTES:**

- ALL WORK, POWER OUTAGES, AND/OR SHUT DOWN OF EXISTING SYSTEMS SHALL BE COORDINATED WITH THE AIRPORT DIRECTOR AND THE RESPECTIVE FAA ATCT PERSONNEL. ONCE SHUT DOWN, THE CIRCUITS SHALL BE LABELED AS SUCH TO PREVENT ACCIDENTAL ENERGIZING OF THE RESPECTIVE CIRCUITS. ALL PERSONNEL SHALL FOLLOW U.S. DEPARTMENT OF LABOR OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA) 29 CFR PART 1910 OCCUPATIONAL SAFETY & HEALTH STANDARDS FOR ELECTRICAL SAFETY AND LOCKOUT/TAGOUT PROCEDURES INCLUDING, BUT NOT LIMITED TO, 29 CFR SECTION 1910.147 THE CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT).
- THE RESPECTIVE PERSONNEL PERFORMING AIRFIELD LIGHTING WORK, VAULT WORK, AND/OR TESTS SHALL BE FAMILIAR WITH, AND QUALIFIED TO WORK ON, 5000 VOLT AIRFIELD LIGHTING SERIES CIRCUITS, CONSTANT CURRENT REGULATORS, AND ASSOCIATED AIRPORT ELECTRICAL VAULT EQUIPMENT.
- CONTRACTOR SHALL EXERCISE CAUTION, PRACTICE SAFETY, AND DISCONNECT THE SERIES CIRCUITS FROM THE RESPECTIVE CONSTANT CURRENT REGULATORS, AS APPLICABLE WHEN PERFORMING WORK ON THE AIRFIELD LIGHTING OR WORK THAT MIGHT AFFECT THE AIRFIELD LIGHTING. CONTRACTOR SHALL MAKE NECESSARY ARRANGEMENTS TO DISCONNECT POWER AND LOCKOUT CIRCUITS FOR PROTECTION OF PERSONNEL.
- EQUIPMENT AND MATERIALS NOT LABELED AS EXISTING ARE NEW.
- SERIES PLUG CUTOUTS SHALL BE TYPE S-1, RATED 5000 VOLTS, 20-AMP. SERIES PLUG CUTOUTS SHALL BE RATED SUITABLE FOR NORMAL OPERATION WITH HANDLE REMOVED OR HANDLE INSERTED. CUTOUTS SHALL DISCONNECT THE INPUT FROM THE FROM THE OUTPUT, SHORT THE INPUT TERMINALS, AND SHORT THE OUTPUT TERMINALS WHEN THE HANDLE/PLUG IS REMOVED. SERIES PLUG CUTOUTS SHALL BE MANAIRCO CAT. NO MRS1, CROUSE-HINDS CAT. NO. 30775, OR APPROVED EQUAL. THE RESPECTIVE MANUFACTURER SHALL CERTIFY IN WRITING THAT THEIR CUTOUT IS SUITABLE AND RATED FOR THE RESPECTIVE APPLICATION.
- BOND EACH REGULATOR FRAME TO VAULT GROUND BUS WITH A DEDICATED #6 AWG COPPER BONDING JUMPER.
- MAINTAIN SEPARATION OF HIGH VOLTAGE WIRING (AIRFIELD LIGHTING 5000 VOLT SERIES CIRCUITS AND/OR OTHER CIRCUITS RATED ABOVE 600 VOLTS) FROM LOW VOLTAGE WIRING (RATED 600 VOLTS AND BELOW) TO COMPLY WITH NEC 300.3(C)(2). HIGH VOLTAGE AND LOW VOLTAGE WIRING SHALL NOT BE INSTALLED IN THE SAME RACEWAY, CONDUIT, WIREWAY, PULL BOX, SPLICE CAN, HANDHOLE, OR MANHOLE.
- PROVIDE PHENOLIC ENGRAVED LEGEND PLATES FOR EACH CONSTANT CURRENT REGULATOR NOTING THE RUNWAY AND/OR TAXIWAY SERVED.
- EXISTING RUNWAY 17-35 CCR SHALL BE REMOVED AND REPLACED WITH A NEW CCR. EXISTING RUNWAY 17-35 CCR SHALL BE RELOCATED TO A STORAGE AREA ON THE AIRPORT.
- PROVIDE A LOCKOUT STATION SUITABLE FOR WALL MOUNTING, WITH 10 LOCKOUT PADLOCKS EACH WITH A DIFFERENT KEY, 5 LOCKOUT HASPS TO ACCOMMODATE MULTIPLE PADLOCKS, AND 100 LOCKOUT TAGS. LOCKOUT STATION AND COMPONENTS SHALL COMPLY WITH OSHA STANDARD 1910.147. INCLUDE HARDWARE TO MOUNT ON THE VAULT INTERIOR WALL.
- FURNISH AND INSTALL UL LISTED FIRE STOP MATERIAL AT EACH SERIES PLUG CUTOUT ENCLOSURE (EXISTING AND/OR NEW) CONDUIT ENTRY AND EXIT.

**FOR BID**





*Kevin N. Lightfoot*

DATE SIGNED: 4/16/2021 LICENSE EXPIRES: 11/30/2021

REHABILITATE  
 RUNWAY 17-35  
 PAVEMENT & LIGHTING

SBG No: 3-17-SBGP-TBD  
 IDA No: ALN-4812

Contract No. SR095


NO.	DATE	DESCRIPTION		
		DES	DWN	REV

ISSUE: APRIL 16, 2021  
 PROJECT NO: 17A008504  
 CAD FILE: E-604.DWG  
 DESIGN BY: KNL 03/18/2021  
 DRAWN BY: CWS 03/18/2021  
 REVIEWED BY: KNL 03/18/2021

SHEET TITLE


SERIES CIRCUIT  
 CABLE TESTING  
 DETAILS

FOR BID

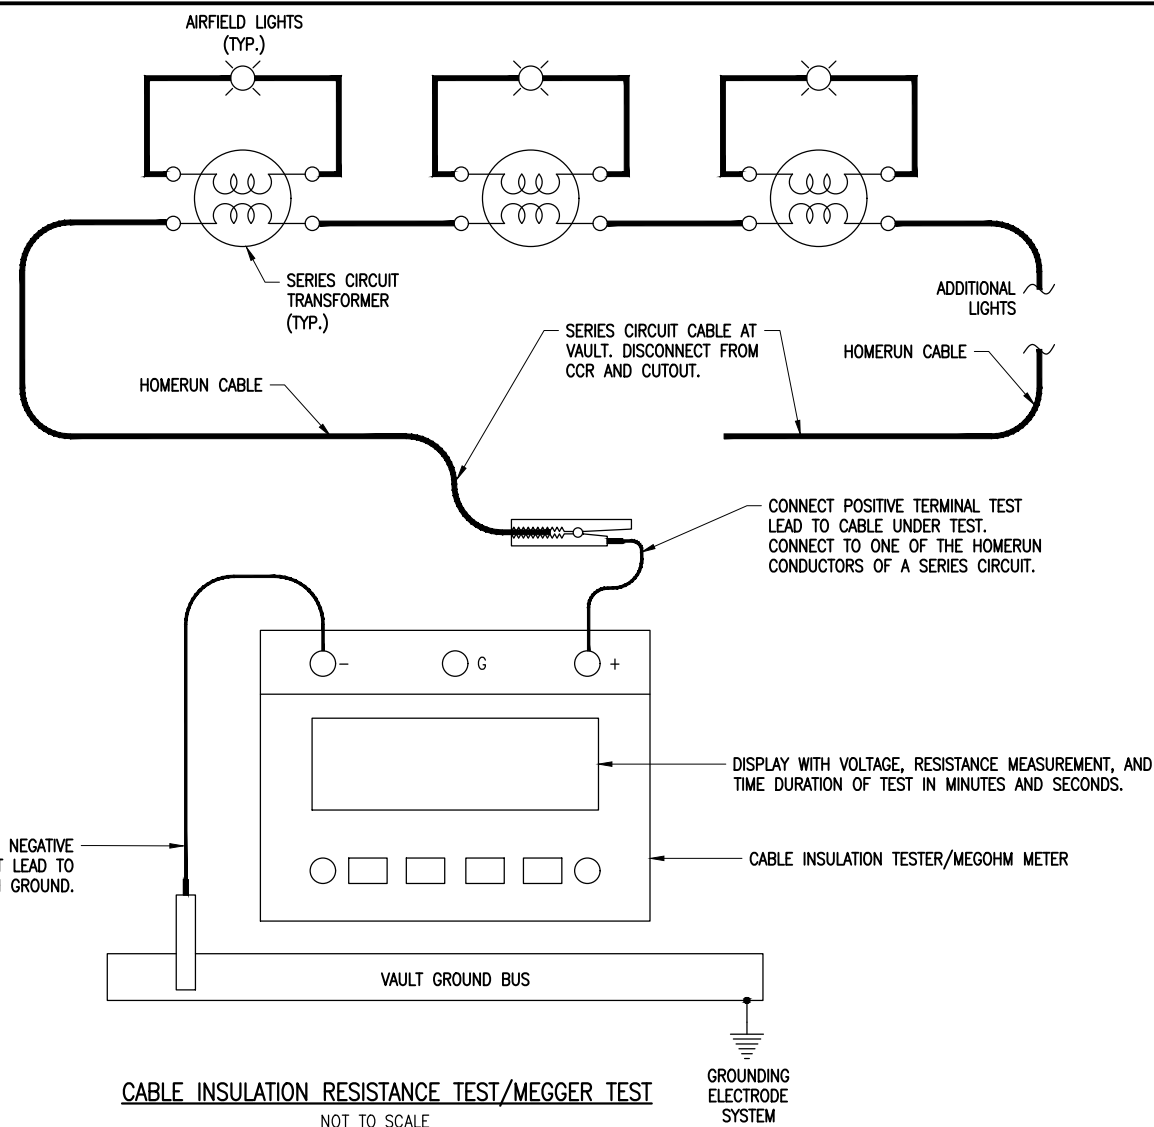

**CABLE INSULATION RESISTANCE TEST (MEGGER TEST) NOTES**

- PRIOR TO BEGINNING EXCAVATIONS, AIRFIELD LIGHTING MODIFICATIONS, CABLE INSTALLATION, AND/OR ANY OTHER WORK THAT MIGHT POSSIBLY AFFECT AIRFIELD LIGHTING CIRCUITS, ALL EXISTING SERIES CIRCUIT LIGHTING CABLES SHALL BE MEGGER TESTED WITH AN INSULATION RESISTANCE TESTER AND RECORDED AT THE RESPECTIVE AIRPORT ELECTRICAL VAULT.
- AFTER AIRFIELD LIGHTING MODIFICATIONS, ADDITIONS, UPGRADES, AND/OR OTHER WORK AND ADDITIONS HAVE BEEN COMPLETED ALL EXISTING SERIES CIRCUIT LIGHTING CABLES SHALL BE MEGGER TESTED WITH AN INSULATION RESISTANCE TESTER AND RECORDED AT THE RESPECTIVE AIRPORT ELECTRICAL VAULT.
- THE CONTRACTOR IS RESPONSIBLE TO EMPLOY THE SERVICES OF PERSONNEL QUALIFIED, FAMILIAR WITH, AND TRAINED TO PERFORM THE RESPECTIVE TESTS, AND QUALIFIED TO WORK ON 5000 VOLT AIRFIELD LIGHTING SERIES CIRCUITS, CONSTANT CURRENT REGULATORS, AND ASSOCIATED AIRPORT ELECTRICAL VAULT EQUIPMENT.
- INSULATION RESISTANCE TESTING EQUIPMENT FOR USE WITH 5,000 VOLT SERIES CIRCUIT CABLES SHALL USE AN INSULATION RESISTANCE TESTER CAPABLE OF TESTING THE CABLES AT 5,000 VOLTS. OLDER SERIES CIRCUIT CABLES AND/OR CABLES IN POOR CONDITION MAY REQUIRE THE TEST VOLTAGE TO BE PERFORMED AT A VOLTAGE LOWER THAN 5,000 VOLTS (EXAMPLE 1,000 VOLTS, 500 VOLTS, OR LESS THAN 500 VOLTS). THE RESPECTIVE TEST VOLTAGE SHALL BE RECORDED FOR EACH CABLE INSULATION RESISTANCE TEST RESULT.
- INSULATION RESISTANCE TESTING EQUIPMENT FOR USE WITH 600 VOLT RATED CABLES SHALL USE A 500 VOLT INSULATION RESISTANCE TESTER. THE RESPECTIVE TEST VOLTAGE SHALL BE RECORDED FOR EACH CABLE INSULATION RESISTANCE TEST RESULT.
- IT IS RECOMMENDED TO USE THE SAME INSULATION RESISTANCE TEST EQUIPMENT THROUGHOUT THE PROJECT TO ENSURE RELIABLE COMPARATIVE READINGS AT THE BEGINNING OF THE PROJECT AND AT THE COMPLETION OF THE PROJECT.
- DISCONNECT THE AIRFIELD LIGHTING SERIES CIRCUIT CABLES FROM THE CONSTANT CURRENT REGULATOR WHEN PERFORMING CABLE INSULATION RESISTANCE TESTS (MEGGER TESTS). TEST THE CABLES THAT GO TO THE AIRFIELD FOR THE RESPECTIVE AIRFIELD LIGHTING SERIES CIRCUIT. CONNECT THE CABLE INSULATION RESISTANCE TESTER TO ONE OF THE AIRFIELD LIGHTING SERIES CIRCUIT CABLES AND TO A GOOD GROUND IN THE AIRPORT ELECTRICAL VAULT SUCH AS THE AIRPORT VAULT GROUND BUS. CONDUCT THE CABLE INSULATION RESISTANCE TEST ON EACH RESPECTIVE CABLE FOR NOT LESS THAN 90 SECONDS. RECORD THE TEST RESULTS AT THE END OF THE TIME DURATION FOR THE TEST.
- FAA ADVISORY CIRCULAR 150/5340-26C MAINTENANCE OF AIRPORT VISUAL AID FACILITIES PROVIDES GUIDANCE ON INSULATION RESISTANCE TESTS. ALSO REFER TO THE USER MANUAL FOR THE RESPECTIVE CABLE INSULATION RESISTANCE TESTER. REASONABLY NEW SERIES CIRCUIT CABLES AND TRANSFORMERS WITH GOOD CONNECTIONS SHOULD READ 500 MEGA-OHMS TO 1,000 MEGA-OHMS OR HIGHER. THE READINGS SHOULD DECREASE WITH AGE. THE RESISTANCE VALUE DECLINES OVER THE SERVICE LIFE OF THE CIRCUIT; A 10-20 PERCENT DECLINE PER YEAR MAY BE CONSIDERED NORMAL. A YEARLY DECLINE OF 50 PERCENT (4 PERCENT MONTHLY) OR GREATER INDICATES THE EXISTENCE OF A PROBLEM, SUCH AS A HIGH RESISTANCE GROUND, SERIOUS DETERIORATION OF THE CIRCUIT INSULATION, LIGHTNING DAMAGE, BAD CONNECTIONS, BAD SPLICES, CABLE INSULATION DAMAGE, OR OTHER FAILURE. FAA ADVISORY CIRCULAR 150/5340-26C NOTES "GENERALLY SPEAKING, ANY CIRCUIT THAT MEASURES LESS THAN 1 MEGOHM IS CERTAINLY DESTINED FOR RAPID FAILURE." AIRFIELD LIGHTING SERIES CIRCUITS WITH CABLE INSULATION READINGS OF LESS THAN 1 MEGOHM ARE NOT UNCOMMON FOR OLDER CIRCUITS THAT ARE 20 YEARS OR MORE OF AGE.
- BASED ON INFORMATION IN FAA AC NO. 150/5340-26C MAINTENANCE OF AIRPORT VISUAL AID FACILITIES, THE CABLE INSULATION RESISTANCE VALUE INEVITABLY DECLINES OVER THE SERVICE LIFE OF THE CIRCUIT; A 10-20 PERCENT DECLINE PER YEAR MAY BE CONSIDERED NORMAL. IN THE EVENT THAT THE CABLE INSULATION RESISTANCE READINGS HAVE DECLINED MORE THAN 2 PERCENT PER MONTH IT MIGHT INDICATE CABLE DAMAGE DUE TO LIGHTNING OR DAMAGE AS A RESULT OF CONTRACTOR OPERATIONS. WHERE THE CABLE INSULATION RESISTANCE READINGS HAVE DECLINED MORE THAN 2 PERCENT PER MONTH OVER THE PROJECT CONSTRUCTION DURATION AS A RESULT OF CONTRACTOR OPERATIONS, CONTRACTOR WILL NEED TO INVESTIGATE, ADDRESS, AND REPAIR THE RESPECTIVE CABLE CIRCUITS.

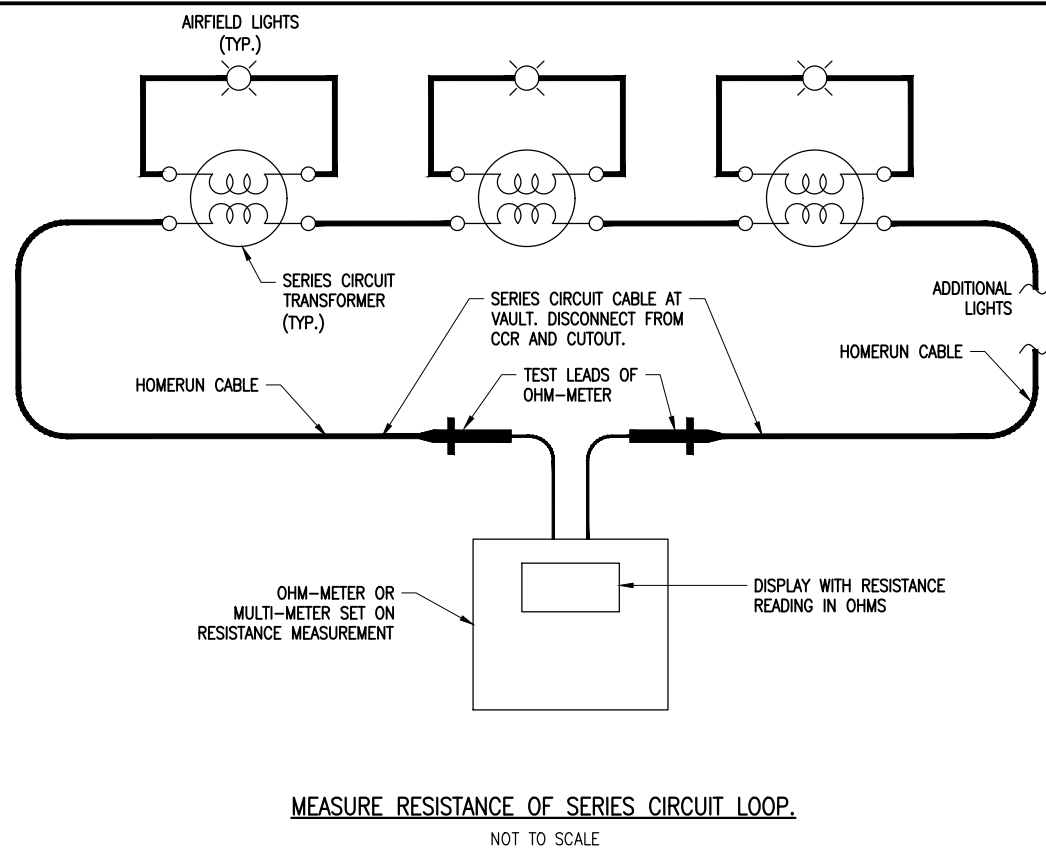

**SERIES CIRCUIT LOOP RESISTANCE MEASUREMENT NOTES**

- PRIOR TO BEGINNING EXCAVATIONS, AIRFIELD LIGHTING MODIFICATIONS, CABLE INSTALLATION, AND/OR ANY OTHER WORK THAT MIGHT POSSIBLY AFFECT AIRFIELD LIGHTING CIRCUITS, THE RESPECTIVE SERIES CIRCUIT CABLE LOOPS SHALL HAVE THE RESISTANCE MEASURED WITH AN OHMMETER AND RECORDED FOR EACH CIRCUIT AT THE VAULT.
- AFTER AIRFIELD LIGHTING MODIFICATIONS, ADDITIONS, UPGRADES, AND/OR OTHER WORK AND ADDITIONS HAVE BEEN COMPLETED THE RESPECTIVE SERIES CIRCUIT CABLE LOOPS SHALL HAVE THE RESISTANCE MEASURED WITH AN OHMMETER AND RECORDED FOR EACH CIRCUIT AT THE VAULT.
- ALL EXISTING SERIES CIRCUIT CABLE LOOPS SHALL HAVE THE RESISTANCE MEASURED WITH AN OHMMETER AND RECORDED FOR EACH CIRCUIT AT THE VAULT. THE RESISTANCE OF THE SERIES CIRCUIT LOOP WITH CONNECTIONS USING #8 AWG COPPER CONDUCTOR SHOULD BE APPROXIMATELY 0.8 TO 1 OHM PER THOUSAND FEET OF CABLE LENGTH. THE RESISTANCE OF THE SERIES CIRCUIT LOOP WITH CONNECTIONS USING #6 AWG COPPER CONDUCTOR SHOULD BE APPROXIMATELY 0.5 TO 0.7 OHM PER THOUSAND FEET OF CABLE LENGTH. THE NUMBER OF SERIES CIRCUIT TRANSFORMERS AND CONNECTIONS WILL AFFECT THE OVERALL RESISTANCE OF THE SERIES CIRCUIT LOOP AND THEREFORE THE MEASUREMENTS MIGHT BE SLIGHTLY HIGHER THAN THE CALCULATED RESISTANCE FOR THE RESPECTIVE LENGTH OF CABLE.

APR 19, 2021 2:49 PM HERNDD01562  
 I:\17\JOBS\17A008504\CAD\AIRPORT\T\SHHEETE-604