


NOTES:

- 1.- ALL CONDUIT BUSHINGS SHALL HAVE AN ISOLATED THROAT.
- 2.- PROVIDE HEAT SHRINK BOOT AT THE TOP OF THE SERVICE ENTRANCE CABLE FOR MOISTURE PROOFING.
- 3.- ALL CONNECTIONS TO GROUND RODS SHALL BE EXOTHERMIC UNLESS OTHERWISE NOTED.
- 4.- ATTACH INCOMING ELECTRIC SERVICE CABLE TO UTILITY POLE EVERY 5' FEET USING INSULATED U-NAIL.
- 5.- PROVIDE CABLE RACK IN HANDHOLES.
- 6.- ALL CONDUCTORS SHALL BE COPPER.
- 7.- PROVIDE STAINLESS STEEL HARDWARE TO ATTACH L BRACKETS TO UNISTRUT AND TO SIGN HANGER.

FRONT VIEW SIDE VIEW
TOP VIEW
**NTS
DISCONNECT MOUNTING DETAIL**

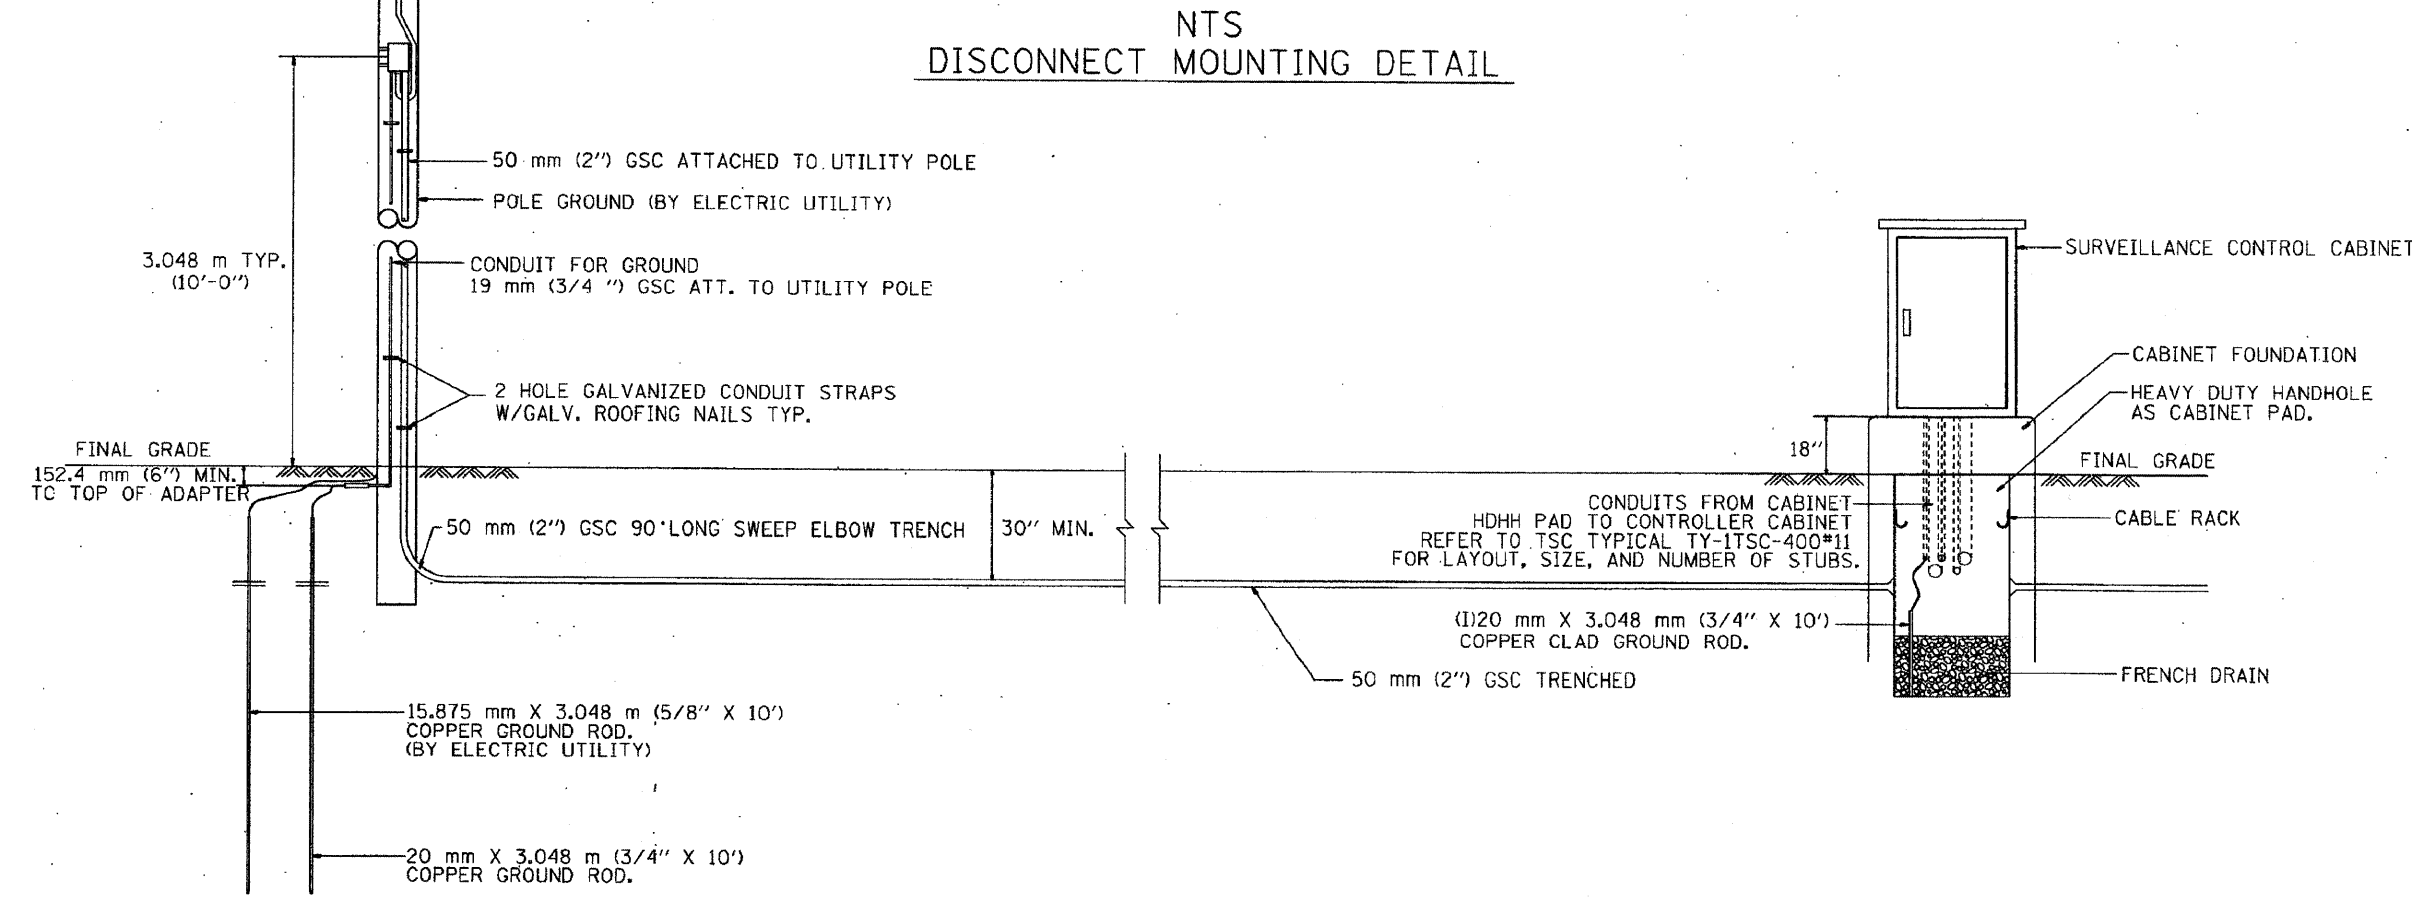

FILE NAME	USER NAME	DESIGNED	REVISED
		DRAWN	REVISED
		CHECKED	REVISED
		DATE	REVISED

**STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION**

**CCTV CAMERA EXPANSION - FAI 55 (US 6 TO I-294)
ELECTRIC SERVICE INSTALLATION**

SCALE: NONE SHEET NO. ___ OF ___ SHEETS STA. ___ TO STA. ___

FA RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
FA155	2007-0621	*	74	67
CONTRACT NO.			60E01	
ILLINOIS FED. AID PROJECT				

E62

* COOK, DUPAGE, WILL