


GENERAL NOTES:

1. ALL BELOW GRADE FASTENERS TO BE STAINLESS STEEL:
 - A. BOLTS AND THREADED RODS - GRADE #304
 - B. NUTS AND WASHERS - GRADE #300
2. FRAME AND LID:
 - NEENAH R-1015-2000 FRAME OR APPROVED EQUAL
 - NEENAH R-1015-2001 SELF SEALING LID OR APPROVED EQUAL
 - "WATER" TO BE CAST INTO COVER

NOT TO SCALE

REV:	DATE:	WATER VALVE IN VAULT	VILLAGE OF VILLA PARK
REV: RMS	DATE: JUL 2004		
DRAWN BY: VV	DATE: JAN 2003		
		WATER - 14	

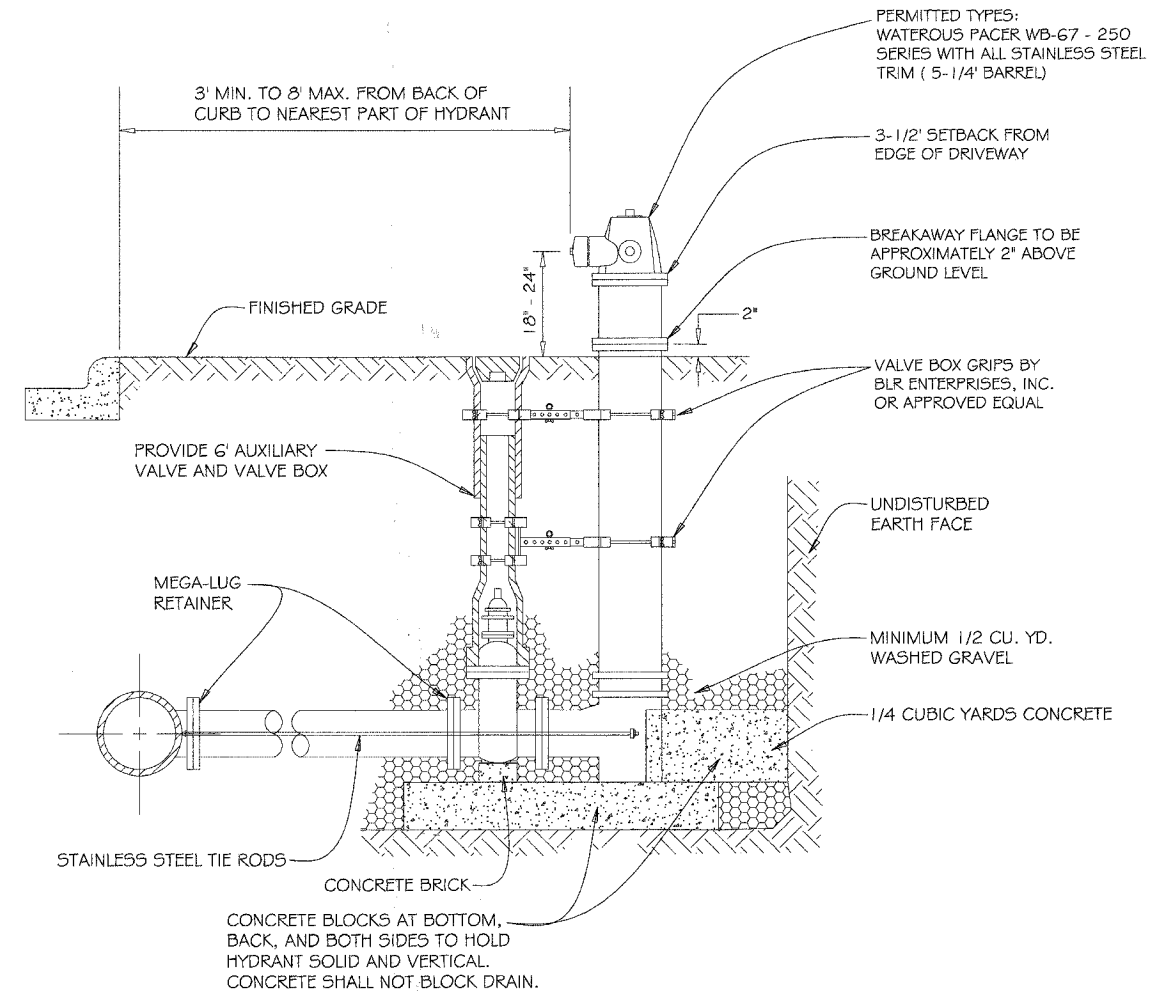

GENERAL NOTES:

1. MAXIMUM BARREL EXTENSIONS ARE 18 INCHES AND SHALL BE WATEROUS EXTENSION FOR WATEROUS HYDRANTS.
2. ALL HYDRANTS ARE TO BE SUPPLIED WITH A 6" FLANGED AND MECHANICAL JOINT AUXILIARY VALVE THAT CONFORMS TO AWWA 500-80. ALL TRIM BOLTS ARE TO BE STAINLESS STEEL.
3. ALL BELOW GRADE FASTENERS TO BE STAINLESS STEEL:
 - A. BOLTS AND THREADED RODS - GRADE #304
 - B. NUTS AND WASHERS - GRADE #300
4. MEGA-LUG RETAINERS MUST BE INSTALLED ON ALL MECHANICAL FITTINGS.

NOT TO SCALE

REV:	DATE:	FIRE HYDRANT SETTING	VILLAGE OF VILLA PARK
REV: RMS	DATE: JUL 2004		
DRAWN BY: VV	DATE: JAN 2003		
		WATER - 04	