F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
	03-00026-00-PK 06-00026-01-MS	MADISON	53	43

FEDERAL AID PROJECT

KEYED NOTES

1. E.C. SHALL FURNISH AND INSTALL SINGLE RECEPTACLE SURFACE MOUNTED IN ELEVATOR PIT FOR SUMP PUMP CONTROL PANEL. PROVIDE SURFACE MOUNTED 4" PVC CONDUIT BETWEEN CONTROL PANEL AND PUMP. E.C. SHALL INSTALL CABLES WHICH ARE PROVIDED WITH THE PUMP BETWEEN CONTROL PANEL AND PUMP WITHIN 4"C.
2. EXTEND AND CONNECT TO PANEL VIA RELAY PANEL. SEE SHEET E4-01 FOR LOCATION OF RELAY PANEL.

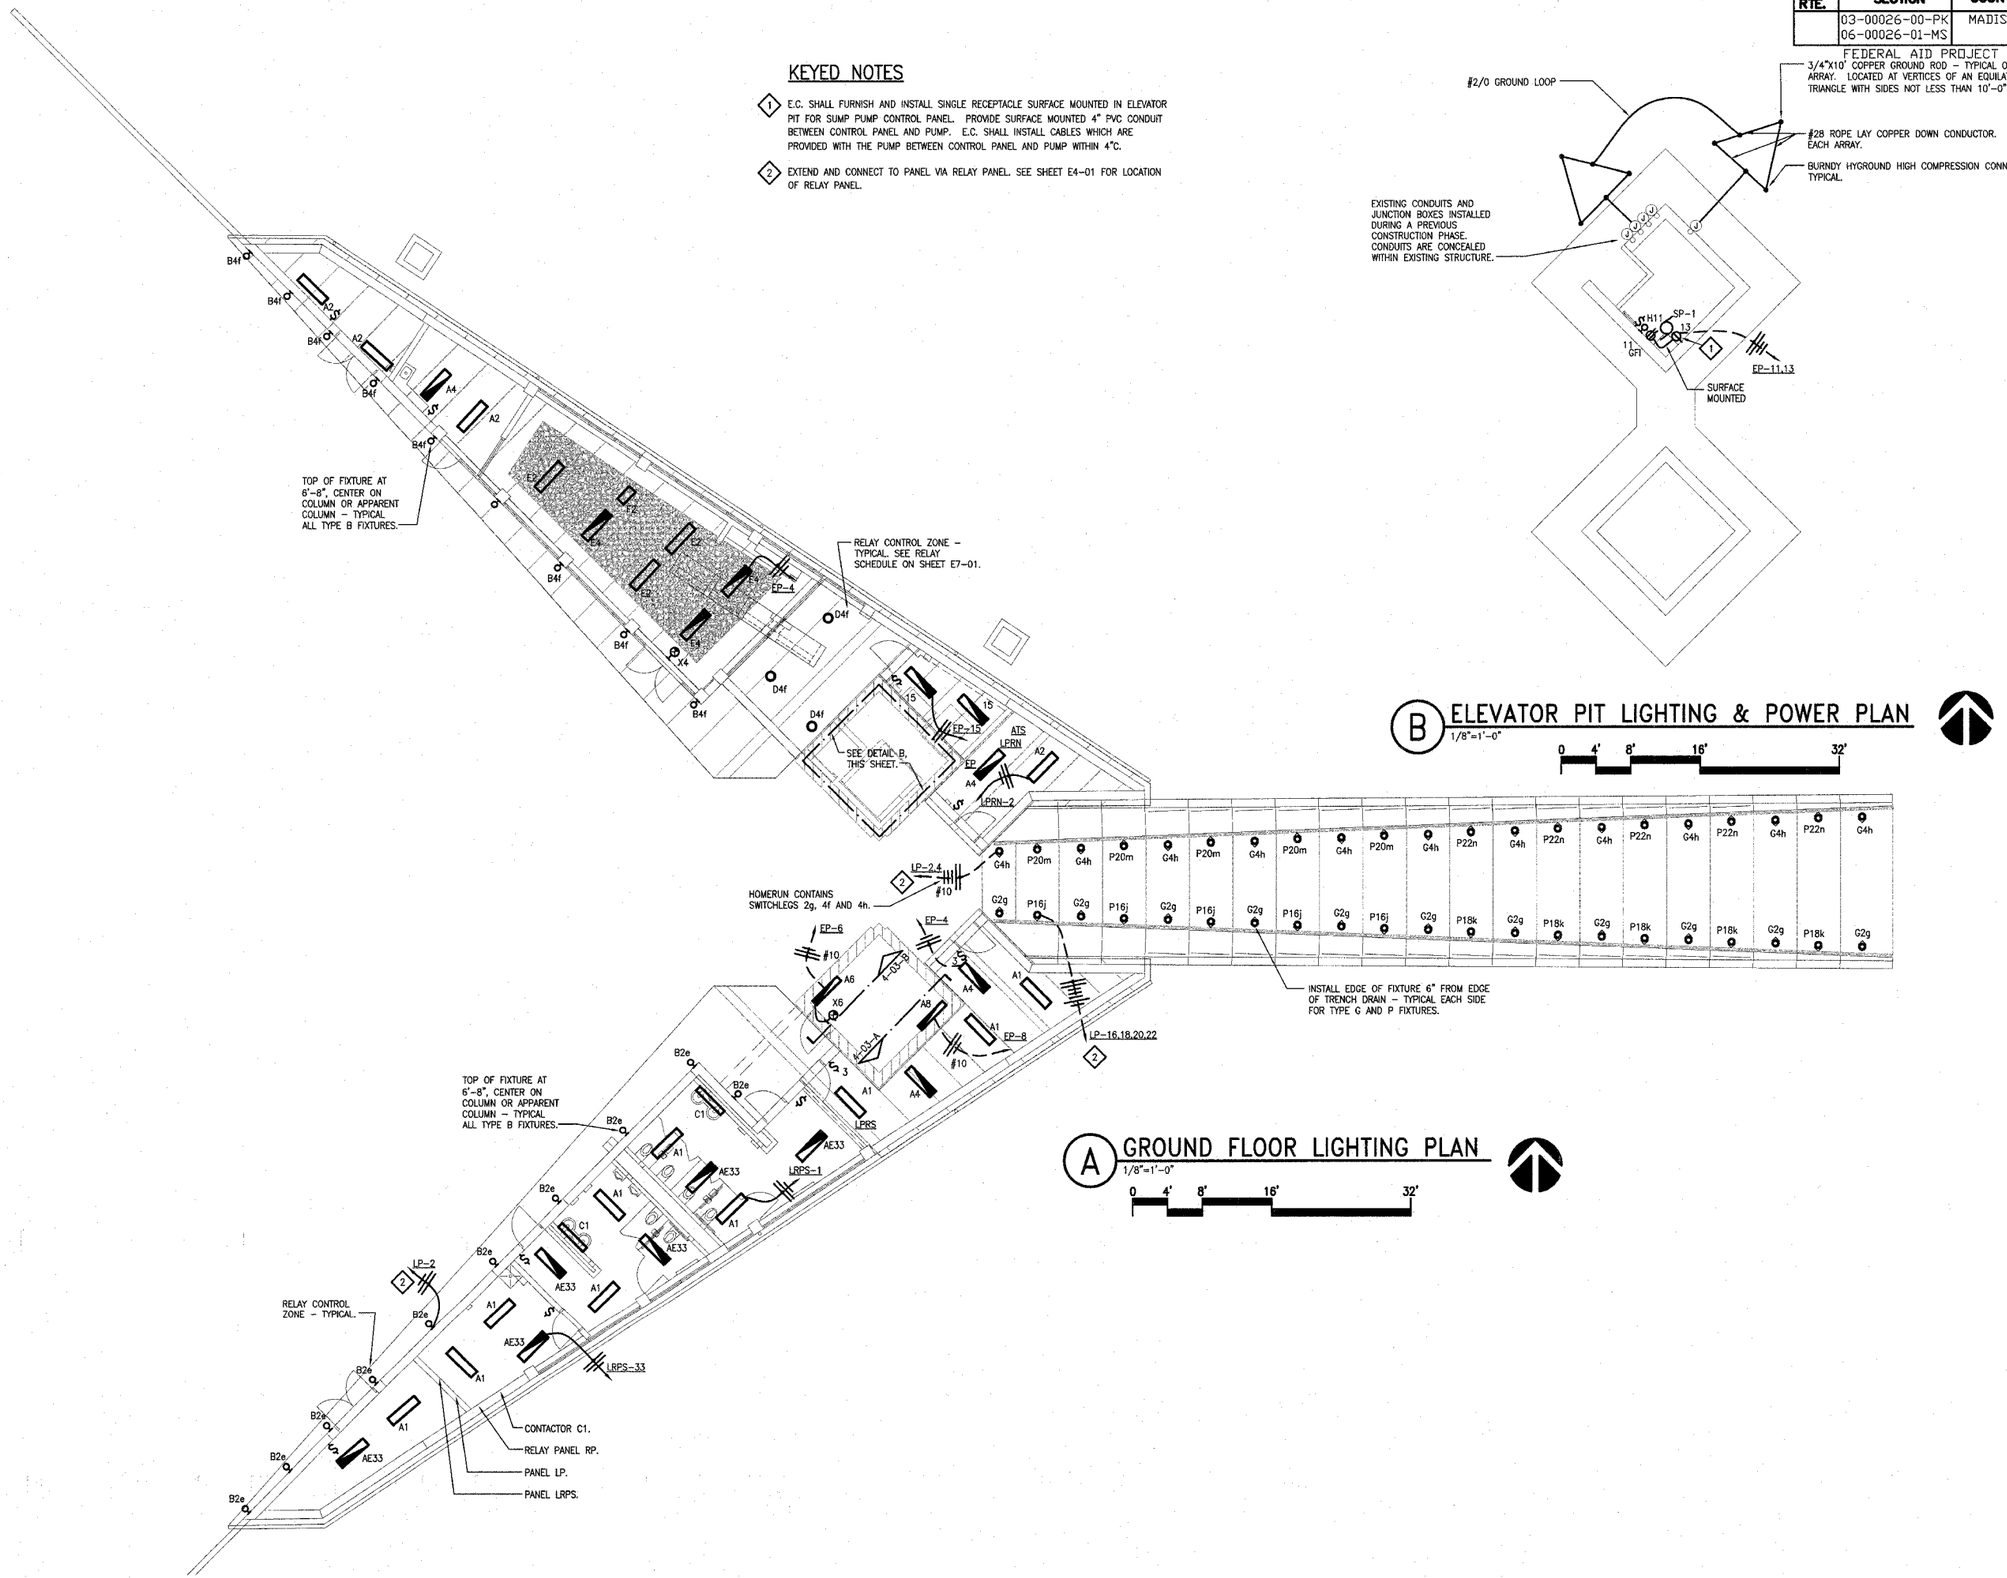

B ELEVATOR PIT LIGHTING & POWER PLAN
1/8"=1'-0"
0 4' 8' 16' 32'

A GROUND FLOOR LIGHTING PLAN
1/8"=1'-0"
0 4' 8' 16' 32'

211 N. Broadway
Suite 1900
St. Louis, MO
63102
(314) 241-6188
FAX (314) 241-0125
KAI

LEWIS AND CLARK MEMORIAL TOWER
VILLAGE OF HARTFORD, ILLINOIS
HARTFORD, ILLINOIS 62049

SHEET TITLE:
GROUND FLOOR LIGHTING PLAN

REV. NO.	REMARKS	DATE

KENNEDY PROJECT NO
KAI- 10-02048

ISSUE DATE
APRIL 11, 2008

SHEET NO
E3-01

©2008 KENNEDY ASSOCIATES INCORPORATED