


DATE	REVISION	BY


THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

- LEGEND**
- EXISTING PAVEMENT
  - EXISTING ELECTRICAL DUCT
  - PROPOSED ELECTRICAL DUCT
  - EXISTING ELECTRICAL CABLES
  - EXISTING ELECTRICAL CABLES TO BE ABANDONED
  - PROPOSED 1/C #8 5KV L-824 UG CABLE IN UD
  - EXISTING STORM SEWER
  - EXISTING ELECTRICAL MANHOLE OR HANDHOLE
  - PROPOSED ELECTRICAL HANDHOLE OR MANHOLE
  - EXISTING STAKE MOUNTED TAXIWAY LIGHTS
  - EXISTING BASE MOUNTED TAXIWAY LIGHTS
  - EXISTING TAXI GUIDANCE SIGN
  - EXISTING ELECTRICAL MANHOLE
  - EXISTING TIE DOWN
  - EXISTING UNDERDRAIN CLEANOUT
  - EXISTING SPLICE CAN

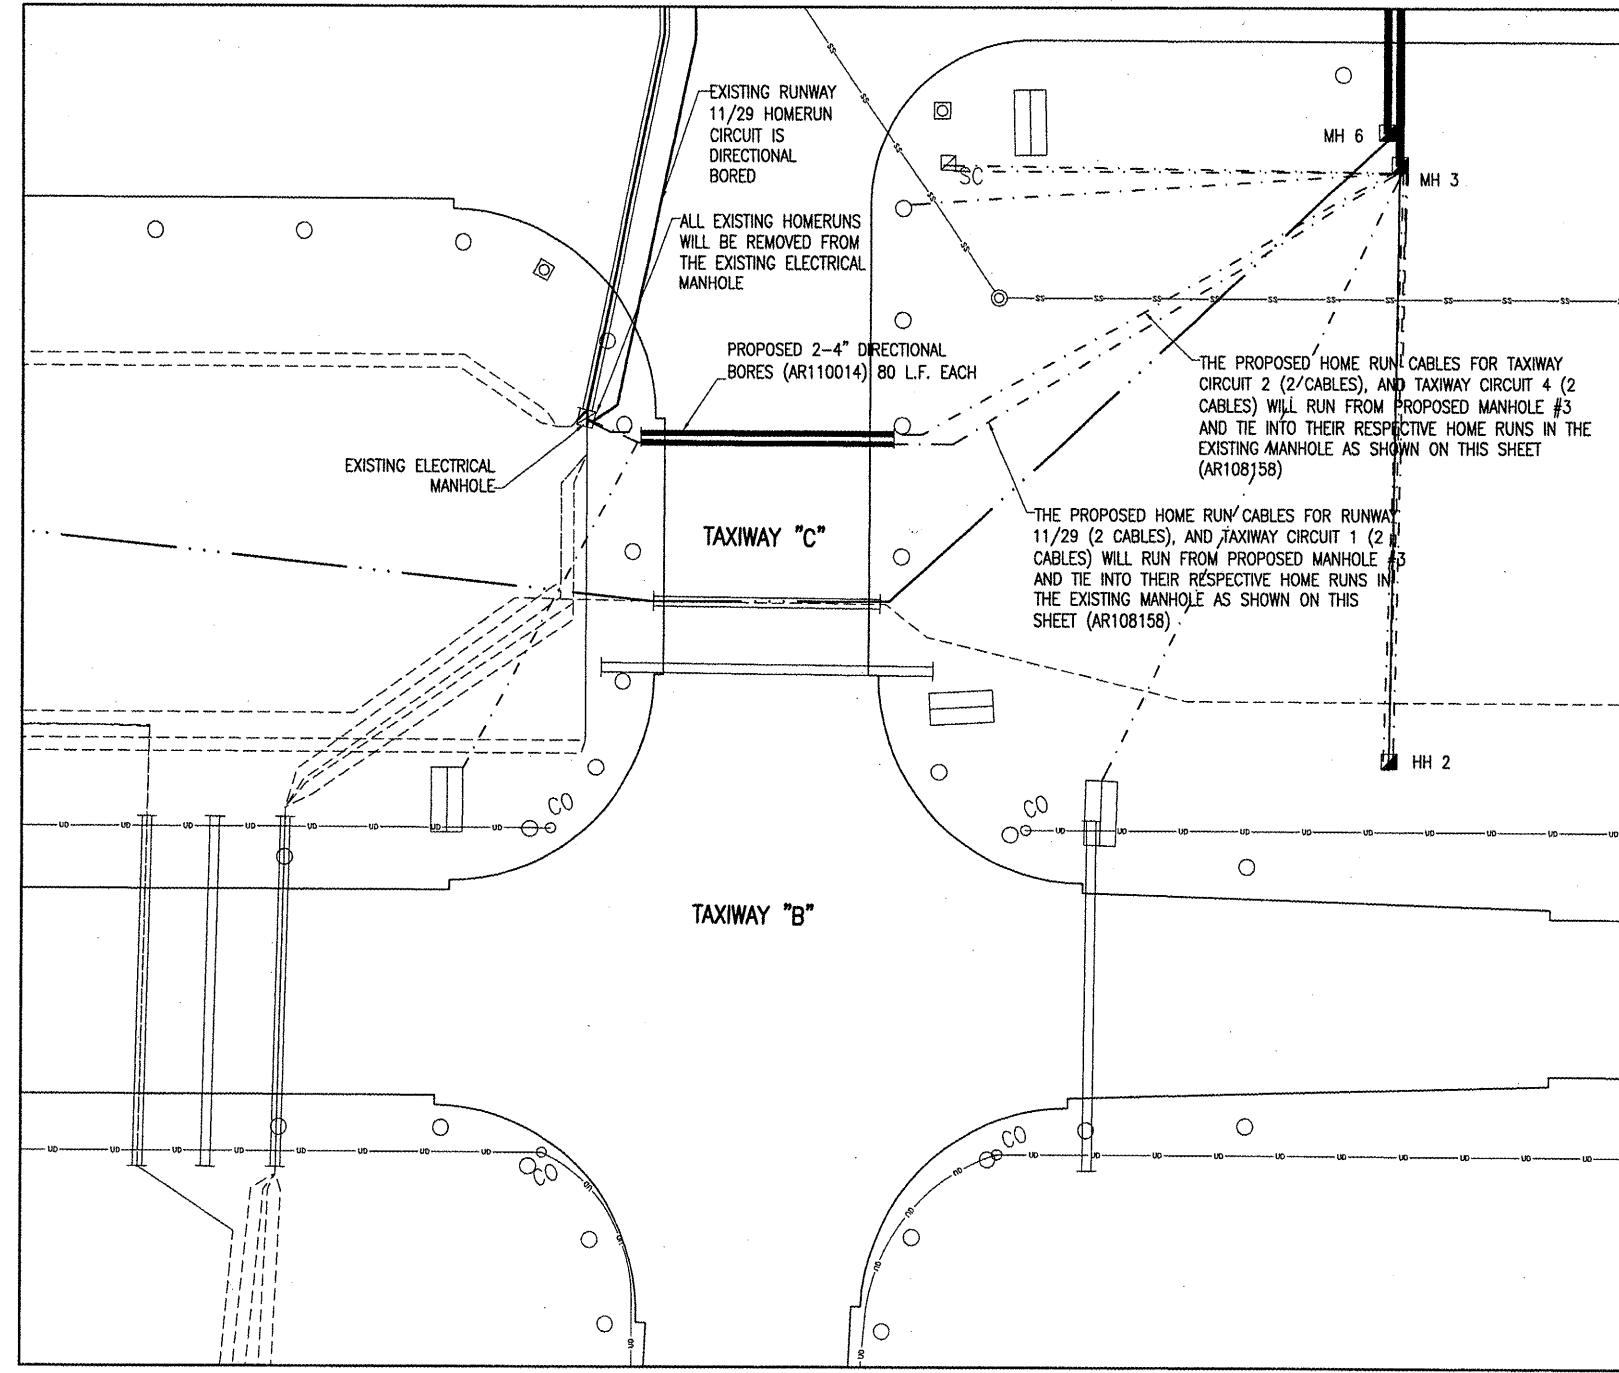

PROPOSED HOME RUNS FOR RUNWAY 11-29, TAXIWAY LIGHTING CIRCUITS 1, 2 & 4

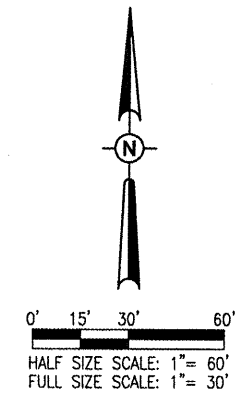

MAY 14, 2008 11:51 AM KINCA00394 I:\AIRPORTS\COLES\07A0101\CAD\SHEETS\R-24\ELE.DWG - CIRCUITS 1-2-4-11-29

COLES COUNTY AIRPORT  
 AUTHORITY  
 COLES COUNTY MEMORIAL AIRPORT  
 A.I.P. PROJ.: 3-17-0068-B20  
 I.L. PROJ.: MTO-3762

I.L. Project No. 07A0101D_0800 Filename: R-24\1ELE.DWG Scale: 1"=30' Date: 04/04/08	CAH 03/19/08 MOR 03/19/08 CAH/KNL 04/03/08
LAYOUT	CAH
DRAWN	MOR
REVIEWED	CAH/KNL

**HANSON**  
 Hanson Professional Services Inc.  
 1625 South Sixth Street  
 Springfield, Illinois 62703-2888  
 Offices Nationwide

REPLACE ELECTRICAL DUCT IN FRONTAL AREA  
 PROPOSED HOME RUNS FOR RUNWAY 11-29, TAXIWAY LIGHTING CIRCUITS 1, 2, & 4