

VAULT LEGEND PLATE SCHEDULE	
DEVICE	LABEL
SERVICE BREAKER FOR VAULT	SERVICE DISCONNECT FOR VAULT 120/240VAC, 1PH, 3W
SERVICE BREAKER FOR MAINTENANCE BUILDING	SERVICE DISCONNECT FOR MAINT. BLDG.
VAULT PANELBOARD	VAULT PANEL 120/240 VAC, 1 PH, 3W FED FROM SERVICE DISCONNECT
MAIN BREAKER IN VAULT PANEL	MAIN DISCONNECT
RUNWAY 13-31 & TAXIWAY CCR	RUNWAY 13-31 & TAXIWAY
SPARE RUNWAY 13-31 & TAXIWAY CCR	SPARE FOR RUNWAY 13-31 & TAXIWAY
CUTOUT ENCLOSURE FOR RUNWAY 13-31 & TAXIWAY	RUNWAY 13-31 & TAXIWAY CUTOUTS
CUTOUT ENCLOSURE FOR RUNWAY 13-31 & TAXIWAY	CAUTION OPERATE CUTOUTS WITH CCR SHUT OFF
NORMAL CUTOUT INPUT SIDE CONNECTION	NORMAL CCR INPUT
SPARE CUTOUT INPUT SIDE CONNECTION	SPARE CCR INPUT
EACH CUTOUT OUTPUT SIDE CONNECTION	OUTPUT
RADIO INTERFACE PANEL FOR RUNWAY 13-31 & TAXIWAY	RUNWAY 13-31 & TAXIWAY
RELAY/CONTACTOR PANEL	CONTACTOR PANEL FOR AIRFIELD LIGHTING EQUIPMENT
CONTACTOR FOR EXHAUST FAN	EXHAUST FAN CONTACTOR
LOW VOLTAGE WIREWAY (PROVIDE 4 LEGEND PLATES 1/2" HIGH BLACK LETTERS WHITE BACKGROUND)	LOW VOLTAGE
HIGH VOLTAGE WIREWAY (PROVIDE 4 LEGEND PLATES 1/2" HIGH BLACK LETTERS WHITE BACKGROUND)	HIGH VOLTAGE
VAULT GROUND BUS (PROVIDE 4 LEGEND PLATES 1/2" HIGH WHITE LETTERS GREEN BACKGROUND)	VAULT GROUND BUS


NOTE: LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH BLACK LETTERS ON A WHITE BACKGROUND UNLESS NOTED OTHERWISE. SECURE WITH WEATHERPROOF ADHESIVE AND MACHINE SCREWS. FURNISH ADDITIONAL LEGEND PLATES WHERE REQUIRED BY CODE, FOR ADDITIONAL EQUIPMENT, AS DETAILED HEREIN ON THE PLANS, AND AS NOTED IN THE SPECIAL PROVISION SPECIFICATIONS.

FURNISH & INSTALL A WEATHERPROOF WARNING LABEL FOR EACH SAFETY SWITCH, PANELBOARD, LOAD CENTER, CUTOUT, & CONTROL PANEL TO WARN PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS, PER THE REQUIREMENTS OF NEC 110.16 "FLASH PROTECTION". LABELS SHALL BE HAZARD COMMUNICATION SYSTEMS, LLC (190 OLD MILFORD RD., BOX 1174, MILFORD, PA 18337, PHONE: 1-877-748-0244) PART NO. H6010-9VWHBJ OR APPROVED EQUAL.

- DIRECTIONS TO TRANSFER RUNWAY 13-31 & TAXIWAY LIGHTING FROM NORMAL CCR TO SPARE CCR.
1. SHUT OFF INPUT POWER (CIRCUIT BREAKER) TO BOTH RWY 13-31/TXY CCR'S & TURN CCR SELECTOR SWITCHES TO OFF.
 2. PULL CUTOUT HANDLE FROM NORMAL CCR UNIT & INSERT INTO SPARE CCR CUTOUT.
 3. TURN ON INPUT POWER (CIRCUIT BREAKER) TO SPARE RWY 13-31/TXY CCR.
 4. GO TO CONTACTOR PANEL & TURN "RWY 13-31 CCR TRANSFER" SELECTOR SWITCH FROM "NORMAL" TO "SPARE" POSITION.
 5. TURN SELECTOR SWITCH ON SPARE CCR TO "REMOTE" POSITION.

PROVIDE PLACARD OR LEGEND PLATE FOR RUNWAY CONSTANT CURRENT REGULATOR PAIR AS NOTED ABOVE: LETTERING TO BE MIN. 1/4" HIGH, BLACK ON WHITE BACKGROUND. LOCATE PLACARD ABOVE CUTOUT ENCLOSURE.

PLACARD DETAIL

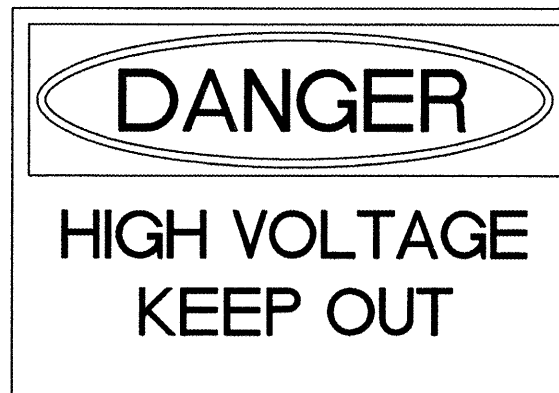

PROVIDE WARNING SIGN ON VAULT EXTERIOR DOORS LABELED "DANGER - HIGH VOLTAGE - KEEP OUT" PER THE REQUIREMENTS OF NEC 110.34 (C).

DATE	REVISION								
	BY								
TRI-TOWNSHIP AIRPORT SAVANNA, CARROLL COUNTY ILLINOIS									
I.L. PROJ.: SFY-3782 A.I.P. PROJ.: 3-17-0091-814									
I&L Project No. 07A0144D_0800 Filename: E-504.DWG Scale: NONE Date: 05/13/08		LAYOUT: KNL 01/02/08 DRAWN: MY 01/03/08 REVIEWED: CAH 02/08/08		HANSON PROFESSIONAL SERVICES, INC. 1525 South Sixth Street Springfield, Illinois 62703-2886 Offices Nationwide					
CONSTRUCT NEW VAULT					LEGEND PLATE SCHEDULE				
16									
16 of 24 sheets									