



FRAMING PLAN

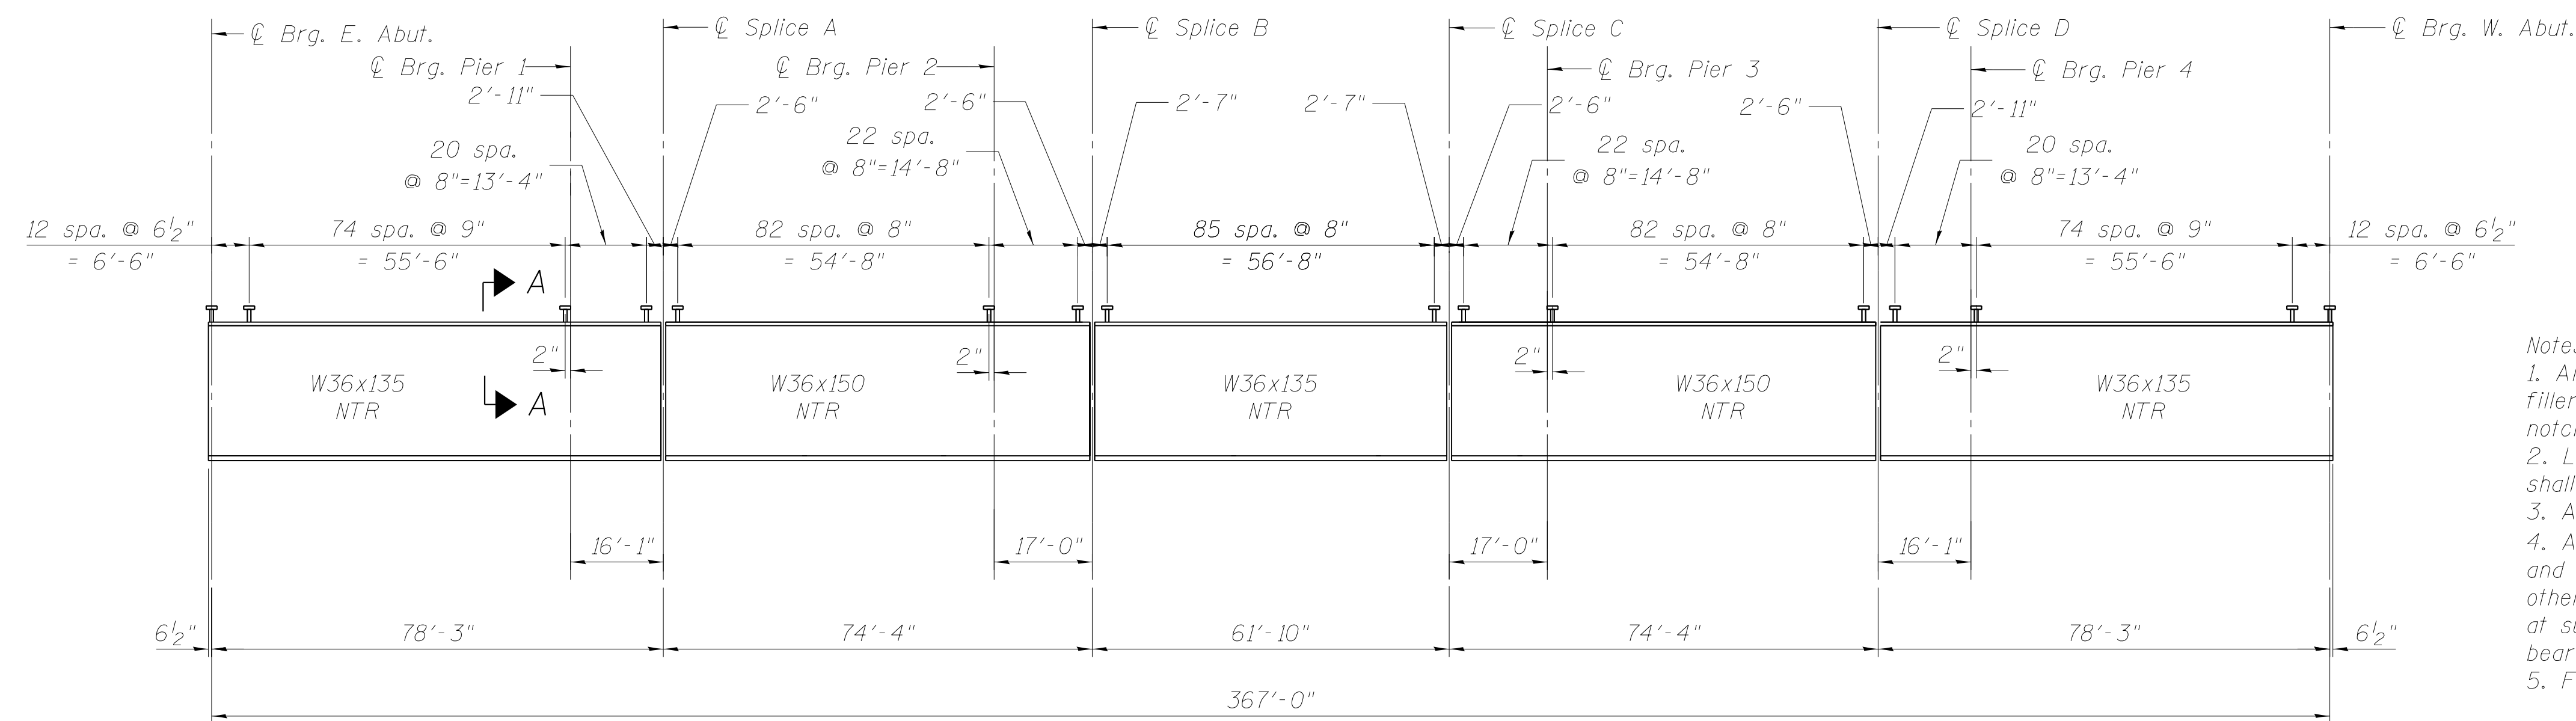

BEAM ELEVATION

- Notes:
1. All flange and web splice plates, except filler plates, shall be M270 Grade 50 and meet notch toughness requirements.
 2. Load carrying components designated "NTR" shall conform to the impact testing requirements, Zone 2.
 3. All wide flange beams shall be M270 Grade 50.
 4. All diaphragms shall be installed as steel is erected and secured with erection pins and bolts except as otherwise noted. Individual cross frames or diaphragms at supports may be temporarily disconnected to install bearing anchor rods.
 5. For Section A-A see sheet S30 of S71.

M:\1_57_OVER_CNRR & OLD_45\Drawings\Structural\Final Plans\BHTS\0366942-029-Framing_Plan.dgn

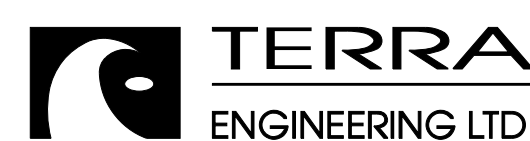

USER NAME =	DESIGNED - EA	REVISED
	CHECKED - OY	REVISED
PLOT SCALE =	DRAWN - CM	REVISED
PLOT DATE =	CHECKED - JB	REVISED

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

FRAMING PLAN AND BEAM ELEVATIONS
STRUCTURE NOS. 038 - 0013 & 0014

SHEET NO. S29 OF S71 SHEETS

F.A.I. RTE. =	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
57	38-2HWB, HVBR-1	IROQUOIS	146	68
CONTRACT NO. 66942				
ILLINOIS FED. AID PROJECT				