LI034

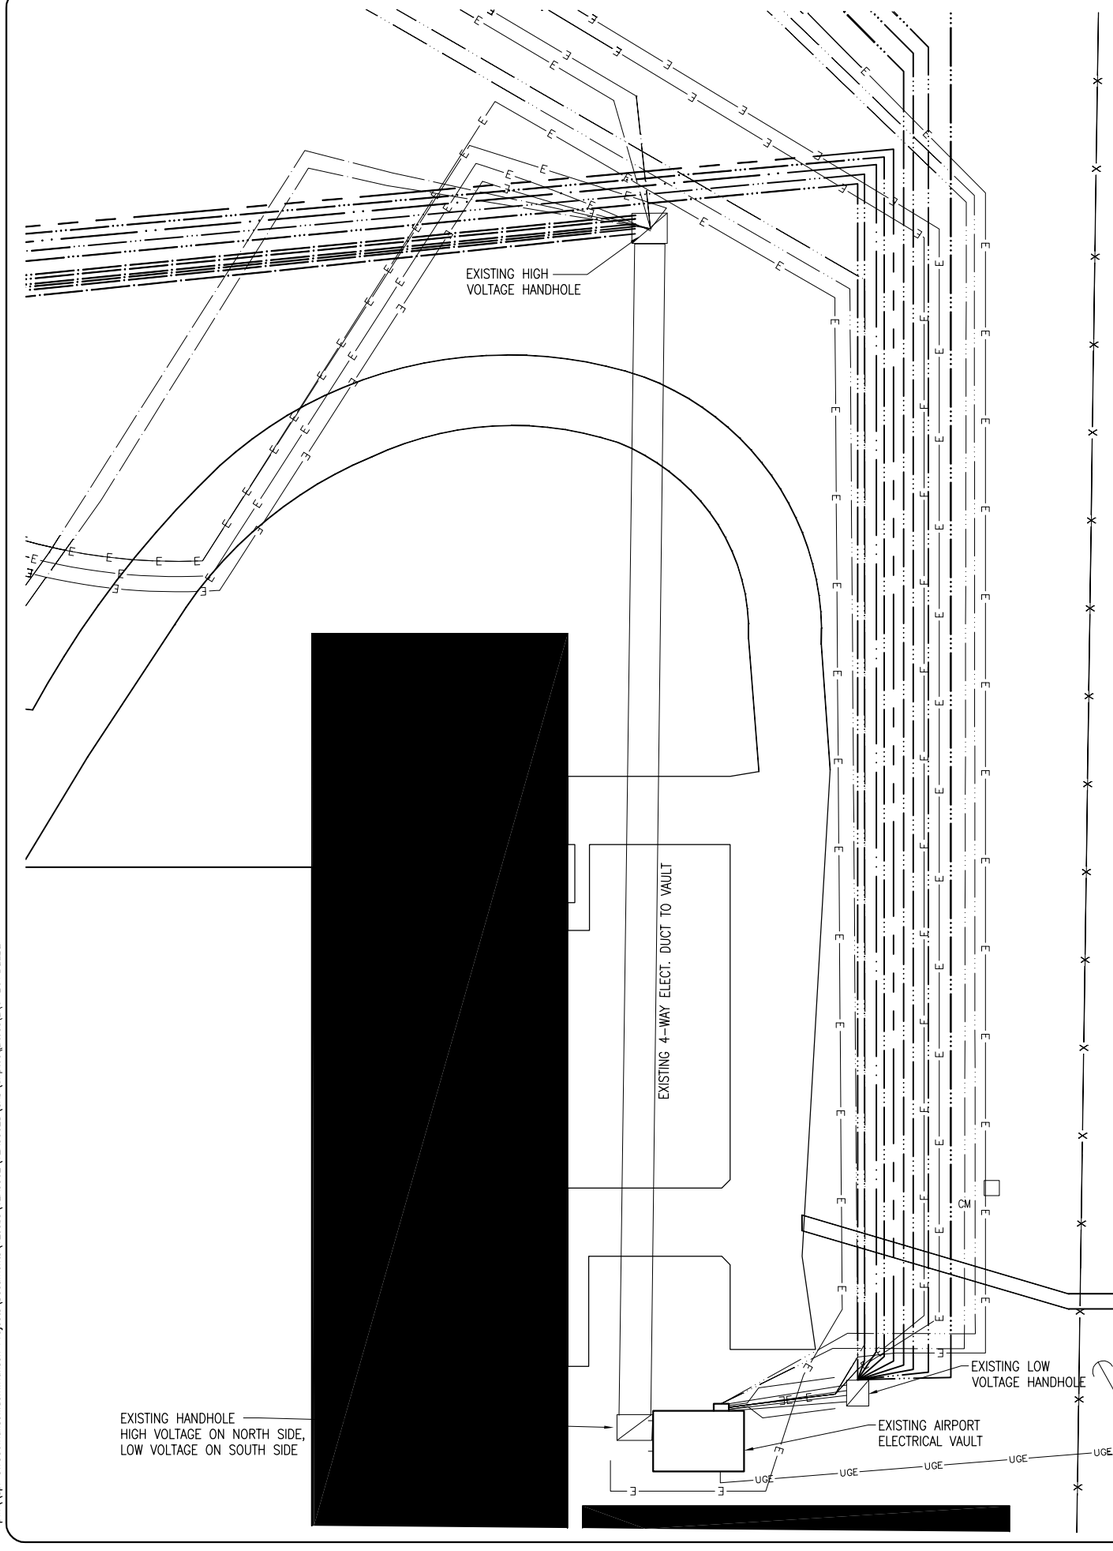

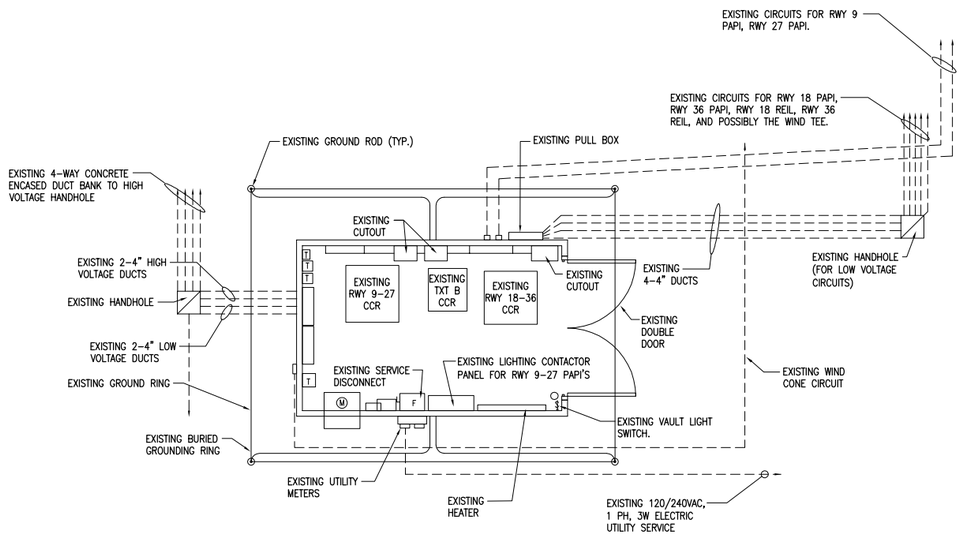

FLOOR PLAN FOR VAULT

LEGEND

- EXISTING PAVEMENT
- EXISTING BUILDINGS
- PROPOSED ELECTRICAL DUCT
- E — EXISTING ELECTRICAL CABLES
- — — — EXISTING ELECTRICAL CABLES
- PROPOSED 1/C #8 AWG, FAA L-824, 5000 V TYPE C UNDERGROUND CABLE IN UNIT DUCT
- PROPOSED 2-1/C #4 AWG, XLP-USE 600 V UNDERGROUND CABLE IN UNIT DUCT
- PROPOSED 3-1/C #6 AWG, XLP-USE 600 V UNDERGROUND CABLE IN UNIT DUCT
- PROPOSED 3-1/C #8 AWG, XLP-USE 600 V UNDERGROUND CABLE IN UNIT DUCT
- EXISTING ELECTRICAL HANDHOLE

N

0' 5' 10' 20'

HALF SIZE SCALE: 1"= 20'
FULL SIZE SCALE: 1"= 10'

REVISION	DATE

LITCHFIELD MUNICIPAL AIRPORT
LITCHFIELD, ILLINOIS

IL. PROJ.: 3LF-4194 BLOCK GRANT PROJ.: 3-17-0063-B19

Hanson Proj. No. 12A0062D
Filename E-142-7-ELEC.dwg
Scale 1"= 20'
Date 01/11/13

LAYOUT	CAH	06/11/12
DRAWN	BAK	06/11/12
REVIEWED	CAH/KNL	01/10/13

HANSON
Hanson Professional Services Inc.
1525 South Sixth Street
Springfield, Illinois 62703-2886
Ph: (217) 788-2450 Fax: (217) 788-2503
www.hanson-inc.com
Offices Nationwide
©Copyright Hanson Professional Services Inc. 2013

REALIGN TAXIWAY "A"

PROPOSED CABLE LAYOUT IN VAULT AREA

26
26 of 42 sheets

FEB 05, 2013 4:20 PM HAGLOOO382
pw:\\spi-svr306.hanson.dom:Hanson Projects\Documents\12Jobs\12A0062\12A0062D\CAD\Airport\Sheets\E-01-485-FREEDER