


NOTES:

1. ALL TAPED SPLICES SHALL USE 2 LAYERS OF ELECTRICAL TAPE OVER 3 LAYERS OF RUBBER TAPE AS REQUIRED BY THE STANDARD SPECIFICATION. COAT THE FINISH TAPED SPLICE WITH BONDING COMPOUND.
2. ALL CABLE SPLICES SHALL BE TAPED UNLESS ANOTHER METHOD HAS BEEN SPECIFICALLY APPROVED BY THE ENGINEER.

**TYPICAL SPLICE DETAIL**

N.T.S.

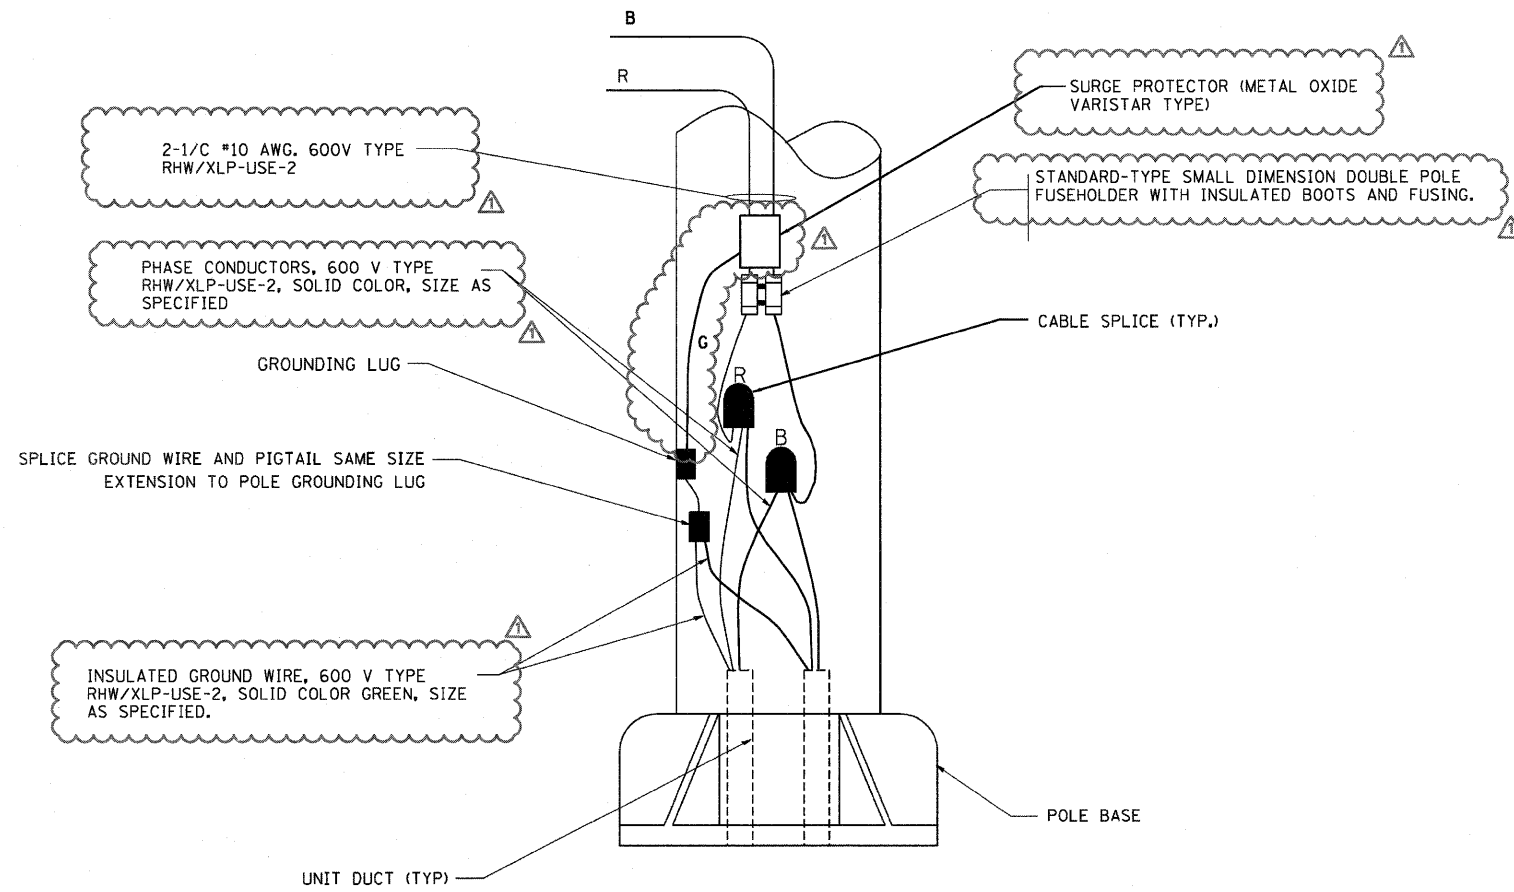

**POLE WIRING DETAIL**

N.T.S.

DIRECTORY = L:\ROCKFORD\112804\112804.dwg - CAD - Sheets\0264515.Mission

**CMT**  
 CRAWFORD, MURPHY & TILLY, INC.  
 CONSULTING ENGINEERS  
 License No. 184-000613

USER NAME = Jason Dove	DESIGNED - AS	REVISED - 04/17/2012
FILE NAME: 0264515-shd-light-112804.dgn	DRAWN - JWD	REVISED -
PLOT SCALE = 20.0000' / 1"	CHECKED - AB	REVISED -
PLOT DATE = 4/18/2012 - 6:20:44 PM	DATE - 01/25/2012	REVISED -

**STATE OF ILLINOIS**  
**DEPARTMENT OF TRANSPORTATION**

**ROADWAY LIGHTING DETAIL**  
**TYPICAL SPLICE - POLE WIRING DETAIL (BE-702)**

SCALE: N/A SHEET 16 OF 20 SHEETS STA. TO STA.

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
742	34R	WINNEBAGO	491	312B
CONTRACT NO. 64515				
ILLINOIS FED. AID PROJECT				