


SLOPE STEPS DETAIL

TYPICAL CROSS-SECTION EMBANKMENT CONSTRUCTION ON SIDEHILL

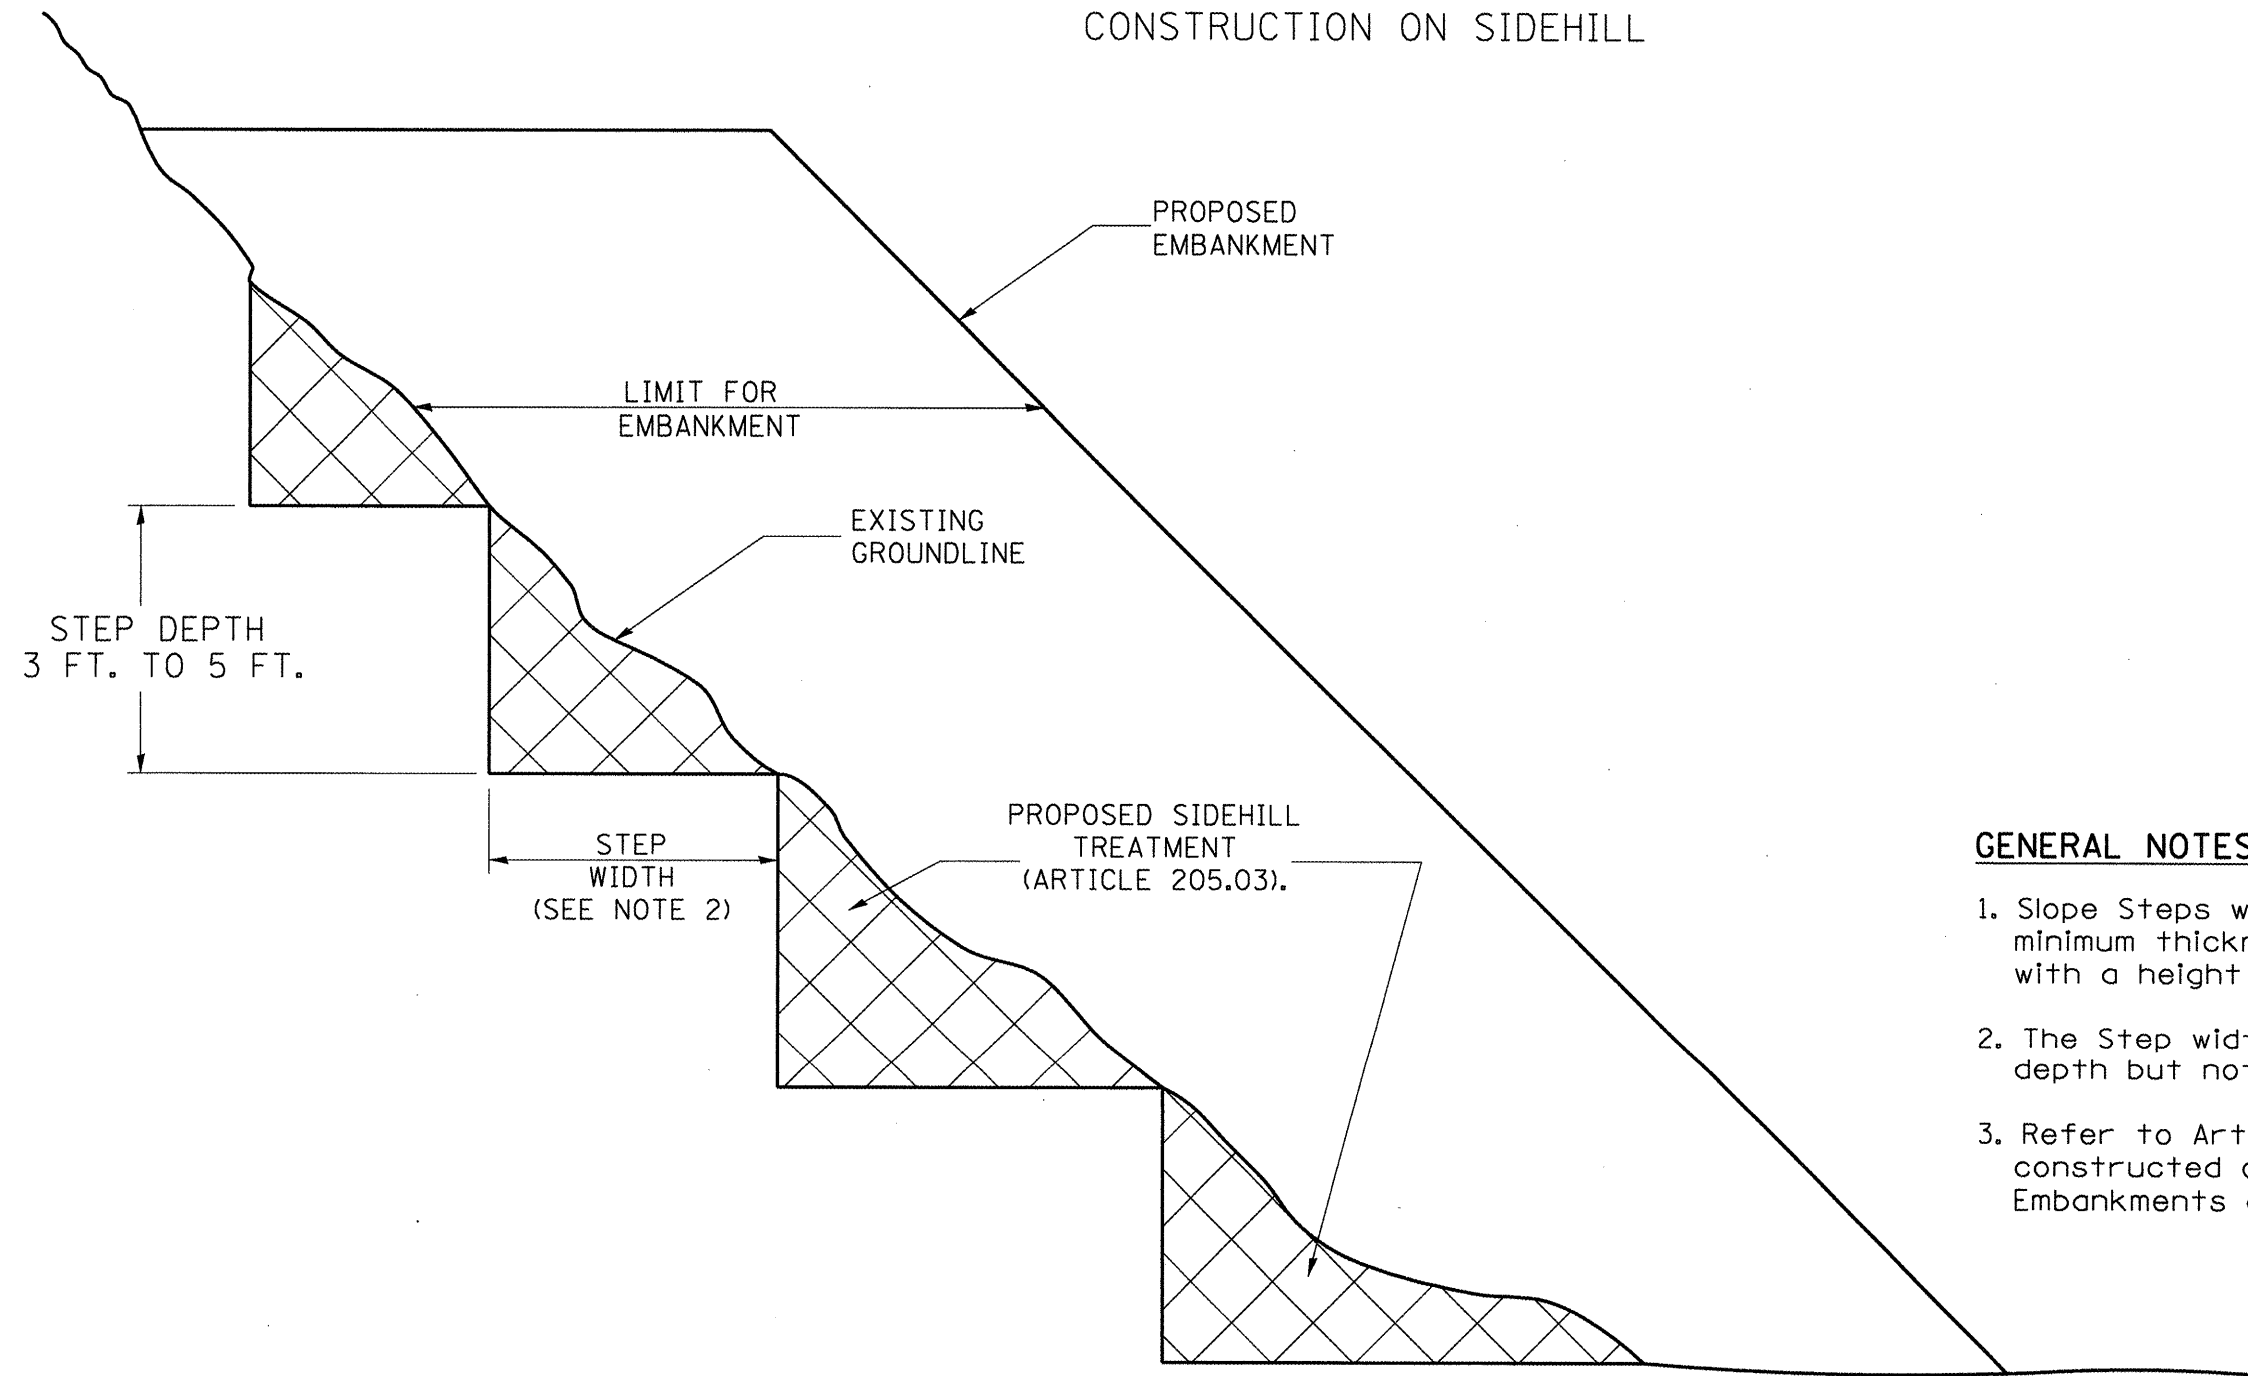

GENERAL NOTES:

1. Slope Steps will be required for all 12(300) minimum thickness "silver fills" and on a fills with a height of 10'(3.0m).
2. The Step width shall be twice the Step depth but not less than 6 feet.
3. Refer to Article 205.03 for Embankment to be constructed on Hillside or Slopes, or if existing Embankments are to be widened.

REPLACEMENT MATERIAL:



STANDARD EMBANKMENT
(IN ACCORDANCE WITH
205 OF THE STANDARD SPECIFICATION).

All dimensions are in inches (millimeters)
unless otherwise noted.

| | | | | | | | | | | |
|----------|--|------|--|---|---------------------------|--|------------------------|------------------|---------------------|------------------|
| 1-1-97 | RENUM. L-5.03, NEW REVISION BOX, REVISED TITLE BOX, REVISED GENERAL NOTES. | T.P. | | STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION | SLOPE STEPS DETAIL | F.A. RTE. 317 | SECTION 16W-1, RS-3 | COUNTY FULTON | TOTAL SHEETS 347 | SHEET NO. 173 |
| 10-16-06 | REVISED TO 2007 SPEC. | M.A. | | NOT TO SCALE | CADD STD. 205001-04 | CONTRACT NO. 88795 | | | | |
| | | | | | | <small>FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT</small> | | | | |