


NOTES

1. CONTRACTOR SHALL EXAMINE THE SITE TO DETERMINE EXISTING CONDITIONS.
2. SEE "ELECTRICAL LEGEND AND ABBREVIATIONS" SHEET FOR GENERAL NOTES AND REQUIREMENTS.
3. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN CONFORMANCE WITH NFPA 70-NATIONAL ELECTRICAL CODE (NEC) MOST CURRENT ISSUE IN FORCE, THE RESPECTIVE EQUIPMENT MANUFACTURER'S DIRECTIONS AND ALL OTHER APPLICABLE LOCAL CODES, LAWS, ORDINANCES AND REQUIREMENTS IN FORCE. ANY INSTALLATIONS WHICH VOID THE U.L. LISTING, ETL LISTING, (OR OTHER THIRD PARTY LISTING) AND/OR THE MANUFACTURER'S WARRANTY OF A DEVICE WILL NOT BE PERMITTED.
4. EXISTING GATE 4 OPERATOR SHALL HAVE SAFETY/DETECTOR LOOPS ADDED AT INTERIOR & EXTERIOR OF GATE. INTERIOR LOOP SHALL ALSO PROVIDE FREE EXIT WHEN A VEHICLE PULLS UP TO EXIT. PROVIDE LOOP DETECTORS AND ASSOCIATED CONDUIT, WIRING, LOOPS, SEALANT, JUNCTION BOXES, AND ACCESSORIES.

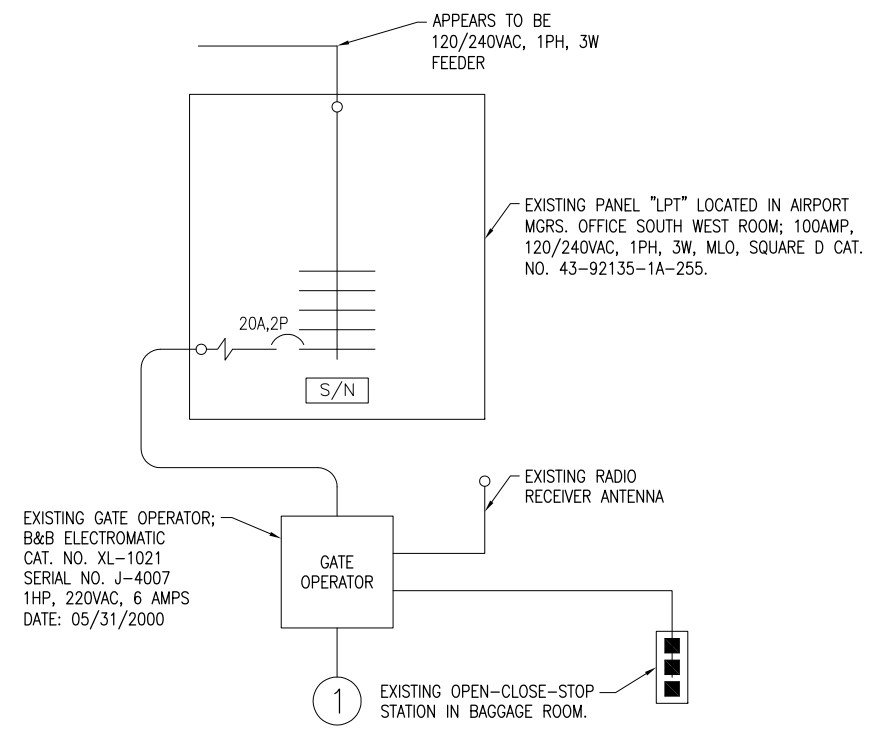

EXISTING ELECTRICAL ONE-LINE
DIAGRAM FOR GATE #4 OPERATOR
(AT SOUTH SIDE OF ADMIN/TERMINAL BLDG.)

REVISION	DATE

DECATUR AIRPORT
DECATUR, ILLINOIS

IL. PROJ.: DEC-4167 A.I.P. PROJ.: 3-17-0033-B4

Hanson Proj. No. 11A0083D	Filename E-606.dwg	Scale NOT TO SCALE	Date 05/08/2012
LAYOUT	KNL	04/11/12	
DRAWN	BAK	04/13/12	
REVIEWED	KNL/RAW	04/19/12	

HANSON
© Copyright Hanson Professional Services Inc. 2012
Hanson Professional Services Inc.
1525 South Sixth Street
Springfield, Illinois 62703-2886
Ph: (217) 788-2450 Fax: (217) 788-2503
www.hanson-inc.com
Offices Nationwide

REPLACE PERIMETER FENCE

GATE 4 ELECTRICAL ONE-LINE

MAY 08, 2012 1:30 PM HARR01115
pw:\sps-svr306\hanson.dom\hanson Projects\Documents\11A0083D\11A0083D\CAD\Airport\Sheet\E-606