


ELECTRICAL LEGEND

- AREA SIGN & POLE TO REMAIN.
- AREA LIGHT & POLE TO REMAIN
- TYPE "A" RAMP LIGHT REMOVED & REPLACED
- NEW TYPE "A" RAMP LIGHT
- SURFACE MOUNTED TYPE "B" RAMP LIGHT REMOVED & REPLACED.
- EXISTING UNDERGROUND ELECTRICAL TO REMAIN
- PROPOSED UNDERGROUND ELECTRICAL
- EXISTING UNDERGROUND ELECTRICAL ABANDONED IN PLACE UNLESS OTHERWISE NOTED
- PLAN NOTE REFERENCE
- REFERENCE TO WIRE & CONDUIT SCHEDULE
- PROPOSED SUBGRADE JUNCTION BOX
- EXISTING SUBGRADE JUNCTION BOX
- PROPOSED DUCT / CONDUIT CROSSING
- EXISTING DUCT / CONDUIT CROSSING
- EXISTING TRANSFORMER TO REMAIN.
- EXISTING JUNCTION BOX


LEGEND

- EXISTING FENCE
- CONCRETE REMOVAL & REPLACEMENT
- SIDEWALK / PAVEMENT
- CURB & GUTTER
- WATER LINE
- GAS LINE
- BURIED TELEPHONE
- STORM SEWER INLET
- FIRE HYDRANT
- EMERGENCY GENERATOR
- GAS METER
- TELEPHONE PEDESTAL

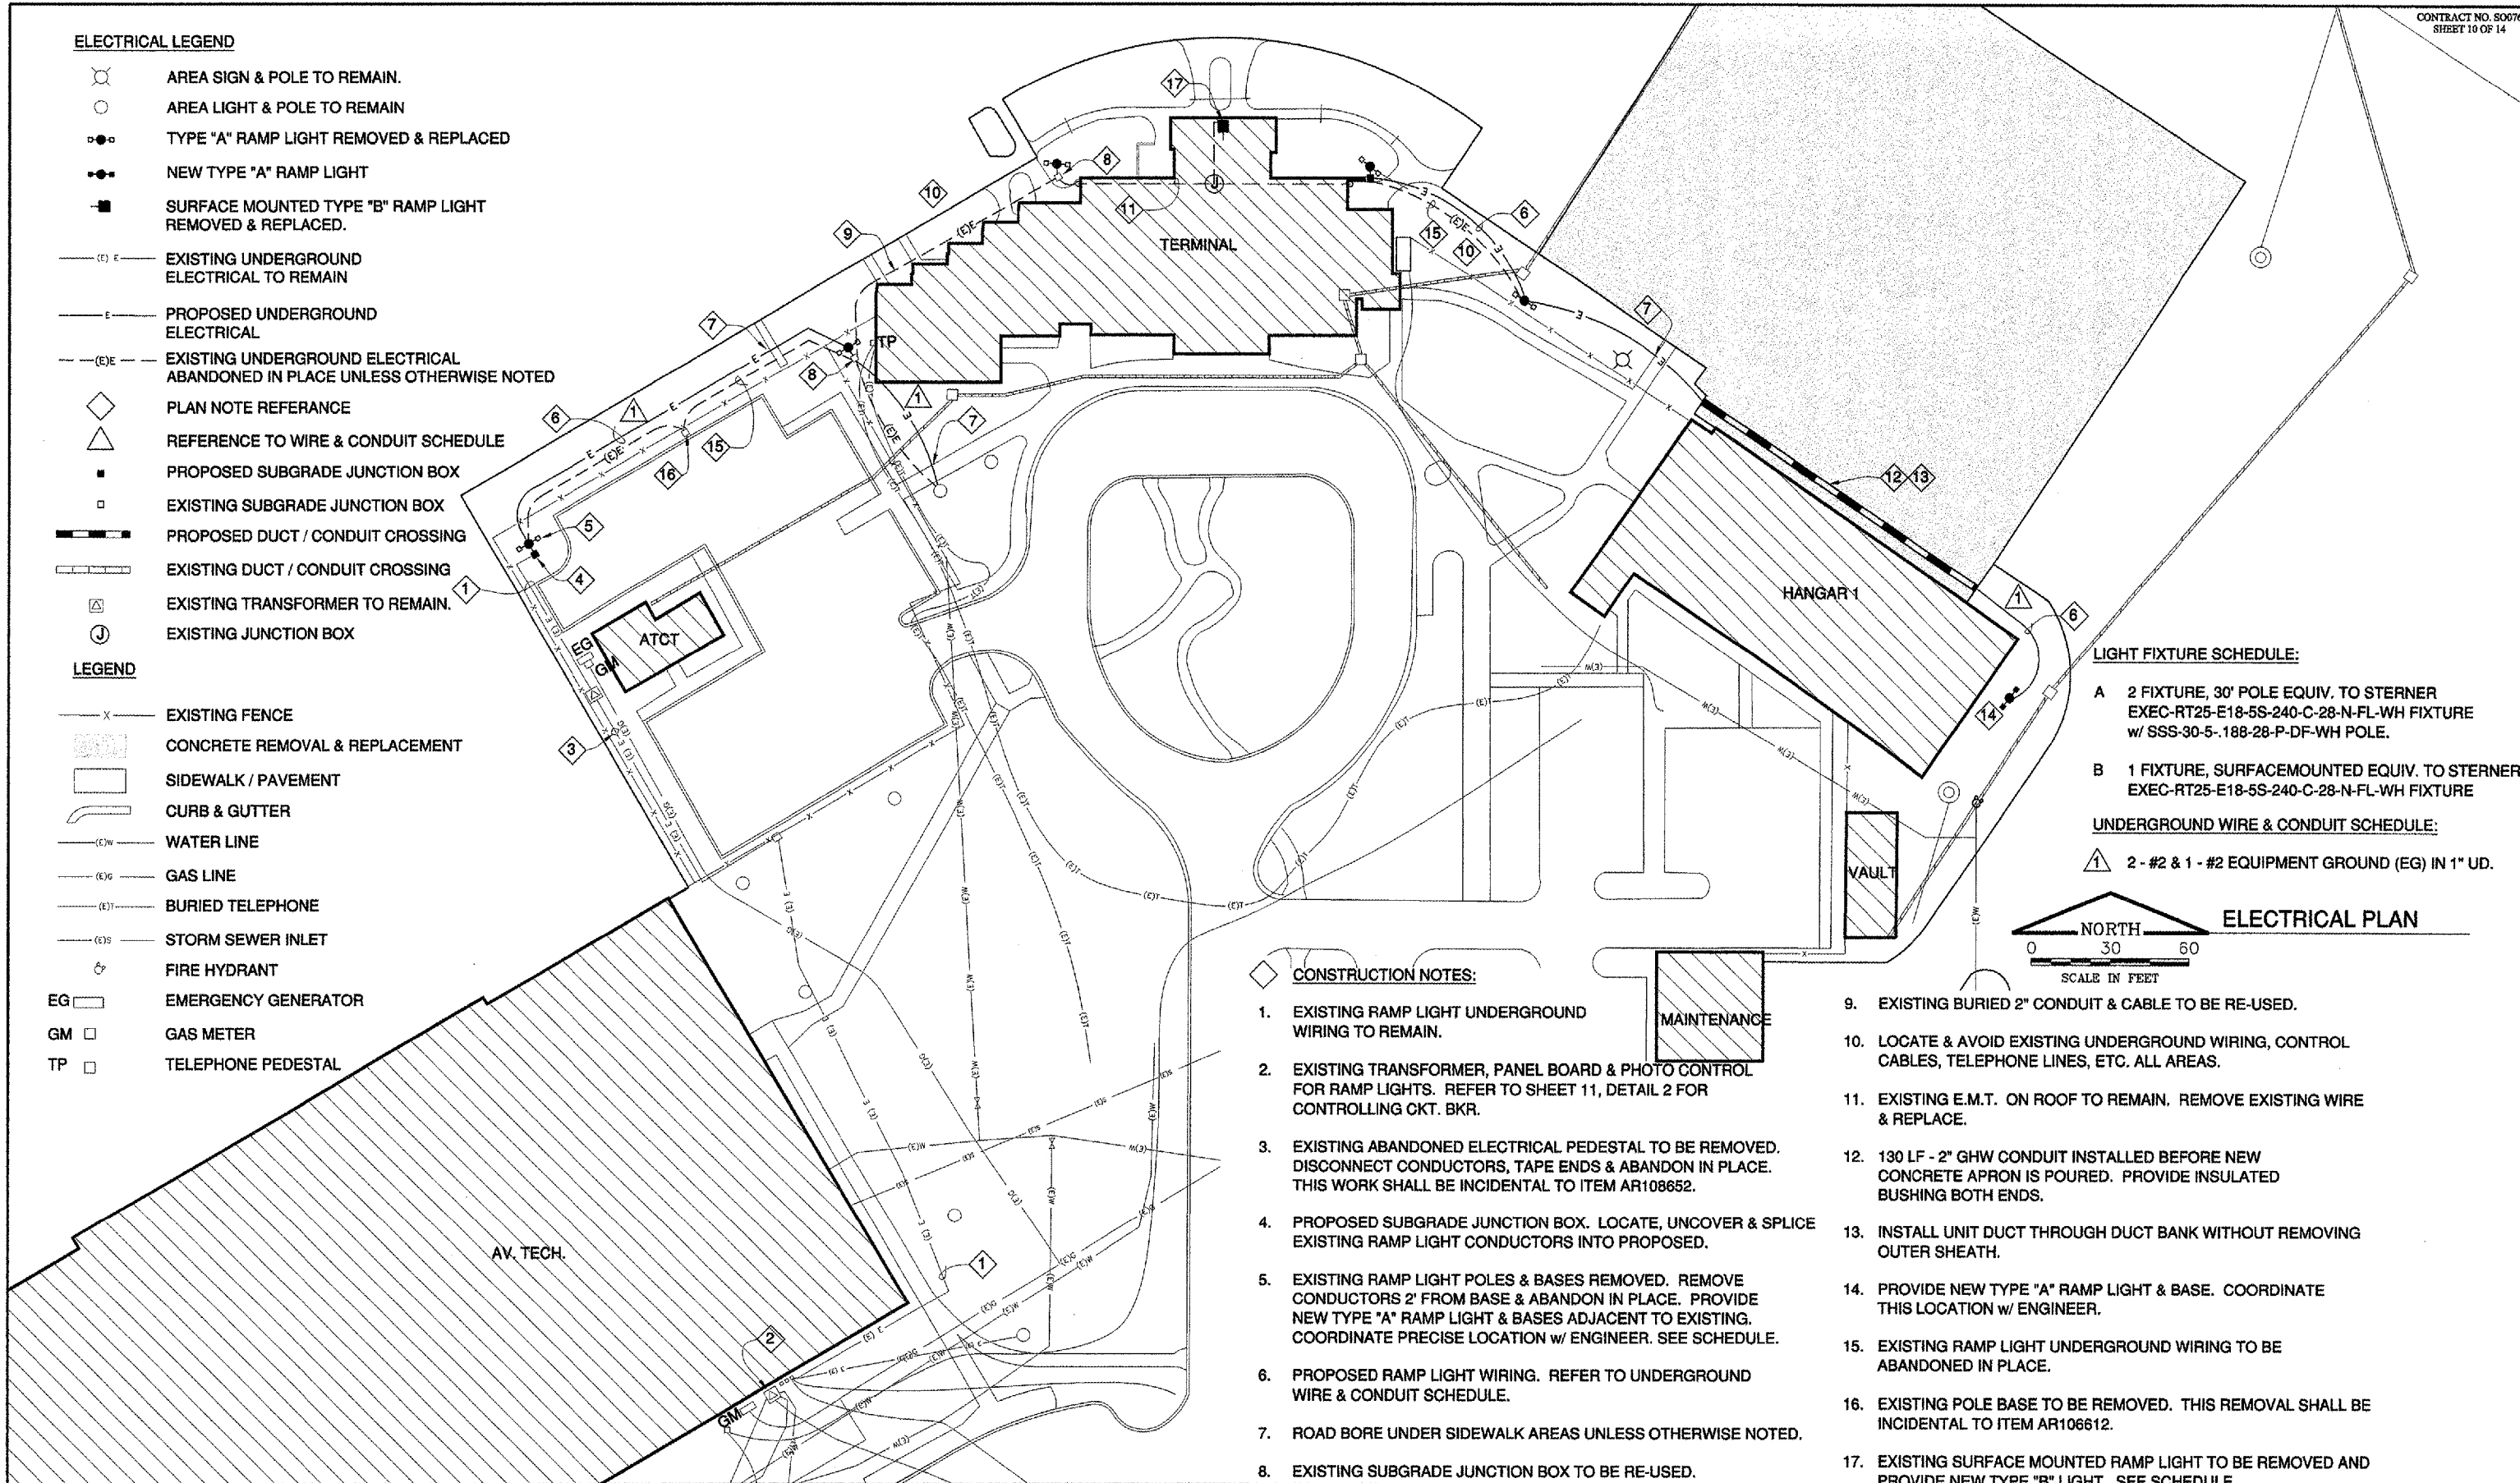

- LIGHT FIXTURE SCHEDULE:**
- A 2 FIXTURE, 30' POLE EQUIV. TO STERNER EXEC-RT25-E18-5S-240-C-28-N-FL-WH FIXTURE w/ SSS-30-5-188-28-P-DF-WH POLE.
 - B 1 FIXTURE, SURFACEMOUNTED EQUIV. TO STERNER EXEC-RT25-E18-5S-240-C-28-N-FL-WH FIXTURE

- UNDERGROUND WIRE & CONDUIT SCHEDULE:**
- 1 2 - #2 & 1 - #2 EQUIPMENT GROUND (EG) IN 1" UD.

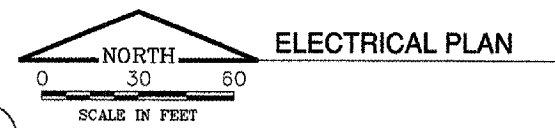

CONSTRUCTION NOTES:

1. EXISTING RAMP LIGHT UNDERGROUND WIRING TO REMAIN.
2. EXISTING TRANSFORMER, PANEL BOARD & PHOTO CONTROL FOR RAMP LIGHTS. REFER TO SHEET 11, DETAIL 2 FOR CONTROLLING CKT. BKR.
3. EXISTING ABANDONED ELECTRICAL PEDESTAL TO BE REMOVED. DISCONNECT CONDUCTORS, TAPE ENDS & ABANDON IN PLACE. THIS WORK SHALL BE INCIDENTAL TO ITEM AR108652.
4. PROPOSED SUBGRADE JUNCTION BOX. LOCATE, UNCOVER & SPLICE EXISTING RAMP LIGHT CONDUCTORS INTO PROPOSED.
5. EXISTING RAMP LIGHT POLES & BASES REMOVED. REMOVE CONDUCTORS 2' FROM BASE & ABANDON IN PLACE. PROVIDE NEW TYPE "A" RAMP LIGHT & BASES ADJACENT TO EXISTING. COORDINATE PRECISE LOCATION w/ ENGINEER. SEE SCHEDULE.
6. PROPOSED RAMP LIGHT WIRING. REFER TO UNDERGROUND WIRE & CONDUIT SCHEDULE.
7. ROAD BORE UNDER SIDEWALK AREAS UNLESS OTHERWISE NOTED.
8. EXISTING SUBGRADE JUNCTION BOX TO BE RE-USED.
9. EXISTING BURIED 2" CONDUIT & CABLE TO BE RE-USED.
10. LOCATE & AVOID EXISTING UNDERGROUND WIRING, CONTROL CABLES, TELEPHONE LINES, ETC. ALL AREAS.
11. EXISTING E.M.T. ON ROOF TO REMAIN. REMOVE EXISTING WIRE & REPLACE.
12. 130 LF - 2" GHW CONDUIT INSTALLED BEFORE NEW CONCRETE APRON IS POURED. PROVIDE INSULATED BUSHING BOTH ENDS.
13. INSTALL UNIT DUCT THROUGH DUCT BANK WITHOUT REMOVING OUTER SHEATH.
14. PROVIDE NEW TYPE "A" RAMP LIGHT & BASE. COORDINATE THIS LOCATION w/ ENGINEER.
15. EXISTING RAMP LIGHT UNDERGROUND WIRING TO BE ABANDONED IN PLACE.
16. EXISTING POLE BASE TO BE REMOVED. THIS REMOVAL SHALL BE INCIDENTAL TO ITEM AR106612.
17. EXISTING SURFACE MOUNTED RAMP LIGHT TO BE REMOVED AND PROVIDE NEW TYPE "B" LIGHT. SEE SCHEDULE.