## **DETAIL OF PRECAST CONCRETE BOX CULVERT M259M**


AASHTO DESIGNATION M259M (ASTM DESIGNATION C-789M) DESIGN LOADING = MS18

SECTION COUNTY 750 (112,113) Y, WRS FAYETTE 159 29 TO STA. FED. ROAD DIST. NO. 7 ILLINOIS FED. AID PROJECT

CONTRACT NO. 94927

CULVERT SIZE	DIMENSIONS					
SPANXRISE	Τ	A	В	С		
(F00T)	(INCHES)	FT-IN	FT-IN	(INCHES)		
2x2 3x2 3x3	4 4 4	2-8 3-8 3-8	2-8 2-8 3-8	4 4 4		
4x2 4x3 4x4	5 5 5	4-10 4-10 4-10	2-10 3-10 4-10	5 5 5		
5x2 5x3 5x4 5x5	6 6 6	6-0 6-0 6-0 6-0	3-0 4-0 5-0 6-0	6 6 6		
6x2 6x3 6x4 6x5 6x6	7 7 7 7	7-2 7-2 7-2 7-2 7-2	3-2 4-2 5-2 6-2 7-2	7 7 7 7		
7x4 7x5 7x6 7x7	8 8 8 8	8-4 8-4 8-4 8-4	5 - 4 6 - 4 7 - 4 8 - 4	8 8 8 8		
8x4 8x5 8x6 8x7 8x8	8 8 8 8	9-4 9-4 9-4 9-4 9-4	5 - 4 6 - 4 7 - 4 8 - 4 9 - 4	8 8 8 8		
9x5 9x6 9x7 9x8 9x9	9 9 9 9	10-6 10-6 10-6 10-6 10-6	6-6 7-6 8-6 9-6 10-6	9 9 9 9		
10x5 10x6 10x7 10x8 10x9 10x10	10 10 10 10 10	11-8 11-8 11-8 11-8 11-8 11-8	6-8 7-8 8-8 9-8 10-8 11-8	10 10 10 10 10		
11x4 11x6 11x8 11x10 11x11	11 11 11 11 11	12-10 12-10 12-10 12-10 12-10	5-10 7-10 9-10 11-10 12-10	11 11 11 11		
12x4 12x6 12x8 12x10 12x12	12 12 12 12 12	14-0 14-0 14-0 14-0 14-0	6-0 8-0 10-0 12-0 14-0	12 12 12 12 12		

REVISIONS NAME DATE		ILLINOIS DEPARTMENT OF TRANSPORTATION					
NAME L	AIE		DETAIL OF	PRECAST			
		CONCRETE BOX CULVERT SECTION F.A.P. 750 (IL. RTE. 185) SECTION 112,113 - FAYETTE CO.					
		SCALE:		DRAWN BY	CRO		
		DATE	JANAURY 19, 2005	CHECKED BY	RCY		
			· · · · · · · · · · · · · · · · · · ·				

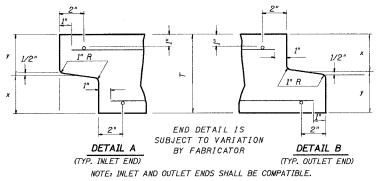

## GENERAL NOTES

SHOP PLANS FOR THE REINFORCEMENT SHALL BE SUBMITTED IN ACCORDANCE WITH THE REQUIREMENTS OF ARTICLE 504.04(a) OF THE STANDARD SPECIFICATIONS.


MINIMUM CONCRETE STRENGTH SHALL BE 5000 PSI AFTER


THE JOINTS OF THE PRECAST BOX SECTIONS SHALL BE SEALED IN ACCORDANCE WITH ARTICLE 542.04(d) OF THE STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.


THE TERMS AS , ASS , AND AS DENOTE THE REQUIRED STEEL AREAS FOR REINFORCEMENT AS SPECIFIED IN ASSHTO M259M. REINFORCEMENT SHALL BE WELDED WIRE FABRIC CONFORMING TO ASSHTO M55M.

LIFTING HOLES SHALL BE FILLED WITH CONCRETE PLUGS AND

DRAINAGE OPENINGS SHALL BE PROVIDED IN ACCORDANCE WITH

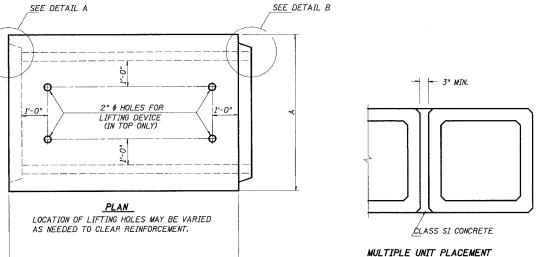



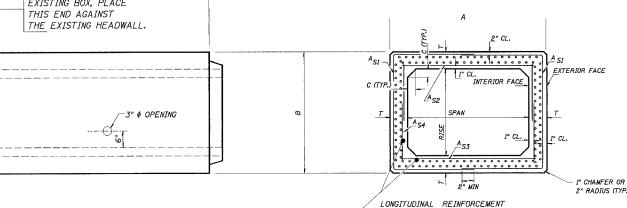

ELEVATION

CROSS SECTION

MASTIC AFTER THE BOX SECTIONS ARE IN PLACE.

ARTICLE 503.12 OF THE STANDARD SPECIFICATIONS. LOCATION AND SPACING OF THE OPENINGS SHALL BE SHOWN ON THE SHOP