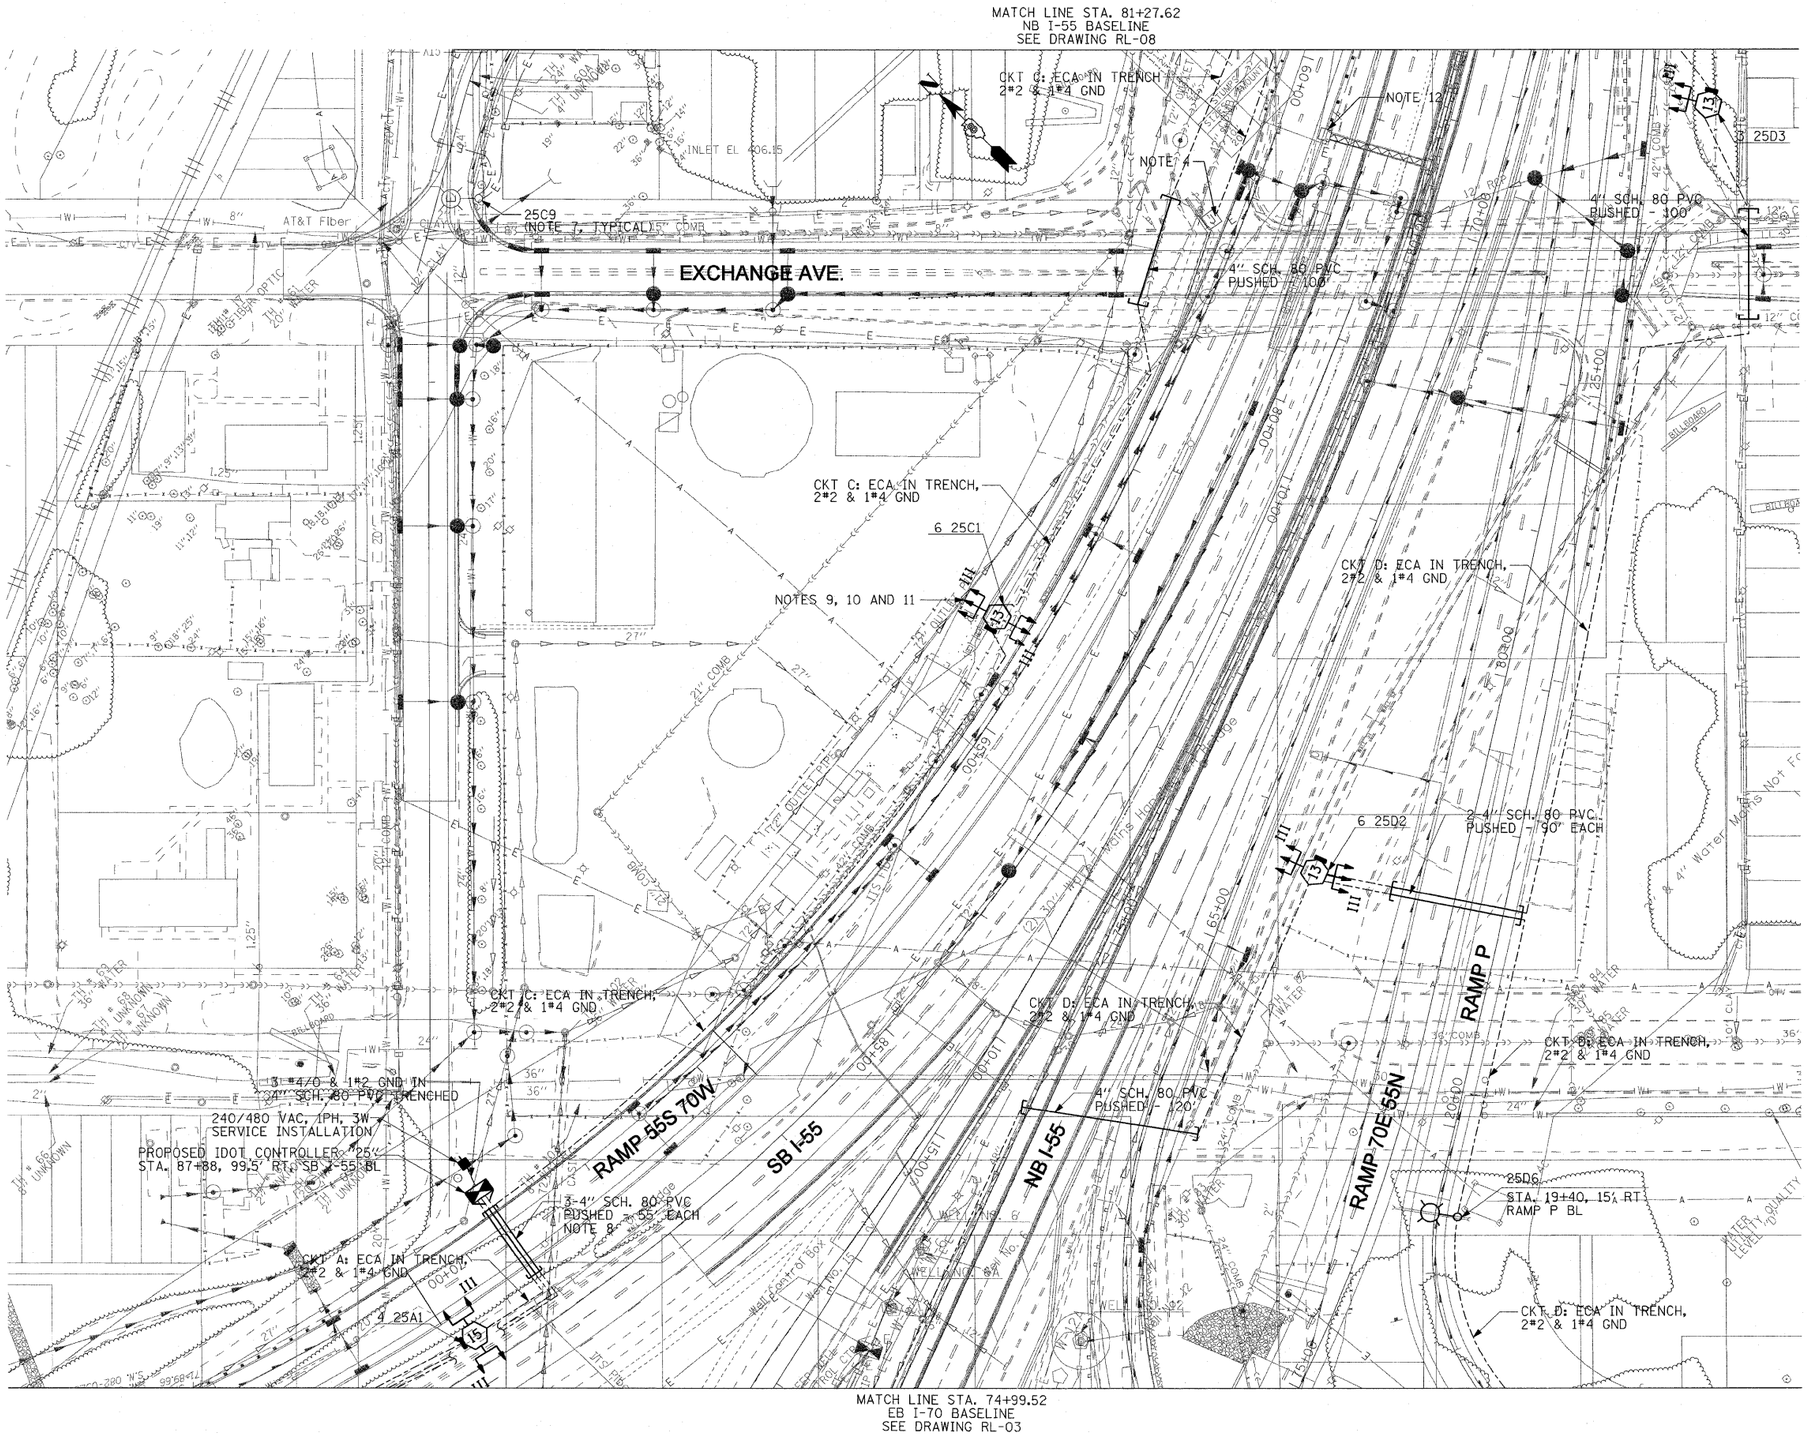

NOTES:

1. SEE DRAWING ME-01 FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS.
2. SEE DRAWING ES-01 FOR HIGH MAST TOWER FOUNDATION SCHEDULE.
3. COORDINATE ALL WORK WITH IDOT CONTRACT NOS. 76C49, 76C50, 76C51, 76C52, 76C53, 76C55, 76C75, AND 76C76.
4. PROVIDE A NEW POWER FEED FOR THE EXISTING EXCHANGE AVE. UNDERPASS LIGHTING. SPLICE THE NEW LIGHTING CIRCUIT TO THE EXISTING LIGHTING CABLES LOCATED IN THE EXISTING WALL MOUNTED JUNCTION BOX. SEE IDOT STANDARD LGT019. FOR DETAILS.
5. THE LOCATONS OF THE PROPOSED CABLES, CONDUITS AND SLEEVES SHOW ON THIS DRAWING ARE DIAGRAMMATIC ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE ALL WORK WITH OTHER CONCURRENT IDOT CONTRACTS SO THAT THE PROPOSED CABLES, CONDUITS AND SLEEVES SHOWN ON THIS DRAWING ARE INSTALLED IN A LOCATION THAT DOES NOT INTERFERE OR CONFLICT WITH EXISTING UTILITIES AND WORK DONE IN OTHER CONCURRENT IDOT CONTRACTS.
6. INSTALL PARALLEL CABLES IN A COMMON TRENCH
7. PROVIDE IDENTIFICATION DECALS FOR EXISTING LIGHTING UNITS ON RAMP O. DECAL INSTALLATION WILL BE PAID FOR UNDER THE "LIGHTING UNIT IDENTIFICATION DECAL" PAY ITEM.
8. PVC CONDUIT SLEEVES SHALL BE INSTALLED BELOW EXISTING GRADE AT ELEVATION 405.00 TO AVOID DAMAGE FROM FUTURE RETAINING WALL W306 WORK IN CONTRACT NO. 76C75. ALL EXCAVATION, SHEETING, SHORING, MATERIALS AND LABOR NECESSARY FOR A COMPLETE INSTALLATION OF THE PUSHED CONDUIT WILL NOT BE MEASURED FOR PAYMENT SEPARATELY, BUT WILL BE INCLUDED IN THE COST OF THE "CONDUIT PUSHED, 4" DIA., PVC" PAY ITEM.
9. HIGH MAST LIGHT TOWER 6 25C1 IS DESIGNATED AS THE PROTOTYPE HIGH MAST LIGHT TOWER AND WILL BE INSTALLED FIRST ACCORDING TO THE SPECIAL PROVISION, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
10. PROVIDE CONCRETE FILLED BOLLARDS AROUND THE TOWER FOUNDATION AS SHOWN ON DRAWING ME-04.
11. THE CONTRACTOR SHALL LOCATE ALL EXISTING IDOT OWNED UNDERGROUND CABLES AND UTILITIES PER THE SPECIAL PROVISIONS. THESE LOCATES SHALL BE PERFORMED PRIOR TO BEGINNING ANY EXCAVATION WORK FOR THE HMLT AND BOLLARD FOUNDATIONS AND SHALL BE PAID FOR UNDER "80300100 - LOCATING UNDERGROUND CABLES" AND "LOCATING UNDERGROUND UTILITIES" PAY ITEMS.
12. PROVIDE A SOLAR POWERED FLASHING BEACON ASSEMBLY FOR THE SIGN STRUCTURE AS SPECIFIED IN THE SPECIAL PROVISIONS AND AS DIRECTED BY THE ENGINEER. THE FLASHING BEACONS SHALL BE MOUNTED ON EACH SIDE OF THE SIGN PANEL AS SHOWN ON THE CONTRACT NO. 76C53 SIGNING PLANS. THE INSTALLATION OF THE FLASHING BEACON ASSEMBLY SHALL BE COORDINATED WITH THE NEW SIGN STRUCTURE AND PANEL WORK IN CONTRACT NO. 76C53.

50' 0' 25' 50' 75' 100'
SCALE: 1" = 50'

RL-07

FILE NAME = $FILEA$	USER NAME = stermerb	DESIGNED - WDS	REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	LIGHTING PLANS PROPOSED WORK			F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
		DRAWN - TL	REVISED -					55/64	82-1L	ST. CLAIR	60	52
	PLOT SCALE = 50.0001 ' / IN.	CHECKED - JPC	REVISED -							CONTRACT NO. 76C54		
	PLOT DATE = 1/3/2011	DATE - JANUARY 4, 2011	REVISED -		SCALE: 1"=50'	SHEET NO. 7 OF 8 SHEETS	STA. 74+99.52 TO STA. 84+27.62	FED. ROAD DIST. NO.	ILLINOIS	FED. AID PROJECT		